

News on IEC 61850 and related Standards

Daily news concerning the standards IEC 61850, IEC 61400-25, IEC 61970 (CIM), IEC 60870-5, ...

Saturday, July 21, 2012


Abbreviations of the standard series IEC 61850

Some 550 updated Abbreviations of the standard series IEC 61850 (7-1, 7-2, 7-3, 7-4, 7-410, 7-420, ...) are listed in the following document:

GGIO	Generic process I/O	7-4 Ed2
GI	general interrogation	IEC 61850-7-2 Ed2
GLOG	Generic log	7-4 Ed2
GoCB	GOOSE control block	IEC 61850-7-2 Ed2
GOMSFE	Generic Object Models for Substation and Feeder Equipment (generisches Objektmodell für Einrichtungen in Stationen und Einspeiseanlagen nach IEEE-SA TR 1550:1999)	

The list contains all LN class names like MMXU and common data classes like WYE ...

[Download the list of Abbreviations of the standard series IEC 61850 \[pdf; 1.1 MB\]](#)

Posted by [Karlheinz Schwarz](#) at 3:05 AM [No comments:](#) 

Labels: [abbreviations](#), [IEC 61850](#), [IEC 61850 edition 2](#)

IEC 61850 for “Facility Smart Grid Information Model”

The Draft BSR/ASHRAE/NEMA Standard 201P “**Facility Smart Grid Information Model**” has been published for Public Review in July 2012.

The draft standard uses a good part from IEC 61850 models (IEC 61850-7-3, -7-3 and -7-420). The paper document has been derived from a UML document.

The purpose of this standard is to define an abstract, object-oriented information model to enable appliances and control systems in homes, buildings, and industrial facilities to manage electrical loads and generation sources in response to communication with a “smart” electrical grid and to communicate information about those electrical loads to utility and other electrical service providers.

The IEC 61850 community should have a look at this draft in order to make sure that the models used form IEC 61850 are referenced - the maintenance of the models in IEC TC 57 should automatically adopted by the standard 201P in the future. This would allow to get a consistent set of models.

[Download the Draft BSR/ASHRAE/NEMA Standard 201P “Facility Smart](#)

Subscribe To IEC 61850 News

Blog Archive

▼ 2012 (99)

▼ July (10)

[Abbreviations of the standard series IEC 61850](#)

[IEC 61850 for “Facility Smart Grid Information Mod...](#)

[List of all published Parts and Drafts of IEC 6185...](#)

[List of almost all IEC 61850 Logical Nodes](#)

[IEC 61850 conformance certificates](#)

[New IEC 61850 Test Lab - TÜV SÜD invites to openin...](#)

[IEC 61850 in Italy - SMA offers IEC 61850 Piggy-Ba...](#)

[SGIP will migrate to SGIP 2.0 in January 2013](#)

[Video from ABB on IEC 61850 for Feeder Automation](#)

[Current Series IEC 61850 comprises 19 parts](#)

► June (17)

► May (14)

► April (10)

[Grid Information Model"\[pdf: 3 MB; 600+ pages\]](#)

Posted by [Karlheinz Schwarz](#) at 1:24 AM No comments: 

Labels: [BACnet](#), [building automation](#), [IEC 61850](#), [IEC 61850-7-420](#), [Information Model](#)

Friday, July 20, 2012

List of all published Parts and Drafts of IEC 61850

The series IEC 61850 comprises 21 parts (8 tagged Edition 2 and 13 tagged Edition 1) and 20 draft parts (projects).

The list of the title and further information (like edition of each part) of all 41 parts (standards and work under progress) can be downloaded:

Published Documents IEC 61850 (2012-07-09): Communication networks and systems for pow			
Part	Current Title	Edition	Stability Date
1	IEC/TR 61850-1	Part 1: Introduction and overview	1.0 (2003-04-28) 2012
2	IEC/TS 61850-2	Part 2: Glossary	1.0 (2003-06-07) 2012
3	IEC 61850-3	Part 3: General requirements	1.0 (2002-05-16) 2012
4	IEC 61850-4	Part 4: System and project management	1.0 (2002-01) 2004 2.0 (2011-04-11) 2015
5	IEC 61850-5	Part 5: Communication requirements for functions and device models	1.0 (2003-07-24) 2012
6	IEC 61850-6	Part 6: Configuration description language for communication in electrical substations related to IEDs	1.0 (2004-03) 2006 2.0 (2009-12-17) 2013

[Download table of all published parts of IEC 61850 and projects \(drafts\) \[pdf: 390 KB\]](#)

Posted by [Karlheinz Schwarz](#) at 9:31 AM No comments: 

Labels: [Edition 1](#), [Edition 2](#), [IEC 61850](#)

List of almost all IEC 61850 Logical Nodes

A list of some 280 Logical Nodes from the following documents has been posted (see below):

- IEC 61850-7-4 Ed2
- IEC 61850-7-410 Ed1
- IEC 61850-7-420 Ed1
- IEC 61400-25-2 Ed1

Clause	Description	Name	Part	Remark
5.3.2	Physical device information	LPHD	7-4 Ed2	Ext1
5.3.3	Common Logical Node	Common LN	7-4 Ed2	Ext3
5.3.4	Logical node zero	LLN0	7-4 Ed2	Ext1
5.3.5	Physical Communication channel Supervision	LCCH	7-4 Ed2	New
5.3.6	GOOSE subscription	LGOS	7-4 Ed2	New
5.3.7	Sampled value subscription	LSVS	7-4 Ed2	New
5.3.8	Time management	LTIME	7-4 Ed2	New

[Download the list of the 280 Logical Nodes \[pdf: 314 KB\]](#)

You can see if the LN is new, extended (few, several, many extensions)

► [March](#) (12)

► [February](#) (21)

► [January](#) (15)

► [2011](#) (159)

► [2010](#) (153)

► [2009](#) (162)

► [2008](#) (82)

Contributors

 [Michael Schwarz](#)

 [Karlheinz Schwarz](#)


or more or less unchanged.

You will find a lot of new LNs in IEC 61850-7-4 like the LGOS (GOOSE Subscription). The LN LGOS is defined for the monitoring of GOOSE messages:

Logical Node GOOSE Subscription **LGOS**:

DataObject	Semantic
NdsCom	Subscription needs commissioning
St	Status of the subscription
SimSt	Status showing that really Sim(ulation) messages are received and accepted
LastStNum	Last state number received
ConfRevNum	Expected configuration revision number Settings
GoCBRef	Reference to the subscribed GOOSE control block

NettedAutomation offers a comprehensive training on the Migration from the various Edition 2 parts of IEC 61850 that have been published so far.

Posted by [Karlheinz Schwarz](#) at [8:56 AM](#) [No comments:](#) 

Labels: [Edition 1](#), [Edition 2](#), [IEC 61850](#), [IEC 61850 edition 2](#), [IEC 61850-7-4 Ed2](#), [IEC 61850-7-410](#), [IEC 61850-7-420](#), [logical node](#)


Thursday, July 19, 2012

IEC 61850 conformance certificates

The UCAIUG (international UCA users group) manages the certification process for IEC 61850 conformance. With a **guest login** you can access the test requirement documents, authorized test labs and lists of conformance certificates.

The website shows 276 certificates for servers, 13 for clients, and 2 for merging units.

[Access list of certificates of IEC 61850 conformance tested devices and other testing related documents.](#)

Posted by [Karlheinz Schwarz](#) at [10:49 PM](#) [No comments:](#) 

Labels: [certificate](#), [conformance test](#), [IEC 61850](#), [UCA](#)

Tuesday, July 17, 2012


New IEC 61850 Test Lab - TÜV SÜD invites to opening ceremony on July 23

TÜV SÜD reported that the preparations and accreditations for their IEC 61850 testing laboratory are now almost finalized and relocation to their new premises in Barthstraße 16 (Munich) has been completed.

Given this, they invite you to a laboratory demonstration on **23 July 2012 from 4 pm** to give you the opportunity to look behind the scenes and get in contact with you.

For the details of the laboratory demonstration please see the invitation in English and German below:


Invitation for IEC 61850 Lab opening (English):



By car:
Donnersbergbrücke / Mittlerer Ring ring road heading south: exit Pasing, Laim, city centre, turn right into Landsberger Strasse and then left into Barthstrasse.
Donnersbergbrücke / Mittlerer Ring ring road heading north: exit Pasing, Laim, city centre, turn left into Landsberger Strasse and then left into Barthstrasse.

Underground / Tram:
From the Hauptbahnhof central station take underground line U4/U5 in direction Laim, exit at either Heimeranplatz or Westendstrasse.
From the Hauptbahnhof central station take Tram 19 in direction Conndorfplatz, exit Barthstrasse, or Tram 19 in direction Pasinger Marienplatz, exit Barthstrasse.

TÜV SÜD AG
Embedded Systems (V INM)
Barthstraße 16
80339 München / Munich
Tel.: +49 89 5190-3162
Fax.: +49 89 5190-3437
sonja.hertlin@tuv-sued.de
www.tuv-sued.de



Invitation
**Embedded Systems
Laboratory Demonstration**

Munich, 23 July 2012


TÜV SÜD AG

Embedded Systems Laboratory Demonstration

After one year of meticulous preparation, Embedded Systems has applied for accreditation by UCA and DAKKS. With accreditations near completion, the first testing and certification projects have been launched.

Following relocation to our new premises in Barthstrasse, the Embedded Systems Team would like to thank its cooperation partners and supporters by staging a laboratory demonstration. In the new testing laboratory, our experts will put embedded systems intended for use in the smart grid through their paces. To measure and regulate the conditions in our power grids, the energy supply of the future depends on intelligent electronic devices (IEDs) that communicate with each other and automatically regulate the feed-in of, say, renewable energy. These devices will be tested and certified for their interoperability in accordance with IEC 61850 and their characteristics in accordance with VDE-AR-N 4105. The testing laboratory also offers IT security testing and certification of equipment and infrastructure.

We warmly invite you to come to our laboratory demonstration and take a look behind the scenes.


Dr. Kai Strübbe
Head of Embedded Systems
TÜV SÜD AG

**Embedded Systems
Laboratory
Demonstration**

**We would be
happy to have
you at our laboro**

On: 23 July 2012

At: Embedded Systems Laboratory, Barthstrasse 16, 80339 Munich

4 pm: Welcome and registration

4:10 pm: Laboratory tour and presentation

4:50 pm: Dinner and networking

RSVP
by 13 July 2012
sonja.hertlin@tuv-sued.de

Einladung zur IEC 61850 Lab Eröffnung (Deutsch):

Labordemonstration Embedded Systems

Nach einem Jahr der optimalen Vorbereitung sind bei Embedded Systems nun die Akkreditierungen durch UCA und DAkkS beantragt und nahezu abgeschlossen. Gleichzeitig laufen die ersten Test- und Zertifizierungsprojekte an.

Nach dem Umzug in die neuen Geschäftsräume in der Berthstraße möchte sich das Embedded Systems Team nun bei seinen Kooperationspartnern und Unterstützern mit einer Labordemonstration bedanken. In dem neuen Testlabor werden zunächst Eingebettete Systeme für das Smart Grid geprüft. Die zukünftige Energieversorgung braucht zur Messung und Regelung des Zustands der Netze intelligente Geräte, die miteinander kommunizieren und selbständig die Einspeisung von z.B. Erneuerbaren Energien in das Stromnetz regulieren. Diese Geräte werden auf ihre Kommunikationsfähigkeit nach IEC 61850 und ihre Eigenschaften nach VDE-AR-N 4105 geprüft und zertifiziert. Zusätzlich werden Tests und Zertifizierungen zur IT Sicherheit der Geräte und Infrastruktur durchgeführt.

Wir laden Sie recht herzlich ein, bei der Labordemonstration einen Blick hinter die Kulissen zu werfen.



Dr. Kai Strübbe
Leiter Embedded Systems
TÜV SÜD AG

Labordemonstration Embedded Systems

Wir erlauben uns

Datum: 23.

Ort: Te:
3.1
Bei
80%

16:00 Bei
dur

16:10 Lal
dur
Pat

16:50 „G
mit

Bitte senden Sie
bis zum 09. Jul
sonja.hertling@

Karlheinz Schwarz (NettedAutomation) and Detlef Raddatz (SystemCorp) look forward to seeing you there.

Posted by [Karlheinz Schwarz](#) at 3:34 AM No comments: 

Labels: [conformance test](#), [IEC 61850](#), [Smart Grid](#), [testing](#)

Saturday, July 14, 2012

IEC 61850 in Italy - SMA offers IEC 61850 Piggy-Back for PV Inverters

As you may have heard, IEC 61850 is a crucial standard for PV inverters in Italy. All requirements of the Italian CEI 0-21 standard (use of IEC 61850 is recommended – expected to be mandatory soon) will be required for new plants as of July 01, 2012.

Even for plants up to 6 kW it is required to provide an interface to the network operator!

SMA has reacted on the requirements for Italian customers ... including a "... Piggy-back that will be able to receive the IEC-61850 commands to implement remote shutdown and narrow the frequency limits of the inverter."

Read the SMA Customer information on these requirements including IEC 61850 in [English](#) / [German](#).

Posted by [Karlheinz Schwarz](#) at 12:55 AM No comments: 

Labels: [IEC 61850](#), [IEC 61850-90-7](#), [inverter](#), [Italy](#), [PV](#), [Wechselrichter](#)

Wednesday, July 11, 2012

SGIP will migrate to SGIP 2.0 in January 2013

The Smart Grid Interoperability Panel (SGIP) will transition from a public-private partnership to a self-financed, legal entity that retains a working partnership with government early 2013.

Since the formation of the SGIP in 2009, the activity of the SGIP by NIST personnel and member volunteers has been supported and enabled by the work of a Program Administrator that has been fully funded by NIST in the approximate amount of \$5 to 7 million per year; a significant portion of those funds came from the ARRA program.

The SGIP 2.0 has five principal responsibilities:

1. To provide the technical guidance and coordination necessary to **facilitate standards development** for Smart Grid interoperability
2. To identify and specify the necessary **testing and certification requirements**, including providing the underlying rationale, to assess the **achievement of interoperability using Smart Grid Standards**
3. To oversee the performance of these activities to maintain **momentum and achievement**
4. To proactively inform and **educate** smart grid industry stakeholders on the definition of and the benefits attributable to interoperability
5. To conduct an outreach to similar organizations in other countries to help establish global interoperability alignment

[Download the SGIP 2.0 Business Sustainment Plan - Roadmap to the Future of Smart Grid Interoperability](#)

Interoperability requires subsets (or profiles) of the various standards. It would be great if the SGIP 2.0 would support the development of profiles for specific applications, e.g., for PV inverter with an IEC 61850 interface. IEC 61850 provides many information models and services – just a few may be needed for very simple PV inverters. These profiles should have very few (or better no) optional definitions. If vendor A uses option 1 and B uses option 2 – then interoperability may be limited.


Somebody told me the other day: “If you accept a special feature of a vendor’s product, you may have to use this vendor’s products forever.” Don’t use any special function! If a profile has no options, then all products have to support the same information models and services ... and protocols.

Posted by [Karlheinz Schwarz](#) at 7:04 AM [No comments:](#) 

Labels: [IEC 61850](#), [NIST](#), [NIST Roadmap](#), [SGIP](#), [SGIP 2.0](#), [Smart Grid](#)

Video from ABB on IEC 61850 for Feeder Automation

[ABB has published a nice 3 minute video on IEC 61850 for Feeder Automation \(Relay series 670\)](#)

Posted by [Karlheinz Schwarz](#) at 4:20 AM [No comments:](#) 

Labels: [ABB](#), [distribution automation](#), [feeder automation](#), [GOOSE](#), [IEC 61850](#)



Monday, July 9, 2012

Current Series IEC 61850 comprises 19 parts

The complete series of IEC 61850 comprises 19 parts as per 2012-07-09:

Content and structure of IEC 61850


The Parts of IEC 61850-x-y (20

Reference	IEC 61850-SER ed1.0
Title	Communication networks and systems in substations - ALL PARTS
Publication date	2012-05-09
Format, price (Swiss francs) and language	<div><div> 4203.-</div><div>EN FR EN FR RU SP</div><div>2521 pages</div></div> <div><div> 4203.-</div><div>EN FR EN FR RU SP</div><div>43122 Kb</div></div>
Abstract	<p>This pack contains all parts to IEC 61850 and an informative pdf file containing most of IEC 61850-7-3 and IEC 61850-7-4. The reader can use these pages to easily read the content of the two standards, without going back and forth in the documents.</p> <p>This pack contains the following:</p> <ul style="list-style-type: none">IEC/TR 61850-1 ed1.0IEC/TS 61850-2 ed1.0IEC 61850-3 ed1.0IEC 61850-4 ed2.0IEC 61850-5 ed1.0IEC 61850-6 ed2.0IEC 61850-7-1 ed2.0IEC 61850-7-2 ed2.0IEC 61850-7-3 ed2.0IEC 61850-7-4 ed2.0IEC 61850-7-410 ed1.0IEC 61850-7-420 ed1.0IEC/TR 61850-7-510 ed1.0IEC 61850-8-1 ed2.0IEC 61850-9-2 ed2.0IEC 61850-10 ed1.0IEC/TS 61850-80-1 ed1.0IEC/TR 61850-90-1 ed1.0IEC/TR 61850-90-5 ed1.0

Eight (8) of the 19 parts have been published as Edition 2; 11 parts are tagged as Edition 1. So, the series IEC 61850 (as of today) is composed of parts tagged Edition 1 AND Edition 2.

Note: **There is and will never be an Edition 2 of the standard series !!!**

[Access the IEC Website for the latest update on the Series IEC 61850.](#)

Posted by [Karlheinz Schwarz](#) at 5:52 AM No comments: 

Labels: [Edition 1](#), [Edition 2](#), [Edition 3](#), [IEC 61850](#), [IEC 61850 edition 2](#)

Saturday, June 30, 2012

Using ConfRev to report a change of value

The configuration revision is a very useful information for clients (Reporting) and subscribers (GOOSE and SV). It is highly recommended that a receiving IED marks the received values as **invalid** in case the receiver expects **ConfRev=X** but receives a message with a value **unequal X**.

The service Reporting (or GOOSE) could be used to inform receivers that there is a change in the ConfRev – long before it may receive a message with a different (incremented) value.


By the way, the functionality to “monitor” changes of control block attribute values is called “Service Tracking” and is defined in IEC 61850-7-2 Edition 2.

The Control Block Attribute ConfRev needs to become a member in a data set. This data set may have all ConfRev attributes of all control blocks as members. So, if any change is detected, a message is issued (Report or GOOSE message, or log entry posted).

It is not yet specified in IEC 61850 if the **change of a value** (of the ConfRev) **implemented by a re-configuration** of the IED (e.g., change of the data set) can be used as a trigger (dchg) to issue a report or GOOSE message or post a log entry. Because this new value may become online visible after the IED restart (to interpret the new SCL file).

It would require that the Control Block stores the last ConfRev value non-volatile; in order to figure out that the new value (from configuration tool) is larger than the old one. This is true for SV Control Blocks only, see §19.2.1.6: "A restart of the IED shall not reset the value."

[See IEC 61850 Tissue # 861.](#)

Posted by [Karlheinz Schwarz](#) at 6:29 AM 2 comments: 

Labels: [configuration](#), [configuration change](#), [ConfRev](#), [GOOSE](#), [IEC 61850](#), [IEC 61850-6](#), [IEC 61850-7-2](#), [Reporting](#), [tissues](#)

Mismatch of ConfRev values in IED and SCL file

The issue of how can the values of ConfRev (configuration revision) in an IED be consistent with the configuration file during the lifetime of IED has been discussed many times. The final standardized solution is now discussed in the IEC TC 57 WG 10 task force "System Management".

Here are some hints on the issue that help to understand what to do until we get a standardized solution.

Part IEC 61850-7-2 Edition 2 defines for GOOSE Control Blocks:

18.2.1.6 ConfRev – configuration revision

The attribute ConfRev shall represent a count of the number of times that the configuration of the DATA-SET referenced by DataSet has been changed. Changes that shall be counted are:

- any deletion of a member of the data-set;
- Any adding of a member to the data-set;
- the reordering of members of the data-set; and
- changing the value of the attribute DataSet.

The counter shall be incremented when the configuration changes. At configuration time, the configuration tool will be responsible for incrementing/maintaining the ConfRev value. When configuration changes occur due to SetGoCBValues, the IED shall be responsible for incrementing the value of ConfRev.

If the value of DataSet is set through a SetGoCBValues service to the same value, the ConfRev value shall still be incremented.

Part IEC 61850-6 Edition 2 defines for GOOSE and SV Control Blocks:

confRev

"The configuration revision number of this control block; mandatory. It is **recommended** to increment it by **10000** on any configuration change, to distinguish this from online configuration changes [by services] leading to an increment of 1 only"

Work-around

In the meantime you have to implement a work-around on your own, e.g., when you implement online changes (caused by services), then the build-in IED Tool ("online tool" in the IED) has to increment the ConfRev value by 1. If you implement a change in the SCL file that is used to configure the IED then you are recommended to READ first the current ConfRev value of the IED and increment by 10,000 and "overwrite" the current value in the SCL file before you re-configure the IED.

It should be specified in the PIXIT file how your IED works (as publisher and/or subscriber).

Please note the **tissue 840** (quite new) in which you can read:

"The question, how dynamic changes done online (through the IED front-panel or through communication services) relate to changes made through configuration files and if these changes shall be allowed for real use is a different topic. There is currently a task force active dealing with system management - they will need to address details on how precisely dynamic changes shall be handled compared to static (through configuration) changes."

<http://tissue.iec61850.com/tissue.msp?issueid=840>

In the following document you find also that the issue is well known:

http://www.fgh.rwth-aachen.de/verein/projekte/InterOP_TestReport.pdf

See §2.2.9

There is still some work to be done – you are invited to get involved in the ongoing work of the WG 10 (Project "System Management") to provide your input on the issue "Configuration Version Control".

A special group of the German Mirror committee of IEC TC 57 has published a requirement document for [IEC 61850 Engineering Systems](#):

"Anforderungen an IEC 61850 Engineeringwerkzeuge" [Deutsch]

Posted by [Karlheinz Schwarz](#) at [5:34 AM](#) [No comments:](#) 

Labels: [configuration](#), [ConfRev](#), [engineering](#), [engineering system](#), [IEC 61850](#), [IEC 61850-6](#), [revision control](#)

Thursday, June 28, 2012

Updated IEC 61850 analyzer for WireShark (V2.6)

An updated analyzer for WireShark (V2.6) is available. It supports IEC 61850 (8-1, SCL import for GOOSE, 9-2, and 90-5), MMS and ICCP-TASE.2. Older versions show some problems that do not really exist. Some people are using the Wireshark as THE reference implementation of IEC 61850! The reference is the standard – but the tool is very helpful!

[Download the exe file to install the new Wireshark version for IEC 61850.](#)

The skunkworks version 2.6 analyzes all of the data. An additional utility that must be run to extract the dataset definitions into ETR files. The directory that the ETR files are located in can be set in the protocol preferences tab.

Thanks to Herb Falk for continuously updating the analyzer!

Posted by [Karlheinz Schwarz](#) at [10:06 AM](#) [2 comments:](#) 

Labels: [GOOSE](#), [ICCP](#), [IEC 61850](#), [IEC 61850-8-1](#), [IEC 61850-9-2](#), [MMS](#), [network analyzer](#), [TASE.2 ICCP](#), [wireshark](#)

Sunday, June 24, 2012

Siemens Expects IEC 61850 as the Preferred Solution for Demand Response

According to a Siemens white paper there is a preferred solution for the information exchange in Demand Response applications: IEC 61850.

The paper states: " ... only **IEC 61850 should be used** for the communication between the control center and district controller [gateway between the energy automation and the building automation infrastructure] ... a larger variety of legacy building automation protocols can be expected. In the long term, communication should be based on BACnet, KNX, **or IEC 61850** protocol standards."

[Read the complete white paper for demand response supporting IEC 61850 \[pdf\]](#)

The paper give a good overview about the various applications in power distribution systems.

Posted by [Karlheinz Schwarz](#) at 12:35 PM No comments: 

Labels: [BACnet](#), [Demand Response](#), [distribution](#), [distribution automation](#), [IEC 61850](#), [Siemens](#)

Thursday, June 21, 2012

International Standardized Profiles needed for IEC 61850-8-1 (MMS)

The mapping standard IEC 61850-8-1 (Mapping to MMS) requires in §6.2.2 to implement the MMS-specific **Implementation agreements** requiring "This A-Profile shall conform to the agreements specified in ISO/ISP 14226-1, ISO/ISP 14226-2, ISO/ISP 14226-3, ISO/IEC ISP 11188-1 and ISO/IEC ISP 11188-3."

The tree first ISPs can be downloaded from the NEMA website for free:

[ISO/ISP 14226-1:1996, Industrial automation systems – International Standardized Profile AMM11: MMS General Applications Base Profile – Part 1: Specification of ACSE, Presentation and Session protocols for use by MMS](#)

[ISO/ISP 14226-2:1996, Industrial automation systems – International Standardized Profile AMM11: MMS General Applications Base Profile – Part 2: Common MMS requirements](#)

[ISO/ISP 14226-3:1996, Industrial automation systems – International Standardized Profile AMM11: MMS General Applications Base Profile – Part 3: Specific MMS requirements](#)

Posted by [Karlheinz Schwarz](#) at 3:22 AM No comments: 

Labels: [IEC 61850](#), [IEC 61850-8-1](#), [implementation](#), [MMS](#)

Monday, June 18, 2012

Workshop IEC 61850 mit dem Beck IEC61850@CHIP

IEC 61850/IEC 61400-25 für die Energie-Versorgungssysteme der Zukunft

Beck IPC GmbH und NettedAutomation bieten einen Workshop zum Thema IEC 61850 und IPC@CHIP® an.

Termin :

3. Juli 2012, 9:30 - 17:00 Uhr (in Deutsch)

Veranstaltungsort:

Beck IPC GmbH
35415 Pohlheim,
Grüninger Weg 24

Die Schulung vermittelt die wichtigsten Schritte zur schnellen und kostengünstigen Implementierung von IEC 61850 und IEC 61400-25 konformen Geräten und Systemen.

Die Veranstaltung richtet sich an alle, die sich mit der Einführung genormter Kommunikations- und Informationstechnik in der Energieversorgung und anderen Anwendungsgebieten wie der Automatisierungstechnik beschäftigen. Angesprochen werden Entscheider, Anwendungsprogrammierer, Systemverantwortliche und Service-Techniker. Für die derzeitigen Nutzer des IPC@CHIP® wird aufgezeigt, wie durch eine einfache Ergänzung der Plattform (Stack-API für IEC 61850 von SystemCorp) der Einsatzbereich der Lösungen drastisch erweitert werden kann.

[Weitere Details zum IEC 61850 Workshop finden Sie hier.](#)

[etz-Veröffentlichung über den Chip \[deutsch\].](#)

Posted by [Karlheinz Schwarz](#) at 1:20 AM No comments: 

Labels: [Chip](#), [embedded system](#), [hands-on Training](#), [IEC 61400-25](#), [IEC 61850](#), [implementation](#), [seminar](#), [Training](#)

Friday, June 15, 2012

IEC 61850-90-13 – New Work on IEC 61850 for Steam and Gas Turbines

The new work item has been introduced in the work programme under the title:

IEC 61850-90-13 Ed.1 (57/1259/RVN):

Communication networks and systems for power utility automation – Part 90-13: Extension of IEC 61850 information models to also include **logical nodes and data models for steam and gas turbines**

IEC 61850 defines very common concepts, information models, services and configuration language that can be used in many other application domains outside substations. MMS – as a basic communication service to which IEC 61850 models and services are mapped – was originally defined for the manufacturing floor (MMS – Manufacturing Message Specification). So it is no surprise that it can be used there and in many other application domains.

One key issue in power plants is the RDS PP (related to KKS):

RDS - PP


Reference Designation System for Power Plants

▪ **ISO/TS 16952-10**
Reference designation system – Part 10: Power plants

▪ **ISO TC10 Working group SC10 WG10**
Reference designation system

Examples of RDS PP for Wind Power Plants and IEC 61400-25/61850:

IEC 61400-25-2 Wind Power Plant model

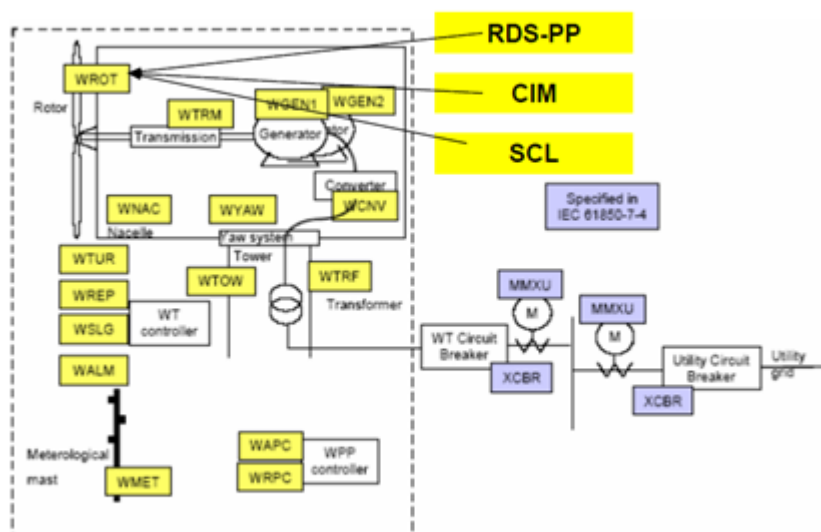


Binding of Information Models:

RDS PP and IEC 61400-25 for Wind Power Plants

Part IEC 61400-25-2

IEC Knoten	Beschreibung	RDS-PP Kennung
WTUR	Turbine	MD
WROT	Rotor	MDA
WTRM	Triebstrang	MDK
WCNV	Umrichter	MKY
WGDC	Netzanbindung	MS
WNAC	Gondel	MUD10
WYAW	Windnachführung	MDL
WTOW	Turm	UMD20
WALM	Alarm	MYA
WSLG	Status	MYA
WALG	Log	MYA
WREP	Report	MYA



RDS PP for Wind Power Plants

Bezeichnung Komponente	RDS-PP Kennung	IEC 61400-25	Bezeichnung Messwert
Windturbinensystem	MD	W. ROT	
Rotorblätter	MDA10	RotSt	Status of rotor
Rotorblatt A	MDA11 MQ001	BlStBl1	Status of blade 1
Rotorblatt B	MDA12 MQ001	BlStBl2	Status of blade 2
Rotorblatt C	MDA13 MQ001	BlStBl3	Status of blade 3
Leitschrank Pitch	MDC10 KF001	PtCtlSt	Status of pitch control
Drehzahlsensor 1			
Hauptwelle	MDK10 BS001	RotSpd	Value of rotor speed at rotor side
Rotorpositions Sensor	nicht vorhanden	RotPos	Angular rotor position
Gondeltemperatur Sensor	nicht vorhanden	HubTmp	Temperature in the rotor hub
Hydraulikölldrucksensor Blatt1	aufgrund von elektrischer	PtHyPresBl1	Pressure of hydraulic pitch system for blade 1
Hydraulikölldrucksensor Blatt2	Umsetzung des	PtHyPresBl2	Pressure of hydraulic pitch system for blade 2
Hydraulikölldrucksensor Blatt3	Pitches nicht vorhanden	PtHyPresBl3	Pressure of hydraulic pitch system for blade 3
Sollwertgeber Pitchwinkel 1	MDC11 KF001	PtAngSpBl1	Pitch angle set points for blade 1



Examples from IEC 61850-7-510 (Hydroelectric power plants – Modelling concepts and guidelines):

EXAMPLE2: 3 Phase Measurement¶

Signal¶	RDS-PP¶	IEC61850 Possible Solution¶
Power¶	G1-M1-T1¶	G1_M1/MMXU01.TotW.mag.f¶
frequency¶	G1-M1-T3¶	G1_M1/MMXU01.Hz.mag.f¶

EXAMPLE 3: Speed Controller¶

Signal¶	RDS-PP¶	IEC61850 Possible Solution¶
Speedsetpoint internal¶	G1-M1-B0=C0¶	G1_M1_B0/FSPT02.SptVal.ctlVal¶
Speedsetpoint external¶	G1-M1-B0=C1¶	G1_M1_B0/FSPT03.SptVal.ctlVal¶
actual Speed¶	G1-M1-B0=P0¶	G1_M1_B0/HSPD.Spd.mag.f¶
Isolated network cmd on¶	G1-M1-B0=P1¶	G1_M1_B0/HGOV.ModAct.ctlVal¶
Isolated network is on¶	G1-M1-B0=P2¶	G1_M1_B0/HUNT.GridMod.stVal¶
Permanent Droop¶	G1-M1-B0=P3¶	G1_M1_B0/HGOV.Drp.ctlVal¶
Speedcontroller is on¶	G1-M1-B0=P4¶	G1_M1_B0/HGOV.ModAct.stVal¶
Speed controller output¶	G1-M1-B0=K0¶	G1_M1_B0/HGOV.Out.mag.f¶
Speed higher¶	G1-M1-B0=K1¶	G1_M1_B0/FSPT02.SptChg.ctlVal[2]¶
Speed lower¶	G1-M1-B0=K2¶	G1_M1_B0/FSPT02.SptChg.ctlVal[3]¶

Step by step we learn that IEC 61850 is in harmony with many other designation standards ... and it can be used for almost all online (runtime) information exchange and system and IED configuration.

Posted by [Karlheinz Schwarz](#) at 6:35 AM [No comments:](#) 

Labels: [IEC 61850-7-510](#), [IEC 61850-90-13](#), [IED](#), [IED configuration](#), [KKS](#), [power generation](#), [Power Plants](#), [RDS](#), [RDS PP](#)

IEC 61850-85-1 FDIS published for ballot

IEC 61850-85-1 Ed.1 (57/1258/FDIS):
Standard for N times 64 kbit per second optical fiber interfaces between teleprotection and multiplexer equipment (IEEE C37.94)

has been published for FDIS ballot ; ballot closes 2012-08-10.

This standard describes the interconnection details for N, where N = 1, 2...12, times 64 kilobit per second connections of teleprotection equipment to digital multiplexers using optical fiber. Requirements for both physical connection and the communications timing are also included.

Posted by [Karlheinz Schwarz](#) at 6:08 AM [No comments:](#) 

Labels: [IEC 61850-85-1](#), [ieee C37.94](#), [protection](#), [teleprotection](#)

[Home](#)

[Older Posts](#)

Subscribe to: [Posts \(Atom\)](#)

News on IEC 61850 and related Standards

Daily news concerning the standards IEC 61850, IEC 61400-25, IEC 61970 (CIM), IEC 60870-5, ...

Friday, June 15, 2012

More Open Positions that require Knowledge on IEC 61850 in the USA


SimplyHired lists today some 80 open positions in the USA that require knowledge on IEC 61850 – one way or the other.

[Search for open positions on IEC 61850 in the U.S.](#)

In one case it says: "Strong Communication protocols (61850, DNP, Modbus) knowledge" is required.

Good education in IEC 61850 pays off.

Education in IEC 61850 is a must in some universities ... this week I saw this hint a technical university in Europe (KTH Stockholm):

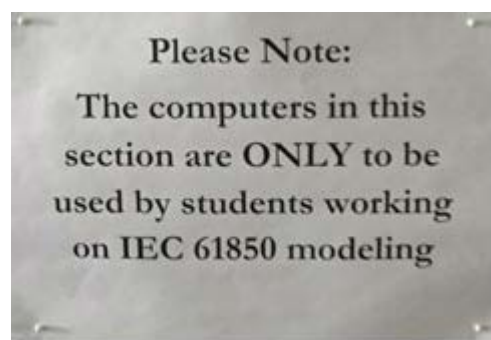

IEC 61850 IEDs and test equipment in an IEC 61850 lab:



Subscribe To IEC 61850 News

Posts

All Comments

Blog Archive

▼ 2012 (99)

► July (10)

▼ June (17)

[Using ConfRev to report a change of value](#)

[Mismatch of ConfRev values in IED and SCL file](#)

[Updated IEC 61850 analyzer for WireShark \(V2.6\)](#)

[Siemens Expects IEC 61850 as the Preferred Solution...](#)

[International Standardized Profiles needed for IEC...](#)

[Workshop IEC 61850 mit dem Beck IEC61850@CHIP](#)

[IEC 61850-90-13 – New Work on IEC 61850 for Steam ...](#)

[IEC 61850-85-1 FDIS published for ballot](#)

[More Open Positions that require Knowledge on IEC ...](#)

[IEC 61850 – Soon Getting Intelligent Logical Nodes...](#)

[IEC 61850-90-14 FACTS](#)

Karlheinz Schwarz run a one day hands-on training on the Beck Development Kit 65 for PHD Students at the KTH.

Posted by [Karlheinz Schwarz](#) at 5:56 AM No comments: 

Labels: [Beck Chip](#), [development kit](#), [education](#), [hands-on Training](#), [IEC 61850](#), [SCL](#), [Smart Grid](#), [smart people](#), [Training](#)

Wednesday, June 13, 2012


IEC 61850 – Soon Getting Intelligent Logical Nodes?

IEC 61850 is one of the crucial subjects in standardization, power systems (generation, transmission, distribution,), education, and research ... all over.

One research issue is to bring “dynamics” and “Intelligence” into the more static Logical Node classes - By applying another IEC standard: IEC 61499 (Function Blocks).

A discussion of IEC 61499 and IEC 61850 can be found in a presentation by Valeriy Vyatkin, University of Auckland, New Zealand and Christopher Schemm, infoteam; presented at Automation Day, October, 17th, 2011, Nuremberg, Germany.

Here is one of the slides showing the idea of iLN (intelligent Logical Node):

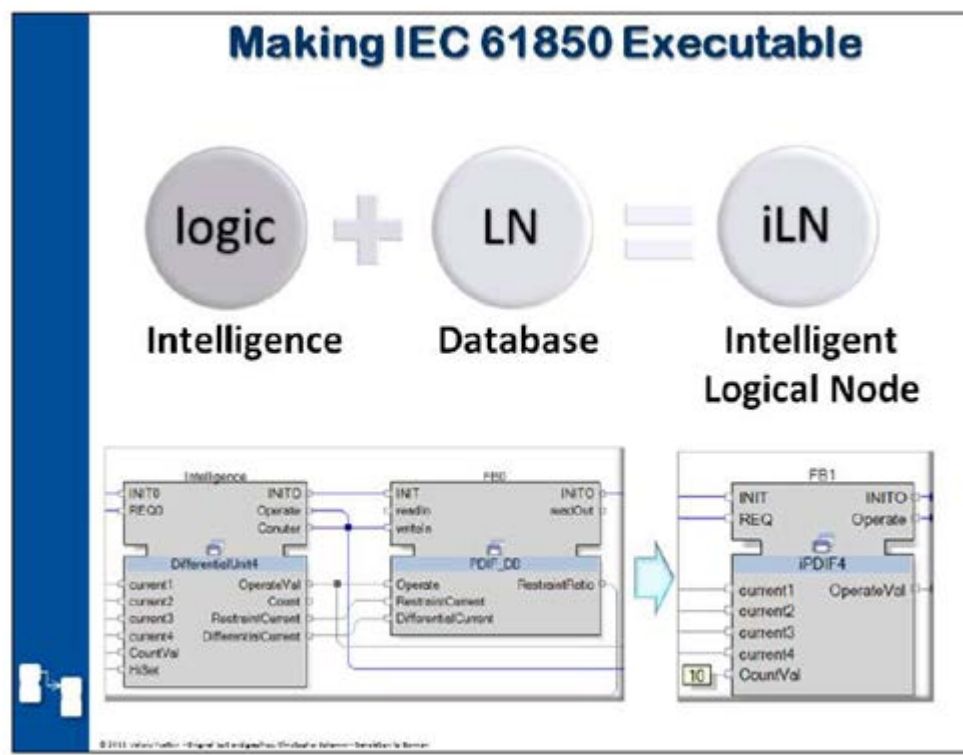

[Download the presentation on IEC 61499 and IEC 61850 including notes \[notes in German\] \[pdf\]](#)

Posted by [Karlheinz Schwarz](#) at 5:16 AM No comments: 

Labels: [IEC 61131-3](#), [IEC 61499](#), [IEC 61850](#)

[\(Flexible AC Transmission Sy...](#)

[IEC 61850 at the Remote Monitoring and Control Con...](#)

[Two MW Wind-to-Gas converter build for E.ON in Ger...](#)

[29 Different Ethernet Solutions for Real-time Comm...](#)

[IEC 61850-90-8 Object Models for E-Mobility](#)

[IEC 61850 Goes Power Distribution – Grid4EU Projec...](#)

[Smart Grid – A Compelling Force for Mega Merger Ea...](#)

- May (14)
- April (10)
- March (12)
- February (21)
- January (15)

- 2011 (159)
- 2010 (153)
- 2009 (162)
- 2008 (82)

Contributors

 [Karlheinz Schwarz](#)

 [Michael Schwarz](#)

IEC 61850-90-14 FACTS (Flexible AC Transmission Systems) data modeling

IEC TC 57 has published a proposal to work on

IEC TR 61850-90-14 (57/1250/DC):

Communication networks and systems for power utility automation –
Part 90-14: **Using IEC 61850 for FACTS** (Flexible AC Transmission Systems) data modeling

The applications comprise shunt compensation, series compensation, multi-function power flow control, voltage regulation, angle regulation, ...

Posted by [Karlheinz Schwarz](#) at [12:22 AM](#) [No comments:](#) 

Labels: [FACTS](#), [IEC 61850-90-14](#), [Information Model](#)

Thursday, June 7, 2012

IEC 61850 at the Remote Monitoring and Control Conference, Denver (CO), September 18-19

Looking for the latest on Remote Monitoring and Control? Check the program of the Remote Monitoring and Control Conference, Denver (CO), September 18-19, 2012

The Remote Monitoring and Control Conference has released its 2012 **show brochure**. Included in the brochure are presentation descriptions, the show's full schedule, conference workshop information (on DNP3, IEC 61850, IEC 62351 Security, ...), exhibitors, co-located event profiles, registration details and information on booking your room at the show hotel.

[Click Here to View the Brochure](#) [pdf, 4 MB]

If you are automating, remotely monitoring and controlling your oil & gas, water/wastewater, utility/T&D, telecom and transportation infrastructure equipment and systems, this is a must attend event.

Please note that NettedAutomation GmbH will have an exhibition booth in cooperation with SystemCorp (vendor of IEC 61850 Stack/API) and Beck IPC. The latest products for IEC 61850 (like IEDs, Gateways to/from DNP3, Modbus, IEC 60870-5-101/104, ...) will be presented.

Posted by [Karlheinz Schwarz](#) at [8:13 AM](#) [No comments:](#) 

Labels: [DNP3](#), [Fernwirktechnik](#), [Gateway](#), [IEC 60870-5-101](#), [IEC 60870-5-104](#), [IEC 61400-25](#), [IEC 61850](#), [Modbus](#), [RTU](#), [security](#)

Monday, June 4, 2012

Two MW Wind-to-Gas converter build for E.ON in Germany


Storage of energy is one of the basic building blocks for the future power delivery system. The option of converting **electric power** into **gas** is one of the most discussed and promising storage options these days. In February I have discussed this briefly:

[Wind and Solar Gas – A Challenging Storage Option](#)

A **2 MW utility scale converter project** at E.ON in North Eastern Germany has been announced by **Hydrogenics** the other day. Up to 30 MWh of energy can be converted from wind power into gas in 24 hours – the gas will be injected into the regional natural gas pipeline, making the natural gas pipeline network a storage system for surplus electrical power generated from renewable resources. Great idea.

[Read the complete news report "Hydrogenics wins order from E.ON for 'Power-to-Gas' energy storage project in Germany"](#)

Standards like IEC 61850 and IEC 61400-25 (Wind Turbines) are ready to support the monitoring and control of wind turbines, and many other applications.

Posted by [Karlheinz Schwarz](#) at 7:14 AM No comments: 

Labels: [Automation](#), [IEC 61400-25](#), [IEC 61850](#), [monitoring](#), [renewables](#), [storage](#), [wind gas](#), [wind power](#)

Sunday, June 3, 2012

29 Different Ethernet Solutions for Real-time Communication! – What about IEC 61850?

The industrial automation market intended in the mid 90s to get a single Ethernet based international standard for the factory floor. Until today the industry is struggling to keep the number of solutions smaller than 30 (!). 29 solutions are listed at the following site (as of September 2008): [Real-Time-Ethernet](#)

One of the most prominent experts in real-time communication (Dr. Karl Weber) came recently (after many tests and investigations) to the conclusion that IEC 61850 is a good candidate for htcp: (Hyper Control Transfer Protocol): [Read his presentation on IEC 61850 for htcp](#)

[A suggestion to use Ethernet as a fieldbus published in 1991 could be found in the paper "Bridging MAP to Ethernet" \[PDF, 720 KB\]](#)

The wait for MMS on Ethernet is over (as stated at the end of the paper) – **Native Ethernet** and MMS are well accepted standard (!) solutions in power systems (generations, transmission, distribution, ...): IEC 60870-6 TASE.2 (ICCP), IEC 61850, IEC 61400-25, IEC 61869-9, ...

IEC 61850 (not only Ethernet) could be used in almost all application domains that need to exchange information in real-time. Will IEC 61850 replace any of the 29 solutions? IEC 61850 will be used at least in applications that have a close relation to electric power – this is a lot! Think about motor control and protection systems or electric cars ... electricity is all over – so will IEC 61850 be in a few years.

Posted by [Karlheinz Schwarz](#) at 10:08 AM No comments: 

Labels: [Ethernet](#), [fieldbus](#), [ICCP](#), [IEC 61850](#), [MMS](#), [real-time](#), [standards](#), [wind power](#)

Saturday, June 2, 2012

IEC 61850-90-8 Object Models for E-Mobility

IEC TC 57 has published (as 57/1254/DC) on June 01, 2012 the

Draft IEC TR **61850-90-8** – Communication networks and systems for power utility automation – Part 90-8: **IEC 61850 object models for**

electric mobility

The Technical Report describes how current standardization for Electric Road Vehicles and the Vehicle-to-Grid Communication Interface can be linked to the IEC 61850-7-420 standard for Distributed Energy Resources (DER). The technical report provides necessary background information and proposes an object model for e-mobility in order to establish an Electric Vehicle plugged into the power grid as DER according to the principles of IEC 61850-7-420. The basic information modeling in IEC 61850 and IEC 61850-7-420 already covers a lot of needs for the e-Mobility domain. Missing parts can be modeled as new logical nodes and data objects, which this technical report defines.

New/extended information models are:

E-mobility supply equipment LN **DESE**


E-mobility outlet LN **DEOL**

E-mobility Electric Vehicle LN **DEEV**

Power cable LN **ZCAB**

Schedule LN **DSCH**

It is easy to add the definition of the **LN DEOL** to an ICD File. Here is an example of the "Plug Present" Data Object of the New LN Class according to DTR 61850-90-8:

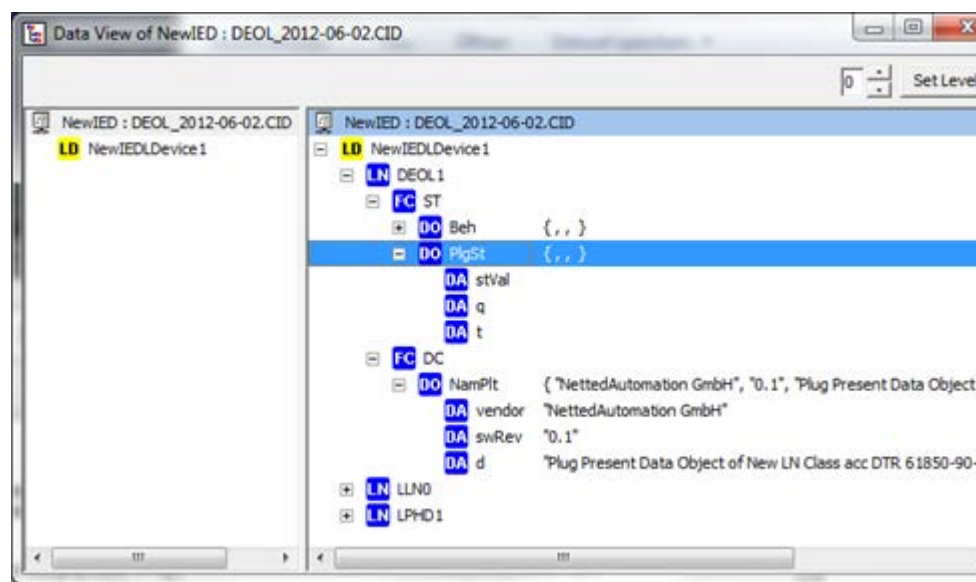

This LN Class can easily be added to the model template for the SystemCorp ICD Designer <<61850DTT.xml>>:

```

2095 <!-- section xxxx LN: E-Mobility Plug Present / 2012-06-02 Name: DEOL--
2096 <LNNodeType id="DEOL" lnClass="DEOL">
2097     <DO name="Mod" type="ENC" pre="O" />
2098     <DO name="Beh" type="ENS" pre="M" />
2099     <DO name="Health" type="ENS" pre="O" />
2100     <DO name="NamPlt" type="LPL" pre="O" />
2101     <DO name="PlgSt" type="ENS-DEOL" pre="O" />
2102 </LNNodeType>

2208 <!-- section 7.3.5 Enumerated status (ENS-DEOL)-->
2209 <DOType id="ENS-DEOL" cdc="ENS" desc="Enumerated status">
2210     <DA name="stVal" fc="ST" bType="Enum" type="PlugStatus" dchg="true" pre="M"
2211     <DA name="q" fc="ST" bType="Quality" qchg="true" pre="M" />
2212     <DA name="t" fc="ST" bType="Timestamp" pre="M" />

```

Almost any new Logical Node published by IEC or any other extended or new LN can easily be modeled with the ICD Designer ... and can easily be applied for building clients and servers using the SystemCorp IEC61850 Stack/API, e.g., using the free evaluation version of the

SystemCorp Windows DLL or using the Beck IPC embedded controller.

There is no need to purchase an expensive package to use IEC 61850 for any model. Just use the SystemCorp IEC61850 Stack/API – and you are ahead of the market.

Many people are now using the Beck IPC Development Kit DK61 or DK55 to implement a gateway between “their data” and the various models according to IEC 61850. It just takes hours to get their (or your) data speaking IEC 61850 ...

It's really so easy!

Posted by [Karlheinz Schwarz](#) at [2:30 AM](#) [No comments:](#) 

Labels: [E-Mobility](#), [Gateway](#), [ICD](#), [IEC 61850](#), [IEC 61850-90-8](#), [implementation](#), [Object model](#)

Friday, June 1, 2012

IEC 61850 Goes Power Distribution – Grid4EU Project

The electrical power distribution is faced a lot of challenges all over in the years to come: renewable power, virtual power plants, energy storage, aging infrastructure, aging workforce, security, ...

How to get prepared for the future power transmission and distribution system? There are many answers. **One is to work in teams.** The European Commission funds projects for major smart grid demonstrations integrating production from renewable energy and management mechanisms active demand management (Smart Grid). The project **Grid4EU** received a favorable agreement of the European Commission. 27 companies and organizations started the project on 1st of November 2011.

The budget for the project is 54 Million Euro, it will run until end of 2015:

- 6 DSOs (cover more than 50% of the metered electricity customers in Europe)
- 27 partners (Utilities, Energy Suppliers, Manufacturers, Research Institutes)

[Website of the Grid4EU project.](#)

[Statement from the project leader ERDF.](#)

According to several information I received, IEC 61850 is playing a crucial role when it comes to information models and information exchange in medium and low voltage applications. There is a need for the project partners to be trained in order to get a reasonable level of knowledge on how to implement and use IEC 61850. It is highly recommended to have the training at the beginning – and not when people figure out after years that they have missed to use the standards in the way they were intended.

More to come ... stay tuned.

Posted by [Karlheinz Schwarz](#) at [11:09 PM](#) [No comments:](#) 

Labels: [education](#), [IEC 61850](#), [low voltage](#), [medium voltage](#), [Smart Grid](#)

Smart Grid – A Compelling Force for Mega Merger

Eaton and Cooper

Eaton takes over Cooper Industries for 11.8 Billion US\$. Why? ...
Expansion into power distribution, grid automation, and smart grid, ...
;-)

Cooper Power Systems supports IEC 61850: Their substation automation products comply with the IEC 61850 Standard for grid integration and automation ... Eaton has also a range of protection relays and other IEDs supporting IEC 61850 ... It could be expected that IEC 61850 will be a crucial component in the future of both companies.

[More information from Eaton can be found here.](#)

Posted by [Karlheinz Schwarz](#) at [1:03 PM](#) [No comments:](#) 

Labels: [Cooper](#), [distribution](#), [distribution automation](#), [Eaton](#), [IEC 61850](#)

Thursday, May 24, 2012

IEC 61850-3 Ed2 CDV is out for ballot

The CDV for IEC 61850-3 Ed.2 is out for comments and ballot:

Communication networks and systems for power utility automation – Part 3: General requirements

The ballot closes 2012-10-19


This part of IEC 61850 defines general requirements, mainly regarding construction, design and environmental conditions for utility communication and automation IED's and systems in power plant and substation environments. These general requirements are in line with requirements for IED's used in similar environments, for example measuring relays and protection equipment.

IEC 61850 is used in many applications in the power distribution. The applicability of the requirements (defined in the above CDV) for distribution networks or DER seems to be defined in a more details. Currently clause 6.7.1 defines "In addition to the mentioned electrical plants, Electricity Utilities can install apparatus in control centers, radio repeaters, or low voltage distribution points in industrial, commercial or residential areas. **These locations are covered by other generic standards or product standards.**"

Does this mean that all or most or some requirements defined in IEC 61850-3 Ed2 are not applicable for these locations? etc.

It is highly recommended that experts from all over have a close look at this CDV to make sure that IEDs applied in DER and distribution networks are not burdened with requirements not needed.

[Contact your IEC TC 57 national committee for a copy of the IEC 61850-3 Ed2 CDV.](#)

Posted by [Karlheinz Schwarz](#) at [10:24 PM](#) [No comments:](#) 

Labels: [Edition 2](#), [EMC](#), [IEC 61850](#), [IEC 61850-3](#)

IEC 61850 Extensions for FACTS

IEC TC 57 is about to develop the information model for FACTS (Flexible AC Transmission Systems)

IEC TR 61850-90-14: Communication networks and systems for power utility automation – Part 90-14: Using IEC 61850 for FACTS (Flexible AC Transmission Systems) data modeling

If you are interested in this work contact your IEC TC 57 national committee.

Posted by [Karlheinz Schwarz](#) at 9:58 PM No comments: 

Labels: [FACTS](#), [IEC 61850](#), [IEC 61850-90-14](#)

Wednesday, May 23, 2012

Work on IEC 61850-90-11 started -- Logics

It was agreed internationally to develop IEC TR 61850-90-11: Communication networks and systems for power utility automation – Part 90-11: Methodologies for modelling of logics for IEC 61850 based applications.

The scope could be quite narrow, taking into account simple logics for input and output signal ... but it could cover also the way how to program complex distributed applications. The standards like IEC 61131-3 or IEC 61499 may be taken into account.

[Some discussion on the use of IEC 61499 ...](#)

Posted by [Karlheinz Schwarz](#) at 11:22 PM No comments: 

Labels: [application programming](#), [applications](#), [IEC 61131-3](#), [IEC 61499](#), [IEC 61850](#), [logic](#)

New Work on Security for SCL, CIM, DNP3 XML-Files

XML files are used for IEC 61970 (CIM), IEC 61850, and IEEE 1815 (DNP3) and IEEE C37.111 (COMTRADE). How can one trust that the content of an XML file for these applications has not been modified? etc.

A new work proposal has been published:
Power systems management and associated information exchange –
Data and communications security –
Part 11: Security for XML Files (future IEC 62351-11)

The ballot closes 2012-07-27

This work is one of the crucial aspects of the future power systems – the various files may contain very sensitive information that has to be protected ... like the protection relays and protection engineers protect the power system!!

I hope that the management takes this work very serious!

Posted by [Karlheinz Schwarz](#) at 10:12 PM No comments: 

Labels: [CIM](#), [COMFEDE](#), [COMTRADE](#), [DNP3](#), [IEC 61850](#), [IEC 61968](#), [IEC 61970](#), [IEC 62351](#), [IEEE 1815](#), [SCL](#), [security](#), [XML](#)

Denver (CO): Workshop on International Standards

for Smart Grids and SCADA Application Domains

A **two day Workshop on International Standards for Smart Grids and SCADA Application Domains** will be conducted by two gurus of standards for power systems on

September 18 – 19, 2012 – Hyatt Regency Denver (CO) Tech Center

Topics are among others: NIST SGIP standards catalog, IEC 61850, IEC 62351 (security), DNP3, ... security measures, solutions, and needs, as well as the global market penetration of standards in power systems, ...

[Details and registration information for the Smart Grid Standards Workshop can be found here.](#)

[If you want to have a specific topic presented and discussed during the workshop, please let me know.](#)

Posted by [Karlheinz Schwarz](#) at 1:27 AM No comments: 

Labels: [DNP3](#), [IEC 61850](#), [NIST](#), [NIST Roadmap](#), [Power Automation](#), [power distribution](#), [power generation](#), [power systems](#), [security](#), [seminar](#), [SGIP](#), [standards](#), [Training](#)

Stockholm: Course on IEC 61850 and Interoperability in SmartGrids including CIM

The School of Electrical Engineering KTH, Royal Institute of Technology, Stockholm is conducting a course on interoperability issues in electrical power delivery systems 11-13 June 2012.

This course will provide fundamental knowledge to the interoperability issues in the Smartgrid, introduction to state of the art systems and technologies, and hands-on practice with relevant industry standard tools.

Aims and Objectives of the course are among others:

- Introduction and understanding of Interoperability issues in the Smartgrid
- Introduction to the state of the art systems, methodologies and frameworks for interoperability in the Smartgrid: IEC 61850 and related standards like IEC 62351 (Security), CIM, ...
- To perform hands-on practice and exercises on interoperability solutions in IEC 61850 based industry standard automation and control systems
- Hands on IEC 61850 substation automation systems with introduction to software tools and IEDs
- Interoperability in 61850 based environments with multi-vendor IEDs
- Interoperability in 61850 based advanced Smartgrid use cases
- KTH LAB hands-on/demo
- Overview and introduction to leading research projects in the field

[Program of the Course on IEC 61850 and Interoperability in SmartGrids \[pdf\]](#)

[General course information and updates.](#)

I look forward to meeting you there.

If you know someone who may be interested in this event please forward the information.

Posted by [Karlheinz Schwarz](#) at 1:09 AM [No comments:](#) 


Labels: [CIM](#), [education](#), [IEC 61850](#), [security](#), [seminar](#), [Smart Grid](#), [smart solution](#), [Training](#)

Tuesday, May 22, 2012

Solvimus bietet IEC 61850 für den Niederspannungsbereich

Die solvimus GmbH (Ilmenau) bietet mit Ihren Steuerungen der auvis-Reihe und dem Gerät MUC.easy für Smart Metering verschiedene Produkte, welche diese Norm unterstützen. IEC 61850 wird somit auch in der Niederspannungsebene verfügbar.

[Pressemitteilung zu IEC 61850 in solvimus-Produkten.](#)

Posted by [Karlheinz Schwarz](#) at 10:05 PM [No comments:](#) 

Labels: [distribution](#), [distribution automation](#), [embedded system](#), [IEC 61850](#), [smart metering](#), [smart solution](#)

Friday, May 18, 2012

USA: IEC 61850-90-5 – Synchrophasor Communication appreciated

The North American Electric Reliability Corporation (NERC) and the North American SynchroPhasor Initiative (NASPI) applauded the publication of IEC 61850-90-5 as an improved synchrophasor data communication solution.

[Access the FERC and NASPI press release on IEC 61850-90-5.](#)

[More details on IEC 61850-90-5 see below.](#)

Posted by [Karlheinz Schwarz](#) at 11:04 PM [No comments:](#) 

Labels: [GOOSE](#), [IEC 61850](#), [sampled value](#), [Synchrophasor](#), [wide area network](#)

Thursday, May 10, 2012

IEC TR 61850-7-510 ed1.0 has been published

The new part IEC 61850-7-510 has been officially published:

Communication networks and systems for power utility automation -
Part 7-510:


Basic communication structure - **Hydroelectric power plants -
Modelling concepts and guidelines**

[Download the Preview of IEC 61850-7-510](#)


IEC/TR 61850-7-510:2012 provides explanations on how to use the Logical Nodes defined in IEC 61850-7-410 as well as other documents in the IEC 61850 series to model complex control functions in power plants, including variable speed pumped storage power plants. This publication is to be used in conjunction with IEC 61850-7-410 which introduced the general modelling concepts of IEC 61850 to hydroelectric power plants.

This document lays a ground for control devices like PLCs to implement the information interface. One simple implementation could be to integrate an IEC 61850 gateway into a PLC. The gateway could, for example, be implemented with an powerful embedded controller.

The controller would implement the information model and the services like GOOSE for operational status, Setting limits or Reporting of status or measured values:

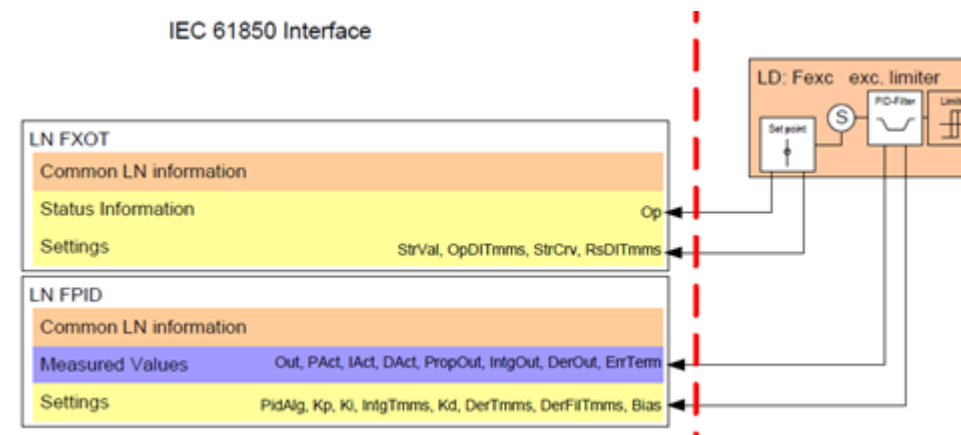

A gateway could be easily build with available embedded controllers that provide an easy API for IEC 61850 clients, servers, publishers and subscribers.

Posted by [Karlheinz Schwarz](#) at 10:27 PM No comments: 

Labels: [API](#), [application programming](#), [applications](#), [embedded system](#), [hydro power](#), [IEC 61850](#)

[Newer Posts](#)

[Home](#)

[Older Posts](#)

Subscribe to: [Posts \(Atom\)](#)

News on IEC 61850 and related Standards

Daily news concerning the standards IEC 61850, IEC 61400-25, IEC 61970 (CIM), IEC 60870-5, ...

Thursday, May 10, 2012

IEC TR 61850-90-5 ed1.0 published


The new part IEC 61850-90-5 has been officially published:

Communication networks and systems for power utility automation - Part 90-5:

Use of IEC 61850 to transmit synchrophasor information according to IEEE C37.118

[Download the Preview of IEC 61850-90-5](#)

IEC/TR 61850-90-5:2012 provides a way of exchanging synchrophasor data between PMUs, PDCs WAMPAC (Wide Area Monitoring, Protection, and Control), and between control center applications. The data, to the extent covered in IEEE C37.118-2005, are transported in a way that is compliant to the concepts of IEC 61850. However, given the primary scope and use cases, this document also **provides routable profiles for IEC 61850-8-1 GOOSE and IEC 61850-9-2 SV packets**. These routable packets can be utilized to transport general IEC 61850 data as well as synchrophasor data.

Posted by [Karlheinz Schwarz](#) at [10:10 PM](#) [No comments:](#) 

Labels: [GOOSE](#), [IEC 61850](#), [sampled value](#), [Synchrophasor](#), [wide area network](#)

Wednesday, May 9, 2012

IEC 61850 Approved for NIST SGIP Catalog of Standards

The SGIP (Smart Grid Interoperability Panel) membership voted to include the IEC 61850 Standard Series into the Catalog of Standards (CoS) with approval of some 100 per cent.

The IEC 61850 series of standards define object models, abstract services, and mappings to communications protocols for field devices and systems. The scope of IEC 61850 includes information exchanges **within substations**, for **protective relaying**, **between substations**, **between substations and control centers**, **within hydro power plants**, for **distribution automation**, for managing **distributed energy resources (generation and storage)**, and for managing **charging of electric vehicles**.

[See the complete list of approved standards for the NIST SGIP Catalog of Standards, including IEC 61850](#)

This is a major step towards the application of IEC 61850 in North America and other regions. The use of IEC TC 57 information and information exchange standards is rapidly growing all over!

The interest in small boxes like the various [COM.TOM's \(as gateways](#)

Subscribe To IEC 61850 News

 Posts 

 All Comments 

Blog Archive

▼ 2012 (99)

► July (10)

► June (17)

▼ May (14)

[IEC 61850-3 Ed2 CDV is out for ballot](#)

[IEC 61850 Extensions for FACTS](#)

[Work on IEC 61850-90-11 started -- Logics](#)

[New Work on Security for SCL, CIM, DNP3 XML-Files](#)

[Denver \(CO\): Workshop on International Standards f...](#)

[Stockholm: Course on IEC 61850 and Interoperabilit...](#)

[Solvimus bietet IEC 61850 für den Niederspannungsb...](#)

[USA: IEC 61850-90-5 – Synchrophasor Communication ...](#)

[IEC TR 61850-7-510 ed1.0 has been published](#)

[IEC TR 61850-90-5 ed1.0 published](#)

[IEC 61850 Approved for NIST SGIP Catalog of](#)

between IEC 60870-5-101/104, DNP3, Modbus ... and also between [these and IEC 61850, and for collecting measurements of the electrical system and equipment](#)) is picking up all over. One big utility is about to install 40.000 of these boxes to monitor transformers in distribution substations! More to come.

Posted by [Karlheinz Schwarz](#) at [2:44 PM](#) [No comments:](#) 

Labels: [Beck](#), [Beck Chip](#), [distribution](#), [distribution automation](#), [DNP3](#), [Gateway](#), [IEC 60870-5-101](#), [IEC 60870-5-104](#), [IEC 61850](#), [NIST](#), [NIST Roadmap](#), [SGIP](#)

Monday, May 7, 2012

Report on the big South-Western US Blackout on September 08, 2011

Some 6 months after the big blackout in the Pacific Southwest, leading to cascading outages and leaving approximately 2.7 million customers without power in parts of Arizona, Southern California, and Baja California, and Mexico, a comprehensive report has been published.

The Key Findings, Causes, and Recommendations are as follows:


"The September 8, 2011, event showed that the system was not being operated in a secure N-1 state. This failure stemmed primarily from **weaknesses** in two broad areas—**operations planning** and **real-time situational awareness**—which, if done properly, would have allowed system operators to proactively operate the system in a secure N-1 state during normal system conditions and to restore the system to a secure N-1 state as soon as possible, but no longer than 30 minutes. **Without adequate planning and situational awareness**, entities responsible for operating and overseeing the transmission system could not ensure reliable operations within System Operating Limits (SOLs) or prevent cascading outages in the event of a single contingency. As demonstrated in Appendix C, **inadequate situational awareness** and planning were also identified as causes of the 2003 blackout that affected an estimated 50 million people in the United States and Canada."

One of the crucial needs for real-time operations is the **availability of real-time INFORMATION – to become aware of the situation at the level of the electrical process, primary equipment, secondary functions, and distributed power resources**! This requires real-time information exchange which seems to have not been properly installed, available or used. One challenge is to handle the many vendor and user specific communication protocols. It is very surprising that even at the power transmission level the awareness seems to be showing gaps. The situational awareness (supported by real-time information exchange) at the high voltage levels is one of the most crucial issues in power systems!

So, what is the situation in the implementation of real-time information exchange systems in the lower voltage levels? Hm ... IEC 61850 installed all over would definitely help to get a good awareness of the situation of the system – allowing to proactively operate the system.

More standard based communication (IEC 61850, DNP3, ...) to come.

[Read complete power outage report.](#)

Posted by [Karlheinz Schwarz](#) at [12:54 AM](#) [No comments:](#) 

Labels: [communication](#), [control](#), [DNP3](#), [IEC 61850](#), [power outage](#), [real-time](#)

[Standards...](#)

[Report on the big South-Western US Blackout on Sep...](#)

[Draft IEC 61850-90-7 – Object models for photovolt...](#)

[Draft IEC 61850-90-4 – Network engineering guideli...](#)

- ▶ [April](#) (10)
- ▶ [March](#) (12)
- ▶ [February](#) (21)
- ▶ [January](#) (15)

- ▶ [2011](#) (159)
- ▶ [2010](#) (153)
- ▶ [2009](#) (162)
- ▶ [2008](#) (82)

Contributors

 [Karlheinz Schwarz](#)

 [Michael Schwarz](#)

Draft IEC 61850-90-7 – Object models for photovoltaic, storage, and other DER inverters

IEC has published the following very crucial draft for ballot (57/1239/DTR):

IEC 61850-90-7 Ed. 1:

Communication networks and systems for power utility automation –
Part 90-7: IEC 61850 object models for photovoltaic, storage, and other DER inverters

The ballot closes on 2012-06-29.


This 114 page Technical Report describes the functions for inverter-based Distributed Energy Resources (DER) systems, including photovoltaic systems (PV), battery storage systems, electric vehicle (EV) charging systems, and any other DER systems with a controllable inverter. It defines the IEC 61850 information models to be used in the exchange of information between these inverter based DER systems and the utilities, Energy Service Providers (ESPs), or other entities which are tasked with managing the volt, var, and watt capabilities of these inverter-based systems.

These inverter-based DER systems can range from very small grid-connected systems at residential customer sites, to medium-sized systems configured as microgrids on campuses or communities, to very large systems in utility-operated power plants, and to many other configurations and ownership models. They may or may not combine different types of DER systems behind the inverter, such as an inverter-based DER system and a battery that are connected at the DC level.

The crucial object models for IEC 61850-90-7 have already been implemented on the Beck IPC Development Kit 61.

[Please contact your national committee to get a copy of this crucial document.](#)

[A list of crucial models defined in IEC 61850-90-7 can be found here.](#)

Posted by [Karlheinz Schwarz](#) at 12:22 AM No comments: 

Labels: [IEC 61850](#), [IEC 61850-90-7](#), [inverters](#), [PV](#), [Smart Grid](#)

Draft IEC 61850-90-4 – Network engineering guidelines

IEC has published the following draft for ballot (57/1238/DTR):

IEC 61850-90-4 TR Ed.1:

Communication networks and systems for power utility automation –
Part 90-4: Network engineering guidelines for substations


The ballot closes on 2012-06-22.

[Please contact your national committee to get a copy of this crucial document.](#)

This 192 page Technical Report provides definitions, guidelines, and specifications for the network engineering of IEC 61850 based (substation and other) automation.

It addresses issues such as Ethernet technology, network topology, redundancy, traffic latency and quality of service, traffic management by multicast and VLAN, network-based clock synchronization and testing of

the network.

Posted by [Karlheinz Schwarz](#) at [12:08 AM](#) [No comments:](#) 

Labels: [Ethernet](#), [Ethernet switches](#), [IEC 61850](#), [redundancy](#), [traffic engineering](#)


Sunday, April 29, 2012

Siemens SIPROTEC 5 – Documents online

<http://www.energy.siemens.com/br/en/automation/power-transmission-distribution/protection/siprotec5/>

Click on "Download Software & Documents" on right side of page.

The SIP 5.01 booklet is listed as "System Catalog V1.0"

Posted by [Karlheinz Schwarz](#) at [11:28 AM](#) [No comments:](#) 

Labels: [IEC 61850](#), [Siemens](#), [SIPROTEC 5](#)

Friday, April 27, 2012

IEC Standards for the Integration of Wind Energy and Photovoltaic

Dr. Kai Strübbe, Head of Embedded Systems, TÜV SÜD AG, presented some crucial aspects of the Integration of renewable power into the Smart Grids at the Hanover Fair 2012:

The Integration of Wind Energy and Photovoltaic into a Smart Grid Hannover Messe, 24 April 2012

According to the figures shown in the presentation there are more than 1,000,000 low voltage substations in Germany – most of them are not yet controllable! It's a huge market.

He said that **"IEC 61850 Will Be the Esperanto of the Smart Grid"** – Right. IEC 61850 (IEC 61400-25) is a language that is already spoken in the medium and high voltage networks – the huge low voltage domain is next!

There is a huge interest in **learning this language and easy to use IEC 61850 hardware and software** shown during the fair in Hanover. The crucial questions were on how to implement the standards in a short time to market. SystemCorp and TQ had the right answer.

[Download the presentation from Dr Stübbe \[pdf, en, 1 MB\]](#)

By the way, there are still seats available for the next 3 day public IEC 61850 training in Frankfurt (Germany) from 09–11 May 2012.

3 day General Seminar/Hands-on Training with Real IEDs (embedded controller with Linux, RTOS, ...), Starter Kit (Windows DLL), and several Demo Software (Client/Server and GOOSE messaging)	<input type="checkbox"/> 09-11 May 2012	Frankfurt (Germany)
	<input type="checkbox"/> 17-19 October 2012	Frankfurt (Germany)
Fee for Seminar/Training: € 1.950,-	Special offer for Hanover Fair 2012: 1. Receive an IEC 61850 Development Kit (Beck IPC DK61) included in the regular fee, or 2. Get a discounted fee of € 1.150 (without DK61)	

[If you are interested in the training and FREE IEC 61850 development kit DK61 contact us please.](#)

Posted by [Karlheinz Schwarz](#) at 12:00 AM No comments: 

Labels: [embedded system](#), [hands-on Training](#), [IEC 61400-25](#), [IEC 61850](#), [seminar](#), [Smart Grid](#), [smart people](#), [Training](#)

Wednesday, April 25, 2012

Famous Visitors at the TQ/SystemCorp Booth at Hanover Fair 2012

Reinhard Bütikofer (Member of the EU Parliament) and Ludwig Karg (E-Energy) visited the TQ/SystemCorp booth C45 in Hall 13 on Wednesday (2012-04-25). They discussed the future of Smart Grids (under the headline of IEC 61850 and IEC 61850 embedded controllers from TQ):



Detlef Raddatz and Pritam Munot (both from SystemCorp, Perth Western Australia) have explained the benefits of IEC 61850 stack and API integrated on TQ embedded controllers (ARM 9 and ARM 11) – these products help to “Get Smart Quick”:



Posted by [Karlheinz Schwarz](#) at 11:48 PM No comments: 

Labels: [embedded system](#), [IEC 61400-25](#), [IEC 61850](#), [Smart Grid](#), [smart metering](#), [smart people](#), [smart solution](#), [SystemCorp](#), [TQ](#)

Hanover Fair – NettedAutomation Brochure for Download

There is an overwhelming interest in IEC 61850 we are facing at the Hanover Fair 2012. The 47 page brochure from NettedAutomation on IEC 61850 and IEC 61400-25 distributed run already out at the third day!



The brochure is now available for download:

[Download the 47 page brochure on IEC 61850 distributed at the Hanover Fair 2012 \[pdf, 5.8 MB\].](#)

Posted by [Karlheinz Schwarz](#) at 11:20 PM No comments: 

Labels: [embedded system](#), [hanover fair](#), [IEC 61400-25](#), [IEC 61850](#), [NettedAutomation](#), [Smart Grid](#), [smart people](#), [SystemCorp](#), [TQ](#)

TQ IEC 61850 Embedded Controllers at the Hanover Fair

The following embedded controller are on display at the Hanover Fair; the interest in getting a package of a hardware piece with an integrated IEC 61850 API for servers and clients is huge:

TQMa28

Functional talent for universal applications


The TQMa28 Minimodule, based on the i.MX28 processor, offers a balanced ratio between computing and graphic performance. The basis for this is an ARM926 core with up to 450 MHz. The realised memory on the module provides best system support. The module is best suited for smart metering and for easy visualization and control applications.

A large number of interfaces and module functions are implemented in the CPU due to the high level of interface and function integration. This allows the basic board to be developed easily and at low-cost.

All the processor's functional pins are on the module plug-in connector.

The highlights:

- Smallest ARM9 module
- Low-cost due to highest level
- Extended temperature range
- 2x IEEE1588 Ethernet (L2 Switch)
- Low power consumption (typ.)
- Long-term availability
- Power management
- Battery charge functionality
- IEC 61850 stack

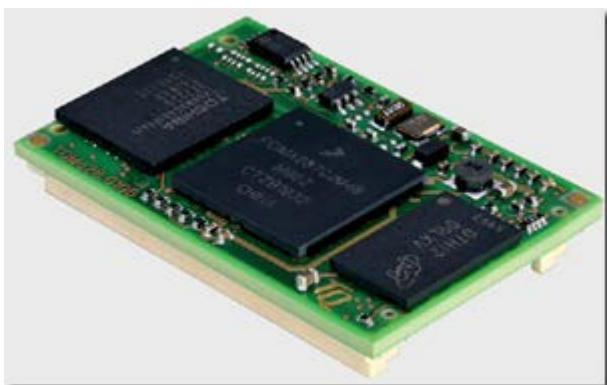

[Download technical specification for TQMa28 with IEC 61850.](#)

TQMa35


Allroundtalent for many applications

The TQMa35 Minimodule, based on the Freescale i.MX35 processor, offers a balanced ratio between computing and graphic performance. The basis for this is an ARM11 core with up to 532 MHz.


A large number of interfaces and module functions is implemented due to the high level of interface and function integration in the CPU. This allows the basic board to be developed easily and at low-cost.

All the processor's functional pins are on the module plug-in connector.

- All CPU interfaces are available
- Extended boot options (BootROM, eMMC)
- Extended temperature range
- eMMC Flash
- Low power consumption
- Long-term availability
- IEC 61850 stack

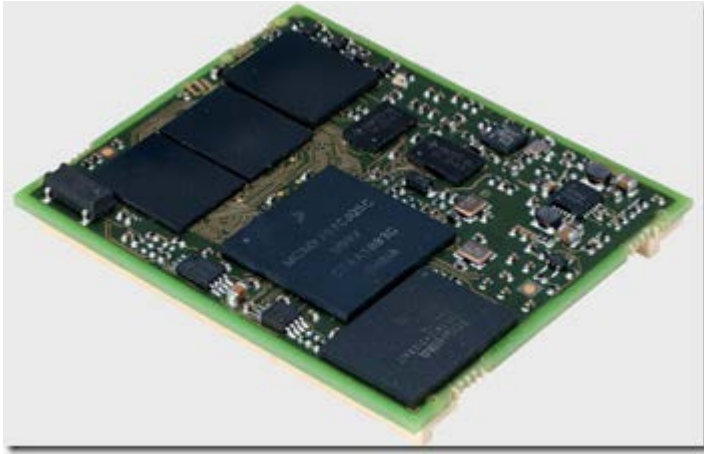

[Download technical specification for TQMa35 with IEC 61850.](#)

Posted by [Karlheinz Schwarz](#) at 11:19 PM No comments: 

Labels: [embedded system](#), [IEC 61400-25](#), [IEC 61850](#), [stack](#), [SystemCorp](#), [TQ](#)

IEC 61850 at the Hanover Fair

TQ, SystemCorp and NettedAutomation present IEC 61850 on embedded ARM platforms at the Hanover Fair, from Monday to Friday (23.-27. April 2012) - (Hall 13 Stand C45):





The interest in IEC 61850/IEC 61400-25 on powerful embedded controllers is huge! Visitors from all over visited the booth for information or asked for offerings for small and large quantities during the first two days.

Posted by [Karlheinz Schwarz](#) at [12:15 AM](#) [No comments:](#) 

Labels: [embedded system](#), [IEC 61400-25](#), [IEC 61850](#), [Smart Grid](#), [smart people](#), [smart solution](#), [stack](#), [starter kit](#)

Friday, April 20, 2012

IEC 62351-10 – Security architecture guidelines

A new key draft document on Security has been published by IEC:

IEC 62351-10 TR Ed.1:

Power systems management and associated information exchange –
Data and communications security – Part 10: Security architecture
guidelines

Ballot closes on 2012-06-22; ask your [IEC National Committee for a copy](#).

Cyber security becomes more and more a basic requirement in power control systems as standard IT and other forms of modern communication technology are being increasingly used for control and supervision of these systems. The application of IT communication technology requires the consideration of already existing vulnerabilities, which can be exploited by potential attackers, as recent intentional and unintentional cyber incidents on SCADA and other industrial control systems have shown. The increasing number of control system cyber incidents world-wide with medium to high impact underlines the requirement for appropriate security measures. The draft document targets the description of security architecture guidelines for power systems based on essential security controls, i.e., on security-related components and functions and their interaction. Furthermore, the relation and mapping of these security controls to the general system architecture of power systems is provided as guideline to support system integrators to securely deploy power generation, transmission, and distribution systems applying available standards.

The main clause is:

- 4. MAPPING SECURITY CONTROLS TO THE TC57 ARCHITECTURE
- 4.1 SECURITY DOMAINS WITHIN A GENERIC POWER SYSTEM ARCHITECTURE
- 4.2 APPLICATION OF SECURITY CONTROLS TO A GENERIC POWER SYSTEM ARCHITECTURE
- 4.3 APPLICATION OF SECURITY CONTROLS TO SPECIFIC POWER SYSTEM SCENARIOS
 - 4.3.1 Substation Automation
 - 4.3.2 Control Center – Substation Communication
 - 4.3.3 Advanced Metering
- 4.4 IDENTIFIED GAPS

See the list of all parts of the series IEC 61351:

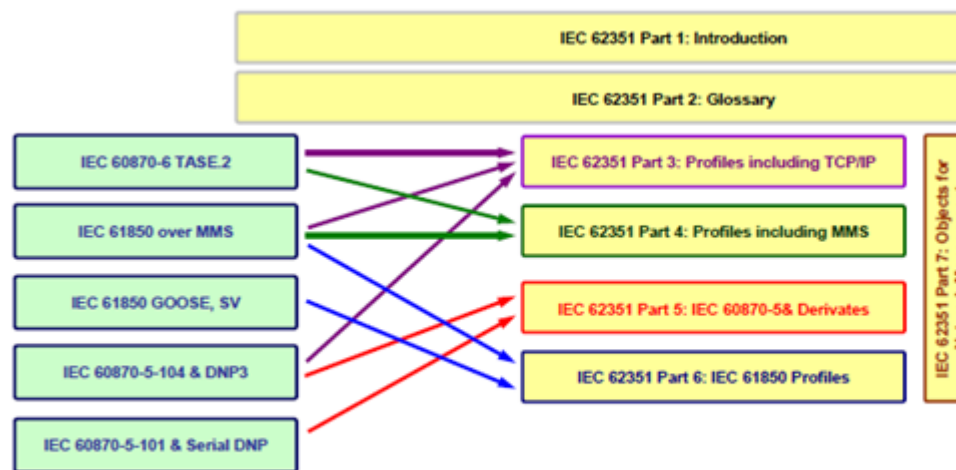


Figure 7: Mapping of IEC 62351 Parts to applicable protocols

It is HIGHLY recommended to ALL stakeholders in the energy industry to keep an close eye on the security issues!!

Posted by [Karlheinz Schwarz](#) at 10:16 PM No comments:

Labels: [IEC 61850](#), [IEC 62351](#), [security](#)

Friday, April 6, 2012

IEC 61850 ready for VHP-Ready (Virtual Heat and Power Ready)

Vattenfall Europe New Energy GmbH and Vattenfall Europe Wärme AG seem to be ahead of many other utilities in implementing "virtual Power Plants". They have set a standard on how to use renewable energy in a virtual power plant. The information exchange is realized with two IEC TC 57 standards: IEC 60870-5-104 (Fernwirktechnik) and IEC 61850-7-420 (DER).

Vattenfall is one of the leaders of the implementation of virtual power plants. The concept is called: **VHP READY – Virtual Heat & Power Ready**.

Their objective is by end of 2012 to provide their services to 150.000 housing units (with some 500 CHP or heat pumps) communicating with a Vattenfall control center. By 2013 they expect some 1,000 CHP or heat pumps providing heat and electric power to some 200.000 housing with an electric capacity of 200 MW.

The requirements document lists a total number of signals of 40:

- 8 binary status signals,
- 17 measurements and calculated values,
- 5 metered values, and
- 10 control points.

[Requirements document referring to IEC 60870-5-104 and IEC 61850 can be downloaded](#) [German, pdf, 23 pages, 360 KB]

VHP READY – Virtual Heat & Power Ready

Vattenfall virtuelles Kraftwerk

Several other projects are under way in Germany to implement a similar approach. In one project there is already a plan to define (and possibly standardize) a specific profile (subset) of IEC 61850-7-420. Such a profile would represent the above some 40 signals – a very simple set of models that could easily be implemented in an IEC 61850 IED like the **Beck IPC IEC 61850 com.tom**:

Simple components for effective and fast to market solutions




IEC 61850 Software implementation

- MMS over TCP/IP
- GOOSE Publisher/Subscriber
- Sampled Values
- Data sets
- Buffered reporting
- Unbuffered reporting
- Control
- Data Logging
- Time synchronization via SNTP
- File Transfer via MMS and FTP

[More information on Beck IPC IEC 61850 com.tom.](#)

[Basic component for IEC 61850: the IPC@CIP](#)

[Download the discussion about benefits using Beck's ready-to-go solutions with IEC 61850](#) [pdf, 2.3 MB, 18 pages]

Posted by [Karlheinz Schwarz](#) at 11:07 PM [No comments:](#) 

Labels: [Beck Chip](#), [CHP](#), [control](#), [control center](#), [Heat Pump](#), [IEC 60870-5-104](#), [IEC 61850](#), [IED](#), [monitoring](#), [Vattenfall](#), [virtual power plant](#), [VPP](#)

SystemCorp, TQ and NettedAutomation at Hanover Fair 2012

IEC 61850 software, hardware and peopleware are crucial topics at the Hanover Fair 2012. SystemCorp, TQ and NettedAutomation provide all three:

- SystemCorp has the right software to get started in hours or days
- TQ has powerful embedded controller that run the IEC 61850 API and
- NettedAutomation provides the education to get Smart People for smart grids

[IEC 61850 - Get there first with SystemCorp, TQ and NettedAutomation as competent partners!](#)

[IEC 61850 - Mit SystemCorp, TQ und NettedAutomation als kompetente Partner zuerst am Ziel!](#)

Posted by [Karlheinz Schwarz](#) at 2:22 AM [No comments:](#) 


Labels: [education](#), [embedded system](#), [IEC 61850](#), [NettedAutomation](#), [SystemCorp](#), [TQ](#)

Monday, April 2, 2012

CDV of IEC 61850-10 Ed.2.0 approved

The CDV of IEC 61850-10 "Communication networks and systems for power utility automation - Part 10: Conformance testing" has been approved by the 25 P-members of IEC TC 57 end of March 2012.

The next step will be the FDIS publication for final ballot.

Posted by [Karlheinz Schwarz](#) at 11:26 AM [No comments:](#) 

Labels: [conformance test](#), [IEC 61850](#), [iec 61850-10](#)

Friday, March 30, 2012

IEC 61850 für Smart Grids in Deutschland

BDEW und ZVEI empfehlen acht "reife" und notwendige Technologien für den unmittelbaren Einsatz für Smart Grids:

Smart Grids in Deutschland – Handlungsfelder für Verteilnetzbetreiber auf dem Weg zu intelligenten Netzen (27. März 2012)

"Um die Verteilnetze effizient zu gestalten, erhöht sich der Bedarf an **Messung, Regelung und Automatisierung**. Aus Sicht eines Verteilnetzbetreibers kommt es jetzt darauf an, die wichtigsten Technologien und deren Wirksamkeit zu identifizieren. Es stellt sich die Frage, **welche Technologien bereits heute zur Verfügung stehen und welches Potenzial diese zur Lösung der verteilnetzspezifischen Probleme mitbringen.**"

Von 25 Smart-Grid-Komponenten gelten acht als „erfolgversprechend“:

- Sensorik im Netz,
- Netzleittechnik,
- Kommunikations- und Dateninfrastruktur,
- regelbare Windkraft,
- regelbare Photovoltaik,
- kleinere KWK-Anlagen,
- Pumpspeicherkraftwerke sowie
- Komponenten zur Blindleistungskompensation.

"Als etablierte Kommunikationsstandards in der Energieverteilung liegt die Verwendung der IEC 61850 nahe. Die IEC 61850 erlaubt einen sicheren und effektiven Datenaustausch zwischen den Smart IEDs und das übergreifende Nutzen von Sensoren und Aktoren. ... **Die konsequente Umsetzung des gemeinsamen Systemstandards IEC 61850 über alle Spannungsebenen hinweg, bietet die Voraussetzung für einheitliche Kommunikations- und Datenstrukturen. Dies ist eine Voraussetzung für den wirtschaftlichen Ausbau der Verteilnetz-Automatisierung.**

[IEC 61850 und ... in "Smart Grids in Deutschland – Handlungsfelder für Verteilnetzbetreiber auf dem Weg zu intelligenten Netzen"](#) [PDF, 32 Seiten, 10,9 MB]

Posted by [Karlheinz Schwarz](#) at 5:27 AM No comments: 

Labels: [control](#), [de](#), [Deutschland](#), [IEC 61850](#), [PV](#), [Sensors](#), [Smart Grid](#), [smart people](#), [smart solution](#), [Verteilnetz](#), [wind power](#)

Tuesday, March 27, 2012

Edition 1, Edition 2, and soon Edition 3 of IEC 61850?

Some people are already looking for Edition 3 of IEC 61850! If you are looking for IEC 61850 Edition 2 or IEC 61850 Edition – you will never find them!! Really.

Editions are specific to parts – NOT to the series IEC 61850 per se with its 20+ parts!!

[Check out more information about Editions of the parts of IEC 61850.](#)

Posted by [Karlheinz Schwarz](#) at 10:10 PM No comments:



Labels: [Edition 1](#), [Edition 2](#), [Edition 3](#), [IEC 61850](#), [IEC 61850 edition 2](#)

Get Free IEC 61850 Development Kit (HW and SW)

The application of IEC 61850 is very successful all over. More and more people are looking for hardware and software that can be used right away – for an easy implementation of applications and Gateways between IEC 61850 and DNP3, Modbus, IEC 60870-5-101/104 and for short time to market developments.

NettedAutomation has scheduled the next public training course to be held in **Frankfurt from May 09-11, 2012**. As a **special gift we offer you a free IEC 61850 Development Kit (Beck IPC DK61)** with an ready to go API and example application source code in C/C++ and IEC 61131/CoDeSys. The DK61 will be used during the course ... after the event you can take the kit home and continue developing applications for IEC 61850 and IEC 61400-25.

[Download a description of the Development Kit \[pdf, 1.4 MB\]](#).

The gift is included in the regular training fee.

This offer is valid until April 27, 2012. Register soon.

[The program and further information on the training course can be downloaded.](#)

[If you are interested in the training and FREE IEC 61850 development kit DK61 contact us please.](#)

The retail price of the DK61 is 1,299 Euro. The regular course fee will be discounted by 800 Euro if you don't want to get the kit but attend the training course only. Students get a further discount ... please ask for it.

Download the [discussion about benefits using ready-to-go solutions with IEC 61850, DK61, Beck Chip, ... and PV Inverter models](#) [pdf, 2.3 MB, 18 pages]

Posted by [Karlheinz Schwarz](#) at [11:14 AM](#) [No comments:](#)

Labels: [application programming](#), [CoDeSys](#), [development kit](#), [DNP3](#), [Evaluation](#), [IEC 60870-5-104](#), [IEC 61131-3](#), [IEC 61400-25](#), [IEC 61850](#), [seminar](#), [Training](#)

[Newer Posts](#)

[Home](#)

[Older Posts](#)

Subscribe to: [Posts \(Atom\)](#)

News on IEC 61850 and related Standards

Daily news concerning the standards IEC 61850, IEC 61400-25, IEC 61970 (CIM), IEC 60870-5, ...

Tuesday, March 27, 2012

HAW Hamburg: IEC-Normen für Smart Grids und die Energiewende

Das HAW Hamburg (Hochschule für Angewandte Wissenschaften) lädt Studierende und Wissenschaftler sowie Experten aus der Industrie, den Betreibergesellschaften und Verbänden zu einem Impuls-Vortrag ein:

IEC-Normen für Smart Grids und die Energiewende

Mittwoch, 4. April 2012

16:00 - 17:30 Uhr, mit anschließender Diskussion

Veranstaltungsort:

HAW Hamburg, Berliner Tor 5, Hörsaal 01.10 (1. Stock)


Die Veranstaltung ist kostenlos.

Flexible und intelligente Stromnetze sind in aller Munde - die dafür nötigen Kommunikationssysteme und Normen werden allerdings gerade erst entwickelt. Experte Karlheinz Schwarz wird die globalen Entwicklungen von nationalen und internationalen Roadmaps und Normen vorstellen.

Im Rahmen der nachhaltigen Weiterentwicklung der Versorgungssysteme muss mit den verfügbaren Ressourcen (Energiequellen, technischen Einrichtungen und Menschen mit Erfahrung) sowie den physikalischen Gesetzmäßigkeiten verantwortungsvoll und "smart" umgegangen werden. Smart Grids helfen, die Physik zum Wohl der Menschen sicher und zuverlässig nutzbar zu machen - gestern, heute und morgen.

Es werden globale Entwicklungen von nationalen und internationalen Roadmaps (DIN, CEN/CENELEC/ETSI, NIST, Chinese State Grid, IEC usw.) und Normen (IEC 61850, IEC 61968/70 CIM usw.) vorgestellt, die helfen werden, die Energieversorgungsnetze auch unter geänderten Randbedingungen sicher und zuverlässig zu erhalten.

[Weitere Informationen zur Veranstaltung finden Sie hier.](#)

Posted by [Karlheinz Schwarz](#) at [10:36 AM](#) [No comments:](#) 

Labels: [CIM](#), [Energiewende](#), [IEC 61400-25](#), [IEC 61850](#), [IEC 61968](#), [IEC 61970](#), [Smart Grid](#), [smart people](#)

Monday, March 26, 2012

Smart Grids – A 19th century invention

Intelligent, safe electrical power distribution networks were invented at the start of electrification and have been further developed up to the present day. Electrical fuses, protective devices and monitoring devices have been phenomenal in the protection of life and technical

Subscribe To IEC 61850 News

 Posts 

 All Comments 

Blog Archive

▼ 2012 (99)

► July (10)

► June (17)

► May (14)

► April (10)

▼ March (12)

[IEC 61850 für Smart Grids in Deutschland](#)

[Edition 1, Edition 2, and soon Edition 3 of IEC 61...](#)

[Get Free IEC 61850 Development Kit \(HW and SW\)](#)

[HAW Hamburg: IEC-Normen für Smart Grids und die En...](#)

[Smart Grids – A 19th century invention](#)

[ABB to deliver 17 IEC 61850 based substations to R...](#)

[Powerful Arm and Freescale Platforms with IEC 6185...](#)

[Fix in IEC 61850-7-4 Edition 2 - Mode and Behaviou...](#)

[IEC 61850 Gateway And Programmable IED](#)

[Wireless Temperature](#)

installations for **more than 100 years**. Without these "smart" devices a fault-free, fail-safe electrical energy supply system would be inconceivable and the supply of electrical energy much too dangerous.

Since the 19th century engineers have developed, tested, used on a large-scale and continuously improved suitable solutions for the safe and reliable operation of the rapidly growing supply of ever more applications with electrical energy. During the sustained further development of the supply systems, it is necessary to handle the available resources (energy sources, technical installations and individuals with experience) as well as the laws of physics both responsibly and in a "smart" manner. Smart grids help to make it possible to use physics safely and reliably for the benefit of man – in the past, today and in the future.

A new paper discusses some aspects of the development of Smart Grids.

[Download the Smart Grid paper in English single sided](#) or [double sided](#).


[Laden Sie das Smart Grid paper in Deutsch im Einseiten-Format herunter](#) oder [im Doppelseiten-Format](#).

The papers will be published by Bender (Gruenberg/Germany) in the Bender magazine MONITOR 01/2012.

[Bender creates new technologies for safe handling of electrical power](#); to ensure the protection of people and the safe operation of machines, systems and manufacturing plants.

IEC standards are quite important for Bender! Mr Wolfgang Hofheinz (CTO of Bender) is President of the DKE (German national committee of the IEC international standardization organization) since 2010.

[Check which IEC product standards and guidelines Bender applies](#)

Posted by [Karlheinz Schwarz](#) at [9:18 AM](#) [No comments:](#) 

Labels: [future](#), [history](#), [IEC Standards](#), [protection](#), [reliable power delivery](#), [Smart Grid](#), [smart people](#)

Thursday, March 15, 2012

ABB to deliver 17 IEC 61850 based substations to Rio Tinto (Western Australia)

ABB has won orders worth approximately \$100 million for 17 substations to support Rio Tinto's iron ore expansion in the Pilbara ... the protection and communication equipment will be compliant with IEC 61850.

[News report on 17 new IEC 61850 based substations for Rio Tinto](#).

Posted by [Karlheinz Schwarz](#) at [10:44 PM](#) [No comments:](#) 

Labels: [ABB](#), [Australia](#), [IEC 61850](#), [Substation](#), [Substation Automation](#)

Tuesday, March 13, 2012

Powerful Arm and Freescale Platforms with IEC 61850 Stack and API at Hanover Fair 2012

SystemCorp and TQ offer the easy to use and powerful IEC 61850 stack and API running on two Mini modules:

[Sensors for Switchgears and I...](#)

[IETF Energy Management WG \(EMAN\) inspired by IEC 6...](#)

[Australia: The Dutch Disease and IEC 61850!?](#)

► [February](#) (21)

► [January](#) (15)

► [2011](#) (159)

► [2010](#) (153)

► [2009](#) (162)

► [2008](#) (82)

Contributors

 [Michael Schwarz](#)

 [Karlheinz Schwarz](#)

1. TQMa28 is based on the i.MX28 processor (ARM926 core with up to 450 MHz)
2. TQMa35 is based on the Freescale i.MX35 processor (ARM 11 core with up to 532 MHz)

The platforms will be presented during the Hanover Fair:

Hall 13, Stand C45


Co-exhibitor with: [TQ-Systems](#)

23-27 April 2012 - daily, 9 a.m. to 6 p.m.

Karlheinz Schwarz will also be present at the booth – offering training services and answering questions related to IEC 61850, IEC 61400-25, IEC 60870-5/6, IEC 61968/70 CIM, DNP3, ...

[Check for more details on the ARM 9 and ARM 11 platforms offering IEC 61850.](#)

[Read the experience and CV of Karlheinz Schwarz.](#)

Posted by [Karlheinz Schwarz](#) at [4:32 AM](#) [No comments:](#) 


Labels: [API](#), [CIM](#), [ICCP](#), [IEC 60870-5-104](#), [IEC 60870-6](#), [IEC 61400-25](#), [IEC 61850](#), [IEC 61968](#), [IEC 61970](#), [SystemCorp](#)

Friday, March 9, 2012

Fix in IEC 61850-7-4 Edition 2 - Mode and Behaviour

Please note that Table A.2 – Definition of mode and behaviour in IEC 61850-7-4 Edition 2 has an error that has been corrected, see Tissue 671:

<http://blog.iec61850.com/search?updated-max=2012-03-27T11:14:00-07:00&max-results=18&start=36&by-date=false>[21.07.2012 12:10:18]

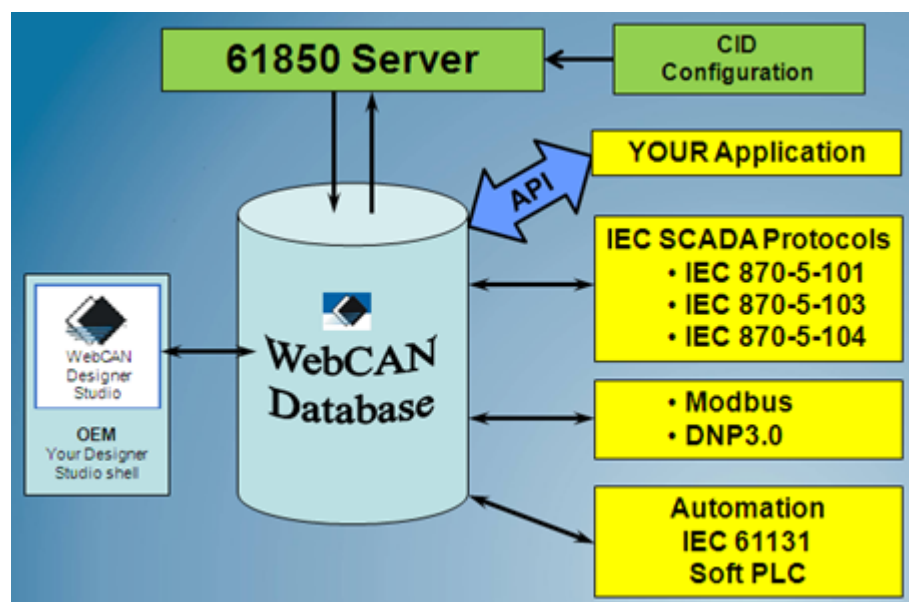

In addition to the Gateway functionality any other application programmed on the very same platform can provide data exchange with the IEC 61850 server through the simple API of the IEC 61850 stack. Various embedded controllers like the Beck IPC Chip provide these possibilities.

This allows with one IEC 61850 license to implement gateway functionalities AND let any other application functionality “speak” IEC 61850.

Access the description of the [IEC 61850 Protocol Stack Online API Manual](#).

Posted by [Karlheinz Schwarz](#) at 1:53 AM No comments: 

Labels: [API](#), [applications](#), [Beck Chip](#), [DNP3](#), [Gateway](#), [IEC 60870-5-104](#), [IEC 61131-3](#), [IEC 61850](#), [Modbus](#), [stack](#), [SystemCorp](#)

Wednesday, March 7, 2012

Wireless Temperature Sensors for Switchgears and IEC 61850

Monitoring the temperature of likely failure points within electric power switchgear provides invaluable data on the health of that piece of equipment. Wireless solutions for temperature monitoring of medium-voltage and high-voltage switchgear are appropriate means to get critical information about the health of switchgears – especially for aging switchgears that have an ever more crucial impact on the reliability of the electric power system.

Ruggedized passive wireless radio-based temperature sensor and monitoring systems are a great answer for medium-voltage and high-voltage electric power switchgear. The access to these measured temperature values through IEC 61850 is now available by Intellisaw.

Access the [Intellisaw website to read the benefits of their Wireless sensors](#).

Check the [temperature measurement model STMP of IEC 61850](#).

Posted by [Karlheinz Schwarz](#) at 9:18 PM No comments: 

Labels: [IEC 61850-3](#), [IEC 61850-7-4 Ed2](#), [Smart Grid](#), [switch gear monitoring](#), [temperature monitoring](#)

IETF Energy Management WG (EMAN) inspired by IEC 61850 and CIM

IETF EMAN, Energy Management, is an active WG that is modeling (in the MIB) a lot of power related real world objects "connected" one way or the other to a network. SNMP is used to access this information. The objective of Energy Management (EMAN) is to provide an energy management framework for networked devices.

Networked devices could be Ethernet switches, routers, battery controller, other storages, gateways, ... more or less anything that is connected to a network!

<http://tools.ietf.org/wg/eman/>

The WG sees IEC 61850 as the most applicable standard to EMAN. Concepts from IEC 61850 and CIM have been reused (somehow) by the EMAN WG. A closer cooperation of the models would be appreciated by the next generation of engineers and programmers ...

There is ONE real world – many models could be thought of to describe that single real world. I hope that for energy applications we will prevent to get too many models. IEC 61850 models should be used as default solution in all devices closely connected to the physical level of energy systems ... different notations and protocols may be used BUT the content/semantic should be identical!

A MMXU should model the 3-phase electrical system – all over and in all models.

Posted by [Karlheinz Schwarz](#) at [12:15 AM](#) [No comments:](#) 

Labels: [CIM](#), [IEC 61850](#), [IEC 61968](#), [IEC 61970](#), [ietf](#), [Information Model](#), [MIB](#), [SNMP](#)

Thursday, March 1, 2012

Australia: The Dutch Disease and IEC 61850!?

Dustin Tessier suggests in his paper the increased application of IEC 61850 in Australia as a means against the Dutch Disease – a very interesting paper. He states:

"With a bit of sponsorship from the government, this cost saving technology [IEC 61850] established in 2004 - could immediately translate into production efficiencies throughout the utility, LNG, and industrial sectors. This is but one example of low lying fruit that have yet to be picked in the Australian productivity domain."

The Dutch Disease is a serious threat against nations that have a high dependency on their exportable resource commodities; which explains the apparent relationship between the increase in exploitation of natural resources and a decline in the manufacturing sector. Nations that are victim to low productivity rates, are more vulnerable than others, and it is these nations that must first seek the "low lying fruit" when trying to stimulate efficiencies within their economy. **The answer? IEC 61850!** This is an attractive technology, as it applies across most industries, be it utilities, LNG, metals and mining, desalination plants, etc. With a bit of sponsorship from the government, this cost – saving technology established in 2004 – could immediately translate into production efficiencies throughout the utility, LNG, and industrial sectors. This is but one example of low lying fruit that have yet to be picked in the Australian productivity domain. This is likely true for Canada, Brazil, ...

According to Wikipedia "the **Dutch disease** is a concept that explains the apparent relationship between the increase in exploitation of natural resources and a decline in the manufacturing sector. The mechanism is that an increase in revenues from natural resources (or inflows of foreign aid) will make a given nation's currency stronger compared to that of other nations (manifest in an exchange rate), resulting in the nation's other exports becoming more expensive for other countries to buy, making the manufacturing sector less competitive."

Download the [Document Death To The Dutch Disease: The Century of the Surplus](#) [pdf, 1.2 MB]

Posted by [Karlheinz Schwarz](#) at [1:54 AM](#) [No comments:](#) 

Labels: [Australia](#), [economy](#), [IEC 61850](#), [Power Automation](#), [Power Plants](#), [power systems](#)

Wednesday, February 29, 2012

New Release of NIST Framework and Roadmap for Smart Grid Interoperability Standards

DoE (U.S. Department of Commerce) and NIST (National Institute of Standards and Technology) have published an updated roadmap for the Smart Grids (Release 2.0) the other day.

The general direction and objectives of the framework and roadmap described in the first release have been approved by release 2. Several topics of Release 1.0 have been improved and extended. IEC 61850 (and other IEC TC 57 standards like 60870-6 TASE.2/ICCP, IEC 61968/70 CIM, and IEC 62351 Security) are still understood as key standards for Smart Grids.


New aspects covered:

- Developments related to ensuring **cybersecurity** for the Smart Grid, including a **Risk Management Framework** to provide guidance on security practices;
- A new framework for **testing the conformity of devices and systems** to be connected to the Smart Grid—the Interoperability Process Reference Manual; and
- An overview of future areas of work, e.g., **electromagnetic disturbance and interference**.

You can read between the lines that the people in charge for smart(er) grids have understood that the implementation of new devices and systems is more a **marathon than a sprint**. Take a look at the process of standardization of IEC 61850 which started in 1995, released first complete set mainly in 2004-2005, and extended the standard since then. It took many years before the market saw a bunch of vendors and users that implemented the standard (2007 - 2010). But: The pace in implementing and using the standard has increased steadily all over since 2010 – 15 years after IEC 61850 standardization work started, some 20 years after UCA 2.0 was initiated, and 25 years after the MAP project started.

Don't worry if you see a lot of legacy stuff still running and commissioned. Keep in mind: **Haste makes waste**. Take your time.

Download the [NIST Framework and Roadmap for Smart Grid Interoperability Standards, Release 2.0](#) [pdf, 7.5 MB]

Posted by [Karlheinz Schwarz](#) at [11:04 PM](#) [No comments:](#) 

Labels: [CIM](#), [IEC 61400-25](#), [IEC 61850](#), [NIST Roadmap](#), [security](#), [Smart Grid](#), [smart people](#)

Saturday, February 25, 2012

Easy, Affordable and Fast Integration of IEC 61850 in Small Devices

High financial and time expenditures for the implementation of IEC 61850 in control systems and other devices prevented so far a broad market penetration of the standard in the lower voltage levels and in distributed power generation. A reasonable and cost effective solution is now available with the Beck IPC@CHIP. The development of IEC 61850 conformant interfaces in power delivery systems – particularly renewable and decentralized power producers and consumers – can now be realized within very short time to market.

The stack and API used on many platforms has been developed by SystemCorp (Bentley, Western Australia), e.g., on the Beck IPC Chip.

A new paper has been written about the benefits of using ready-to-go solutions. The paper discusses embedded controller with IEC 61850 stack and API, DLL and other libraries with IEC 61850 stack and API, ... You will find also a brief discussion of the information models for PV inverters (IEC 61850-90-7).

Download the [discussion about benefits using ready-to-go solutions with IEC 61850 and PV Inverter models](#) [pdf, 2.3 MB, 18 pages]

Posted by [Karlheinz Schwarz](#) at 12:29 PM No comments: 

Labels: [API](#), [applications](#), [Beck](#), [Beck Chip](#), [embedded system](#), [Evaluation](#), [IEC 61400-25](#), [IEC 61850](#), [SystemCorp](#)

Video on the Use of IEC 61850-6 SCL to configure a server and a client

This presentation explains the use of two IED specific SCL files to configure IEDs. One is used to **configure a server and** the second **(with the same model - but different bindings between the model and the real data)** is used to **configure a client**. The API "Write call " at the client and the "Write callback" at the server are briefly explained. The API is provided by SystemCorp (Bentley, Western Australia). The API is available at the Beck IPC Chip and other embedded controllers, or for Windows (DLL) and Linux.

Click [HERE](#) for an evaluation kit running on a PC (with DLL and applications). The evaluation package runs for six months. It uses two SCL files for configuring the server and the client (as shown in the video).

I hope you will enjoy this video!
Your feedback to [Karlheinz Schwarz](#) would be appreciated.

Posted by [Karlheinz Schwarz](#) at [5:46 AM](#) [No comments:](#) 

Labels: [configuration](#), [IEC 61850-6](#), [IED configuration](#), [SCL](#), [system configuration](#), [Training](#), [video](#)

Friday, February 24, 2012

Video with brief Introduction to IEC 61850 and IEC 61400-25

IEC 61850 and IEC 61400-25 comprise some 25 documents. Part IEC 61850-7-1 contains some basic modeling concepts that may help to get a few ideas what IEC 61850 is about. I guess that just a few people have read that part. In my training courses with almost 3.000 attendees I have gained a lot of experience on how to explain the basic concepts. In 2011 I have conducted more than 30 training sessions (from one to 12 days). Today I am starting a new service to the industry: providing videos that explain basics with animated up-to-date slides.

The first video is a brief presentation of the key concepts of IEC 61850 (one slide): modeling methods, models, configuration language, communication, and mappings. The demonstration shows how these concepts are used to compose a system. Of course, this slide is just showing the basics of a "small system". This slide is part of the introduction of my commercial training courses.

Please click on the start button to see the video – in order to see it in the full screen, click again on the video and select the full screen button.

I hope you will enjoy this video!
Your feedback to [Karlheinz Schwarz](#) would be appreciated.

Posted by [Karlheinz Schwarz](#) at 5:44 AM No comments: 

Labels: [Ethernet](#), [GOOSE](#), [IEC 61400-25](#), [IEC 61850](#), [MMS](#), [models](#), [SCADA](#), [SCL](#), [SMV](#), [TCP/IP](#), [video](#)

Thursday, February 23, 2012

Siemens Industry offers PRP Ethernet Redundancy Products

Ethernet is obviously to become the number ONE solution for almost all automation domains – just a few experts expected this success some 20 years ago. Even one of the serious supporters of Fieldbusses (Siemens) is supporting this trend by offering new Ethernet products.

High Availability Seamless Redundancy (HSR) and Parallel Redundancy Protocol (PRP) are the latest additions to the IEC 62439 Standard for High Availability Industrial Ethernet Networks. Designed for mission critical and time sensitive applications such as those found in Electric Utility protection and control applications (referenced by IEC 61850-8-1). Below is an excerpt of the TCP/IP Profile (PRP1 and HSR are also contained in the GOOSE and SV profiles):

OSI Model Layer	Specification			m/o
	Name	Service specification	Protocol specification	
Communication	Requirement for internet host	RFC 1122		m
Transport	ISO Transport on top of TCP	RFC 1006		m
	Internet Control Message Protocol (ICMP)	RFC 792		m
	Transmission Control Protocol (TCP)	RFC 793		m
Network	Internet Protocol	RFC 791		m
	An Ethernet Address Resolution Protocol (ARP)	RFC 826		m
Link Redundancy	Parallel Redundancy Protocol and High Availability Seamless Ring	IEC 62439-3 – PRP1 or HSR		o
	Rapid Spanning Tree Protocol (RSTP)	IEEE 802.1D		o

Siemens offers IEC 62439-3 PRP compliant Ethernet products (SCALANCE X204RNA).

Click [HERE](#) for information on SCALANCE X204RNA in English
Click [HERE](#) for information on SCALANCE X204RNA in German
Click [HERE](#) for Manuals and further information

Click [HERE](#) for further information on the concepts [ppt presentation]
Click [HERE](#) for other IEC 62439 products [Hirschmann]

Posted by [Karlheinz Schwarz](#) at 4:56 AM No comments: 

Labels: [Ethernet](#), [Ethernet switches](#), [IEC 61850](#), [IEC 61850-8-1](#), [redundancy](#)

Thursday, February 16, 2012

Excerpt of IEC 61850 etz Report online

A excerpt of the etz Report 34 (in German only) is available online:




2004 / 184 Seiten

Themen: IEC 61850 - Datenmodelle und Kommunikation für die Schutztechnik, Stationsleittechnik, Netzleittechnik, Leitsysteme, Schaltanlage, Energieversorgung, u.v.a.m.

Click [HERE](#) for an excerpt of the book.

Click [HERE](#) for order information.

Posted by [Karlheinz Schwarz](#) at [5:00 AM](#) [No comments:](#) 

Labels: [etz Report](#), [IEC 61850](#), [Stationsleittechnik](#)

Tuesday, February 14, 2012

Update on: How to define New Data Objects in IEC 61850?

The post dated January 15, 2012, on "How to define New Data Objects in IEC 61850?" has been updated and enhanced to help you to understand the model extensions. It contains also to older links ...

Click [HERE](#) for the updated post.

Posted by [Karlheinz Schwarz](#) at [1:58 AM](#) [No comments:](#) 

Labels: [IEC 61400-25](#), [IEC 61850](#), [model extensions](#)


Monday, February 13, 2012

Download IEC 61850 Blog Content as PDF Document

For those readers of the blog that want to get the complete content as a single pdf document, it is one click away ... it contains the 585 posts from 2008 until 2012-02-13.

Click [HERE](#) to download all posts in one pdf [12.5 MB, 420+ pages DIN A4]

Enjoy!

Posted by [Karlheinz Schwarz](#) at [9:37 AM](#) [No comments:](#) 



Teilen

Missbrauch melden

Nächstes Blog»

Blog erstellen

Anmelden

News on IEC 61850 and related Standards

Daily news concerning the standards IEC 61850, IEC 61400-25, IEC 61970 (CIM), IEC 60870-5, ...

Monday, February 13, 2012

Smart Grid Last Mile Infrastructure

20 experts from 15 companies have drafted an architecture for "A Standardized and Flexible IPv6 Architecture for Field Area Networks".

The "paper is intended to provide a synthetic and holistic view of open standards Internet Protocol version 6 (IPv6) based architecture for Smart Grid Last Mile Infrastructures in support of a number of advanced Smart Grid applications (meter readout, demand-response, telemetry, and grid monitoring and automation) and its benefit as a true Multi-Services platform. ... provide an efficient, flexible, secure, and multi-service network based on open standards."

IEC TC 57 standards like CIM, IEC 61850, and IEC 610870, as well as DNP3, IEEE 1888, and Modbus are understood as crucial application standards.

Click [HERE](#) for the above architecture.

What is **IEEE 1888**? A new IEEE project ...

Standard for Ubiquitous Green Community Control Network Protocol

Click [HERE](#) for some background information

Click [HERE](#) for the PAR

Click [HERE](#) to visit the project website.

I hope that the experts involved in the project IEEE 1888 will rely on standards like CIM, IEC 61850, and IEC 610870, ... Hope that the energy automation market is smarter than the industrial automation market: keeping the number of protocol solutions very low!! The industrial automation domain has a lot of headaches with the proliferation of the many many protocols (100+)!!

Posted by [Karlheinz Schwarz](#) at 7:31 AM 0 comments

Labels: [CIM](#), [Cisco](#), [communication](#), [fieldbus](#), [IEC 60870-6](#), [IEC 61850](#), [Smart Grid](#), [smart metering](#), [utilities](#)

Saturday, February 11, 2012

IEC 61850 on every Pole?

Pole mounted power distribution equipment and communication could be found all over in big cities like the one shown in the following picture I took in Seoul:

Subscribe To IEC 61850 News

Posts

All Comments

Blog Archive

▼ 2012 (28)

▼ February (13)

[Smart Grid Last Mile Infrastructure](#)

[IEC 61850 on every Pole?](#)

[Ethernet for Real-Time Applications – IEEE Symposi...](#)

[IEC 60870-6 TASE.2 \(ICCP\) - New Editions](#)

[Load-Shedding by Police and SMS](#)

[Italian Norm about to Require IEC 61850 for almost...](#)

[IEC 61850 Training Courses in Frankfurt and Denver...](#)

[Modeling Circuit Breakers for Single and Three Pha...](#)

[Long-Term Solutions for The Transition of Energy S...](#)

[Wind and Solar Gas – A Challenging Storage Option](#)

[IEEE Standards for free download](#)

[U.S. System Integrator opened Test Facility for IE...](#)



[Power Quality Information modeled in IEC 61850](#)

► [January](#) (15)

► [2011](#) (159)

► [2010](#) (153)

► [2009](#) (162)

► [2008](#) (82)

Contributors

[Michael Schwarz](#)


[Karlheinz Schwarz](#)

In the future you may see many pole mounted boxes that function as routers supporting the hybrid grids (power, gas, heat, ...), traffic control, ... and may other applications.

Several companies are offering the needed communication infrastructure that connects many of the millions of devices.

One of these comprehensive solutions is the "**Cisco Connected Grid** – Deliver More Value from Your Operations Over a Single, Intelligent, Secure Platform". A key element in this platform is IEC 61850.

Click [HERE](#) for a presentation on "Cisco Connected Grid" [pdf, 25 pages]

Posted by [Karlheinz Schwarz](#) at [12:15 AM](#) [1 comments](#) 

Labels: [CIM](#), [Cisco](#), [IEC 61850](#), [power distribution](#), [power systems](#), [routers](#)

Friday, February 10, 2012

Ethernet for Real-Time Applications – IEEE Symposium in Munich

On January 17, 2012 TÜV SÜD (Munich, Germany) held a symposium on real-time Ethernet. Ethernet is not fit for real-time – that is what has been said from the very beginning. But: time and technology has changed. "Deterministic Ethernet & Unified Networking - **Never bet against Ethernet** ...", this is the opening statement of one of the 11 presentations of the symposium. Ethernet seems to be THE backbone of all automation systems in the near future.

The 11 presentations can be downloaded:


1. [Opening by TÜV SÜD](#)
2. [IEEE 802.1 AVB standards status](#) (audio video bridging, Broadcom)
3. [Real-time networks and preemption](#) (Cisco)
4. [Latency Scenarios of Bridged Networks](#) (Deggendorf University)
5. [Real-time Ethernet Requirements](#) for Automation Applications (iniT)
6. [Ultra Low Latency Traffic Class](#) @ Industry (Siemens)
7. [Adaptive Scheduling](#) of Streams in RT (Czech TU Prague)
8. [AVB and Fault Tolerant Networking](#) (Belden/Hirschmann) – **Ethernet everywhere!**
9. [Robustness Requirement in Industry and Energy](#) (ZHAW, CH)

10. [Deterministic Ethernet & Unified Networking](#) (TTTech)
11. [IEEE 1588v2 Time Synchronization in Energy Automation Applications](#) – Case Studies from China (RuggedCom) – **Huge substation with more than 160 Ethernet Switches!**

When I was about to do my diploma thesis at Siemens in Karlsruhe in 1981, my topic was to do some practical analysis of Ethernet. Due to the high cost of two (2) Ethernet MAUs (40.000 DM / 20.000 Euro) it was decided not to purchase the hardware – people did not believe that Ethernet would be an option at all ... and forever. Many experts believed in Token Passing.

I did not agree (I was still a student). So, I decided to look for an answer of making shared Ethernet deterministic ... [it ended up in a patent Siemens got](#).

More to come ... in China and all over. Ethernet and IEC 61850 (based on Ethernet) are providing real standard solutions.

Posted by [Karlheinz Schwarz](#) at [11:09 PM](#) [0 comments](#) 

Labels: [Ethernet](#), [Ethernet switches](#), [IEC 61850](#), [IEEE 1588](#), [IEEE 802](#), [real-time](#)

Thursday, February 9, 2012

IEC 60870-6 TASE.2 (ICCP) - New Editions

IEC TC 57 has published three Committee Drafts (CD) that are intended to provide new editions of the popular standards for control center to control center communication.

IEC 60870 defines a mechanism for exchanging time-critical data between control centres. It defines a standardized method of using the ISO 9506 Manufacturing Message Specification (MMS) services to implement the exchange of data.

Closing date for comments: 2012-05-04

57/1213/CD

IEC 60870-6-503 Ed.3: Telecontrol equipment and systems - Part 6-503: Telecontrol protocols compatible with ISO standards and ITU-T recommendations - **TASE.2 Services and protocol**


57/1214/CD

IEC 60870-6-702 Ed.2: Telecontrol equipment and systems - Part 6-702: Telecontrol protocols compatible with ISO standards and ITU-T recommendations - **Functional profile for providing the TASE.2 application service in end systems**

57/1215/CD

IEC 60870-6-802 Ed.3: Telecontrol equipment and systems - Part 6-802: Telecontrol protocols compatible with ISO standards and ITU-T recommendations - **TASE.2 Object models**

[Contact your National Committee](#) for a copy.

Posted by [Karlheinz Schwarz](#) at [11:50 PM](#) [0 comments](#) 


Labels: [IEC 60870-6](#), [iso 9506](#), [MMS](#), [TASE.2](#), [TASE.2 ICCP](#)

Load-Shedding by Police and SMS

The German TV channel ZDF showed yesterday how businesses in Nice

(France) shed loads: by policeman coming by ... and by SMS messages.

Click [HERE](#) for a video [in German only, at ZDF.de]

Posted by [Karlheinz Schwarz](#) at [11:30 PM](#) [0 comments](#) 

Labels: [load shedding](#), [power outage](#), [power systems](#)

Tuesday, February 7, 2012

Italian Norm about to Require IEC 61850 for almost all PV Inverters

The CEI (Comitato Elettrotecnico Italiano) has published in December 2011 a norm that strongly proposes to use IEC 61850 to connect PV inverters (>1kV and >6 kW) to external systems (grid operator, ...):

CEI 0-21 "Regola tecnica di riferimento per la connessione di Utenti attivi e passivi alle reti BT delle imprese distributrici di energia elettrica".


"Reference technical rules for the connection of active and passive users to the LV electrical Utilities"

Click [HERE](#) for the press release and link to the norm provided by CEI [pdf, Italian].

Click [HERE](#) for a up-to-date presentation presenting the background and needs for ... and for standard communications in low voltage (LV) power systems.

The document IEC 61850-90-7 "IEC 61850 object models for inverters in distributed energy resources (DER) systems" is about to published in a few months. This document is a perfect fit for the needs of PV inverters.

IEC TC 57 WG 17 has met in San Diego (CA) last week. The final draft paper is expected to be available in a few weeks.

Posted by [Karlheinz Schwarz](#) at [11:11 AM](#) [0 comments](#) 

Labels: [DER](#), [distribution automation](#), [IEC 61850](#), [IEC 61850-90-7](#), [inverters](#), [photo voltaic](#), [PV](#)

IEC 61850 Training Courses in Frankfurt and Denver (CO)

Are you looking to tap the experience of training almost 3.000 experts all over? Here are a few public events in Germany and U.S. that provide a wide range of experience and knowledge presented by Karlheinz Schwarz.

Understanding the basics of standard series IEC 61850 and IEC 61400-25 will help you to get smoothly to systems that are based on interoperable devices.

[Frankfurt \(Germany\), 09.-11. May 2012](#)
[Frankfurt \(Germany\), 17.-19. October 2012](#)

3 day IEC 61850/61400-25 Seminar/Hands-on Training (NettedAutomation) with with several embedded Controller Development Kits (Linux, RTOS, ...), Starter Kit (Windows DDL), and several other demo software

[Denver, CO, \(USA\), Remote Conference, 18.-19. September 2012](#)

2 day Seminar (NettedAutomation) on Power System Communication covering IEC 61850, IEC 61400-25, DNP3, NIST Interoperability Roadmap, Smart Grids, ...

Posted by [Karlheinz Schwarz](#) at [10:51 AM](#) [0 comments](#) 

Labels: [hands-on Training](#), [IEC 61400-25](#), [IEC 61850](#), [seminar](#), [stack](#), [starter kit](#), [Training](#)

Monday, February 6, 2012

Modeling Circuit Breakers for Single and Three Phases

Models for switchgear are defined in IEC 61850-7-4 Edition 2. The model defines several aspects like controlling and monitoring of real circuit breaker switchgear:

XCBR excerpt of model:


Status information		
EEHealth	ENS	External equipment health
LocKey	SPS	Local or remote key (local means without substation automation communication, hardwired direct control)
Loc	SPS	Local control behaviour
OpCnt	INS	Operation counter
CBOpCap	ENS	Circuit breaker operating capability
POWCap	ENS	Point on wave switching capability
MaxOpCap	INS	Circuit breaker operating capability when fully charged
Dsc	SPS	Discrepancy
Measured and metered values		
SumSwARs	BCR	Sum of switched amperes, resettable
Controls		
LocSta	SPC	Switching authority at station level
Pos	DPC	Switch position
BlkOpn	SPC	Block opening
BlkCls	SPC	Block closing
ChaMotEna	SPC	Charger motor enabled
Settings		
CBTmms	ING	Closing time of breaker

XCBR represents usually one (1 phase) circuit breaker. In some special cases it may represent all three (3 phase) circuit breaker. If you want to trip all three CBs of a 3-phase system, you have to define an instance 1 for that purpose: e.g., All_XCBR1.

In case you want to model the case to trip a single phase CB, you have to model 3 instances of XCBR, e.g., A_XCBR1, B_XCBR2, C-XCBR3.

The data object XCBR.SumSwARs represents the "Sum of switched amperes, resettable". What to do when you want to model the SumSwARs of all three phases?

I saw this model the other day: extended data objects:SumSwARs1, SumSwARs2, SumSwARs3 ... for Phase A, B, and C in a single XCBR instance:

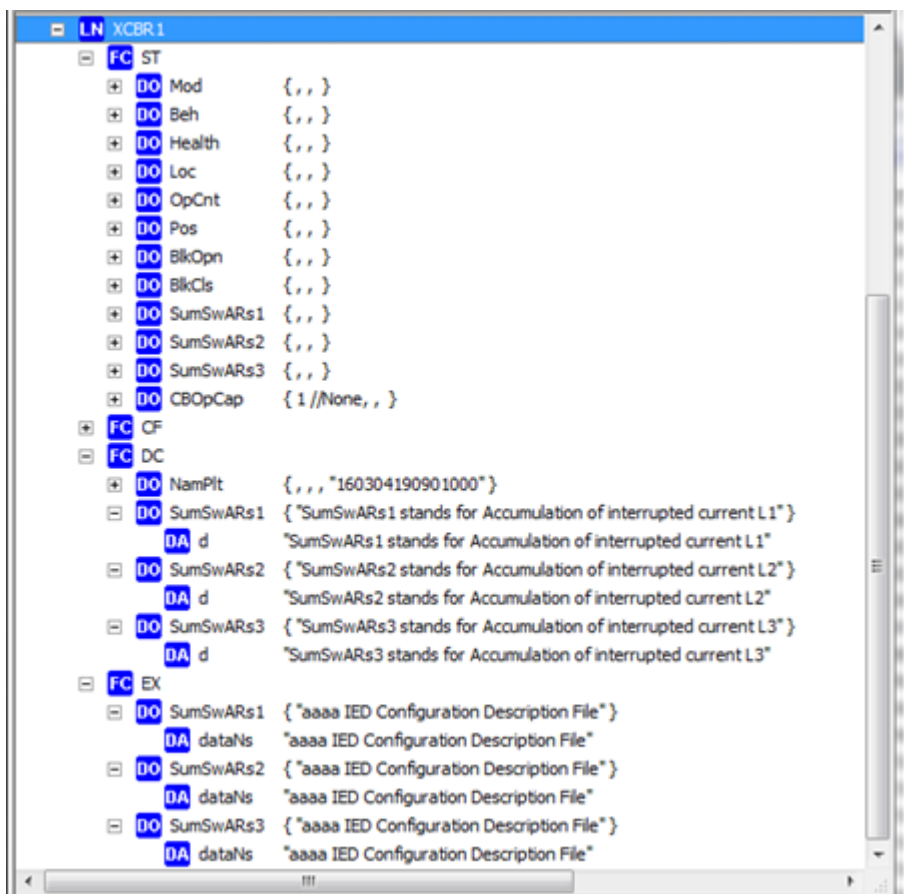

From a general modeling point of view this could be done (it is not wrong!) – **But it is highly recommended not to do!** Since a XCBR is usually representing a single CB then we need 1 instance per phase. A_XCBR1 would represent the sum of switched amperes of Phase A. The All-XCBR1 (see above) could represent the sum of switched amperes of all 3 CBs.

Posted by [Karlheinz Schwarz](#) at 3:01 AM [2 comments](#)

Labels: [circuit breaker XCBR](#), [IEC 61850](#), [model extensions](#), [models](#)

Long-Term Solutions for The Transition of Energy System Needed

Energy supply systems have a long lifetime (30 ... 40 ... 50+ years). Electric energy is flowing through generators, wires, transformer, switchgears, motors, and other loads; gas and heat is flowing through tubes ... The energy is usually flowing top-down today. In the future we will have to manage energy flow top-down, bottom-up, back and forth, converted between ...

The transition of the energy system as planned today, will take decades to happen. According to Eberhard Umbach, the president of the KIT (Karlsruher Instituts für Technologie) it would be a great success, if we could get started within the next 10 years ([Read in the News \[German\]](#)).

“Der Präsident des Karlsruher Instituts für Technologie (KIT) hat Zweifel am Gelingen der Energiewende und dem Ausbau der Windenergie im Südwesten. “Das größte Problem ist, dass wir künftig dezentrale Netze brauchen, die separat geregelt werden und miteinander verknüpft sind”, sagte Eberhard Umbach der “Frankfurter Allgemeinen Zeitung” (Montag).

*Ein Aspekt werde von den Politikern derzeit weitgehend ignoriert, sagte Umbach: "Zur Steuerung der dezentralen Netze fehlt uns heute die entsprechende Informationstechnologie einschließlich entsprechender Sicherheitsmaßnahmen, da reicht es nicht, ein paar neue Programme zu schreiben." **Wenn innerhalb der nächsten zehn Jahre erste Schritte gelängen, so Umbach, dann "wären wir sehr gut".***


That means for the information and information exchange infrastructure that it has to stay (standardized one way or the other) for some 30 ... 50 years. It is unlikely to replace a comprehensive infrastructure, that is required for the future hybrid energy system, every 10 years or so. In the manufacturing domain (car production, ...) it is likely that a factory will be upgraded to a new "standard" every 7 to 10 years.

So, we have some years left to do large scale deployments of the basic information and information exchange infrastructure for the hybrid energy system of the future.

The basic definitions that can be used today, in 10 or even in 30 years are the IEC 61968/70 (CIM) and IEC 61850. The crucial parts of these standard series are independent of implementation technologies: models of a generators, measurements of the electrical 3-phase system or power quality information are semantic models that could be used forever. A "phase A current" is a "phase A current" today and in 40 years.

There is one issue here: How could I figure out which models exist? Good question!

Click [HERE](#) for the list of 280+ Logical nodes (2010).

Posted by [Karlheinz Schwarz](#) at [12:14 AM](#) [0 comments](#) 

Labels: [CIM](#), [energy supply](#), [IEC 61850](#), [long-term solution](#)

Friday, February 3, 2012

Wind and Solar Gas – A Challenging Storage Option

As you know, there is a crucial challenge with renewable power generation – wind and solar power are often generated during times when it could not be transported to the load centers! Usually generation has to stop – even the wind is blowing and the sun is shining. So, how to work around?

In November 2011 there was a big conference in Berlin to discuss a new way of storing energy: the existing **natural gas network** may become a cornerstone for a renewable energy system that provides huge storage, transport and distribution capacities that are hundred times larger than the electric power grid.

Electrons and gas? Yes!

The **"SolarFuel" power-to-gas method could convert renewable electricity into CO2 neutral, renewable natural gas.**

What does it all mean:

- More renewable electricity could be generated.
- Renewable natural gas stores the energy for days, weeks and months due to huge capacities in the tubes used for transportation and distribution
- Energy is accessible everywhere and at any time.

I remember that our gas utility here in Karlsruhe buried huge tubes

(some 100 cm in diameter) in the 90s – this allows to transport and store more gas (volume increases to the second of the diameter). Copper wires can transport more electric power with bigger cables – but the wires do not store more electric power ;-)

The gas storage in Germany could (if full) be tapped for some 6 month!!

The new discussion is about **Hybrid Grids: Electric Power, Gas and Heat**. More to come soon.

One thing is for sure: **We will be challenged by a steep growing demand of Information Models to be added to IEC 61850 for the many aspects of hybrid grids.** UCA (the forerunner of IEC 61850) was adapted by the GRI (Gas research institute, USA) for use by gas utilities. This effort culminated in an evaluation of UCA in a gas utility environment at Pacific Gas and Electric Company, San Francisco, in the 90s.

Excerpt of logical nodes (called Bricks in UCA) from the document: Integrated UCA(TM) for Gas Industry / Volume 2: Gas Industry Device Object Models.

Integrated UCA™ For Gas Industry

Volume 2: Gas Industry Device Object Models


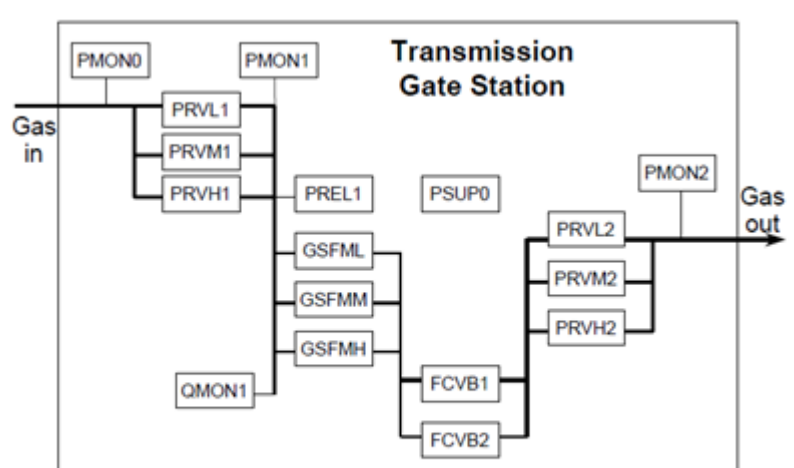


Figure 3-3
The Logical Device for a Transmission Gate Station May Have Many Bricks

- Pressure monitors for inlet, intermediate and outlet gas (PMON0, 1, 2 respectively)
- First stage pressure regulating valves (PRVL0, PRVM0 and PRVH0 for low, mid and high range valves respectively)
- Gate station flow monitors for low, medium and high flow rates (GSFLO, GSFMO, and GSFHO respectively)
- **Gas quality monitor (QMON0):**

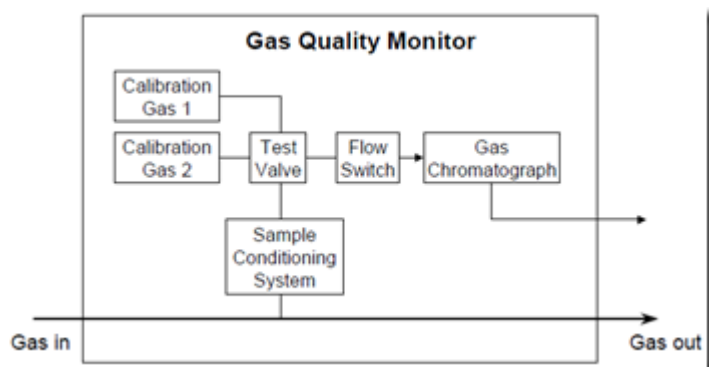

Click [HERE](#) for the list of 6 **reports from GTI** (former GRI) [2000]
Click [HERE](#) to get some more information on **wind and solar gas**.
Click [HERE](#) for a comparison of IEC 61850 and UCA [2004].

IEC 61850 logical nodes for the gas and heat application domain could easily be defined and (if needed) standardized.

Posted by [Karlheinz Schwarz](#) at [9:13 AM](#) [0 comments](#) 

Labels: [energy storage](#), [gas](#), [IEC 61850](#), [solar gas](#), [storage](#), [UCA](#), [wind gas](#)

Thursday, February 2, 2012

IEEE Standards for free download

Did you know that many IEEE 802 and other standards are available for free of charge download? IEEE provides these documents for free six months after their publication.

Click [HERE](#) for the list of free standards.

Posted by [Karlheinz Schwarz](#) at [7:57 AM](#) [0 comments](#) 

Labels: [download](#), [Ethernet](#), [IEEE](#), [IEEE 802](#), [standards](#)

Wednesday, February 1, 2012

U.S. System Integrator opened Test Facility for IEC 61850

Burns & McDonnell (Kansas City, MO) has invested in a new lab for technologies like IEC 61850 to offer a "work bench" for their employees and their clients. The lab supports GOOSE, MMS, and Sampled Values messaging.

The lab helps *"tying IEC-61850 to the power line carrier and integrating advanced protection and control systems with legacy equipment using RS-232 and DNP interfaces."*

This way they will gain crucial experience with the new standard series IEC 61850 –this is what you see in the factory automation domain where a lot of "fieldbus X" **competence centers** are offering services for specific fieldbus technologies.

Click [HERE](#) for the press release (2012-01-27).

Burns & McDonnell is involved in an upgrade project with 19 substations using IEC 61850 technology, 2010 – 2016:

*"Burns & McDonnell is responsible for detailed design including Northeast Utilities' new **Next Generation Substation Protection & Controls**. The new P&C system integrates **relays, SCADA equipment and yard equipment using IEC 61850 protocol, significantly reducing costly wiring.**"*

Click [HERE](#) for the project description.

Posted by [Karlheinz Schwarz](#) at [10:55 PM](#) [0 comments](#) 

Labels: [DNP3](#), [IEC 61850](#), [interoperability](#), [protection](#), [SCADA](#), [testing](#)

Power Quality Information modeled in IEC 61850

IEC 61850 is a powerful standard – also for describing the exchange of Power Quality Information.

IEC 61850 has been extended to support many advanced power quality applications like those defined in IEC 61000-4-30 and EN 50160. IEC 61850-7-4 Edition 2 defines logical nodes, that support modeling and configuring event sequencing with additional quality reporting and waveform recording.

Excerpt of logical nodes for power quality:

- Harmonics (MHAI)
- Flicker (MFLK)
- Imbalanced power calculations (MADV)
- Frequency variation (QFVR)
- Current transient (QITR)
- Current unbalance variation (QUIB)
- Voltage transient (QVTR)
- Voltage unbalance variation (QVUB) and
- Voltage variation (QVVR).

Click [HERE](#) for a nice summary published by Schneider Electric.

Click [HERE](#) for a draft list of Logical Nodes for Power Quality (this content was used as input to the development of IEC 61850-5 Edition 2 and IEC 61850-7-4 Edition 2).

Posted by [Karlheinz Schwarz](#) at [3:50 AM](#) [0 comments](#) 

Labels: [EN 50160](#), [IEC 61000-4-30](#), [IEC 61850](#), [IEC 61850-7-4 Ed2](#), [power quality](#), [power systems](#), [Schneider Electric](#)

Tuesday, January 31, 2012

FINSENY – European Consortium of 35 Organizations supports IEC 61850 and IEC 61400-25

Have you heard about **FINSENY** before? I didn't know about these activities. What is it? Another European project – yes, but one that seems to build on existing standards like IEC 61850, IEC 61968/70, IEC 61400-25, IEC 62351, ... IEC 60870-5.

FINSENY – Future Internet for Smart Energy (2011 – 2015)

FINSENY project: **35 organizations** from the ICT and energy sectors team-up to identify the ICT requirements of Smart Energy Systems. This will lead to the **definition of new solutions and standards, verified in a large scale pan-European Smart Energy trial** ... As part of the FI-PPP programme, FINSENY will analyse energy-specific requirements, **develop solutions** to address these requirements, and prepare for a **Smart Energy trial** in phase two of the programme.

Click [HERE](#) for the list of the 35 organizations.

Fortunately the work done so far refers to IEC TC 57 and TC 88 standards!

*“ ... **existing standards** which are worldwide considered and recognized like the IEC TC57 standards for **Communication networks and systems for power utility automation (IEC 61850)** and System interfaces for distribution management (IEC 61968) will be taken into account when defining the architecture, data models and communication relationships as well as existing telecommunication standards supporting the Future ... ”*

Click [HERE](#) for a statement on standards.

A first list of consolidated ICT Requirements recommends: *"To ensure interoperability the communication should rely on well-known and frequently used standards like IEC 61850, IEC 61968/61970 (CIM), or IEC 60870-5-101/104 (Telecontrol) and others. Also to be respected are specialized communication standards like - IEC 61400-25-4 for wind turbines ..."*

Click [HERE](#) for the requirements document [pdf, 262 pages]

A very detailed description of typical use-cases in **power distribution** has been written: "Distribution Network Building Block": *" ... Advanced ICT solutions that could provide Future Internet and the economies of scale that could be reached are essential for the development of the Smart Distribution Network. This deliverable presents a **Reference Model for the Distributed Network Scenario** and selects and describes a set of building blocks (UC) that should be representative enough for a further analysis of ICT requirements of smart DN solutions."*

Click [HERE](#) for the Distribution Network Building Block [pdf, 98 pages]

I was a bit surprised when I read in that document about the **communication with SCADA** systems:

*"SCADA System **updates real time information** from the RTU by means of **continuous polling**. The RTU is **monitoring continuously** Power Equipment through its Analog and Digital Inputs. When a change occurs in some of the inputs, the RTU takes note of it in order to send it in the next request from the SCADA System **SCADA System requests every 2 seconds** for any change of state or measurements detected in the RTU. When a request of state or measurement change is received, **RTU sends all these changes** to the SCADA System ..."*


Hm, this seems a bit ... ok, smart people will develop smart(er) devices – the IEDs (Intelligent Electronic Devices) – that will help to reduce the sheer unlimited amount of data to be exchanged continuously every 2 seconds. The project expects millions of devices to communicate with. Suppose 100 signals to be exchanged every 2 seconds from 100.000 devices: 5.000.000 signals per second ... IEDs (RTUs, Data Managers, Data Aggregators, Gateways, ...) with IEC 61850 will send information only if it is needed!! – on an event like a state change or limit violation.

Exchanging millions of signals per second means we need a high bandwidth – good for vendors that sell "bandwidth"! That is the question, how can more active power flow through the copper cable? Same may accomplish it the smart way with the reactive power compensation that can be done smart by inverters – smart electricians may solve this by just putting a bigger cable into the ground.

Click [HERE](#) for some discussion of polling versus spontaneous reporting.

The document lists also **Monitoring and Control of Inverter Functions** (Connect / Disconnect to/from grid, Adjust Maximum Generation Level, Adjust Power Factor, ... Scheduled Actions based on time, temperature, power pricing ... VAr modes for VAr support from PV/Storage inverters (Modes PV1...PV5) ... Advanced functions (Watt/Frequency or Watt/Voltage mode, advanced schedules, low voltage fault ride through (FRT), separate Watt and VAr management, harmonic cancellation) ...

The FINSENY papers are worth to read and study.

Posted by [Karlheinz Schwarz](#) at [10:32 PM](#) [0 comments](#) 

Labels: [CIM](#), [distribution](#), [distribution automation](#), [FINSENY](#), [IEC 61400-25](#), [IEC 61850](#), [PV](#), [RTU](#), [Smart Grid](#), [smart people](#), [smart solution](#)

Siemens Industry to take over RuggedCom

The Siemens division Industry (not Energy!) announced yesterday (2012-01-30) that they agreed with RuggedCom to acquire Canadian network supplier RuggedCom Inc. The other day it was reported that Belden was trying to take over RuggedCom.

Click [HERE](#) for the Siemens press release from 2012-01-30.

It is quite interesting to see how long it took to make Ethernet an enjoyable solution:

Excerpt from the press release: "Siemens' portfolio of **industrial Ethernet networking components is enjoying above-average growth rates compared to the competition**. Until now, the main emphasis of Siemens' installed base in this segment has been in Europe. "RuggedCom's portfolio would be an ideal addition to our range of industrial Ethernet communication products, improving our industrial-quality router and switch offering. In addition, the acquisition would improve our footprint in the North America and the Asia-Pacific region," said Anton S. Huber, CEO of the Siemens Industry Automation Division. Huber also indicated that all of **RuggedCom's and Siemens' product lines would be developed further in the next few years.**"

What is meant by "**competition**" in the statement "industrial Ethernet networking components is enjoying above-average growth rates compared to the **competition**"? Is Ethernet competing with the "Profi"- and many other Fieldbusses ... Profibus and ProfiNet ... FF fieldbus ...?

For me this deal indicates that the **native Ethernet** solution as provided by RuggedCom and used in **IEC 61850** is the most "enjoyable" and successful network solution in the next 20 years or so! RuggedCom is (as Belden/Hirschmann) quite active in the IEC 61850 standardization.

When I worked for Siemens Industry in the early 90s, I recommended to use native Ethernet instead of fieldbusses ... now we write 2012 – 20 years later.

Click [HERE](#) for the paper "Bridging MAP to Ethernet" [PDF, 720 KB, 1991]

Click [HERE](#) for the paper "Fieldbus standardization: Another way to go" [PDF, 720 KB, 1991].

Posted by [Karlheinz Schwarz](#) at [12:25 AM](#) [0 comments](#) 

Labels: [Ethernet](#), [Ethernet switches](#), [fieldbus](#), [IEC 61850](#), [Power Automation](#), [power systems](#), [RuggedCom](#), [Siemens](#), [Substation](#), [Substation Automation](#)

Saturday, January 28, 2012

IEC President Wucherer talks about the Electric Future

The new IEC President, Dr Klaus Wucherer talked to the IEC Council recently.

According to the IEC e-tech website (2012-01-28): "*Wucherer underlined that as an engineer and industrialist he has been in contact*

*with the IEC in one way or another throughout most of his working life. He contributed to IEC work through his company and the National Committee and was an industry customer for IEC products and services. ... **Wherever there is electricity, the IEC needs to be involved.**"* In my opinion: IEC is already deeply involved – many experts have to learn this.

Dr Wucherer was my boss at Siemens Automation and Drives when I started my consultancy business 20 years ago – he was in Nuremberg and I was in Karlsruhe. The reason I became a consultant was this: Dr Wucherer asked me three times to move from Karlsruhe to Nuremberg – I decided to stay in Karlsruhe and work in the standardization as a consultant. Dr Wucherer, colleagues of mine and I were deeply involved in the national, European and international standardization of Fieldbuses and MAP. Dr Wucherer supported the standardization work in the 80s and 90s. We agreed that the future would require true international standards for information exchange.

As a Siemens employee under Dr Wucherer I wrote two remarkable papers on the standardization: one about the future of Fieldbuses and one about MAP in 1991:

Click [HERE](#) for the paper "Bridging MAP to Ethernet" [PDF, 720 KB]

Click [HERE](#) for the paper "Fieldbus standardization: Another way to go" [PDF, 720 KB].

I would extend his statement "**Wherever there is electricity, the IEC needs to be involved**" to

Wherever there is electricity, the IEC 61850 needs to be involved!

Click [HERE](#) for some crucial information models for the electricity defined in IEC 61850-7-4 that demonstrate the importance of the above extended statement.

The "electricity world" is likely to prevent the proliferation found in the industrial automation domain's fieldbuses. If the many fieldbus consortia define their fieldbus specific profiles for the electric world then we will get as many information models as fieldbuses! Or?

Click [HERE](#) to see bunch of 60+ fieldbuses in ONE IEC standard in 2008: The IEC 61158.

Posted by [Karlheinz Schwarz](#) at 1:56 AM 1 comments 

Labels: [Automation](#), [Ethernet](#), [fieldbus](#), [IEC](#), [IEC 61158](#), [IEC 61850](#), [MAP](#), [Power Automation](#), [power systems](#), [Siemens](#)

Download IEC 61850 Blog Content as PDF Document

For those readers of the blog that want to get the complete content as a pdf document, you can just get it with one click ... it contains the posts from 2008 until 2012-01-27.

Click [HERE](#) to download all posts in one pdf [12 MB, 410+ pages DIN A4]

Enjoy!

Posted by [Karlheinz Schwarz](#) at 1:05 AM 0 comments 

Labels: [download](#), [IEC 61850](#)

News on IEC 61850 and related Standards

Daily news concerning the standards IEC 61850, IEC 61400-25, IEC 61970 (CIM), IEC 60870-5, ...

Friday, January 27, 2012


IEC 61850 in the U.S. – A Personal View of IEC 61850

Scott Olson (POWER Engineers) investigated recently to figure out the situation of the application of IEC 61850 in the U.S.: He found IEC 61850 on the radar screen!

In his report (A personal view of IEC 61850) he wrote early January 2012 that IEC 61850 is **“More Than a Protocol”**. Yes – it is much more than a protocol. It is not something like “DNP4” or “IEC 60870-5-105”. The standard series IEC 61850 provides a bunch of definitions applicable in many different subsets – there will never be an implementation that implements the whole standard series! **Never ever.**

Some explanation on basic concepts of the standard series IEC 61850 follow (before we have a closer look into Scott Olson’s report):

IEC 61850 provides **models of real world information** (status, measurements, and control points, settings, ...) for many different application domains. The following slide shows an example of a model: XCBB – circuit breaker of a real substation.

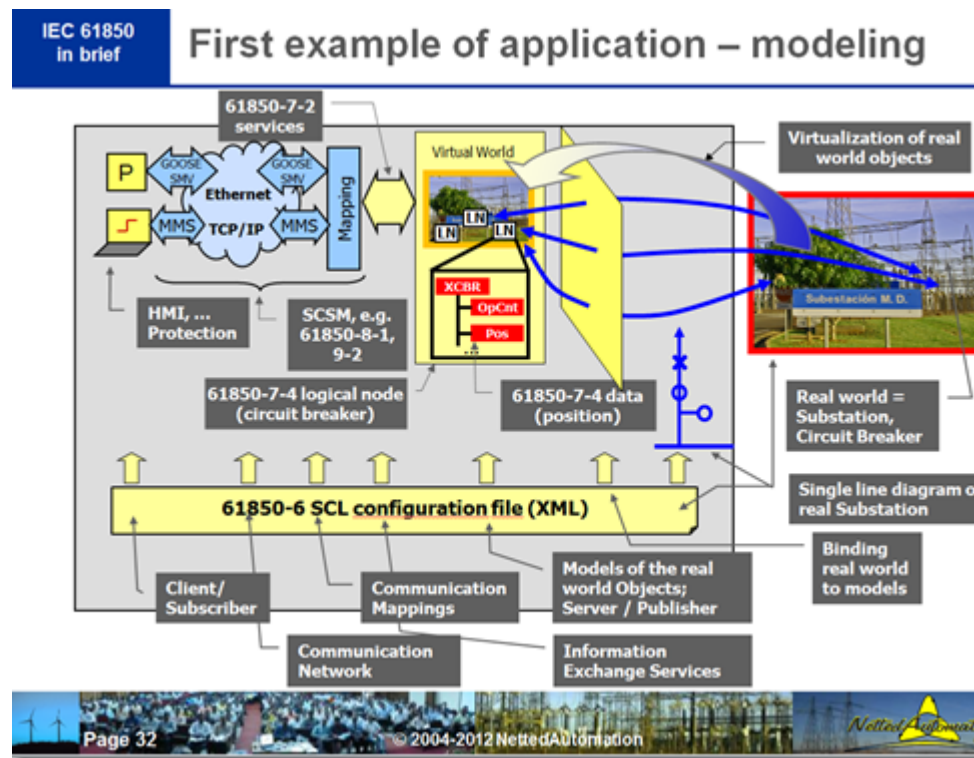

Another area is the **system configuration language (SCL)** that describes many aspects of devices and the whole system. Third, there is the **communication** shown in the top left corner. The communication defines services. These services are realized by **protocols**. The protocols are comprising TCP/IP based client-server communication and Ethernet based real-time communication (GOOSE and sampled

Subscribe To IEC 61850 News

 Posts 

 All Comments 

Blog Archive

▼ 2012 (11)

▼ January (11)

[IEC 61850 in the U.S. – A Personal View of IEC 618...](#)

[How to secure Millions of devices in a Smart\(er\) G...](#)

[How to define New Data Objects in IEC 61850?](#)

[Siemens SIPROTEC 5 – More flexible IEC 61850 Systeme...](#)

[New Parts in IEC 61850 Tissue Database](#)

[Description of IEC 61850 Application Examples](#)

[Path to future Power System – Sprint or Marathon?](#)

[Belden seeks to acquire networking specialist Rugg...](#)

[Status of the parts of the IEC 61850 series. Janua...](#)

[ABB review – Special Report IEC 61850](#)

[Register of tested IEC 61850 devices](#)

► 2011 (159)

systems and devices, how to document requirements and systems, ...

A remaining question is: What is most important to look at or to implement or to apply? It depends. From a device point of view it is absolute important to have the communication services and protocol – and application program interface (API) – implemented. This is required in TWO devices – the server, that provides the models, and the client that reads values or receives spontaneous reports:

IEC 61850
in brief

What is important in using IEC 61850?

<u>In order to exchange first bit</u>	<u>If focus is on application</u>
<ul style="list-style-type: none"> ■ <u>Information models</u> ■ <u>Configuration language</u> ■ <u>Abstract Services</u> ■ <u>Communication protocols</u> <ul style="list-style-type: none"> – TCP/IP based SCADA [Polling, spontaneous messages (events, reporting), logging, control, ...] – Real-time (GOOSE) – Real-time (SMV) – Selfdescription 	<ul style="list-style-type: none"> ■ <u>Information models</u> ■ <u>Configuration language</u> ■ <u>Abstract Services</u> ■ <u>Communication protocols</u> <ul style="list-style-type: none"> – TCP/IP based SCADA [Polling, spontaneous messages (events, reporting), logging, control, ...] – Real-time (GOOSE) – Real-time (SMV) – Selfdescription

Page 38
© 2004-2012 Netted Automation

From a application point of view it is crucial to look at the models!! ;-)

The models should be discussed independent of ANY protocol!!! Many people have understood that the models, services and protocols of IEC 61850 are all independent of each other – that is one of the crucial benefits! That is the reason why IEC 61400-25-4 (Wind Power application of IEC 61850) defines the mapping of process values (the signal lists) and simple services to DNP3 and IEC 60870-5-101/104. Because the models, services and configuration language are independent of the protocols.

And also note that the use of IEC 61850 is first of all intended for the substation automation and power generation ... finally it may be used (in the long term) in the communication with control centers.

Back to the crucial lessons Mr Olson and others have learnt:

He writes: "We received a great email from one of our readers, who reminded us that there was a difference between a standard and a protocol—the latter being a component of the former—and that it was possible to implement IEC 61850 protocols without going all out to implement the standard.

"For example," our reader offered, "61850 GOOSE messaging may be used between IEDs to eliminate physical wiring and increase speed of interaction between IEDs while continuing to use DNP to communicate upwards to SCADA and higher-level systems where slower communications updates are acceptable.


It was such a great point to make: **The migration to the IEC 61850 standard does not force the absolute replacement of protocols that are already in place.** Solutions can be implemented that allow

parts of 61850 to be added to the network while the legacy protocols continue to be used over the same network. For example, station bus protocol (IEC 61850-8-1) could be used to simplify the interface between IEDs, human-machine interfaces (HMIs), etc. within the substation network while continuing to use DNP interface to SCADA. As process bus (IEC 61850-9-2) devices become readily available, the opportunity to eliminate copper wiring between current transformers (CTs) and IEDs could provide tremendous ..."

The lesson that everybody should learn soon (or should have learnt): IEC 61850 could be implemented in many different subsets for even more simple to complex applications. I hope that at the end of 2012 the universe has understood that the **standard series IEC 61850 is more than just a protocol – it goes far beyond DNP3, IEC 60870-5-101/104, even beyond OPC and OPC UA! It's a system-supporting solution.**

By the way, this blog is visited by many experts from North America. It is likely that Mr Olson's lesson will be read by many U.S. people.

Click [HERE](#) for the full "personal view".

Posted by [Karlheinz Schwarz](#) at [12:13 PM](#) [0 comments](#) 

Labels: [ACSI](#), [control center](#), [DNP3](#), [IEC 61400-25](#), [IEC 61850](#), [Migration](#), [OPC UA](#), [protocol](#), [SCADA](#), [Substation](#), [Substation Automation](#), [USA](#)

How to secure Millions of devices in a Smart(er) Grid?

There are many R&D projects underway to find appropriate ways how to secure millions of devices that need to communicate – all over.

A nice paper discusses this issues in the light of the question: what is a workable solution for a some hundred devices may not scale for millions of devices.

The report concludes: "The cryptographic infrastructure underlying the smart grid the community envisions will likely require PKI, for scalability – **but this is the beginning, not the end, of the solution.**"

The good message we hear more often these days is: The path to **smart(er) Hybrid Grids (power, gas, heat, ...)** will be long and steep. A challenge for a people involved – one way or the other.

Click [HERE](#) for the 3 page paper.

There is some progress in making power system automation more secure. Siemens writes in the *SIPROTEC 5 - System Overview, Protection, Automation and Monitoring · Siemens SIP 5.01 · V1.0 (not yet available for download)*:

- Long-lasting, rugged hardware with outstanding EMC immunity and resistance to weather and mechanical loads
- Sophisticated self-monitoring routines identify and report device malfunctions immediately and reliably
- Conformance with the stringent Cyber Security requirements defined in the BDEW Whitepaper and NERC CIP
- Encryption along the entire communication segment between DGS I 5 and the device
- Automatic recording of access attempts and security critical operations on the devices and systems

Click [HERE](#) for the DBEW Whitepaper "Requirements for Secure Control

and Telecommunication Systems” [Dual Language: EN/DE]

Click [HERE](#) for further information in German (only).

[Garderos \(Munich, Germany\)](#) offers industrial-grade (ruggedized) routers which are self-managing and **cyber-secure** ... secure against cyber-attacks ... applicable for power grid applications.

Posted by [Karlheinz Schwarz](#) at [8:42 AM](#) [0 comments](#) 

Labels: [CIP](#), [encryption](#), [ruggedized](#), [security](#), [Siemens](#), [SIPROTEC 5](#)

Sunday, January 15, 2012

How to define New Data Objects in IEC 61850?

The need to define new data objects is likely to have various reasons. One reason is that experts do not know which logical nodes and data objects are already defined. Let's assume there is really a need for a new data object – there is not any data object that may fit.

Example (I found on the Web):

The LN SIML (Insulation Medium Supervision) provides the data object **H2ppm** (Measurement of Hydrogen (H2 in parts Per Million)).

How to model related semantic, e.g., “Hydrogen ppm Rate of Change” or “Hydrogen ppm Rate of Change Goodness of Fit”

These two semantic models are **not defined in the standard**. What is the best way to model these two?

1. Defining values in GGIO? – maybe not,
2. Defining new data objects in SIML? – may be the best solution (could be standardized later), or
3. Defining something like H2ppm1 (measured value), H2ppm2 (rate of change”, and H2ppm3 (roc Godness of Fit)? – **That is definitely wrong!**

Why are the following data objects in conflict with the standard modeling method?

I found this definition for LN: SIML Name: Insulation Medium Supervision (Product Specification):

H2ppm1	MV	Yes	Measurement of Hydrogen (H2 in parts Per Million)
H2ppm2	MV	Yes	Hydrogen ppm Rate of Change
H2ppm3	MV	Yes	Hydrogen ppm Rate of Change Goodness of Fit

The standard IEC 61850-7-4 Edition 2 defines the LN as follows:

LN: SIML Name: Insulation Medium Supervision (Standard IEC 61850-7-4 Edition 2):

These data objects are not allowed to instantiate multiple times!

Excerpt of IEC 61850-7-1 Edition 2 that defines the extension rule for data objects:

14.6 Specialisation of data by use of number extensions

Standardised data names in logical nodes provide a unique identification. If the same data (i.e. data with the same semantics) are needed several times as defined, additional data with number extensions shall be used. The rules for number extensions shall follow the naming conventions defined in IEC 61850-7-2 and be as follows:

- *the number extension usage shall only be defined by the **owner of the data namespace**. This shall be done by adding the number extension 1 to a data object name (e.g. data1),*
- ***data with no number extension shall not be extended by third parties,***
- *data with the number extension 1 can be extended. Number extensions may be ordered or not (1,2,3,4, or, 1,2,19,25),*
- *if only one instance of an extendable data is present in an LN, it shall have the number extension "1".*

14.8 Example for new Data

New Data "Colour of Transformer Oil"

Data name	Attribute type (CDC)	Value of ColrTOil.dataNs
ColrTOil	INS	myVendor1Extension:2010A

The above figure shows also that a data Namespace Attribute "datNs" has to be specified for each new data object.

For the above semantic it would work with the following (standard conformant) definition:

H2ppm1 (measured value) → H2ppm
H2ppm2 (rate of change) → H2ppmRoc datNs=Vendor so and so
H2ppm3 (roc Godness of Fit) → H2ppmRocGdns datNs=Vendor so and so

Hope that helps ...

Posted by [Karlheinz Schwarz](#) at 1:08 PM 0 comments 

Labels: [data object](#), [Edition 2](#), [extended objects](#), [Extensions](#), [IEC 61850](#), [logical node](#), [namespace](#)

Friday, January 13, 2012

Siemens SIPROTEC 5 – More flexible IEC 61850 System Engineering and IED Configuration

According to the "SIPROTEC 5 - System Overview, Protection, Automation and Monitoring · Siemens SIP 5.01 · V1.0" the new SIPROTEC 5 line supports several more flexible ways to configure IEC 61850 IEDs and Models.

See page 58: "The name of the logical device (ldName) is freely editable. For example, the standard-conforming name CTRL can be changed to CONTROL. Structural changes can also be made by changing the logical device (LD), so that the interface structure can be flexibly adapted to the user's own requirements. **Rigid manufacturer specifications are a thing of the past.** Prefix and instance of the logical node (LN) can also be edited. ... **Flexible engineering** is the key to bringing the **system view into harmony with the IEC 61850 structure of the device.**"

IEC 61850 seems to have totally influenced the new series. They put a headline over the communication description: "IEC 61850 - Simply Usable ... The internal structure of SIPROTEC 5 devices conforms to IEC 61850."

Compared to the products offered in the past (since 2004 when the first systems with IEC 61850 communication where commissioned) this **increase in flexibility provided by SIPROTEC 5 will be appreciated by system integrators and users.**

Posted by [Karlheinz Schwarz](#) at [10:37 PM](#) [2 comments](#) 


Labels: [Edition 2](#), [IEC 61850](#), [Siemens](#)

Wednesday, January 11, 2012

New Parts in IEC 61850 Tissue Database

The following new parts have been added to the tissue database:

Click [HERE](#) for Part 4 (2011; Edition 2)
Click [HERE](#) for Part 7-1 (2011; Edition 2)
Click [HERE](#) for Part 9-2 (2011; Edition 2)

Posted by [Karlheinz Schwarz](#) at [11:36 PM](#) [0 comments](#) 

Labels: [Edition 2](#), [IEC 61850](#), [IEC 61850-9-2](#), [maintenance](#), [technical issue](#), [tissues](#)

Description of IEC 61850 Application Examples

A couple of application examples using IEC 61850 for substation protection and automation can be found in a 48 page brochure from Siemens (English and German).

The following topics are covered:


- Switchgear Interlocking with IEC 61850-GOOSE
- Reverse Interlocking Using the GOOSE of IEC 61850
- Beneficial Engineering of IEC 61850 Substation Automation Systems
- Innovative Solutions for Substation Control with IEC 61850
- Seamless Migration
- Ethernet Topologies with IEC 61850
- IEC Interoperability, Conformance and Engineering Experiences

IEC Browser – A Powerful Test Tool for IEC 61850

The description is to a large extent vendor-neutral.

Click [HERE](#) for the English version [pdf, 1.4 MB]

Click [HERE](#) for the German version [pdf, 1.4 MB]

Posted by [Karlheinz Schwarz](#) at [11:11 PM](#) [7 comments](#) 

Labels: [example](#), [GOOSE](#), [IEC 61850](#), [Migration](#), [protection](#), [Siemens](#), [Substation Automation](#)

Saturday, January 7, 2012

Path to future Power System – Sprint or Marathon?

Many people have assumed that the conversion of today's power system into a smarter system could be done in a few years – comparable with a **Sprint**.

After eight years of extensive training on IEC 61850 and other power related topics I conducted for more than 2,750 experts, from more than 700 companies and more than 70 countries I have learned that the conversion is more like a **Marathon**!

Many people believe that smart meters would convert the system in a few years to become a Smart Grid. The German Network Regulator has stated that a **roll-out of huge number of smart meters is not required** for the stable network operation. The report states also that the development of a Smart(er) Grid is more like an evolution – not a revolution.

Click [HERE](#) for the Report (pdf, German only)

At the Hanover Fair in April 2010 I took the following photo of a hybrid PEV vehicle and a charging station. The battery was charged with a **regular extension cord** connected to a **conventional outlet** – in the morning before visitors walked around!!



Photo: Karlheinz Schwarz

The car is already a **Sprinter** – but the Plug into the future could be expected after a “**Marathon**” – **it just takes some more time!**

The International Energy Agency (IEA) states in their “Technology Roadmap on Smart Grids” that “The “smartening” of the electricity system is an evolutionary **process, not a one-time event.**”

Click [HERE](#) for the IEA roadmap [pdf, 50 pages].

Click [HERE](#) for a discussion of the results of the stimulus funding of the U.S. government by end of 2011. According to that report “18 million [installed] smart meters only covers 13 percent of the 142 million customers in the U.S., for example, and automating 671 substations leaves another 11,795 more to go, or 95 percent of those remaining in the United States. As befits its title, this **stimulus funding was meant to stimulate a new wave of smart grid investment across U.S. utilities**, not merely to serve as a **one-time jobs-and-spending jolt**.

My students are told all the time: Do not hurry! Take your time. To win in a Marathon you need sustainable training. Only **Smart (i.e., well trained) People** will be able to implement the needed systems to measure, monitor, control, protect, optimize, ... the electrical power system.

Posted by [Karlheinz Schwarz](#) at [8:09 AM](#) [0 comments](#) 

Labels: [education](#), [electric vehicles](#), [electro mobility](#), [IEC 61850](#), [power systems](#), [Smart Grid](#), [smart metering](#), [smart people](#), [smart solution](#), [Training](#)

Friday, January 6, 2012

Belden seeks to acquire networking specialist RuggedCom


Ruggedized network infrastructure compliant to IEC 61850-3 is crucial for the implementation of Smart(er) Grids. RuggedCom – one of the well known brands in the substation domain – is one of the companies that offers network components to build the needed communication infrastructure.

One of RuggedCom competitors, Belden (Hirschmann is a brand of Belden), wants to take RuggedCom over.

Click [HERE](#) for the press news.

This shows that the Power Industry is following the **native Ethernet** solutions. IEC 61850 is based on the native Ethernet solution in contrast to the industrial automation domain where a lot of even standardized solutions like EtherCat, ProfiNet, PowerLink, ... compete with each other Ethernet-based and traditional Fieldbuses, e.g., Profibus, CAN, Interbus, ...

The Electric Power System has a highly standardized process: the 3 phase A.C. system (50 or 60 Hz). This single process requires a single communication solution: IEC 61850 based on native Ethernet.

Posted by [Karlheinz Schwarz](#) at [11:34 PM](#) [0 comments](#) 

Labels: [Belden](#), [Ethernet](#), [Ethernet switches](#), [hirschmann](#), [IEC 61850-3](#), [RuggedCom](#)

Thursday, January 5, 2012

Status of the parts of the IEC 61850 series, January 2012

The standard series comprises 18 officially published parts; another 12 are in preparation. Most published parts are Standards; some are Technical Reports (TR) and Technical Specifications (TS):

1	IEC/TR 61850-1	Part 1: Introduction and overview
2	IEC/TS 61850-2	Part 2: Glossary
3	IEC 61850-3	Part 3: General requirements
4	IEC 61850-4	Part 4: System and project management
5	IEC 61850-5	Part 5: Communication requirements for functions and device models
6	IEC 61850-6	Part 6: Configuration description language for communication in electrical substations related to IEDs
7	IEC 61850-7-1	Part 7-1: Basic communication structure - Principles and models
8	IEC 61850-7-2	Part 7-2: Basic information and communication structure - Abstract communication service interface (ACSI)
9	IEC 61850-7-3	Part 7-3: Basic communication structure - Common data classes
10	IEC 61850-7-4	Part 7-4: Basic communication structure - Compatible logical node classes and data object classes
11	IEC 61850-7-410	Part 7-410: Hydroelectric power plants - Communication for monitoring and control
12	IEC 61850-7-420	Part 7-420: Basic communication structure - Distributed energy resources logical nodes
13	IEC 61850-8-1	Part 8-1: Specific communication service mapping (SCSM) - Mappings to MMS (ISO 9506-1 and ISO 9506-2) and to ISO/IEC 8802-3
14	IEC 61850-9-1	Part 9-1: Specific Communication Service Mapping (SCSM) - Sampled values over serial unidirectional multidrop point to point link
15	IEC 61850-9-2	Part 9-2: Specific communication service mapping (SCSM) - Sampled values over ISO/IEC 8802-3
16	IEC 61850-10	Part 10: Conformance testing
17	IEC/TS 61850-80-1	Part 80-1: Guideline to exchanging information from a CDC-based data model using IEC 60870-5-101 or IEC 60870-5-104
18	IEC/TR 61850-90-1	Part 90-1: Use of IEC 61850 for the communication between substations

Another 12 Parts are under development. Some of these are almost ready for publication in 2012.

Several of the above listed documents have the tag "Edition 2", some have still the tag "Edition 1" and are in the maintenance process.

A complete list comprises all 30 parts: Title, publication, stability date, ... see excerpt in the table below (the complete table can be downloaded – see below):


Published Documents: Communication networks and systems for power

Part	Current Title	Edition	Stability Date	2002	2
1	IEC/TR 61850-1	Part 1: Introduction and overview	1.0 (2003-04-28)	2012	
2	IEC/TS 61850-2	Part 2: Glossary	1.0 (2003-08-07)	2012	
3	IEC 61850-3	Part 3: General requirements	1.0 (2002-01-16)	2012	
4	IEC 61850-4	Part 4: System and project management	1.0 (2002-01)	2004	
		2.0 (2011-04-11)	2015		
5	IEC 61850-5	Part 5: Communication requirements for functions and device models	1.0 (2003-07-24)	2012	
6	IEC 61850-6	Part 6: Configuration description language for communication in electrical substations related to IEDs	1.0 (2004-03)	2006	
		2.0 (2009-12-17)	2013		
7	IEC 61850-7-1	Part 7-1: Basic communication structure - Principles and models	1.0 (2003-07)	2005	
		2.0 (2011-07-15)	2013		

The table indicates as well how many tissues have been posted at the [tissue database](#) for most parts tagged edition 1 and tagged edition 2.

Please note that there is NO "IEC 61850 Edition 2" !! There are only Editions of the PARTS!!

If you want to know the current status of the standard series IEC 61850 (January 2012) you have to check the status of ALL documents at early January 2012 (red vertical line in the figure below):

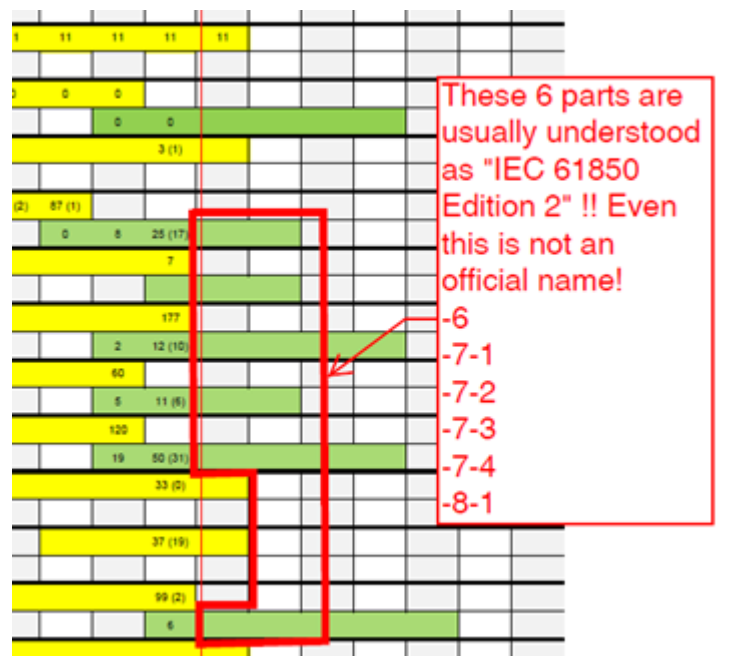

Some of the documents are still Edition 1 (yellow) others are Edition 2 (green). 10 of the 18 parts are still EDITION 1 !! 8 parts are EDITION 2. The other 12 parts under development will be published as EDITION 1.

The 6 parts that are usually understood as "IEC 61850 Edition 2" are:


- 6 Ed2
- 7-1 Ed2
- 7-2 Ed2

-7-3 Ed2
-7-4 Ed2
-8-1 Ed2

This is NOT an official name!

Most parts published by January 2013 are still marked EDITION 1 !!

Click [HERE](#) to download the complete table [pdf, 2 pages]

Posted by [Karlheinz Schwarz](#) at [1:13 PM](#) [0 comments](#) 

Labels: [draft](#), [Edition 1](#), [Edition 2](#), [IEC 61850](#), [IEC 61850 edition 2](#), [status](#), [technical issue](#)

Wednesday, January 4, 2012

ABB review – Special Report IEC 61850

ABB has published already in August 2010 a very comprehensive and nice report on various aspects of IEC 61850. The report comprises 64 pages! Most visitors of this blog may not know the report.

The report starts with a very true statement: “**Communication is more than exchanging data**; it means **globally understandable information** based on syntax and semantic. This is behind IEC 61850, the topic of this issue of ABB Review Special Report.” It continues: “**Electric energy is the backbone of our global society**. Its reliable supply from conventional and renewable sources via complex networks requires seamless control that is only possible with the help of a standard providing a high-level and comprehensive description of the information exchanged.”

Most people are like to say that the **Internet is the backbone of our global society** – What would the Internet be without electric energy? How would your home look like without electric power? You would not be able to read this post without electric power. Many people see electric power like sunshine and rain – it is just here.

Click [HERE](#) for the report [pdf, edition August 2010]

Posted by [Karlheinz Schwarz](#) at [6:48 AM](#) [0 comments](#) 

Labels: [ABB](#), [IEC 61850](#), [IEC 61850 edition 2](#), [Smart Grid](#)

Register of tested IEC 61850 devices

KEMA has recently published an updated Test Register (version 2011-11-28) for

- IEC 61850 Client Systems [8 clients successfully test]
- IEC 61850 Server Devices [total: **212** – 2011:**42** / 2010:21 / 2009:34 /before:115]
- IEC 61850 Ethernet Switches [23]
- IEC 61850 Sampled Value Publishers (Merging Units) [2]

Click [HERE](#) for the complete list [pdf]

Click [HERE](#) for the IEC 61850 certificates; if you don't have an UCAIUG login account you can apply for a free guest account.

Posted by [Karlheinz Schwarz](#) at [5:48 AM](#) [0 comments](#) 

Labels: [certificate](#), [client](#), [conformance test](#), [IEC 61850](#), [server](#), [UCA](#)

Thursday, December 29, 2011


How can you feed back your experience with IEC 61850?

The many parts of the standards series IEC 61850 published require some kind of maintenance. In order to collect, discuss, solve, and document the feedback from the market, IEC TC 57 WG 10 has set-up a database: The Technical Issues database or just: the Tissues database.

More and more experts from utilities feed their experience back to the standardization groups. An example is the latest post of today:

Click [HERE](#) for the Tissue #810 on the Logical node RFLO.

In case you find any tissue in the published standards search the Tissue database first and post a new tissue if your tissue has not yet been posted.

Posted by [Karlheinz Schwarz](#) at 2:22 AM 0 comments 

Labels: [IEC 61850](#), [maintenance](#), [technical issue](#), [tissues](#)

TÜV-SÜD announces IEC 61850 Test Lab and Smart Grid Forum

TÜV-SÜD in Munich accelerates the support of the standard series IEC 61850 in 2012:

- Test Services
- Smart Grid Forum (20.-21. März 2012)

TÜV-SÜD will provide a wide range of services to reach a high level of interoperability of IEDs:



Click [HERE](#) for more details of the services [English, PDF]

Click [HERE](#) for more details of the services [German, PDF]

The Smart Grid Forum (Munich, 20.-21. März 2012) will be conducted in German). Topics are:

- Normen und Standards für Smart Grids
- IEC 61850 in der Anwendung
- Smarte Daten: Normen und Richtlinien für den sicheren Datenaustausch

- Verteilnetzautomatisierung durch intelligente Netzkomponenten: aktuelle Projektbeispiele von Netzbetreibern und Industriekunden
- IT-Sicherheit und Datenschutz im intelligenten Netzsystem

Click [HERE](#) for more information.

Posted by [Karlheinz Schwarz](#) at 2:08 AM 0 comments 

Labels: [conformance test](#), [forum](#), [IEC 61850](#), [interoperability tests](#), [testing](#), [TÜV SÜD](#)

Wednesday, December 28, 2011

MMS (ISO 9506) Introduction – Why to focus on the API?

Jan Tore Sørensen and Martin Gilje Jaatun (SINTEF ICT, Trondheim, Norway) have published a nice introduction to the basic architecture and definitions of MMS in a 46 page document – easy to read and understand.

This documents demonstrates that MMS is not complex. IEC 61850-8-1 (and IEC 61850-9-2) use MMS for specifying the message exchange between IEC 61850 servers (publishers) and clients (subscribers).

Implementing IEC 61850 compliant systems comprising SCL tools, servers, clients, publishers, and subscribers means to implement:

1. Upper layers on top of TCP/IP (or on Ethernet for publisher/subscriber)
2. Protocol machine (MMS, GOOSE and SV)
3. Encoding/Decoding ASN.1 BER messages
4. **ACSI services (LD, LN, Control Blocks (reporting, Logging, service tracking, GOOSE, and SV), DataSets, Control, LOG –> mapped to protocols, mainly MMS)**
5. **Object model (dictionary in IED and behavior according to IEC 61850-7-4)**
6. **API (application program interface) for server, client, publisher, and subscriber**
7. **IED configuration using SCL file**
8. **SCL tool for system engineering and IED configuration**

A ballpark estimate of the efforts needed to implement a reasonable subset of IEC 61850 (if one develops the software from scratch) is in the range of some 10 man-years. Only a small part of efforts (likely less than 10 per cent) deals with MMS and the underlying protocols required by MMS.

A different solution for the client-server messaging, e.g., by using a webservice, would have a minor impact on the total efforts. From a application point of view an efficient API should be in the focus when implementing of using IEC 61850!

Click [HERE](#) for the complete paper on MMS [pdf, 446 KB]

Note that IEC 61850 is much more than a protocol – and much more than MMS. MMS is just an international standard like Ethernet or TCP/IP.

Posted by [Karlheinz Schwarz](#) at 6:37 AM 0 comments 

Labels: [API](#), [applications](#), [IEC 61850](#), [IEC 61850-8-1](#), [MMS](#), [webservice](#)

Tuesday, December 20, 2011


Siemens and IEC 61850: More than 200,000 IEC 61850 IEDs installed

According to Siemens they are "the world market leader in digital protection technology ... from the experience out of an installed base of more than 1 million devices and **200,000 with IEC 61850**".

Often people ask, why are the many fieldbus users groups (for CAN, PROFINET, POWERLINK, EtherNet/IP, EtherCAT, SERCOS III, Foundation Fieldbus, ControlNet, DeviceNet, ...) more active than the UCA International Usersgroup (representing IEC 61850)? One reason seems to be this: most of the 50+ fieldbus solutions are competing with each other. It is no surprise that each users group tries to promote the benefits and the success of their solution.

IEC 61850 does not seem to have (serious) competitors – so it is not required to do a lot of marketing by a users group.

Click [HERE](#) for a brochure from Siemens on their relays (Relay Selection Guide, pdf).

Posted by [Karlheinz Schwarz](#) at [8:32 AM](#) [0 comments](#) 

Labels: [Edition 1](#), [Edition 2](#), [IEC 61850](#), [protection](#), [Siemens](#)

Example of a new part of IEC 61850 – Edition 1 or Edition 2?

The Technical Report IEC/TR 61850-90-1 (Substation to Substation Communication) has been published in March 2010 – quite new part of IEC 61850:



Is this document part of IEC 61850 Edition 1 or IEC 61850 Edition 2?
Neither nor!

It just is IEC/TR 61850-90-1 Edition1 – Edition 1 of part 90-1; NOT a part of **IEC 61850 Edition 1**. There was never an official Edition 1 of the SERIES IEC 61850 nor will there be an Edition 2 of the whole SERIES.

Vendors are often making statements like "Full compatibility between IEC 61850 Editions 1 and 2" or "Efficient operating concepts by flexible engineering of IEC 61850 Edition 2" ... What does that mean? Hm, it seems to be a marketing expression, or?

Posted by [Karlheinz Schwarz](#) at [8:11 AM](#) [0 comments](#) 

Labels: [Edition 1](#), [Edition 2](#), [IEC 61850](#)

Tuesday, November 29, 2011

NEW: Embedded Linux Gateway supporting IEC 61850 and IEC 61400-25

[SSV Embedded Systems](#) (Hannover, Germany) offers the embedded Linux gateway module DIL/NetPC DNP/9265 now with a preinstalled IEC 61850 (IEC 61400-25) protocol stack. An easy to configure and use IEC 61850 API (application program interface) allows for a **very short time-to-market development** – within days and weeks. Program your application, model the IEC 61850 logical nodes and data object that expose your application data, bind them together, configure the communication services like data sets and control blocks (reporting and GOOSE) – and you can connect with other IEC 61850 devices. The model, the binding, and the communication services are described in a standard SCL file (System Configuration Language, IEC 61850-6) and uploaded to the module. Restart the module and you are done. **It's that easy.**

The ARM9-based DNP/9265 is equipped with 32MB of SDRAM, as well as 32MB of NOR flash for holding the boot-loader and Linux O/S, says the company. I/O is passed through a 40-pin DIL socket, and includes three UARTs for COM functions, as well as 20-bit GPIO.

The module supplies one interface each for USB 2.0 Host, SD card, I2C, SPI, and CAN (ISO/11898A 2.0B), says the company. A 10/100Mbps Ethernet port is also supported. Additional features include a watchdog timer, power supervisor for VCC control, and in-system programming features.

Measuring 2.17 x 0.91 inches (55 x 23mm), the module runs on a 3.3 Volt power supply, with supply current at typically 300mA, with a maximum of 500mA. The module is said to support temperatures ranging from 32 to 158 deg. F (0 to 70 deg. C).


SSV also offers other DIL/NetPC-based gateway box products for smart grid and virtual power plant applications. These gateways allow to connect distributed generation installations (such as CHPs, wind-turbines, small hydro, back-up gensets etc.) **directly via IEC 61850** with any other application like power grid monitoring or control centers.

In addition to Linux and the integrated IEC 61850 the SSV gateway solutions comes with drivers and protocol stacks for SSL- or IPsec-based VPNs (*virtual private networks*). This allows secure data communication with powerful encryption technologies over the public telecommunication infrastructure, such as the Internet.

Click [HERE](#) for the news [in German]

Click [HERE](#) for a description of the product [in English]

Click [HERE](#) to check the IEC 61850 (IEC 61400-25) API online [in English]

Posted by [Karlheinz Schwarz](#) at [11:24 PM](#) [0 comments](#) 

Labels: [API](#), [distribution automation](#), [embedded system](#), [IEC 61400-25](#), [IEC 61850](#), [Linux](#), [power generation](#), [security](#), [Substation](#), [Substation Automation](#), [wind power](#)

Saturday, November 26, 2011

Reminder – Introduction to IEC 61850 and IEC 61400-25 on ARM and LINUX on December 14

The introduction to the standard series and the new Embedded Modules developed by TQ with IEC 61850 und IEC 61400-25 (using ARM

Architectures, Linux and the very simple and powerful SystemCorp IEC61850 API) is less than three weeks ahead (in **Wessling/Munich, 2011-12-14**).

Click [HERE](#) for the event and information on the embedded controllers (in German).

Posted by [Karlheinz Schwarz](#) at [3:33 AM](#) [0 comments](#) 

Labels: [embedded system](#), [IEC 61400-25](#), [IEC 61850](#), [smart metering](#), [smart people](#), [smart solution](#), [Training](#)

[Home](#)

[Older Posts](#)

Subscribe to: [Posts \(Atom\)](#)

News on IEC 61850 and related Standards

Daily news concerning the standards IEC 61850, IEC 61400-25, IEC 61970 (CIM), IEC 60870-5, ...

Friday, November 25, 2011

Easy Smart Metering and IEC 61850 MUC (Multi Utility Communication)

Solvimus (Ilmenau, Germany) offers an Easy Smart Metering and IEC 61850 MUC (Multi Utility Communication) device – combining metering and IEC 61850.

The MUC.easy(TM) supports:

- M-Bus, wM-Bus, RS-232, RS-485, S0, or CL to connect to meters
- Integrated Webserver
- GSM/GPRS
- Ethernet
- DSL
- Powerline Communication (PLC), and
- a powerful embedded IEC 61850 solution

Click [HERE](#) for the News in German.

Click [HERE](#) for some overview of the MUC with IEC 61850

Posted by [Karlheinz Schwarz](#) at [5:11 AM](#) [0 comments](#) 

Labels: [61850](#), [Gateway](#), [IEC 61850](#), [M Bus](#), [meter](#), [MUC](#), [Multi Utility Communication](#), [smart metering](#)

Wednesday, November 23, 2011

Details of NEW Hirschmann RSP and Embedded Switches With IEC-Standard Redundancy and IEEE 1588 disclosed

The recently announced new Ethernet Switches from Hirschmann that support redundancy protocols are now officially disclosed.

With Hirschmann™ RSP Switches, Which Support the New IEC-Standard Redundancy Protocols (PRP, HSR), Networks Can Now be Built for the First Time With Genuinely Uninterrupted Data Communication.

The Advantages at a Glance

- Extensive range of redundancy methods: PRP, HSR, PRP/HSR Red Box, MRP, Fast MRP, RSTP
- Precise synchronization compliant with IEEE 1588v2
- Enhanced security mechanisms: authentication, radius, role based access, port security, SSHv2, HTTPS and SFTP, plus others currently in preparation.
- Fast device replacement, comprehensive logging and storage of all configuration data, plus operating software updates via SD card
- High level of vibration resistance
- Broad immunity to electrostatic discharges and magnetic fields
- Temperature range from -40°C to +70°C

Subscribe To IEC 61850 News

Blog Archive

► [2012](#) (11)

▼ [2011](#) (159)

► [December](#) (5)

▼ [November](#) (11)

[NEW: Embedded Linux Gateway supporting IEC 61850 a...](#)

[Reminder – Introduction to IEC 61850 and IEC 61400...](#)

[Easy Smart Metering and IEC 61850 MUC \(Multi Utili...](#)

[Details of NEW Hirschmann RSP and Embedded Switches...](#)

[The Aging Workforce in the Electric Power domain](#)

[IEC 61850 soon for Steam and Gas turbines](#)

[Integration of Renewables in the Grid – A Huge Cha...](#)

[IEC 61850 Editions – Help to Prevent Confusions](#)

[Seminário e Treinamento NORMA IEC 61850 - Institut...](#)

[Distribution Company Vector's Ten-Years Plan for I...](#)

Power supply 24/36/48 V DC or 60/120/250 V DC and 110/230 V AC

- Strong and compact metal housing

Click [HERE](#) for the technical Brochure [pdf, English]

Click [HERE](#) for the technical Brochure [pdf, Deutsch]

The New Embedded Ethernet EES20 and EES25 Switches from Hirschmann™ Combine the Functional Scope of a Powerful Managed Switch With Interruption-free Redundancy Protocols and Precise Synchronization.

- This module allows automation equipment to be extended to include state-of-the-art switch technology with very little effort
- The additional network functionality gives the equipment sustained competitive advantages
- Development process and time-to-market are significantly shortened thanks to Embedded Ethernet

Click [HERE](#) for the technical Brochure [pdf, English]

Click [HERE](#) for the technical Brochure [pdf, Deutsch]

Posted by [Karlheinz Schwarz](#) at [12:48 AM](#) [0 comments](#) 

Labels: [communication](#), [Ethernet](#), [Ethernet switches](#), [hirschmann](#), [redundancy](#)

Saturday, November 19, 2011

The Aging Workforce in the Electric Power domain

The Electric Power Utility domain is looking for many electrical power engineers all over. One example can be found by searching the simplyhired.com:

Click [HERE](#) for a search on **power system engineer**

The search results in **38,329** hits for the U.S. allone !!

Some **6.000 hits** are related to protection, **800** to SCADA, and **55** to IEC 61850, **12** to DNP3.

Click [HERE](#) for a search on **electrical engineer**

The search results in **86,596** hits for the U.S.

72 are related to IEC 61850 and 20 to DNP3.

Power systems require skilled and experienced engineers. How to become an experiences and skilled engineer? By education, training, learning-by-doing, ...

During the year 2011 a lot more electric power engineers and IT experts have received one or the other education and training with regard to IEC 61850.

I see a lot more of interest on the radar screen for 2012.

Have you ever thought about to get a training that build up your skills in the application of IEC 61850 and related standards? Note that in many of the open positions you can read something like: experience in relevant **protocols** and interfaces (IEC 61850, IEC 60870-x, DNP, etc.).

Many people still expect that IEC 61850 is a protocol. It is definitely much more than a protocol.

Click [HERE](#) to see some differences.

[IEC 61850 and IEC 61499 in Action at SPS/IPC/Drive...](#)

- ▶ [October](#) (22)
- ▶ [September](#) (11)
- ▶ [August](#) (11)
- ▶ [July](#) (23)
- ▶ [June](#) (20)
- ▶ [May](#) (10)
- ▶ [April](#) (6)
- ▶ [March](#) (16)
- ▶ [February](#) (16)
- ▶ [January](#) (8)

- ▶ [2010](#) (153)
- ▶ [2009](#) (162)
- ▶ [2008](#) (82)

Contributors

[Michael Schwarz](#)

[Karlheinz Schwarz](#)

Posted by [Karlheinz Schwarz](#) at [1:49 PM](#) [0 comments](#) 

Labels: [DNP3](#), [education](#), [electrical engineer](#), [engineer](#), [engineering](#), [IEC 61850](#), [power system engineer](#), [power systems](#), [protocol](#), [workforce](#)

Thursday, November 17, 2011

IEC 61850 soon for Steam and Gas turbines

A New Work Item has been proposed by Sweden to use IEC 61850 for Steam and Gas Turbines (Document 57/1193/NP). IEC 61850-7-410 defines already extensions of the Information models for applications in Hydro Power Plants.

The draft second edition of IEC 61850-7-410 has been extended to cover power system stabilizer (PSS) functions, as well as complex excitation systems. In order to use the IEC 61850 communication system for thermal power plants, additional data models for e.g. steam turbines with ancillary equipment is required. In a further future work, additional models for boilers, burner management, flue gas cleaning could be added.

The ballot of the NP closes 2012-02-17.

If you are interested in getting involved contact your IEC TC 57 National Committee.

Click [HERE](#) for the list of countries involved in IEC TC 57.

Posted by [Karlheinz Schwarz](#) at [5:26 AM](#) [0 comments](#) 

Labels: [gas power plants](#), [hydro power](#), [IEC 61850](#), [IEC 61850-7-410](#), [Power Plants](#), [steam power plants](#)

Integration of Renewables in the Grid – A Huge Challenge

Sometimes some experts expect that IT is one of the most crucial aspects of the future power delivery system – yes it is important ... to some extent.

The Power System is STILL (and forever) an ELECTRICAL SYSTEM! Mark O'Malley writes in the 2011-11/12 issue of the IEEE Power & Energy magazine that the "Grid integration is, in his view, the most interesting and exciting area of research in the world today." ... and tomorrow and for the next decade at least.

After many years of low investments in the power industry (material, equipment, systems, human resources, ...) it is expected that it will grow now. Some companies have already increased their budgets for education in Energy and IT related issues.

Click [HERE](#) for the complete opinion of Mark O'Malley.

Posted by [Karlheinz Schwarz](#) at [5:01 AM](#) [0 comments](#) 

Labels: [education](#), [power systems](#), [renewables](#)

Thursday, November 10, 2011

IEC 61850 Editions – Help to Prevent Confusions

After my recent Newsletter on IEC 61850 many experts visited the blog post of the first discussion on Editions which summarizes:

BUT there will be not an EDITION 2 of the standard SERIES IEC 61850 per se!! Various parts (of the **first 16** parts) will be revised and extended and then published tagged as EDITION 2.

New parts will be published with the tag **EDITION 1**, e.g., IEC 61850-80-1 (Guideline to exchanging information from a CDC-based data model using IEC 60870-5-101 or IEC 60870-5-104) - **IEC/TS 61850-80-1, Edition 1.0, 2008-12**

Click [HERE](#) for the complete post.

There are a lot of confusions when people talk about Editions of IEC 61850.

In a new paper it is reported: “**Edition 2.0 of IEC 61850 Standard** has been released considering valid technical issues and future aspects of protocol usage. ... compares **the IEC 61850 Edition 2.0** specification to its predecessor Edition 1.0.”

Click [HERE](#) for that paper.

There is hope that experts will use more precise language when it comes to editions of the many parts of IEC 61850 and related documents.

In addition to the question of the Edition of the standard there is another question, when it comes to the **Devices that implement IEC 61850**: Does this or that Device **conform to IEC 61850 Edition 1** or **Edition 2**?

Since there is NO EDITION 2 of the STANDARD, a Device could **NOT** be characterized as an IEC 61850 Edition 2 Device!!

We have to differentiate the various aspects of the Standard: Which Logical Nodes, Common Data Classes, Services, which subset of the Configuration Language Edition 2, et cetera are implemented.

Edition 2 of any part of IEC 61850 can mean the following:

1. **(Usually: Most) Definitions of parts tagged Edition 1** have been taken over in the same parts tagged Edition 2 **without any change**.
2. **(Some) Definitions of parts tagged Edition 1** have been taken over in parts tagged Edition 2 with **fixes or minor changes**. During the tissue process the parts tagged Edition 1 have already been “fixed” to some extend.
3. **(Less or more) New Definitions** have been added in parts tagged Edition 2. [Service tracking in IEC 61850-7-2, many new LNs in IEC 61850-7-4, ...]
4. **(Some) Definitions of parts tagged Edition 1** have been moved to parts tagged Edition 2 without changes. [e.g., LN STMP from IEC 61850-7-410 Ed1 to IEC 61850-7-4 Ed2; Substitution has been moved from IEC 61850-7-2 Ed1 to IEC 61850-7-3 Ed2, ...]

A Device A that implements those definitions from several parts tagged Edition 1 that have not changed in Edition 2 of these parts is compliant to edition 2 of these parts without any modifications! If a Device B implements some new features of one or more parts tagged Edition 2, then these new features have to be listed in some detail to understand the situation. Some detail means that **the implemented features per part tagged Edition 1 and/or Edition 2 have to be listed**.

Examples:


1. A Device may just implement a new LN from Edition 2 of part IEC 61850-7-2; the other definitions are used as defined in Edition 1 of the other parts like IEC 61850-7-3, 7-2, 8-1, ... **So, is this an Edition 1 or Edition 2 Device? Both! But we better do NOT TAG a Device being Edition 1 or Edition 2.** It's a Device implementing the services according to the PICS of part IEC 61850-7-2 Edition 1 (the subset used may be unchanged in Edition 2), IEC 61850-8-1 Edition 1, ... and the STMP LN of IEC 61850-7-4 Edition 2.).
2. The same Device could be understood as implementing the STMP LN according to a part that is **tagged Edition1**: The STMP LN is still officially published in IEC 61850-7-410 Edition 1. Edition 2 of 7-410 will not have the STMP LN any more – it is already moved to 7-4 Edition 2.

Users should **not wait until a Device or the Communication Stack is compliant to Edition 2 of the Standard IEC 61850!!** You will never get such a Device because there is NO Edition 2 of IEC 61850. You may want to use one or the other new service of IEC 61850-7-2 Edition 2 (like Service tracking of control block services) or a new LN from IEC 61850-7-2 Edition 2 or from IEC 61850-7-420 Edition 1 or IEC 61850-90-7 Edition 1 ...

Always list some details what has been implemented from the various parts tagged Edition 1 or Edition 2 – if you want to prevent confusion.

Additional discussions on this topic will follow – time permitted.

Stay tuned.

Posted by [Karlheinz Schwarz](#) at [10:57 PM](#) [0 comments](#) 

Labels: [communication](#), [conformance](#), [Edition 1](#), [Edition 2](#), [IEC 61850](#), [IEC 61850 edition 2](#)

Monday, November 7, 2011

Seminário e Treinamento NORMA IEC 61850 - Instituto Instronic

Dear expert in Brazil and other countries, please note the **final call** for the IEC 61850 course in Sao Paulo (Brazil):

NOTE the course will be simultaneously translated into **Portuguese**.

Seminário e Treinamento IEC 61850

OSASCO - SÃO PAULO - 21 A 23 DE NOVEMBRO

A Instronic em parceria com a STRI traz para o Brasil o Seminário e Treinamento Prático sobre a IEC 61850

A IEC 61850 é o padrão global para Automação do Sistema de Energia. Ela permite um design aberto e possibilita a combinação de produtos de vários fornecedores. Para que os usuários e integradores de sistemas maximizem os benefícios da IEC 61850, é necessário que as empresas eduquem seu recurso mais importante - as pessoas, e comecem a migração para o IEC 61850.

O treinamento traz o processo de design e engenharia para aplicações reais e também uma configuração em uma instalação de teste real.

O curso é ministrado pelo especialista Karlheinz Schwarz, da Netted Automation



Não perca essa oportunidade!

Para outras informações entre em contato conosco:

Tel.: 11.3383.3700 - Rm. 159

Email: instituto@instronic.com.br

www.instronic.com.br



STRI

Maria Rita do Amaral
Instituto -Instronic
Instronic Instrumentos de Testes Ltda
Tel.: (11) 3383.3700 - Ramal 159
instituto@instronic.com.br
www.instronic.com.br

Posted by [Karlheinz Schwarz](#) at [2:30 PM](#) [0 comments](#)

Labels: [61850](#), [hands-on Training](#), [IEC 61850](#), [IEC 61850 edition 2](#), [seminar](#), [Training](#)

Sunday, November 6, 2011

Distribution Company Vector's Ten-Years Plan for IEC 61850


Vector Limited is the electric power distribution company in the Auckland (New Zealand) area. The company publishes every year an **Asset Management Plan (AMP)** – informing the public and others

what the company is planning to do with their assets. The current plan covers a ten year planning period from 1 April 2011 to 31 March 2021.

One goal of the current AMP is to demonstrate innovation and efficiency improvements. What does this mean related to **IEC 61850**? A lot in the past and in the future:

- Vector's substation automation system is based on resilient optical Ethernet local area network running **IEC 61850 compliant IEDs**.
- Vector's current standard for **internal and external communication systems is IEC 61850 standard**. DNP3 is also used as an interim solution.
- At present over **50% of Vector's primary substation** are equipped with **IEC 61850 compliant IEDs**.
- Vector has been running an annual **RTU replacement programme** for a number of years, and is currently replacing approximately **10 RTUs per region per annum**. To replace conventional RTUs, two approved solutions have been used, traditional RTUs with a **migration path to IEC 61850, and fully compliant IEC 61850 solutions**.
- ...

Click [HERE](#) for the current plan (2011-2021) [PDF, 10 MB]

Posted by [Karlheinz Schwarz](#) at [10:30 PM](#) [0 comments](#) 

Labels: [asset management](#), [CIM](#), [communication](#), [condition monitoring](#), [distribution automation](#), [IEC 61850](#), [RTU](#), [utilities](#)

Thursday, November 3, 2011

IEC 61850 and IEC 61499 in Action at SPS/IPC/Drives in Nuremberg, Nov 22-24, 2011

If you want to see IEC 61850 and IEC 61499 in action at SPS/IPC/Drives in Nuremberg (Germany), Nov 22-24, 2011, visit the ISaGRAF booth please:

Hall 7A / booth 502

Click [HERE](#) for a free ticket to visit the SPS/IPC/Drives exhibition [German].

Click [HERE](#) for a free ticket to visit the SPS/IPC/Drives exhibition [English].

There is also a special presentation on IEC 61499 on 23rd of November, 2011:

Click [HERE](#) for more information.

Posted by [Karlheinz Schwarz](#) at [1:14 PM](#) [0 comments](#) 

Labels: [IEC 61499](#), [IEC 61850](#), [ISaGRAF](#)

Friday, October 28, 2011

Use-Cases for Distributed Photovoltaic and Storage Systems

EPRI (Electric Power Research Institute, Palo Alto, USA) has been active in the research and development of the electrical power delivery systems. Just remember the projects UCA 1.0 (Utility Communication

Architecture) and UCA 2.0. Both projects have contributed to the IEC TC 57 (Power System Management) and influenced several crucial standard series like the CIM, IEC 60870-6 TASE.2 and IEC 61850.

The work on the "Utility Communication Architecture" is going on in various IEC TC 57 projects and EPRI is still contributing to this process (especially to the definition of **IEC 6185-90-7 - Object models for photovoltaic, storage, and other DER inverters**). A very interesting EPRI report looks into the "**Uses for Distributed Photovoltaic and Storage Systems**". The report lists and discusses briefly the following use-cases:

- Energy Generation
- Local Energy Storage to Compensate for Photovoltaic Intermittency
- Use of Energy Storage for Arbitrage Benefit
- Use of Local Energy Storage to Maximize Photovoltaic Generation Value
- Energy Storage for Customer or Community Backup Power
- Energy Storage to Reduce or Limit Peak Loading on the Utility System
- Energy Storage for Load Following
- Energy Storage to Reduce Customer Peak Demand
- Energy Storage for Local Power Quality Control
- System Stabilization – Transient Watt Modulation with Line Frequency
- System Stabilization - Transient Watt Modulation with Line Voltage
- Var Production for Voltage Regulation
- Var Production for Voltage Stabilization
- Var Production for Power Factor Management
- Var Compensation for Intermittent Generation
- Connect/Disconnect from Grid – Non Islanding
- Connect/Disconnect from Grid – Islanding
- On/Off Control of PV and/or Storage Inverter
- Adjusting Maximum Generation Level
- Metering Energy from Photovoltaic or Storage Device
- State Monitoring
- Event Reporting by Exception
- Event Logging

Click [HERE](#) for the 44 page report on use cases.

Click [HERE](#) for an overview about IEC 61850-90-7.

In an up-to-date publication of the German VDI nachrichten it is reported about storage possibilities on 2011-10-28 that:

- The capacity of all German pumped-storage hydropower plants would provide power for **1 hour**.
- The capacity of 42 million German cars would last for **24 hours**.
- The capacity of the German oil and gas storages would last at least for **2 months**.
- The storage of "Wind or PV Power" (Converting Electricity to Natural Gas) is also an option.

Click [HERE](#) for an R&D report on Converting Electricity to Natural Gas.

Whatever the energy Mix will be – there is a crucial need for information and communication systems supporting the future power delivery system!

The good news is that there is no need to develop standards for information and communication systems from scratch! There are sufficient standards available, implemented and tested so that the power industry can straight use them: IEC 60870-6 TASE.2, CIM, IEC 61850, IEC 61400-25, ...

Posted by [Karlheinz Schwarz](#) at [2:30 AM](#) [0 comments](#) 

Labels: [communication](#), [EPRI](#), [IEC 61850](#), [IEC 61850-90-7](#), [inverter](#), [PV](#), [storage](#), [wind power](#)

Thursday, October 27, 2011

“Visit” a U.S. Power Grid Control Center

The New York Times provides some information about the work in Control Centers of the U.S. Power Grid ... quite interesting information.

Click [HERE](#) for the article.

If you want to apply for a job managing the North American power grid, you have to answer communication related questions like this (from NERC):

6. Standard COM-001-1, encourages “redundant and diversely routed” telecommunications facilities. Why “would “diversely routed” facilities be encouraged?

1. So communications can be simultaneously sent and received over the redundant paths.
2. **So as not to create a monopoly for one particular telecommunication service.**
3. So more neighboring systems can tie into the telecommunications network
4. So one specific problem could not eliminate redundant facilities

If you would answer with 2. ... you may ... hmmm ... ;-)

Click [HERE](#) for this and more questions.

Posted by [Karlheinz Schwarz](#) at [5:09 AM](#) [0 comments](#) 

Labels: [communication](#), [control center](#), [operator](#)

Wednesday, October 26, 2011

SGIP calls for Comments on Draft NIST Framework and Roadmap for Smart Grid Interoperability Standards, Release 2.0

The NIST SGIP (Smart Grid Interoperability Panel) has published the

Draft NIST Framework and Roadmap for Smart Grid Interoperability Standards, Release 2.0

for public comments via Federal Register Notice on October 25, 2011

Click [HERE](#) for the NIST Framework and Comments page.

Click [HERE](#) for the Draft Release 2.0 [PDF, 5.3 MB].

What is new in the Release 2.0 (Draft)?

Interoperable standards and protocols for the Smart(er) Grids are the focus of NIST. To reach these objectives NIST developed a three-phase plan:

1. To accelerate the **identification** of an initial set of standards;
2. To establish a robust Smart Grid **Interoperability Panel** (SGIP) to sustain the development of the many additional standards that will be needed; and

3. To set up a **conformity testing and certification** infrastructure.

The results of Release 1 (2009-11) have been improved in the draft Release 2. The most crucial result so far (in my view) is the fact that the relevant standards listed in Release 1 has been accepted – one way or the other – by the stake holders in the Smart(er) Grid community! There are some additional standards listed – but the list from 2009 is still representing the core standards.

The most crucial result of all these activities in the power utility domain is that we have prevented a situation found in the industrial automation market with **more than 100 Fieldbus standards** – with some 50+ in a single standard (IEC 61158)!

Draft Release 2 identifies 20 Smart Grid-relevant standards, 15 other requirement and guideline documents, 9 cyber security documents; and another list of some 60 specifications/requirements that are listed for further review. The 20 standards are:

	Standards	
1	BACnet	Building Automation
2	ANSI C12	Metering
3	LON	Various applications
4	IEEE 1815 (DNP3)	Substation and feeder automatio
5	ICCP (IEC 60870-6 TASE.2)	Inter-control center communication
6	IEC 61850	Power utility automation (Transmission, Distribution, Generation, ...) at field level
7	IEC 61968/61970	CIM; communication between control center systems
8	IEEE C37.118/IEC 61850-90-5	Phasor measurements
9	IEEE 1547	Physical and electrical interconnections between utilities and distributed generation (DG) and storage.
10	IEEE 1588/IEC61588	Time synchronization
11	IETF RFC 6272	Internet Protocols
12	IEEE 1901	Broadband Power Line
13	Multispeak	Application software integration within the utility operations domain
14	NEMA SG AMI I	Smart meters
15	SB WEQ19, REQ18	Energy Usage Information
16	NISTIR 7761	NIST Guidelines for Assessing Wireless Standards for Smart Gr Applications
17	OpenADR	Open Automated Demand Response
18	OPC-UA	Exposes complex data and metadata defined by other information model specifications (e.g. IEC 61850, BACnet, OpenADR).
19	GML	Open Geospatial Consortium, Geography Markup Language
20	Zigbee Smart Energy Profile 2.0	Home Area Network (HAN) Device Communications and Informatior

		Model
	Requirements and Guidelines	
21	OpenHAN	Home area network (HAN)
22	AEIC Guidelines	Testing criteria for standards-based AMI
23	SAE J1772	SAE Electric Vehicle and Plug in Hybrid Electric Vehicle Conductive Charge Coupler
24	SAE J2836/1	Use Cases for Communication Between Plug-in Vehicles and the Utility Grid
25	IPRM	SGTCC Interoperability Process Reference Manual (SGIP's Smart Grid Testing and Certification Committee)
26	--	
	Cyber Security	
27	Security Profile for Advanced Metering Infrastructure, v 1.0	
28	Department of Homeland Security (DHS), National Cyber Security	Recommendations
29	DHS Cyber Security Procurement Language for Control Systems	Guidance to procuring Cyber security technologies for control systems products and services
30	IEC 62351 Parts 1-8	This family of standards defines information security for power system control operations.
31	IEEE 1686	Intelligent electronic devices (IEDs) to accommodate critical infrastructure protection
32	CIP 002-009	NERC Critical Infrastructure Protection
33	NIST Special Publication (SP) 800	Cyber security standards and guidelines for federal information systems, including those for the bulk power system.
34	IEC 61851	Charging electric road vehicles
35	NISTIR 7628	Introduction to NISTIR 7628 Guidelines for Smart Grid Cyber Security

The second list comprises standards for review like GPS, IEC 61400-25 (IEC 61850 for wind turbines), IEEE P1901 (Broadband powerline), ISO/IEC 8824 ASN.1 (Abstract Syntax Notation), IEEE 802, 3GPP, 2G, 3G, 4G, ISA SP 100 (Wireless), IEC 61000, ISA SP 99, ISO 27000, WS-Security, ...

The second list contains standards that do (to my interpretation) **NOT contain any competing solutions for IEC 61968/70, IEC 61850, IEEE 1815 DNP3**, ... they cover other crucial aspects. And there is very little overlap between the 35 standards listed above.

Congratulation to all people involved in the work of SGIP!

It would be very helpful to provide your comments to the draft – in order to reach a global consensus.

Posted by [Karlheinz Schwarz](#) at [5:16 AM](#) [0 comments](#) 

Labels: [building automation](#), [CIM](#), [Cyber Security](#), [distribution automation](#), [IEC 61400-25](#), [IEC 61850](#), [IEC 61968](#), [IEC 61970](#), [interoperability](#), [NIST](#), [NIST Roadmap](#), [OPC UA](#), [Power Automation](#), [Smart Grid](#), [Substation Automation](#), [TASE.2 ICCP](#), [wind power](#)

Tuesday, October 25, 2011

New Embedded Modules from TQ with IEC 61850 and IEC 61400-25 using ARM Architectures and Linux

Two New Embedded Modules developed by TQ with IEC 61850 und IEC 61400-25 (using ARM Architectures, Linux and the very simple and powerful SystemCorp IEC61850 API) are available:

ARM9 Modul with i.MX28 from Freescale
Click [HERE](#) for more details.

ARM11 Modul with i.MX35 from Freescale
Click [HERE](#) for more details.

TQ is conducting a one day introduction into the standards IEC 61850 and IEC 61400-25 and demonstrates how to build applications for IEC 61850 based on the above controllers.

Date: 2011-12-14 (Wednesday)

Location:

TQ-Systems GmbH
Mühlstraße 2
82229 Seefeld
Germany (near Munich)

Click [HERE](#) for **more details on the seminar**.

Click [HERE](#) for the **Program (Presentation Language: German)**

If you are interested in a presentation in English, please contact TQ.

Posted by [Karlheinz Schwarz](#) at [2:14 PM](#) [0 comments](#) 

Labels: [API](#), [applications](#), [Arm processor](#), [embedded system](#), [IEC 61400-25](#), [IEC 61850](#), [Linux](#), [seminar](#), [stack](#), [starter kit](#), [SystemCorp](#), [TQ](#)

NEW Hirschmann Ethernet Switches for Substations and other Critical Applications

Hirschmann is (to my knowledge) the leading manufacturers of Ethernet Switches for mission critical industrial applications. Hirschmann is also quite active in the domain of substations (IEC 61850, ...). The following new products offer standardized features like **RSTP** (Rapid Spanning Tree Protocol), **PRP** (Parallel Redundancy Protocol) and **HSR** (High-availability Seamless Redundancy).

With these components there is sufficient timeliness guaranteed in mission critical substation protection and automation systems. This is far above the old "yellow cable" Ethernet of the 80s and 90s.

Hirschmann™ presents **switches from its new RSP family**

Redundancy with zero switchover time:

Click [HERE](#) for further information (English)

Click [HERE](#) for further information (German)

Hirschmann™ once again demonstrates its market leadership in Industrial

Ethernet Hirschmann™ switches support seamless redundancy. The new **PRP (Parallel Redundancy Protocol)** and **HSR (High-availability Seamless**

Redundancy) protocols are two newly developed redundancy methods that significantly increase the availability and reliability of network connections:

Click [HERE](#) for further information (English)


Click [HERE](#) for further information (German)

Hirschmann™ markets new **Embedded Ethernet components Module with the functional scope of a standalone switch:**

Click [HERE](#) for further information (English)

White Paper on **Media Redundancy Concepts** - High Availability in Industrial Ethernet:

Click [HERE](#) for further information (English)

Posted by [Karlheinz Schwarz](#) at [11:30 AM](#) [0 comments](#) 

Labels: [Belden](#), [Ethernet](#), [Ethernet switches](#), [hirschmann](#), [HSR](#), [IEC 61850](#), [PRP](#), [redundancy](#), [RSP](#)

Monday, October 24, 2011

Cleanup of IEC 61850-7-4 Edition 2

The edition 2 of the base information models of IEC 61850 (published in 2010 as IEC 61850-7-4) has some definitions that need corrections. You can find the most crucial ones documented on the IEC 61850 Tissue Database (Technical Issues).

Click [HERE](#) for the complete list of part 7-4 Ed2.

Example:

Annex A defines the Interpretation of mode and behaviour

There is an obvious error in the table. When Beh=on AND incoming data with q=test THEN the expected behaviour of LN shall be "Processed as **invalid**", and not "Processed as **valid**".

Recommendation for readers of the various parts of IEC 61850: Please check the list of the Tissue Database in order to figure out the corrections made by the IEC 61850 community. As the above example shows, the corrections could be very critical!

Posted by [Karlheinz Schwarz](#) at [1:47 AM](#) [0 comments](#) 

Labels: [corrections](#), [IEC 61850](#), [maintenance](#), [tissues](#)

Thursday, October 20, 2011

Need Help regarding MMS (ISO 9506)?

Experts that are looking for further helpful information on MMS (Manufacturing Message Specification – ISO 9506) can download a report published as part of MSc Thesis "Security in Industrial Networks" in Norway, 2007:

Click [HERE](#) for the links to two papers.

Unfortunately the authors did not mention IEC 61850 and IEC 61400-25 as the most crucial standard series that use MMS.

The security measures for MMS are defined in IEC 62351-4.

Click [HERE](#) for additional information on security and IEC 61850/MMS.

Click [HERE](#) for find more information on MMS.

Posted by [Karlheinz Schwarz](#) at [1:07 PM](#) [1 comments](#) 

Labels: [ASN.1](#), [BER](#), [Encoding](#), [IEC 61400-25](#), [IEC 61850](#), [message encoding](#), [MMS](#), [security](#)

Improvements of IEC 61850-6 (System Configuration Language) and other parts

The IEC 61850 System Configuration Language (SCL) as defined in IEC 61850-6 Edition 2 is a very crucial, successful and comprehensive part of the standard series IEC 61850. This part has a major impact of System Design, System Engineering and Device Configuration Tools.

The standard defines many concepts and a lot of details! People in the SCL Team and other groups have worked hard to provide a consistent and complete specification. As usual, there are typos, incompletely defined details, ... The IEC 61850 community takes these inconsistencies and errors very serious.

Since the publication in 2009 there have 21 tissues (technical issues) been reported on part 6:

Click [HERE](#) for the list of the IEC 61850-6 Edition 2 tissues.

One typical tissue (Tissue 719) is about the "maxAttributes" definition in clause 9.3.1:

The definition of ConfDataSet - maxAttributes is confusing especially the part in brackets (an FCDA can contain several attributes).

2 interpretations seem possible :

- maxAttributes = max nb of members in the dataset
- maxAttributes = max sum of attributes of all dataset member

The tissue has helped to clarify what is meant:

"ConfDataSet.maxAttributes shall define the maximum number of members in a data set ..."

Click [HERE](#) for the complete tissue 719.

Please check the tissue database if you find anything in the published standards (of any Edition) that may be wrong or not complete or unclear. **Before you post a tissue check if it has already been reported and solved.**

Click [HERE](#) for the Tissue Database entry on IEC 61850 and [HERE](#) for IEC 61400-25.

You can help the IEC 61850 community to improve the standard by checking the content of the tissue data bases and posting your findings on possible deficiencies.

Thanks!

Posted by [Karlheinz Schwarz](#) at [12:53 PM](#) [0 comments](#) 

Labels: [bugs](#), [fixes](#), [IEC 61400-25](#), [IEC 61850](#), [IEC 61850-6](#), [quality](#), [SCL](#), [tissues](#)

Tuesday, October 18, 2011

Power Outage in San Diego on September 08, 2011, and Synchrophasors

The other day I [reported on standards for synchrophasor](#) measurements. The question was and still is: Could synchrophasor measurements prevent huge black outs? Some say yes – others say maybe or no.

Today it has been reported by Platts (Atlanta) that “The installation of phasor measurement units on part of the power grid affected by the September 8 power outage in Arizona, California and Mexico **is aiding the data collection process** as entities look into the cause of the outage, the head of the North American Electric Reliability Council said Monday. ... Synchrophasors provide precise measurements of critical grid operating data from devices called phasor measurement units, **which inform operators of conditions on a real-time basis**. The **goal of having the units in place** is to help operators see conditions deteriorate and take actions **to avoid large outages**, Paul Barber of the NERC board of trustees said Tuesday.”

Obviously the synchrophasor measurements could not prevent the power outage on September 8, 2011. There needs to be experts to interpret the values!! and understand what to do to stabilize the electric system ... or software needs to be written by experts ...

What is missing in many organizations to keep control over the electric power delivery system? [Peopleware](#)!! Well educated Experts that understand the **electrical system** !! Measurements are a tool: Even a fool with a tool is a fool. And: A fool with a tool can foul-up a system much faster than a fool without a tool. In this regard, IEC 61850 is also just a tool.

Click [HERE](#) for the complete report from today.

Posted by [Karlheinz Schwarz](#) at 2:17 PM [0 comments](#) 

Labels: [education](#), [IEC 61850](#), [outage](#), [peopleware](#), [phasor measurements](#)

[Newer Posts](#)

[Home](#)

[Older Posts](#)

Subscribe to: [Posts \(Atom\)](#)

News on IEC 61850 and related Standards

Daily news concerning the standards IEC 61850, IEC 61400-25, IEC 61970 (CIM), IEC 60870-5, ...

Monday, October 17, 2011

IEC 61400-25 at the Two-Day Windpower Monthly Forum in Hamburg


Anders Johnsson, Marketing & Standardization Coordinator of USE61400-25 User Group, will give a presentation under the title **"How close are we to standardization of wind turbine data?"**

at the Wind Farm Data Management & Analysis - Harnessing your data to optimize performance, reduce downtime & increase profitability, a Two-Day Windpower Monthly Forum 15- 16 November 2011, Hamburg, Germany.

He will present the results of the standardization work done so far and provide an outlook.

Click [HERE](#) for more details.

Click [HERE](#) for a brief introduction to IEC 61850 and IEC 61400-25 [pdf].

Posted by [Karlheinz Schwarz](#) at [10:07 PM](#) [0 comments](#) 

Labels: [IEC 61400-25](#), [IEC 61850](#), [wind power](#)

New Book on CIM (Common Information Model)

IEC TC 57 (Power System Management) publishes standards for control center internal information models (CIM: IEC 61968 and IEC 61970) and for monitoring and controlling the process level (IEC 61850 and IEC 61400-25).

Four experts involved in the application of CIM in projects have written a book on CIM to provide an introduction and describe the basic use cases. The book will be available in January 2012.

Click [HERE](#) for a description of the book and order information.

Click [HERE](#) for a brief introduction to IEC 61850 and IEC 61400-25.

Posted by [Karlheinz Schwarz](#) at [9:54 PM](#) [0 comments](#) 

Labels: [CIM](#), [IEC 61400-25](#), [IEC 61850](#), [IEC 61968](#), [IEC 61970](#)

Saturday, October 15, 2011

Sensors in Smart(er) Grids Not Only For Electrical Measurement

Smart Grid (condition monitoring) Sensors may detect faulting fuses,

Subscribe To IEC 61850 News

 Posts 

 All Comments 

Blog Archive

► [2012](#) (11)

▼ [2011](#) (159)

► [December](#) (5)

► [November](#) (11)

▼ [October](#) (22)

[Use-Cases for Distributed Photovoltaic and Storage...](#)

["Visit" a U.S. Power Grid Control Center](#)

[SGIP calls for Comments on Draft NIST Framework an...](#)

[New Embedded Modules from TQ with IEC 61850 and IE...](#)

[NEW Hirschmann Ethernet Switches for Substations a...](#)

[Cleanup of IEC 61850-7-4 Edition 2](#)

[Need Help regarding MMS \(ISO 9506\)?](#)

[Improvements of IEC 61850-6 \(System Configuration ...](#)

[Power Outage in San Diego on September 08, 2011, a...](#)

[IEC 61400-25 at the Two-Day Windpower Monthly Foru...](#)

insulators, conductors, transformers, as well as fires, ice, water level, floods, oil spills & air pollution conditions and and ...

Myriads of sensors will be installed in the context of Smart(er) Grids the years to come.

Click [HERE](#) for a 10 minute video on various use cases.

Click [HERE](#) for a roll-out of sensors in a distribution network.

Click [HERE](#) on a discussion "How many protocol interfaces can we afford?"

Click [HERE](#) for a project where IEC 61850 is used for exchanging sensor data.

With IEC 61850 – one ne or the other – it is possible to let all sensors speak a SINGLE LANGUAGE. Intelligent sensors may speak IEC 61850 integrated in the sensor itself, or the sensors may communicate to an aggregation device (like an RTU) that provides IEC 61850 connectivity to the next level of monitoring and so on.

Click [HERE](#) for the IEC 61850-7-4 Ed2 Logical Node STMP (Temperature Supervision).

Posted by [Karlheinz Schwarz](#) at 9:58 PM 0 comments 

Labels: [building automation](#), [control center](#), [Data concentrator](#), [distribution automation](#), [IEC 61850](#), [IEc 61850-7-4 Ed2](#), [monitoring](#), [SCADA](#), [Sensors](#), [Smart Grid](#)

Thursday, October 13, 2011

Open Source Synchrophasor Framework for IEC 61850-90-5 under development

On October 02, 2011, I [announced that the IEC TR 61850-90-5](#): "Use of IEC 61850 to transmit synchrophasor information according to IEEE C37.118" is on its way for official publication; expected by end of 2011.

To accelerate the application of the technology defined by IEC 61850-90-5, **Cisco**, Inc. (CSCO) and Systems Integration Specialists Company, Inc. (**SISCO**) have begun an **open source project** intended to provide an implementation framework for synchronized phasor measurement communications.

They expect that an "open source project will foster innovation and faster adoption of the standards using IP-multicast and a scalable security architecture". ... For the open source project, **Cisco will provide source code for the Group Domain of Interpretation (GDOI) protocol**. This protocol provides the type of advanced cyber key management services that are needed to secure communications for power system automation applications, including substation automation and protection, as well as for Smart Grid applications such as metering and demand response. **SISCO will provide the source code for the IEC 61850-90-5 communication profile and the integration of that profile with the GDOI code.** ..."

Click [HERE](#) for the press complete release published by Cisco.

It is very likely that this project will push the application of IEC 61850 in North America and all over.

Posted by [Karlheinz Schwarz](#) at 11:46 AM 0 comments 

Labels: [IEC 61850](#), [iec 61850-90-5](#), [open source](#), [phasor measurements](#)

[New Book on CIM \(Common Information Model\)](#)

[Sensors in Smart\(er\) Grids Not Only For Electrical...](#)

[Open Source Synchrophasor Framework for IEC 61850-...](#)

[IEC 61850 Training Courses in Sao Paulo and Frankf...](#)

[Plug and Play for IEC 61850 – Supported by Siemens...](#)

[Substation Automation Specialist Wanted in the U.S...](#)

[Long-Term Supply Agreement on Ethernet Components ...](#)

[Utility Experience with IEC 61850 at eThekwini Ele...](#)

[Wireshark Analyzer to encode MMS, GOOSE, and SAV M...](#)

[Market Trend: IEC 61850-9-2 Sampled Values accepte...](#)

[New Work Item Proposal on IEC 61850-8-2 – Mapping ...](#)

[IEC 61850-90-5 defines How to Use IEC 61850 to tra...](#)

- [September \(11\)](#)
- [August \(11\)](#)
- [July \(23\)](#)
- [June \(20\)](#)
- [May \(10\)](#)
- [April \(6\)](#)
- [March \(16\)](#)

Tuesday, October 11, 2011

IEC 61850 Training Courses in Sao Paulo and Frankfurt

Plan now for attending one of the training courses conducted by NettedAutomation:

Why should you attend? IEC 61850 is a bit more than DNP3, IEC 60870-5-101/104 or any of the many field busses ... IEC 61850 is THE solution when it comes to advanced information, information exchange and system configuration in the electric power delivery world and in many domains outside. Understanding the basics of IEC 61850 and IEC 61400-25 will help you to get smoothly to systems that are based on interoperable devices.

[Sao Paulo \(Brazil\), 21.-23. November 2011 \(NEW DATE\)](#)

3 day IEC 61850 Seminar/Hands-on Training


[Frankfurt \(Germany\), 09.-11. May 2012](#)

[Frankfurt \(Germany\), 17.-19. October 2012](#)

3 day IEC 61850/61400-25 Seminar/Hands-on Training (NettedAutomation) with with several embedded Controller Development Kits (Linux, RTOS, ...), Starter Kit (Windows DDL), and several other demo software

[?? \(USA\), Remote Conference, September 2012](#)

2 day Seminar (NettedAutomation) on Power System Communication covering IEC 61850, IEC 61400-25, DNP3, NIST Interoperability Roadmap, Smart Grids, ...

Posted by [Karlheinz Schwarz](#) at [10:59 PM](#) [0 comments](#) 

Labels: [hands-on Training](#), [IEC 61400-25](#), [IEC 61850](#), [seminar](#), [Substation Automation](#), [Training](#)

Plug and Play for IEC 61850 – Supported by Siemens

Siemens pushes for a crucial extension of IEC 61850: to allow Plug and Play features for IEDs according to a future IEC 61850:

IEC 61850's primary focus (in the late 90's) was on Substation Automation – this is still the crucial application domain today and for a long time. The application of IEC 61850 in various power generation and distribution application domains is likely to require further features – not yet defined. Several projects (E-Energy in Germany, SGIP' Priority Action Plan (PAP), and other) have investigated in finding gaps in the standard definitions. One result is the definition of a Plug&Play extension developed by Siemens. Siemens has registered their ideas at the ip.com website. What does that mean? **"Defensive publishing is a low cost way to prevent competitors from obtaining patents and protect your freedom to practice."**

Click [HERE](#) for a description what "Defensive Publishing" means.

Excerpt:

"The Plug and Play reference architecture based on well-known protocols like **UPnP (Universal Plug and Play)** and **DPWS (Devices Profiles for Web Services)** is used. Several exchanges and additions, e.g. with respect to discovery mechanisms, are proposed **enabling IEC 61850 to support Plug & Play for "Smart Distribution"**."

Click [HERE](#) for more information.

► [February](#) (16)

► [January](#) (8)

► [2010](#) (153)

► [2009](#) (162)

► [2008](#) (82)

Contributors

[Karlheinz Schwarz](#)

[Michael Schwarz](#)

The work on [Web Services that has been proposed by a New Work Item Proposal](#) will become a crucial work for future applications.

Posted by [Karlheinz Schwarz](#) at [5:28 AM](#) [0 comments](#) 

Labels: [DWPS](#), [E-Energy](#), [IEC 61850](#), [iec 61850-8-2](#), [mapping](#), [PAP](#), [plug and play](#), [SGIP](#), [Web Service](#), [webservice](#)

Substation Automation Specialist Wanted in the U.S. – IEC 61850 is a MUST

Siemens offers an open position for a Product Management Specialist for Substation Automation. One of the position requirements is “Must have worked with **advanced digital Substation Automation using IEC 61850** protocol and functionalities”

Click [HERE](#) for the description.

Posted by [Karlheinz Schwarz](#) at [4:26 AM](#) [0 comments](#) 

Labels: [61850](#), [IEC](#), [IEC 61850](#), [open position](#), [USA](#), [workforce](#)


Monday, October 10, 2011

Long-Term Supply Agreement on Ethernet Components between Hirschmann and Yokogawa Electric Corporation

“Yokogawa will use Hirschmann Industrial Ethernet switches [Neckartenzlingen, Germany] in their Vnet/IP® high-speed control networks and provide maintenance services to facilitate the deployment of highly reliable control networks. Plant control communication network in markets such as oil & gas, power transmission & distribution, pharmaceuticals and water/wastewater must endure harsh environments with extreme ambient temperatures and corrosive gasses.”

Hirschmann is also deeply involved in IEC 61850 standardization and application. More to come ...

Click [HERE](#) for the news report from Belden.

Posted by [Karlheinz Schwarz](#) at [12:29 PM](#) [0 comments](#) 

Labels: [Ethernet](#), [Ethernet switches](#), [hirschmann](#), [IEC 61850](#)

Utility Experience with IEC 61850 at eThekwini Electricity

There are just a few reports from utility personnel describing the impact of IEC 61850 on substation protection and automation systems. A report from eThekwini Electricity provides some results of the application of IEC 61850 based systems. Worth to read report.

With regard to the Financial Implications the reports states:

“An exercise has been carried out to determine the financial impact of the new philosophy. This exercise has produced some better than expected results.”

Click [HERE](#) for the complete paper [7 pages pdf].

Posted by [Karlheinz Schwarz](#) at [1:51 AM](#) [0 comments](#) 

Labels: [cost saving](#), [IEC 61850](#), [implementation](#), [utilities](#)

Sunday, October 9, 2011

Wireshark Analyzer to encode MMS, GOOSE, and SAV Messages

In July 2011 I reported about a [problem analyzing MMS messages with Wireshark](#).


A comment to that post suggests the following successful solution ...
configure the analyzer as follows:

Set in **PRES** protocol preferences new user context item:


Context Id: 3

Syntax Name OID: 1.0.9506.2.1


Select **Edit** and **Preferences** at the bottom:

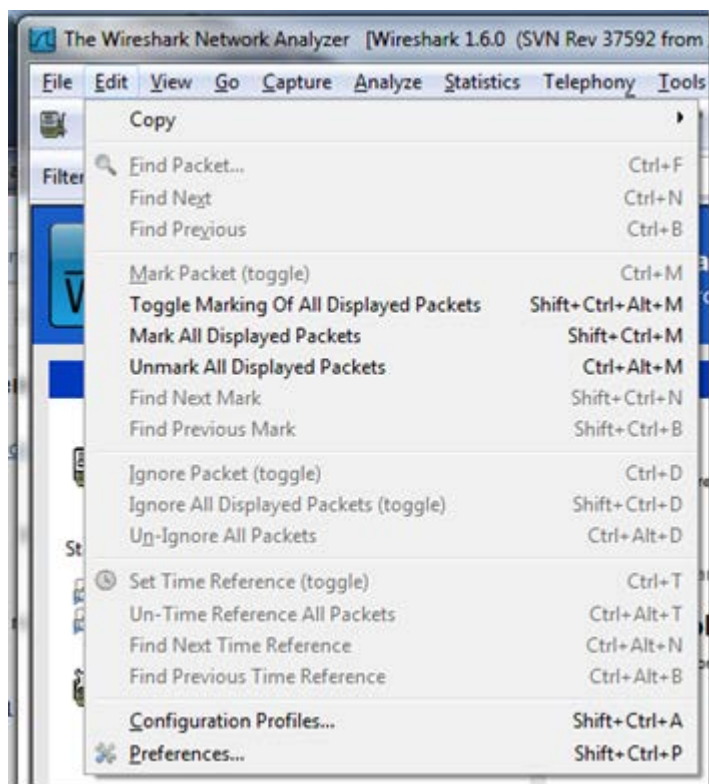

Select Protocols ... and PRES:

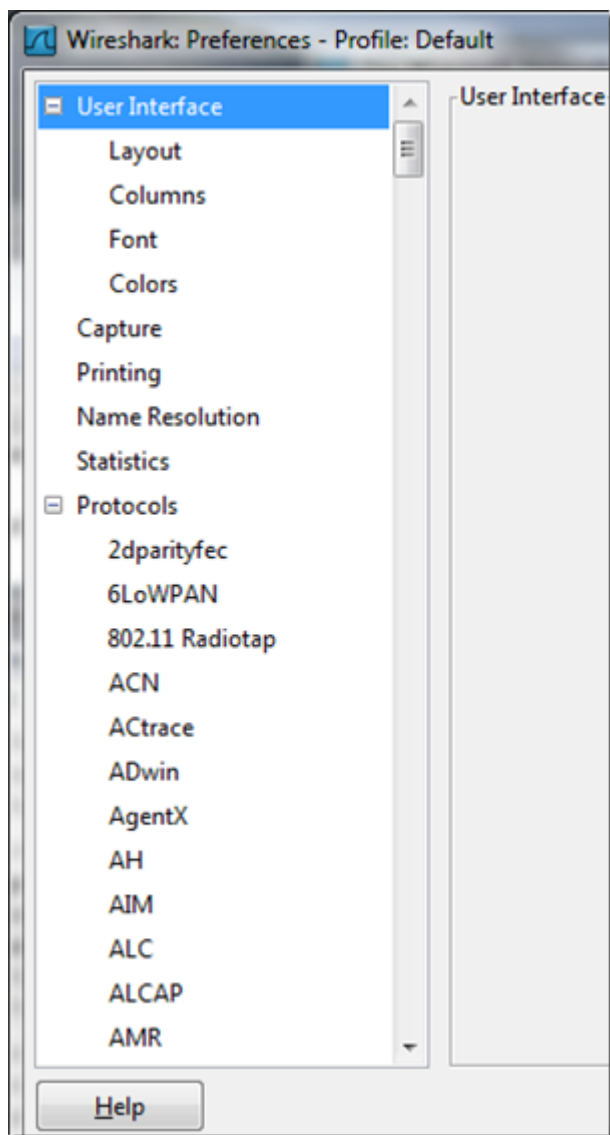

Edit PRES and select New and enter the values from above::

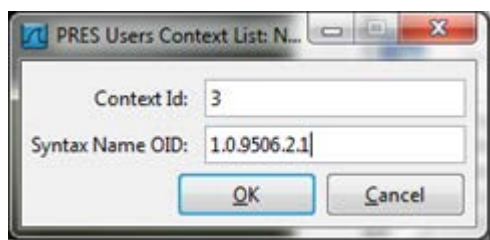

Thanks for the recommendation!

Have a great week.

Posted by [Karlheinz Schwarz](#) at 1:12 PM 0 comments 

Labels: [IEC 61850-8-1](#), [IEC 61850-9-2](#), [message encoding](#), [MMS](#), [wireshark](#)

Market Trend: IEC 61850-9-2 Sampled Values accepted

Omicron has published a paper on the benefits and acceptance of the IEC 61850-9-2 sampled values:


- [English \(Page 47-49\)](#)

- [Deutsch \(Page 43-45\)](#)

By Dr Fred Steinhauser:

Technology of the future: **Sampled Values provide many benefits for the power systems of tomorrow**

Abstracts: "IEC 61850 defines several kinds of communication mechanisms. The Client/Server communication for SCADA and the GOOSE protocol for peer-to-peer status messaging have been widely adopted in a quite short time. Now, after years of experience with these new protocols, also the application of **Sampled Values has become a common topic.**"

Posted by [Karlheinz Schwarz](#) at [11:32 AM](#) [0 comments](#) 

Labels: [9-2LE](#), [IEC 61850](#), [IEC 61850-9-2](#), [sampled value](#)

Friday, October 7, 2011

New Work Item Proposal on IEC 61850-8-2 – Mapping to Web Services

As expected, the New Work Item Proposal on Web Service Mapping has been officially published on 2011-10-07 for ballot:

Future IEC 61850-8-2: Specific communication service mapping (SCSM) – Mappings to web-services (Document 57/1181/NP).

Closing Date of ballot: 2012-01-13

In order to get a copy of the NP document [contact your TC 57 national committee.](#)

Posted by [Karlheinz Schwarz](#) at [9:32 PM](#) [0 comments](#) 

Labels: [IEC 61400-25](#), [iec 61400-25-4](#), [IEC 61850](#), [IEC 61850-8-1](#), [iec 61850-8-2](#), [mapping](#), [Web Service](#), [webservice](#)

Sunday, October 2, 2011

IEC 61850-90-5 defines How to Use IEC 61850 to transmit synchrophasor information according to IEEE C37.118

The new Technical Report IEC TR 61850-90-5: "Use of IEC 61850 to transmit synchrophasor information according to IEEE C37.118" is on its way for official publication.

Synchrophasor information are measured and calculated by PMUs (Phasor Measurement Units) are used to assess the condition of the electrical power delivery system. The synchrophasors and related message formats transmit synchrophasor information over long distances. The payload is defined in IEEE C37.118.


IEC 61850-90-5 will provide a way of exchanging synchrophasor information between PMUs and WAMPAC (Wide Area Monitoring, Protection, and Control), and for and between control center applications.

IEC 61850-90-5 also provides communication profile extensions to allow to route GOOSE and sampled value messages (IEC 61850-8-1 and IEC 61850-9-2) using UDP/IP. These routable messages can be utilized to transport any IEC 61850 information as well as synchrophasor

information.

Applications comprise:

- Synchro-check
- Adaptive relaying
- Out-of-step (OOS) protection
- Situational awareness
- State Estimation and on-line security assessment
- Archive data (event & continuous)
- Special Protection Schemes
- Predictive Dynamic Stability Maintaining System
- Under Voltage Load Shedding

Posted by [Karlheinz Schwarz](#) at [11:27 PM](#) [0 comments](#) 

Labels: [IEC 61850](#), [iec 61850-90-5](#), [synchrophasor](#), [UDP/IP](#), [wide area network](#)

Tuesday, September 27, 2011

Major German RTU Vendor implements IEC 61850 instead of phased-out model IEC 60870-5-101 and 104

The [IDS company](#) based in Ettlingen (Germany) offers a gateway to collect data from many underlying protocols and converts them into IEC 61850 Models for the communication with control centers. They wrote in a recent publication that the **classical RTU protocols IEC 60870-5-101 and –104 are phase-out solutions for the communication with control centers**. One crucial issue they highlight is the semantic information models and self-description services defined in IEC 61850.

The same company was a very strong supporter for using IEC 60870-5-101 and –104 for the communication with control centers – and partly within substations. What I see these days: More and more people are changing their mind!

The protocol gateway (which is a server) uses for the uplink to the control center **IEC 61850 information objects** and **web services according to IEC 61400-25-4 Annex A** for the protocol. This combination (IEC 61850 models and IEC 61400-25-4 mappings) is technically feasible. Formally it is not defined in any standard!

That is why **the gateway (server) cannot interoperate with any IEC 61850 client**. It is a product that can communicate with a client according to IEC 61400-25-4 Annex A only.

The first reason they provided why they did not use MMS is as follows: MMS would require to have permanent TCP and MMS connections maintained! That is true for substation automation, where short reaction times for crucial spontaneous event reports are required. If the required reaction is in the seconds, there is no reason why a permanent connection should be required! MMS does not require permanent connections! A MMS client can close the connection as soon as a service is completed.

Click [HERE](#) for the paper published in the etz magazine [German only].

It is also important to know that (to my knowledge) most vendors implementing IEC 61400-25 are using the mapping according to IEC 61400-25-4 Annex C (MMS, IEC 61850-8-1): [Bachmann](#), [Beckhoff](#), [Ingeteam](#), Siemens, ...

Finally: a new work item has been proposed to IEC TC 57 (home of IEC 61850) to standardize a web service mapping as IEC 61850-8-2. The

question is now: Which solution should be chosen or developed? Three candidates are already discussed and proposed for further investigation:

1. [DPWS](#) (Device Profile Web Services)
2. OPC UA WS
3. IEC 61400-25-4 Annex A (as a starting point)

Nobody knows which solution will finally be standardized for IEC 61850 and how long it will take. There may be additional candidates proposed during the official ballot on the new work item once it is out for ballot ... may be by end of 2011. Hopefully we will see a single solution being published in 8-2. Nobody knows.

Having multiple standards for the mappings means: **split the market in non-interoperability domains!**

Click [HERE](#) for a further a discussion on web services.

Posted by [Karlheinz Schwarz](#) at 7:18 PM 0 comments 

Labels: [control center](#), [DWPS](#), [Gateway](#), [IEC 60870-5-101](#), [IEC 60870-5-104](#), [iec 61400-25-4](#), [IEC 61850-8-1](#), [mapping](#), [MMS](#), [OPC UA](#), [RTU](#), [Web Service](#)

Monday, September 26, 2011

Final Call for IEC 61850 (61400-25) Seminar and Hands-On Training in Frankfurt, October 05-07

The 3 day IEC 61850/61400-25 Seminar/Hands-on Training with real IEDs (embedded controller programmable in C/C++ and IEC 61131-3) and free evaluation software (DLL etc. fully functional - free to take home) is scheduled to be held in **Frankfurt (Germany)** from **05.-07. October 2011**.

There are a few seats available. You can even register the latest by Tuesday evening (Oct 04) ... I can print another set of hand-outs before I leave to Frankfurt ... ;-)

Click [HERE](#) for details. Questions on the attendance fee etc? [Contact us.](#)

I have conducted some 140 courses and educated more than 2,650 experts all over. The experience I collected throughout these events – will be given to you – in case you attend next week. One of the attendees of last week's event in Nashville (TN, USA) wrote me today:

"I really did enjoy the workshop and did get lots of information both from the material and your expertise. I feel I have a better understanding of 61850- which was my goal. Thank you."

See you next week.

Posted by [Karlheinz Schwarz](#) at 3:45 PM 0 comments 

Labels: [61850](#), [DNP3](#), [Evaluation](#), [hands-on Training](#), [IEC 61400-25](#), [IEC 61850](#), [seminar](#)

Sunday, September 25, 2011

Two Are Better Than One – An Old Wisdom

King Salomon wrote some 3,000 years ago about redundancy:

Ecclesiastes 4:9-12: **"Two** are better than **one**, because they have a good reward for their labor. For if they **fall**, the one will **lift up his**

fellow; but woe to him that is alone when he falleth, and hath not another to lift him up. and a **threefold cord is not quickly broken**."

It would be very helpful in the future electric power delivery system if a higher degree of redundancy would be implemented! There is still a lot ... but it is degrading in many places all over.

The major power outage in the San Diego region two weeks ago caused a failure in "a portion of the "north loop" of San Diego County's Regional

Communications System (RCS) experienced a **major failure** when the county-wide power outage hit on September 8, 2011. This was the second major **outage for the redundant 800 MHz RCS** that was designed to carry public safety communications **without the need for a backup system**. ..."

Accountants may say: The backup costs a lot of money ... ;-)

Yup!

Click [HERE](#) to read the full report.

I have seen communication "boxes" for wind turbines that offer **three** communication channels ... just in case! TCP/IP over Ethernet, GPRS, and Satellite. That should work highly reliable and offer a high availability.

Posted by [Karlheinz Schwarz](#) at [12:15 PM](#) [0 comments](#) 

Labels: [IEC 61131-3](#), [IEC 61850](#), [power outage](#), [power systems](#), [redundancy](#)

Friday, September 23, 2011

Modeling Logics with IEC 61850-90-11

IEC TC 57 has started to work officially on models for Logics:

IEC TR 61850-90-11: Communication networks and systems for power utility automation – Part 90-11: Methodologies for modeling of logics for IEC 61850 based applications

The national committees of TC 57 are requested to contribute to the new part of the standard series IEC 61850.

Standards like IEC 61131-3, IEC 61499 and others will be taken into account.

If you are interested in this work, contact your TC 57 National Committee or myself.

A discussion of the use of IEC 61499 in conjunction with IEC 61850 can be found [HERE](#) (Towards Intelligent Smart Grid Devices with IEC 61850 Interoperability and IEC 61499 Open Control Architecture)

Or check [these](#).

Posted by [Karlheinz Schwarz](#) at [6:34 PM](#) [0 comments](#) 

Labels: [IEC 61499](#), [IEC 61850](#), [logic](#), [programming](#)

Power Outage in the South-West – Controlling Huge

Power Systems is a Challenge

A huge interconnected power system follows 100 per cent the rules of laws like the [Kirchhoff's Law](#) and others. The Physics of the electrical system does not care about share-holder value, regulation and de-regulation – it is a law that can't be changed by lawyers and bank managers!

The electrical power in every homes outlet is understood as a given – as sun shine and rain!! It is just here.

Two weeks after the power outage in the South-Western, it is likely that missing communication at the level of humans had a big impact on the stability of the power system.


Click [HERE](#) for some more details.

Click [HERE](#) for a discussion if the regulation or the de-regulation of the power market had a huge impact on the power outage.

Whatever people's interpretation is: the electrical system is an electrical system that cannot be cheated.

I'm wondering why the control systems involved in providing a stable power system in the South-West seemed to not have all crucial information about the power system exchanged between all technical systems (parties) involved. There is a standard available for many years that would allow to exchange all real-time information needed to control the power system: IEC 60870-6 TASE.2 (ICCP).

There is one lesson we have to learn: The information systems could also not change the Kirchoff's and other laws. The electrical system is an electrical system for the last 100+ years and for the future ...

Posted by [Karlheinz Schwarz](#) at [6:18 PM](#) [0 comments](#) 

Labels: [blackout](#), [communication](#), [IEC 60870-6](#), [real-time](#), [TASE.2 ICCP](#)

[Newer Posts](#)

[Home](#)

[Older Posts](#)

Subscribe to: [Posts \(Atom\)](#)

News on IEC 61850 and related Standards

Daily news concerning the standards IEC 61850, IEC 61400-25, IEC 61970 (CIM), IEC 60870-5, ...

Friday, September 16, 2011

Some more Details on the September 8 Power Outage in San Diego


Some more details on the causes that let to the big Power Outage in California, Arizona and Mexico on September 8, 2011 have been published.

The SignOnSanDiego reports on Sept 16: " ... the Cal-ISO chief said, investigators so far have identified **23 separate events that occurred during the 11-minute span**, each of which **played a role** in denying electricity to San Diego County and beyond." 23 is a lot!

Click [HERE](#) for the complete report.

Whatever caused the power outage: There will be something to learn and to change ... and I guess there will be a growing need to exchange more real-time or near real-time information between humans, systems and devices. Standards will help to implement new measures.

Please let me know as soon as you have more details.

Posted by [Karlheinz Schwarz](#) at [11:26 PM](#) [0 comments](#) 

Labels: [DNP3](#), [IEC 61850](#), [IEC 61968](#), [IEC 61970](#), [information exchange](#), [Power Automation](#), [power outage](#), [power systems](#), [standards](#)

Thursday, September 15, 2011

IEC 61850 knowledge required for many new Jobs all over

Nine positions in Germany are open for engineers [today: 2011-09-15] with IEC 61850 (and partly with DNP) background according to the website Simplyhired!

Click [HERE](#) for the list of positions in Germany.

And in North America? The website links to **107 open positions** within North America [today: 2011-09-15] !!! Yes!

Click [HERE](#) for the list in the USA.

11 new positions have been added the last 7 days [today: 2011-09-15]:

Click [HERE](#) for the list of that last 7 days.

Good luck if you are looking for a job where you can use your IEC 61850 experience and knowledge.

IEC 61850 and DNP3 applications are picking up!

Posted by [Karlheinz Schwarz](#) at [2:21 AM](#) [0 comments](#)

Subscribe To IEC 61850 News

 Posts 

 All Comments 

Blog Archive

► [2012](#) (11)

▼ [2011](#) (159)

► [December](#) (5)

► [November](#) (11)

► [October](#) (22)

▼ [September](#) (11)

[Major German RTU Vendor implements IEC 61850 inste...](#)

[Final Call for IEC 61850 \(61400-25\) Seminar and Ha...](#)

[Two Are Better Than One – An Old Wisdom](#)

[Modeling Logics with IEC 61850-90-11](#)

[Power Outage in the South-West – Controlling Huge ...](#)

[Some more Details on the September 8 Power Outage ...](#)

[IEC 61850 knowledge required for many new Jobs all...](#)

[Southern California Edison's Vision for Tomorrow's...](#)

[Huge Power Outage in South-West of U.S.A – started...](#)



Labels: [61850](#), [DNP3](#), [electric power system](#), [GOOSE](#), [IEC 61850](#), [protection](#), [SCADA](#), [schutztechnik](#), [seminar](#), [Smart Grid](#), [standards](#), [Training](#)

Sunday, September 11, 2011

Southern California Edison's Vision for Tomorrow's Smart Electric Grid – Invest in yourself

In the IEEE power & energy magazine, issue of September/October 2011, you can find very interesting and important statements on the future electric power grid. The current issue provides several papers on power distribution systems. One remarkable paper is "Good Vibrations" (p 22-32) from Robert J. Yinger and Ardalan E. Kamiab (both with Southern California Edison, Westminster, California).

They state at the very beginning that "A smart grid involves adding to the grid **millions of smart electronic devices** like phasor measurement units, fault indicators, meters, and electric vehicle chargers that will send and receive **millions of pieces of data per minute** to produce actionable information and using that information to enhance the operations and control of the electric system."

New hardware and software needs to be developed, installed and used – by engineers and programmers that may still be students at a high school. And what about the senior technicians? Are they "open" for "open" systems?

Whatever the mix of renewable power will be – one thing is sure: the future power delivery system needs a lot more information systems for the millions of smart electric devices!! Standards help to keep the cost quite low – by preventing the proliferation of the myriads of vendor specific solutions.

Be aware that standards are just tools – in the hands of people: young and senior experts, and newbies.

For Southern California Edison's vision standards like IEC 61850 and DNP3 are quite crucial. In order to really benefit from the standards, "one of the challenges facing the utility industry over the **next few years is training** the necessary workforce for **planning, building, operating, and maintaining the smart grid**. A large number of new technologies are being applied to the smart grid, including new equipment, state-of-the-art communications technologies, and advanced control capabilities ... that can help the entire utility industry **prepare the workforce of the future** to implement the smart grid ... The **workforce needs to be trained so that all of these new technologies can be implemented smoothly** ... Planning for these advanced smart grid systems **needs to be done now** ..."

There is a chance next week (in Nashville, TN, 20-21 September, 2011) to get prepared for the new standards IEC 61850 and DNP3:

Click [HERE](#) for the program and further details of event next week.

Invest in becoming a valued power automation professional!

Posted by [Karlheinz Schwarz](#) at 1:11 PM 0 comments

Labels: [61850](#), [Automation](#), [distribution automation](#), [DNP3](#), [hands-on Training](#), [IEC 61400-25](#), [IEC 61850](#), [IEC 62351](#), [peopleware](#), [Power Automation](#), [protection](#), [seminar](#), [Smart Grid](#), [smart people](#), [smart solution](#)

[110 Young People attended the Shanghai IEC 61850 a...](#)

[Reporting and GOOSE compared](#)

- ▶ [August](#) (11)
- ▶ [July](#) (23)
- ▶ [June](#) (20)
- ▶ [May](#) (10)
- ▶ [April](#) (6)
- ▶ [March](#) (16)
- ▶ [February](#) (16)
- ▶ [January](#) (8)
- ▶ [2010](#) (153)
- ▶ [2009](#) (162)
- ▶ [2008](#) (82)

Contributors

[Karlheinz Schwarz](#)

[Michael Schwarz](#)

Friday, September 9, 2011

Huge Power Outage in South-West of U.S.A – started in Substation?

The South-West of the U.S.A. was hit by a major power outage (some 5 million people had no power) that was likely being caused by some event in a substation yesterday (Thursday, 2011-09-08). Reports say that it is likely that an employee removing a piece of monitoring equipment has caused a massive power outage. Investigations are underway.

What does this mean for standards like IEC 61850 and IEC 61400-25, DNP3, CIM, ... ? It means a lot for people that deal with the power system! Why? Because we have to understand that the **power delivery system is a huge and complex POWER system!!!** Power engineers and electrical engineers are very crucial to the availability of the power 24 hours and 7 days a week! All the smart(er) grid and substation automation activities and solutions based on **information models and communication standards are secondary** (even they are becoming more important in the future).

When I conducted the [workshop on IEC 61850 and IEC 61400-25 in Shanghai \(China\) last Monday](#), I highly recommended to the 110 young engineers and students that they **should closely team up with the experienced senior power and electrical engineers that have run the power grid so far!**

Information Technology WILL (and MUST) SUPPORT the operation of the future power system – BUT it is more important to have **enough power and electrical engineers**. So, **TEAMWORK** of all people involved in the power system is VERY CRUCIAL!! **And PEOPLEWARE** – well experienced and educated engineers.

Teamwork requires that each person involved has a basic understanding of all the many aspects of the grid, how to operate and maintain it! Electrical engineers need to understand the huge influence that will come through the new standards like IEC 61850, ... and IT people need the basics of the power grid!

If you get more details on the cause of the blackout in San Diego this week, please post it through the comment link to this post. Thanks.

We all (as a Team) have to learn something out of this big event!

Posted by [Karlheinz Schwarz](#) at 2:58 AM 0 comments 

Labels: [blackout](#), [IEC 61400-25](#), [IEC 61850](#), [monitoring](#), [Power Automation](#), [power systems](#), [protection](#), [SCADA](#), [Substation](#), [Substation Automation](#)

Thursday, September 8, 2011

110 Young People attended the Shanghai IEC 61850 and IEC 61400-25 Workshop

The workshop on IEC 61850 and IEC 61400-25 organized by the State Energy Smart Grid R&D Center (Shanghai) hosted at Shanghai Jiao Tong University on Monday, 05 September 2011, was very successful.

The **110 young attendees** from 37 organizations came to the event to get up-to-date information about the standards, market acceptance, challenges with the new standards, experience, and implementation hints.


One of the students of the workshop and the teacher at the entrance:



The 110 attendees (mostly young people):




Professor Peichao Zhang and his colleague Professor Dong Liu organized the event:

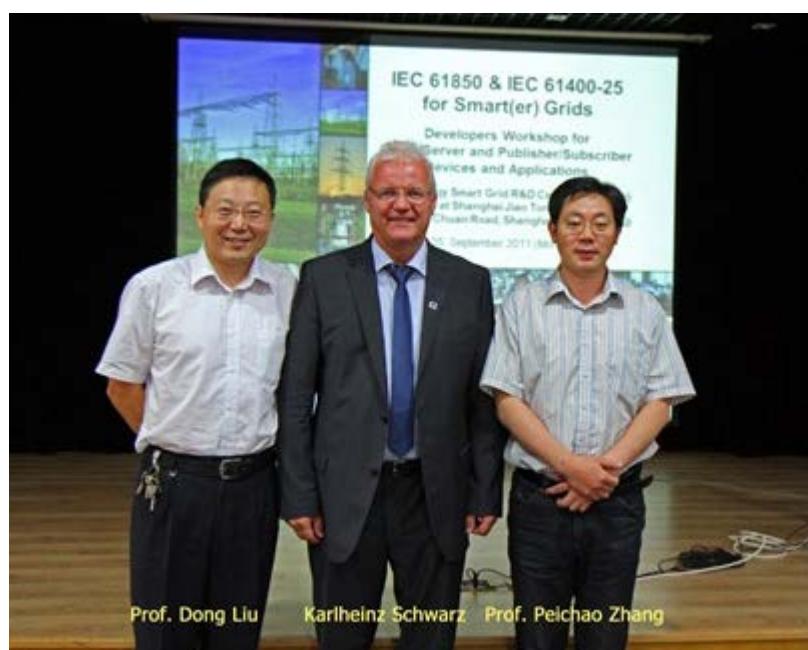

Click [HERE](#) for the program of the event.

According to a report given during the IEC TC 57 Plenary meeting in Shanghai (6.-7. September 2011), one substation per day and one wind power turbine per hour are installed in China. So, there is a huge demand for solutions according to IEC 61850 and IEC 61400-25.

The young people are eager to learn how to use the standards for the various products and applications. The workshop has helped them a lot to get the basics of the standard.

Posted by [Karlheinz Schwarz](#) at 4:42 AM 0 comments 

Labels: [electric power system](#), [IEC 61400-25](#), [IEC 61850](#), [implementation](#), [protection](#), [Smart Grid](#), [smart solution](#), [Substation](#), [wind power](#), [wind turbine controller](#)

Friday, September 2, 2011

Reporting and GOOSE compared


IEC 61850 and IEC 61400-25 offers various possibilities for exchanging data values in real-time or near real-time. Whatever your definition of real-time is, here are some hints on the options and some hints on how to use them:

List of possibilities to exchange data values:

Information
exchange

Summary of accessing data objects (1)

- Get a value of single data object ([GetDataValues](#) – [Client driven](#))
- Get a list of values of data objects ([GetDataValues](#) with list sent each request – [Client driven](#))
- Get the complete list values of data objects using a dataset object ([GetDataSetValues](#) – [Client driven](#))
- Get the complete list of values of data objects (of a dataset) using reporting ([reporting](#), [General Interrogation](#) – [Client driven](#))
- Get the complete list of values of data objects (of a dataset) using reporting ([reporting](#), [Integrity period](#) – [Server driven](#))
- Get one ($\text{BufTm}=0$) or more ($\text{BufTm}>0$) value(s) of data objects (dataset) using [reporting](#) on data and quality change and data update ([Server driven](#))
- GOOSE and Sampled Values ... exchanges complete list of values of data objects of a dataset (events: application specific – [Server driven](#))
- Get sequence of value(s) of data objects (of a dataset) using [logging](#) (on data and quality change and data update – [Client driven](#))



Comparison of Reporting and GOOSE / Sampled measured values (SMV):

Summary of accessing data objects (2)

	Reporting	GOOSE / SMV
Max. message size	... 64.000 ... octets	< 1.500 octets
Segmentation	Yes (option in Report)	No
Flow control	Yes (TCP)	No
Detection of loss	Yes (TCP)	Yes (var. counters)
Reliable transmission	Yes (TCP)	Yes (re-transm. / cyc.
Network routing	Yes (IP)	No
Relation – 1:1	Yes	No / Yes
Relation – 1:n	Yes (multiple CBs)	Yes (Layer 2 multicast
Timeliness	... 1 sec few msec ...
General Interrogation	Yes	No
Layers	1 ... 7, Application	1,2,7, Application
Document	IEC 61850-7-2, 8-1	IEC 61850-7-2, 8-1 / 9



Note that all message contents are encoded ASN.1 BER – with the exception of the data values in SMV and optionally in GOOSE Edition 2 where the data values are fixed encoded (for optimization!).

The timeliness of GOOSE and SMV depends on the definition of the standard (e.g., using special messages directly on data link) AND on the IMPLEMENTATION! The bottleneck is usually in the end-nodes and not in the communication.

Posted by [Karlheinz Schwarz](#) at 2:18 AM 3 comments

Labels: [61850](#), [GOOSE](#), [IEC 61400-25](#), [IEC 61850](#), [real-time](#), [SMV](#)

Sunday, August 21, 2011

PV Power to (de)stabilize the European Power Delivery System?

One swallow does not make a summer – But 100.000 do. One PV system on a roof in the nineties did not make a smart grid based on renewable resources. But due to the growth of renewable resources like PV the power delivery system changes a lot. Usually today the PV inverters do automatically frequency disconnection.

ENTSO-E the “European Network of Transmission System Operators for Electricity” noted in a letter to Commissioner Oettinger of the European Commission that too many “swallows” are flying somehow “uncontrolled” – flying alone ... not being aware what’s going on around them ... not seeing the system (!):

“This letter is to brief you on a security of supply issue arising from the **automatic frequency disconnection settings** of installed photovoltaic (PV) panels in some European countries and to request your support in encouraging the national Regulatory authorities in impacted countries to facilitate the timely implementation of remedial actions.

Due to the interconnected nature of the transmission system until such remedial actions are implemented the synchronous Central European power system **is at increased risk to significant frequency deviations of a magnitude that would generate a widespread loss of supply.**

In several European countries, connection standards applicable to photovoltaic panels and other distributed generation have been or are still specifying that the panels automatically disconnect from the grid whenever the system frequency reaches **0.2 or 0.3 Hz deviations** from the required normal value of 50.0 Hz.

Current information from our Member TSOs, including for example Germany and Italy, indicate that the significant growth in photovoltaics in recent years has resulted in a PV installed capacity (with such settings) approaching 25 000 MW. At these levels there is clearly a risk of an instantaneous generation loss far in excess of the 3000MW generation loss „ride-through“ design limit for the Continental European system. ...”

Click [HERE](#) for the letter from ENTSO-E [English, pdf]

Ok, what to do now? Act! There are many actions needed to get CONTROL over the system in the future system based on many distributed resources! One aspect is to change limits ... but more important is the **control** of the power resources.

A group of IEC TC 57 WG 17 is working on a very crucial part of IEC 61850: Draft IEC 61850-90-7 TR – “Communication networks and systems for power utility automation – Part 90-7: IEC 61850 object models for photovoltaic, storage, and other DER inverters” (57/1155/DC).

Major PV inverter manufacturers and other experts have drafted the above document.

Crucial aspects covered by 90-7 (in addition to IEC 61850-7-420 – DER) are:

7. DER management functions for inverters.

7.1 Immediate control functions for inverters

7.1.1 Function INV1: connect / disconnect from grid

7.1.2 Function INV2: adjust maximum generation level up/down

7.1.3 Function INV3: adjust power factor.

7.1.4 Function INV4: request real power (charge or discharge storage)

7.1.5 Function INV5: pricing signal for charge/discharge action

7.2 Modes for volt-VAr management

7.2.1 Var management modes using volt/VAr arrays

7.2.2 Volt-VAr mode VV11: normal energy conservation mode

7.2.3 Volt-VAr mode VV12: maximum VAr support mode

7.2.4 Volt-VAr mode VV13: static inverter mode

7.2.5 Volt-VAr mode VV14: passive mode.

7.3 Modes for frequency-related behaviours

7.3.1 Frequency management modes

7.3.2 Frequency-watt mode FW21: high frequency reduces active power.

7.3.3 Frequency-watt mode FW22: constraining generating/charging by frequency (see diagram below)

7.4 Dynamic grid support during abnormally high or low voltage levels

7.4.1 Dynamic grid support mode TV31: dynamic grid support during abnormally high or low voltage levels

7.4.2 Example of dynamic grid support capabilities.

7.5 Functions for “must disconnect” and “must stay connected” zones

7.5.1 “Must disconnect” MD curve

7.5.2 “Must stay connected” MSC curve

7.6 Modes for watt-triggered behaviours

7.6.1 Watt-power factor mode WP41: feeding power controls power factor

7.7 Modes for voltage-watt management.

7.7.1 Voltage-watt mode VW51: voltage-watt management: generating by voltage

7.7.2 Voltage-watt mode VW52: voltage-watt management: charging by voltage

7.8 Modes for behaviours triggered by non-power parameters

7.8.1 Temperature mode TMP

7.8.2 Pricing signal mode PS

7.9 Setting and reporting functions

7.9.1 Establishing settings DS91: modify inverter-based DER settings

7.9.2 Event logging DS92: log alarms and events, retrieve logs

7.9.3 Reporting status DS93: selecting status points, establishing reporting mechanisms

7.9.4 Time synchronization DS94: time synchronization requirements

Example (without further explanations):

7.3.3 Frequency-watt mode FW22: constraining generating/charging by frequency:

Example Settings

RmpTms for P1	10s
RmpTmmDec	100% Wmax/minute
RmpTmmInc	40% Wmax/minute
RmpRsUp	10% Wmax/minute

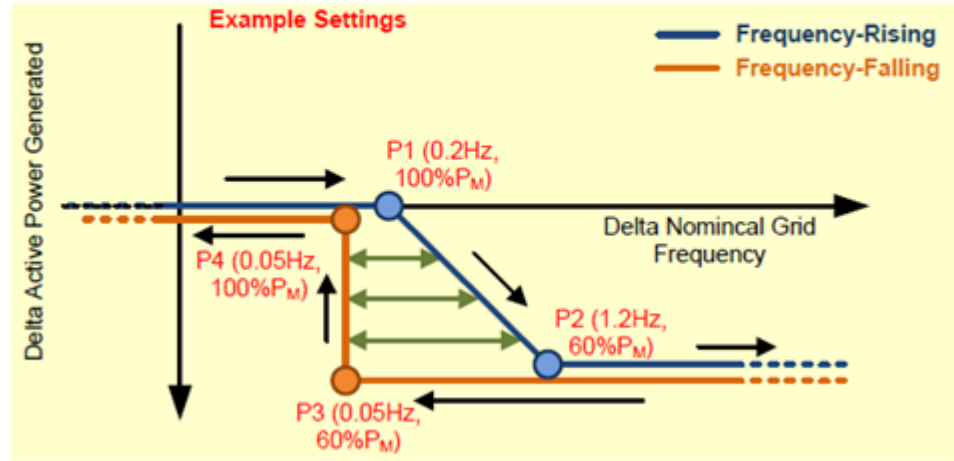


Figure 19: Frequency-based active power modification with the use of an array

It is expected that this part IEC 61850-90-7 is one of the crucial parts of IEC 61850 for the stability of the future power delivery systems all over.

It’s “PV summer time” – there are millions of PV inverter installed (most of them are not controlled ... just “flying” around.

Please contact your national IEC TC 57 committee to get a copy of the document.

Click [HERE](#) for an interesting ENTSO-E Draft “Requirements for Grid Connection Applicable to all Generators” dated 22 March 2011

The Power Systems are quite comprehensive ... and complex!

Posted by [Karlheinz Schwarz](#) at [12:25 PM](#) [0 comments](#) 

Labels: [active power control](#), [control](#), [IEC 61850](#), [IEC 61850-7-420](#), [IEC 61850-90-7](#), [inverter](#), [photo voltaic](#), [PV](#)

Thursday, August 18, 2011

IEC 61850 for Substations Only?

The title and scope of IEC 61850 was for many years very restricted:

2001 – 2009: Communication networks and systems in **substations**

2010 – ... : Communication networks and systems for **power utility automation**

The new title and scope is still too restrictive! The working group wanted to change to “... for automation”. This was not accepted by the IEC Central Office. IEC deals with electro-technical matters. The term “automation” was understood as too broad.


From a content point of view IEC 61850 could be used all over where measurements and status information needs to be communicated – in any application domain. Even if you are just monitoring a process or system (no control need) you can use IEC 61850 models, messages and configuration tools.

The Model “STMP” (temperature supervision logical node) can be used wherever a temperature measurement is taken: Temperature of a transformer, of a room, ambient temperature or your body temperature. When the “STMP.Tmp.mag” value reached the configured limit (Alarm limit or Trip limit) an report or a GOOSE message may be issued.

By the way, IEC 61850 has rules how to define extended logical nodes and data objects. All values can be communicated the Ethernet and TCP/IP based information exchange methods.

Experts pointing to the scope “substations” are not up-to-date. Those arguing that IEC 61850 is for “power utility automation” only may not like to accept that IEC 61850 is very generic or common – applicable in a wide range of applications.

The title and scope are just “toner on paper”.

Posted by [Karlheinz Schwarz](#) at [10:07 PM](#) [1 comments](#) 

Labels: [Automation](#), [building automation](#), [communication](#), [condition monitoring](#), [electric power system](#), [GOOSE](#), [IEC 61400-25](#), [IEC 61850](#), [Information Model](#), [utilities](#)

Progress in Smart Grid Deployment – Too slow?

Many people all over expect that the Electric Power Delivery system will be changed to become smarter over night. A system that has been build over a period of 20, 50, 100+ years cannot be changed in short time! The change is likely to occur in steps over several decades – may be for ever.

Peter Fox Penner (US consultant) has summarized what is going on in the process of change. He concludes: "... Taken together, the trends discussed here show that **the smart grid is expanding and developing**, even if the most successful entities and programs are surprising. More importantly, these trends illustrate the evolutionary **nature of smart grid development**. Arguments that the smart grid is **moving too slowly** underestimate the **scale and complexity** of rebuilding our entire grid. Utilities are tasked with deploying a complex series of infrastructure investments that must work in harmony with their current (already smart) systems, use innovative pricing that customers support, and produce a net benefit. Under **these conditions**, **slow and steady wins the race**. We can expect smart grid development to occur in stages **over decades**, ultimately transforming the power industry into a very different business."

Click [HERE](#) for his report in the IEEE Smart Grid Newsletter.

When we talk about the pace of change in the information technology in industrial automation we should not get nervous when we see the slow progress! How long did it take to get Gigabit/s Ethernet for substation environments developed ... and accepted!? New approaches in Automation take often decades before they are accepted and used.

Click [HERE](#) for a brief discussion on Ethernet and Tokenbus ... written decades ago.

The future for standards is quite bright. When a utility decides to deploy information technology for the next 10 or 20 years it will likely chose a stable standard – so that there is no need to change the solution every 4 or 5 years ... when manufacturers have developed a new solution.

MMS (Manufacturing Message Specification, ISO 9506, used in IEC 61850-8-1 to define the message encoding) has been developed in the late eighties (80s !) – some 25 years ago. Web services are understood by some people as an option for messaging – more up-to-date. I have seen a Report message of a simple state change message using IEC 61400-25-2 Web Services the other day. The length of the XML coded Report message was some 850 octets !! A Report message encoded with MMS/ASN.1 BER (as per IEC 61850-8-1) is really shorter: by a factor of about 10 !!

Don't hurry. Take your time. Rome hasn't be built over night!

I usually sate in my seminars that the deployment of IEC 61850 happens too fast – users often do not have any clue what they got installed. They got it because it was cheaper than xyz. All in a sudden they have several substations with hundreds of IEDs communicating with IEC 61850 – and many (may be almost all) utility engineers have to struggle with this new way to do protection and automation. Many of them have started to get training in IEC 61850 ... and you?

Don't **start slow** and **slow down fast** ;-)

Just start – there is something to learn!

Posted by [Karlheinz Schwarz](#) at [9:47 PM](#) [0 comments](#) 

Labels: [Automation](#), [communication](#), [distribution automation](#), [electric power system](#), [IEC 61400-25](#), [IEC 61850](#), [IEC 61850-90-7](#), [inverter](#), [power systems](#), [Smart Grid](#), [standards](#)

Wednesday, August 17, 2011

**Engineer for IT Security in Industrial Automation
Wanted (TÜV SÜD)**

Der TÜV SÜD in München sucht einen Ingenieur für IT-Sicherheit (w/m)

Aufgaben:

- Erstellung von Prüf- und Testszenarien nach einschlägigen Standards (z.B. IEC 62351, IEC 15408 etc.)
- IT-Sicherheitsberatung und Audits von Industriesystemen (z.B. Leit- und Steuernetzwerke)
- Analyse/Auswertung von (industriellen) Kommunikationsprotokollen (z.B. TCP/IP, XML, PROFINET)
- Durchführung von IT-Sicherheits- und Risikoanalysen
- Durchführung von IT-Sicherheitstests und Penetrationstests
- Berichterstellung
- Mitwirkung bei Fachveranstaltungen (Schulungen, Seminare, Tagungen)

[HIER](#) für weitere Informationen klicken.

Übrigens: die Norm [IEC 62351 wird auch für Geräte nach IEC 61850 und IEC 61400-25](#) eingesetzt.

Posted by [Karlheinz Schwarz](#) at [3:59 AM](#) [0 comments](#) 

Labels: [IEC 62351](#), [security](#)

Test Engineer for IEC 61850 Wanted (TÜV SÜD Munich)

Der TÜV SÜD in München sucht einen Ingenieur für Schaltanlagen (w/m)

Aufgaben:

- Erstellen von Prüf- und Testszenarien zur Prüfung der Konformität und Interoperabilität nach IEC 61850 und IEC 61400-25
- Erstellen, Erweitern und Modifizieren von Test-Skripts für die automatisierte Testdurchführung und -auswertung
- Prüfung von Konfigurationen und technischen Datenmodellen beim Kunden
- Analyse und Auswertung von Kommunikationsprotokollen und Testergebnissen
- Erstellen von Prüfberichten nach vorgegebenen Qualitätsstandards
- Unterstützung des Kunden bei der Umsetzung von Normanforderungen sowie der Bewertung und Behandlung von Testergebnissen
- Mitarbeit bei nationalen und internationalen Standardisierungsgremien, Vertretung bei Konferenzen und Fachveranstaltungen

[HIER](#) für weitere Informationen klicken.

Posted by [Karlheinz Schwarz](#) at [2:16 AM](#) [0 comments](#) 

Labels: [conformance test](#), [IEC 61400-25](#), [IEC 61850](#), [testing](#), [wanted](#)

Thursday, August 11, 2011

Progress in IEC 61850 standardization

The FDIS IEC 61850-9-2 Ed.2:

Communication networks and systems for power utility automation -
Part 9-2: Specific communication service mapping (SCSM) -

Sampled values over ISO/IEC 8802-3

has been accepted as International Standard.

The CDV IEC 61850-10 Ed.2 (57/1162/CDV):
Communication networks and systems for power utility automation -
Part 10: Conformance testing

has been published for comments and ballot by 2012-01-06.

The following has been changed and extended:

- Update of Server device conformance test procedures
- New Client system conformance test procedures
- New Sampled values device conformance test procedures
- New Engineering Tool related conformance test procedures
- New GOOSE performance test procedures

Posted by [Karlheinz Schwarz](#) at [10:28 PM](#) [0 comments](#) 

Labels: [conformance test](#), [GOOSE](#), [IEC 61850](#), [IEC 61850 edition 2](#), [IEC 61850-9-2](#), [sampled value](#)

Wednesday, August 10, 2011

Developers Workshop for IEC 61850 Client/Server and Publisher/Subscriber for Smart Grids in Shanghai

A one-day Developers Workshop for IEC 61850 Client/Server and Publisher/Subscriber Devices and Applications will be conducted by Karlheinz Schwarz at the

State Energy Smart Grid R&D Center (Shanghai) hosted
at Shanghai Jiao Tong University

800 Dong Chuan Road

Shanghai, China, 200240

05. September 2011 (Monday)

智能电网标准 · 应用与开发研讨会

由IEC TC 57核心成员Karlheinz Schwarz先生主讲 内容针对

两种服务类型 客户/服务器架构 发布/订阅架构

两类应用平台 嵌入式装置 Windows应用系统

国家能源智能电网 上海 研发中心

上海交通大学 上海市东川路800号

2011.9.5 (周一)

Click [HERE](#) for the Program in English and Chinese [pdf].

Click [HERE](#) for the profile of the instructor [pdf].

Click [HERE](#) for the registration and contact information [Word document].

Posted by [Karlheinz Schwarz](#) at [12:18 AM](#) [0 comments](#) 

Labels: [Beck Chip](#), [embedded system](#), [IEC 61400-25](#), [IEC 61850](#), [seminar](#), [Smart Grid](#)

Tuesday, August 9, 2011

Germany Increases Energy Research by 75 percent to 3.5 Billion Euros

The German government announced the other day that it will spend much more research money into the development of a clean energy delivery system. The government will spend 3.500.000.000 Euros (\$4.9 billion) into research for renewable generation, higher energy efficiency, energy storage and grid-technology in the next three years (2011-2014).

Click [HERE](#) for the press release [in German only]

It is very likely that a reasonable part of this money will be spend for the IT infrastructure needed for the many applications of future power delivery system. There are at least two stable solutions that have to be taken into account: (1) the electrical system (A.C. and D.C.) and (2) the IP infrastructure. The future power system will be based on these corner stones. The electrical system will be supported by myriads of new intelligent controllers of the power resources (renewable, storage, ...) and new controllers of the grid (transmission and distribution) – and many of the controllers need to **work** (communicate over Ethernet and TCP/IP) **together and being supervised** by other controllers, which are part of the overall control of the power system ...

The international standard series IEC 61850, IEC 61400-25, IEC 61968/70 (CIM), IEC 60870-6 (ICCP), ... are here to help that the dream of the German government becomes true. Without these standards, the future power delivery system would be a nightmare with hundreds of proprietary communication solutions.

Many more companies in Germany and Europe are starting to put their hands on the standards IEC 61850 and IEC 61400-25 to be prepared for the future power delivery system in 2011. More than 20 companies will have received an in-house course on IEC 61850 and other IEC standards by Karlheinz Schwarz by end of 2011, and he will have run about an additional 10 public courses this year.

There is a lot to be done – let's get started or continue dealing with the IT infrastructure using IEC standards.

Of course: The IT infrastructure is just a vehicle for the future power delivery system. There is much more to do than to communicate. By applying already available standards it saves a lot of R&D money that should better be spend on questions like, "What does demand response really mean?"

Click [HERE](#) for a nice paper that discusses questions like: "What happens with the electrical system if a huge number of customers start their dishwashers, washing machines, stoves, AC, ... at the same time after a real-time price information has been received by the consumers?" " Could they behave in a way to cause power outages? May be ...

Posted by [Karlheinz Schwarz](#) at [2:08 AM](#) [0 comments](#) 

Labels: [61850](#), [communication](#), [distribution](#), [distribution automation](#), [E-Mobility](#), [electric power system](#), [IEC 61400-25](#), [IEC 61850](#), [IEC61850](#), [monitoring](#), [Power Automation](#), [power distribution](#), [power systems](#), [seminar](#), [Smart Grid](#), [Training](#)

Tuesday, August 2, 2011

Corrected URLs for IEC 61850 Hands-on Training Course in Sao Paulo (Brazil) on 11.-14. October 2011


The URLs for the STRI/NettedAutomation hands-on training course

scheduled for Sao Paulo (Brazil) on 11.-14. October 2011 were damaged ... please find the correct links:

Click [HERE](#) for the Program and Registration information for attendees from Brazil.

Click [HERE](#) for the Program and Registration information for all other attendees.

The course will be conducted at Instronic: <http://www.instronic.com.br/>

Posted by [Karlheinz Schwarz](#) at [10:52 AM](#) [0 comments](#) 

Labels: [hands-on Training](#), [IEC 61850](#)

Cisco's conclusion on FERC's Non-Ruling on IEC Standards

FERC (Federal Energy Regulatory Commission) decided [in July 2011 to not \(yet\) rule on five Smart Grid standard series](#) suggested by the National Institute of Standards Technology (NIST) / Smart Grid Interoperability Panel (SGIP). These families of standards defined by the International Electrotechnical Commission (IEC) were nominated by NIST/SGIP for consideration by FERC in rule making in October 2011. These are:

- IEC 61968: Application Integration at Electric Utilities-System Interfaces for Distribution Management
- IEC 61970: Energy management system application program interface
- IEC 61850: Communication Networks and Systems for Power Utility Automation
- IEC 60870-6 series: Telecontrol protocols compatible with ISO standards and ITU-T recommendations
- IEC 62351: Power systems management and associated information exchange - data and communications security

Cisco's position on this FERC non-ruling (according to their website – see below) is:

- **"Are the IEC standards really not ready for prime time?** This is unlikely because most of these standards are already in use outside North America.
- **Is cyber security a solved problem?** Not likely, as long as there are hackers in the world, cyber security will be an on-going challenge.
- **Is cyber security an intractable problem?** Far from it, the public Internet and private Internets (e.g. DoD) can be highly secure networks. And open-standards, community-based security mechanisms are far superior to "security by obscurity", or the status quo in utility networking which largely consists of hundreds of parallel SCADA networks.
- **Is greater awareness and education required? Indeed yes. The utility industry and the regulatory commissions need to hear from the Internet community of vendors, service providers, network operators, system admins, and cyber security experts, how** packet networks can be made secure.

The FERC non-action is both a temporary setback and a call-to-action for the Smart Grid community. The concerns expressed by FERC and the regulators are genuine and need to be addressed. Unfortunately, **the need for standards in transmission and distribution networks can't be put off.** Fortunately, the cyber security questions related to

the Smart Grid **have good answers available** from the long experience of the Internet.

Click [HERE](#) for the Cisco Developer Network statement on FERC's non-ruling.

What is true for the security issues (IEC 62351) is true for the other standard families, too! Many engineers need to become aware of the huge challenges by more education and training!!

Investment in peopleware is one of the needed actions to keep the power flowing.

Click [HERE](#) for more discussions on peopleware.

Next opportunity in North America:

Nashville (TN, USA)

20.-21. September 2011

Remote Conference

2 day Seminar (conducted by NettedAutomation) on Power System

Communication covering IEC 61850, IEC 61400-25, DNP3, NIST

Interoperability Roadmap, Smart Grids, security standards, ...

http://www.remotemagazine.com/rem-conf11/rem11_workshop.php

Posted by [Karlheinz Schwarz](#) at 4:46 AM 2 comments 

Labels: [Cisco](#), [education](#), [FERC](#), [IEC 61850](#), [IEC 62351](#), [peopleware](#), [security](#), [Training](#)

IEC 61869-6: The IEC 61850 Interface for Instrument Transformers

IEC TC 38 has published the new Committee Draft (CD) for the Digital interface for instrument transformers (38/418/CD):

IEC 61869: Instrument Transformers -

Part 9: Digital interface for instrument transformers

This standard defines a method for digital communications of instrument transformer

measurements. It is **based on the IEC 61850** series of standards, IEC

60044-8 and the ICA International User Group document

Implementation Guideline for Digital Interface to Instrument

Transformers Using IEC 61850-9-2 (known as 9-2LE). It includes

additional improvements including IEC 61588 network based time

synchronization, and frequency response requirements.

This new standard will be part a product family standard for instrument transformers. It provides an application of the horizontal standard series IEC 61850, which details layered substation communication architecture in the world of instrument transformers.

By providing tutorial material such as examples and explanations, it also gives an access for instrument transformer, protective relay and meter **experts** to concepts and methods applied in the IEC 61850 series.

An overview about the standard series 61869 is shown in the next picture:

PRODUCT FAMILY STANDARDS	PRODUCT STANDARD	PRODUCTS	OLD STANDARD
61869-1 GENERAL REQUIREMENTS FOR INSTRUMENT TRANSFORMERS		61869-2 ADDITIONAL REQUIREMENTS FOR CURRENT TRANSFORMERS	60044-1 60044-6
		61869-3 ADDITIONAL REQUIREMENTS FOR INDUCTIVE VOLTAGE TRANSFORMERS	60044-2
		61869-4 ADDITIONAL REQUIREMENTS FOR COMBINED TRANSFORMERS	60044-3
		61869-5 ADDITIONAL REQUIREMENTS FOR CAPACITIVE VOLTAGE TRANSFORMERS	60044-5
	61869-6 ADDITIONAL GENERAL REQUIREMENT FOR LOW POWER INSTRUMENT TRANSFORMERS	61869-7 ADDITIONAL REQUIREMENTS FOR ELECTRONIC VOLTAGE TRANSFORMERS	60044-7
		61869-8 ADDITIONAL REQUIREMENTS FOR ELECTRONIC CURRENT TRANSFORMERS	60044-8
		61869-9 DIGITAL INTERFACE FOR INSTRUMENT TRANSFORMERS	
		61869-10 ADDITIONAL REQUIREMENTS FOR LOW-POWER STAND-ALONE CURRENT SENSORS	
		61869-11 ADDITIONAL REQUIREMENTS FOR LOW-POWER STAND ALONE VOLTAGE SENSORS	60044-7
		61869-12 ADDITIONAL REQUIREMENTS FOR COMBINED ELECTRONIC INSTRUMENT TRANSFORMER OR COMBINED STAND ALONE SENSORS	
		61869-13 STAND ALONE MERGING UNIT	
		61869-14 ADDITIONAL REQUIREMENTS FOR DC CURRENT TRANSFORMERS	
		61869-15 ADDITIONAL REQUIREMENTS FOR DC VOLTAGE TRANSFORMERS	

- Part 9 Replaces IEC 60044-8 digital solution.
- Provides a product standard for instrument transformers with a digital interface according to 61850; similar to what IEC 62271-3 is doing for switchgear.
- Includes backward compatibility for the UCA International User Group Implementation Guideline for Digital Interface to Instrument Transformers Using IEC 61850-9-2.
- Uses IEC 61588-Ed2 for time synchronization, with an option for 1PPS.

The CD ballot closes 2011-11-04.

Contact your national IEC TC 38 or TC 57 committee to get a copy of the CD.

Posted by [Karlheinz Schwarz](#) at 2:12 AM 0 comments 

Labels: [9-2LE](#), [ct](#), [IEC 61850](#), [IEC 61869](#), [instrument transformer](#), [merging unit](#), [vt](#)

Wednesday, July 27, 2011

Hannover (Germany) Black Out Caused by Aging Infrastructure

Some 600,000 people of the city of Hannover (Northern Germany) were hit by a blackout (up to 81 minutes) on July 13, 2011.

First a power plant was tripped due to some internal problems. Then it was expected that a 220 kV / 110 kV transformer substation would transform more power from the 220 kV network into the 110 kV network – this would have balanced the load in the city and provided power from outside.

The transformer was protected by protection functions that prevent overloading (overheating) the transformer – in order to not damage the transformer windings by too high temperatures ... Due to the increase of power flow after the power plant outage in the city, the protection tripped, because it decided that the flow was above the configured limit. The limit was correctly set – but a capacitor (worth a few Euro) was defect and the result was that the protection tripped the circuit breaker even at a current below the configured limit! It would be interesting to know how old the protection relay was.

Due to the aging of the hardware (capacitor) it happened in Hannover recently. What city or region will be next hit by the aging infrastructure of our electrical delivery system?

More to come.

More maintenance (as decided by the utility in Hannover) is not an anti-aging means – refurbishment of aged components of the infrastructures may help ... but costs a lot of money.

Click [HERE](#) for the press release of the enercity utility of Hannover [German only].

Click [HERE](#) for a discussion of aging infrastructures [German only]

Posted by [Karlheinz Schwarz](#) at [1:36 AM](#) [0 comments](#) 

Labels: [aging infrastructure](#), [electric power system](#), [outage](#), [protection](#)

[Newer Posts](#)

[Home](#)

[Older Posts](#)

Subscribe to: [Posts \(Atom\)](#)

News on IEC 61850 and related Standards

Daily news concerning the standards IEC 61850, IEC 61400-25, IEC 61970 (CIM), IEC 60870-5, ...

Monday, July 25, 2011

What Do You Need to Know to Retrieve Process Values from an IEC 61850 Compliant Device?

The answer is quite simple: Almost nothing! It depends – of course – on the availability of software for IEC 61850. Let's assume that we have a device that plays the role of an IEC 61850 server (providing a data model and services to access the values referenced by the model).

What you need is a software that plays the IEC 61850 client role. There are several options:

- Purchase source code and build your own client and API (Application Program Interface)
- Purchase source code and build your own client with an API already incorporated
- Purchase a client DLL with a simple and easy to use API
- Purchase a ready to go Browser with a graphical interface

If you want to just **retrieve some data values from a IEC 61850 compliant device**, you **JUST need to know the IP address of the device** and a free Browser evaluation software. Download the well known OMICRON IEDScout; the IEDScout runs in Demo mode for free (restricted services!):

Click [HERE](#) for more information and download link for the IEDScout.

Install the IEDScout, go to Configure (right), select New Server just by entering the below IP address and assign a server name:

SEL-421: 99.14.76.126

Use default values ... click on OK ... OK ... done. Go to Discover ... select the server you just configured ... and start communication with the corresponding device. Retrieving the information model may take several minutes! The IEDScout retrieves the model ... some thousand messages exchanged ... you may trace the messages using the Wireshark analyzer. Start the Wireshark first and then start IEDScout and connect to any IED.

Once you have the model retrieved, open the model tree and read a value in the tree or see DataSets and Control Blocks.

How long did it take to access data values from an IEC conformant device? 30 minutes ... may be 45. Maybe it took another 30 minutes to make it run on your Windows system ;-)

How many of the following standards have you read to get access to one of the above IEDs? IEC 61850-7-x, IEC 61850-8-1, ISO 9506-1/-2, ISO 8824, ISO 8825, IEEE 802.1Q, IETF RFC 792, ... 1.000, 2.000, or 5.000 pages?

To use a (graphical) interface at a client there was NO NEED to read any of the above standards! What you may need is basic information

Subscribe To IEC 61850 News

 Posts 

 All Comments 

Blog Archive

► 2012 (11)

▼ 2011 (159)

- December (5)
- November (11)
- October (22)
- September (11)
- August (11)

▼ July (23)

[Hannover \(Germany\)
Black Out Caused by
Aging Infra...](#)

[What Do You Need to
Know to Retrieve
Process Value...](#)

[What About Siemens
Simatic S7 and IEC
61850?](#)

[Siemens Energy Sold
more than 170.000 IEC
61850 IE...](#)

[IEC 61850 Hands-on
Training Course in Sao
Paulo \(B...](#)

[Another Discussion on IEC
61850 versus DNP3](#)

[High Level of
Interoperability of
Devices in the P...](#)

[Workshop IEC 61850 und
IEC 61400-25 für die
Energi...](#)

about IEC 61850.

Of course, this IEDScout is not an API to be used by client applications. You cannot store the retrieved data values ... ok, the full version allows to store the model as an SCL document ... and store subscribed GOOSE messages.

Another easy to use API is the SystemCorp API used to build a very simple client HMI – a .Net/C# application:

<http://blog.iec61850.com/2011/02/updated-c-client-application-for-iec.html>

The API (in form of a DLL) can be used to build your own client application in Windows (DLL) or in Linux (library).


Even the use of the DLL for the client and the use of the C# build HMI does not require to understand all details of the protocol.

Lesson 1 learned: To use the comprehensive protocols like IEC 61850, IEC 60870-5-105, IEC 60870-6 TASE.2, or DNP3 ... a simple and easy to use API is needed!! Reading thousands of pages of standards is NOT what is required!!

Lesson 2 learned: The efforts to use any of the above protocols is more or less the same! Of course there is a configuration language SCL in IEC 61850 that requires a little bit more information/education ...

Implementing the protocols requires a lot of time and efforts ... there may be some difference depending on the protocol.

Be happy by just applying simple and easy to use APIs for clients and servers. Get your first data values communicated within hours – not months ...

Posted by [Karlheinz Schwarz](#) at [10:22 PM](#) [0 comments](#) 

Labels: [API](#), [applications](#), [DLL](#), [DNP3](#), [IEC 60870-5-104](#), [IEC 60870-6](#), [IEC 61850](#), [implementation](#)

What About Siemens Simatic S7 and IEC 61850?

Siemens Energy has a wide range of IEC 61850 compliant IEDs. This is what the power utility market expects. But: Does Siemens' Simatic S7 also support IEC 61850? Yes, Siemens Industry offers a wide range IEC 61850 compliant solutions for Simatic S7 and PCS7; there are several solutions available:

- Client and server for SIMATIC PLCs S7-300, S7-400 and S7 meC.
- Client as WinCC Channel
- Client as DLL
- Gateway IEC 60870-5-104 to IEC 61850

Click [HERE](#) for more details including pricing and contact information [English]

[HIER](#) klicken für mehr Details, Preise und Kontaktinformation [Deutsch]

More to come in various other Siemens Industry products.

Posted by [Karlheinz Schwarz](#) at [9:17 PM](#) [0 comments](#) 

Labels: [IEC 61850](#), [PLC](#), [Siemens](#), [Simatic S7](#), [WinCC](#)

[Getting Started with SystemCorp's IEC 61850 API on...](#)

[FERC and the five IEC Standard Families](#)

[News from the IEC TC 57 Standardization Work](#)

[2,500 Experts Educated in IEC 61850 and other IEC ...](#)

[IEC 61850 in Papers at the CIRED 2011 Conference i...](#)

[The Parts of IEC 61850 – Status 2011-06](#)

[The first Commercial IEC 61850-9-2 Installation by...](#)

[Can IEC 61850-7-2 Edition 2 be used to build Agent...](#)

[Is IEC 61850 Plug&Play or like DNP4.0 or IEC 60870...](#)

[Basics of IEC 61850 Control Blocks and Communicati...](#)

[The four Keep-alives in IEC 61850](#)

[Use of IEC 61400-25 to secure access to key O&M da...](#)

[Wireshark Analyzer and IEC 61850 Messages \(MMS, GO...](#)

[Another Dissertation dealing with IEC 61850: Secur...](#)

[Dissertation on IEC 61850-9-2 Merging Unit](#)

► June (20)

► May (10)

► April (6)

► March (16)

Siemens Energy Sold more than 170,000 IEC 61850 IEDs

Siemens Energy reported yesterday that they have sold more than **170,000 Protection and Control IEDs compliant with IEC 61850** applied in substation automation systems.

Click [HERE](#) to read the press release.

Posted by [Karlheinz Schwarz](#) at [8:35 PM](#) [0 comments](#) 

Labels: [IEC 61850](#), [IED](#), [Siemens](#)

IEC 61850 Hands-on Training Course in Sao Paulo (Brazil) on 11.-14. October 2011 confirmed

The STRI/NettedAutomation hands-on training course scheduled for Sao Paulo (Brazil) on 11.-14. October 2011 is now confirmed. The registration is now open.

Click [HERE](#) for the Program and Registration information for attendees from Brazil.

Click [HERE](#) for the Program and Registration information for all other attendees.

The course will be conducted at Instronic: <http://www.instronic.com.br/>

Posted by [Karlheinz Schwarz](#) at [12:23 AM](#) [0 comments](#) 

Labels: [hands-on Training](#), [IEC 61850](#), [Training](#)

Sunday, July 24, 2011

Another Discussion on IEC 61850 versus DNP3

For more than a decade there are discussions on "IEC 61850 versus DNP3". I just saw a discussion which seems to be quite new.

These discussions happened in the field bus area for the last 20+ years – and still happen. They do not really help the industry. Hope we will not run into the same situation in the power utility domain as in the field bus war!

Click [HERE](#) for the full discussion. There are many aspects discussed in the paper ... I just want to discuss one issue raised:

Excerpt: "In addition, IEC 61850's major advantage—that holistic concept to solutions—is also a major disadvantage for training. It's different from the old system, requiring "a rather steep learning curve," Muschlitz said.

"Many people get depressed when the stack of 1,500 pages of IEC 61850 is put in front of them with the directive 'learn this,' " he said."

Hm? Why should somebody read 1,500 pages of general information and many technical details? Why? Any idea? For what reason?

Have you ever read the technical specification of the many RFCs for TCP and IP and the Ethernet standards? What most people need – in order to use these technologies – is to have a simple API (Application Programmer Interface) for their Application (e.g., Internet Browser).

The real challenge with IEC 61850 is, that – before you can exchange a

► [February](#) (16)

► [January](#) (8)

► [2010](#) (153)

► [2009](#) (162)

► [2008](#) (82)

Contributors

[Michael Schwarz](#)

[Karlheinz Schwarz](#)

single bit with a MMS message – you need the MMS server and MMS client **AND** a specific API (at least at the client side).

Why should you care about MMS and ASN.1? Just use the API and exchange your application data by reading, reporting, GOOSE, Logging, ... DON'T read the many parts of the standard!! The price of the standards will definitely be lower than the cost for reading AND understanding them!!

By the way, how many people that successfully use DNP3 have read and understood all parts of the DNP3 specification (xxx pages)?? I guess most do not have read all the docs – I would get depressed to do so as well ... and you?


One of the key issues is the availability of reasonable and easy to use APIs. See my discussion on an IEC 61850 API from the other day: Click [HERE](#).

If I would have to read and understand all specifications applied for an Airbus A380 in order to fly on it from Frankfurt to Johannesburg – I would never get there! I would better ride my bike ... ;-) ... but then there are the many bridges I have to go over ... and ferries ... to study first their specification and check if they are safe ... I better would stay at home.

Anyway, I have run many trainings on IEC 61850 – A one, two or three day training is much cheaper than buying, reading, and understanding all parts of the standard series. Reading and understanding may take several weeks and cause depressions.

Attending seminars prevents you from becoming depressed! Almost all people that attended our seminars were quite happy! Read what an attendee said: Click [HERE](#).

I wish you a stress-less application of IEC 61850 and other standards!! Good luck!!

Posted by [Karlheinz Schwarz](#) at [11:06 AM](#) [0 comments](#) 

Labels: [DNP3](#), [education](#), [IEC 61400-25](#), [IEC 61850](#), [seminar](#), [Training](#)

Friday, July 22, 2011

High Level of Interoperability of Devices in the Power Utility Domain

There are no (almost no) competing solutions in reaching interoperability of monitoring, protection and control devices in the various areas of the power delivery domain. There is no need for a (FERC, EU, ...) mandate for interoperability standards ... **we have already a high level of interoperability and acceptance of standard families like IEC 60870-6 IEC, IEC 61968/70, IEC 61850, IEC 61400-25, IEC 62351, ...** for the process and for the control center level in transmission, distribution, and generation.

Compare it with the international Field Bus standard IEC 61158 – there are little competing international standards for field busses!! YES!! BUT: There are some **60 solutions competing in ONE SINGLE standard: IEC 61158**. See:

<http://blog.iec61850.com/2008/10/iec-fieldbus-edition-2008.html>

Have you ever seen such a (non) standard? I have seen it when I took the photo of the stack on my desk in my office in 2008! ;-)

We could be very lucky in the power utility world!!

I am happy to read FERC's encouragement of "...utilities, smart grid product manufacturers, regulators, and other smart grid stakeholders to actively participate in the NIST interoperability framework process to **work on the development of interoperability standards and to refer to that process for guidance on smart grid standards.**"

Smart(er) grids need to be build on interoperable standards – Because there is one huge interconnected, interoperable application to be monitored, protected, and controlled: The interconnected power delivery system. The largest machine globally is the European interconnected system. So, interoperability (of the electric power system) is a key objective in the power world.

We need standards for IEDs that are as interoperable as a power generator (or inverter) from Alstom and a transformer from Siemens producing 400/230 V and 50 Hz and a hair dryer from GE that consumes 230 V and 50 Hz.

Electrical Engineers should understand the need of interoperability of IEDs. Just require the same for monitoring, protection and control IEDs.

Posted by [Karlheinz Schwarz](#) at [10:15 PM](#) [0 comments](#) 

Labels: [condition monitoring](#), [Critical Infrastructure Protection](#), [distribution automation](#), [electric power system](#), [fieldbus](#), [IEC 61158](#), [IEC 61400-25](#), [IEC 61850](#), [IEC 61968](#), [IEC 61970](#), [IEC 62351](#), [interoperability](#), [Power Automation](#), [Smart Grid](#), [standards](#)

Workshop IEC 61850 und IEC 61400-25 für die Energie-Versorgungssysteme der Zukunft

Nach dem erfolgreichen Workshop Anfang Juli 2011 bieten Beck IPC GmbH und NettedAutomation GmbH weitere eintägige Workshops zum Thema IEC 61850, IEC 61400-25 und IPC@CHIP® an:

30. September 2011	9:30 - 17:00	Deutsch *1
10. January 2012	9:30 - 17:00	English *2
11. Januar 2012	9:30 - 17:00	Deutsch *1

*1 Program siehe Link unten.

*2 Program in English will be provided soon.

Veranstaltungsort:

Beck IPC GmbH
35415 Pohlheim,
Grüninger Weg 24

Kosten: 399 € pro Teilnehmer

Die Schulung bietet eine Einführung in die Normenreihen und vermittelt die wichtigsten Schritte zur schnellen und kostengünstigen Implementierung von IEC 61850 und IEC 61400-25 konformen Geräten und Systemen basierend auf Beck-Komponenten und dem [SystemCorp API](#).

Hier [KLICKEN](#), um weitere Informationen und das Programm zu erhalten.

Posted by [Karlheinz Schwarz](#) at [12:38 PM](#) [0 comments](#) 

Labels: [Beck Chip](#), [embedded system](#), [IEC 61400-25](#), [IEC 61850](#), [implementation](#),

[Power Automation](#), [seminar](#), [Training](#)

Getting Started with SystemCorp's IEC 61850 API on Embedded Linux in Hours

Yesterday (July 21, 2011) I conducted a one day seminar and hands-on training for a German vendor that offers embedded controllers with embedded Linux. SystemCorp ported their IEC 61850 software including the easy to use API ([Application Program Interface](#)) onto the embedded Linux controller and provided a simple example for digital inputs and outputs. They shipped the controller with an IEC 61850 example to me to run some tests and demonstrate the solution to the vendor of the controller (in Northern Germany).

During the morning I presented IEC 61850 basics in modeling, engineering, configuration, and communication. My intention was: Help the programmers to understand basics of IEC 61850 and support them to enhance the simple application program example with an temperature measurement (STMP logical node) that provides random values. I provided the enhanced CID file with the extended model (STMP).

After lunch we set up the environment and all needed components. Then the C-Programmer started to understand the given simple application program and the API at about 14:00 h. Some three hours later the extended application was up and running and providing values through IEC 61850 messages – just 2 minutes before the general manager of the company joined our meeting!

We were able to use the new information (temperature) with the various IEC 61850 services like polling, reporting, ...

This exercise has again proven that Application programmers can learn the basics of IEC 61850 and write their own application software on the SystemCorp API within a few hours – instead of weeks and months.

The customer was very happy to reach such a challenging objective within a day – before summer vacation season starts!

The embedded Linux platform will be available within the next few months.

Please come by and check this blog – or simply subscribe to the blog (see above right corner).

Posted by [Karlheinz Schwarz](#) at 2:35 AM [0 comments](#) 

Labels: [API](#), [applications](#), [IEC 61850](#), [stack](#)

Wednesday, July 20, 2011

FERC and the five IEC Standard Families

FERC recommended in October 2010 to start a rulemaking process in order to mandate the five families (IEC 61968, IE 61970, IEC 60870-6 TASE.2, IEC 61850 and IEC 62351) for the North American market. For details click [HERE](#).

After many meetings and discussions FERC decided now to recommend these standards – but not to mandate them.

There are good reasons to keep the standardization process going and

not to stop the development of these standards and not to freeze the current content. As I always say: We are still at the very beginning of the development and application of these standards. Of course, the basic technology is defined and mature – but we all need more experience and feedback so that the standards can be improved and extended.

Adoption of any of these standard series mandated by a regulator could harm the whole process of adoption of these standards – because it could stop or blockade the needed maintenance of the standards.


At this time, the five standard families are still recommended by NIST and FERC for guidance in the development of smart(er) grid supporting technologies.

For the standards IEC 61850, IEC 61400-25, IEC 60870-6 TASE.2, and IEC 62351 there seems to be no discussion anymore if these standards will be adopted by the power utility market or not !! The market HAS ADOPTED these standards already. Even if a utility does not ask for IEC 61850 – it will get it! What else?

These standards don't need any rule making, don't need to become mandatory standards in the North American market. They are already THE GLOBALLY ACCEPTED AND USED STANDARDS!! The North American market is also about to adopt these standards. The wait for the rulemaking is over (for now) – these standards can and will be used in North America as in the rest of the world.

Note: There is NO competing solution for these standards on my radar screen at all – really.

Click [HERE](#) for the official order of FERC [Docket No. RM11-2-000] dated July 19, 2011.

Posted by [Karlheinz Schwarz](#) at 10:07 PM 0 comments 

Labels: [FERC](#), [IEC 60870-6](#), [IEC 61850](#), [IEC 61968](#), [IEC 61970](#), [IEC 62351](#), [Mandate](#), [NIST](#), [NIST Roadmap](#)

Tuesday, July 19, 2011

News from the IEC TC 57 Standardization Work

The following documents and New Work Proposals have been approved for final publication on 2011-07-15:

IEC 62351-8 TS Ed.1 [Approved Technical Specification]:
Power systems management and associated information exchange –
Data and communications security – Part 8: Role-based access control

IEC 61850-10-2 TS Ed.1 [Approved New project of Working Group 18]:
Communication networks and systems for power utility automation -
Part 10-2: Interoperability test for hydro equipments based on IEC 61850

IEC 62351-9 TS Ed.1 [Approved New project of Working Group 15]:
Power systems management and associated information exchange –
Data and communications security – Part 9: Cyber security key
management for power system equipment

The following draft documents have been provided for publication on 2011-07-15:

Draft IEC 61850-90-4 TR [WG 10 Document for Comments by 2011-09-02]

Communication networks and systems for power utility automation –
Part 90-4: Network engineering guidelines for substations

Draft IEC 61850-90-7 TR [WG 17 Document for Comments by 2011-09-02]

Communication networks and systems for power utility automation –
Part 90-7: IEC 61850 object models for photovoltaic, storage, and other DER inverters

IEC 61850 together with IEC 61400-25 and IEC 62351 provides a complete suite of standards for automation – even the title restricts the scope to power utility automation. This restriction is just toner on the paper! Almost all definitions in these standards can be used in many other domains. The communication stack (including object dictionary, ACSI, MMS, TCP/IP, Ethernet, ... most of SCL) are completely independent of the electrical world.

Posted by [Karlheinz Schwarz](#) at [10:31 PM](#) [0 comments](#) 

Labels: [IEC 61850-10-2](#), [IEC 61850-90-4](#), [IEC 61850-90-7](#), [IEC 62351](#), [inverters](#), [security](#)

2,500 Experts Educated in IEC 61850 and other IEC standards

Karlheinz Schwarz has trained 2,500 experts in IEC 61850, IEC 61400-25, ICCP/IEC 60870-6, IEC 60870-5-10x, DNP3, ISO 9506 MMS, ... by mid of July 2011. He conducted more than **130 courses** that run from **one to eleven days**. Attendees from more than **70 countries** followed the presentations by one of the most requested trainers in this domain.

One of the attendees thanked for what he got:

"It was a very useful seminar. Karlheinz Schwarz is highly qualified professional in the field. I must say that we got the information from first hands and he was able to answer every question almost at once and if not - knew where to look for the answer. It is great that we had such an opportunity to attend such a seminar.

If to compare this seminar with those provided by vendors I must state that vendors have a different approach – the approach that states that IEC 61850 standard is going to solve all the existing problems. And it is not like that at the moment. What is true here is that we need to have skills and a higher level of competence in the field – either way the standard is not going to bring benefits. It was mentioned by Karlheinz Schwarz during the seminar and it is right. It was very good to know about the existing problems. Nobody before mentioned about those things we should take care of to use the possibilities of IEC 61850 with the highest efficiency. And we can understand why the vendors do not talk about such things – because every need to acquire new knowledge and get the higher level of competence would require more investments from the utilities. It is important for the utilities to know about that."

The next public events are as follows:

Nashville (TN, USA)

20.-21. September 2011

Remote Conference

2 day Seminar (NettedAutomation) on Power System Communication covering IEC 61850, IEC 61400-25, DNP3, NIST Interoperability Roadmap, Smart Grids, ...

http://www.remotemagazine.com/rem-conf11/rem11_workshop.php

Frankfurt (Germany)

05.-07. October 2011.

3 day IEC 61850/61400-25 Seminar/Hands-on Training (NettedAutomation) with Measurement IED and free evaluation software (DLL etc. fully functional - free to take home).

<http://nettedautomation.com/seminars/uca/sem.html#standard>

Sao Paulo (Brazil)

11.-14. October 2011.

IEC 61850 Comprehensive & Independent Hands-on Training.

NettedAutomation/STRI.

www.nettedautomation.com/download/Sem/sp11/STRIA_Spec_IEC61850-hands-on-tr2011v2.pdf

Pohlheim (Germany, 60 km north of Frankfurt at Beck IPC)

30. September 2011 - 1 day workshop [German]

10. January 2012 - 1 day workshop [English]

11. January 2012 - 1 day workshop [German]

Schnelleinstieg in die Produktentwicklung IEC 61850 und IEC 61400-25 konformer Geräte. Fast Track introduction in IEC 61850 and development of standard conformant products.

Gothenburg (Sweden)

IEC 61850 Hands-on Training with Multivendor IEDs

19.-21. October 2011

<http://www.stri.se/index.pl?id=9332&isa=Category&op=show>

Posted by [Karlheinz Schwarz](#) at 11:44 AM 0 comments 

Labels: [Beck](#), [Beck Chip](#), [education](#), [IEC 60870-5-101](#), [IEC 60870-5-104](#), [IEC 60870-6](#), [IEC 61400-25](#), [IEC 61499](#), [IEC 61850](#), [seminar](#), [Training](#)

IEC 61850 in Papers at the CIRED 2011 Conference in Frankfurt (Germany)

One of the topics presented and discussed at the CIRED 2011 Conference in Frankfurt (Germany) was IEC 61850. 15 papers were about IEC 61850 with different objectives and scope.

You can freely access these papers from the CIRED website. Just click on the following links:

- [Minimum common IEC 61850 specification document published by the Spanish gr](#)
- [A Plug & Play concept for IEC 61850 in a Smart Grid](#)
- [A Study on the Application Method of IEC 61850 for Data Acquisition and Exc](#)
- [Compatibility of IEC61850 edition 1 and edition 2 implementations](#)
- [Configuring a IEC 61850 based standard Automation System for a standard Dis](#)
- [From Smart Substations to Smart Grid - How IEC 61850 can help making power](#)
- [Graphical specification for IEC 61850 based substation automation systems](#)
- [IEC 61850 Based Adaptive Distribution Protection](#)
- [IEC 61850 GOOSE over WIMAX for Fast Isolation and Restoration of Faults in](#)
- [IEC61850 9-2 Process Bus: Operational Experiences in a Real Environment](#)
- [IEC61850-BASED LOSS OF MAIN PROTECTION: THE MILANO WI-POWER PROJECT](#)
- [Toward an Auto-Configuration Process Leveraging The IEC 61850 Standard](#)
- [Benefits of converting conventional instrument transformer data](#)

[into Smart](#)

- [On-line condition monitoring and expert system for power transformers - Int](#)
- [Smart eVolution, simplicity and reliability in the MV distribution network](#)

There seems to be a lot of applications which people have not thought about some five or ten years ago.

One of the key needs seems to be all over to USE the standard for many applications in a **FAST TO MARKET** approach – instead of discussing one or the other protocol issues. The use of WIMAX applications demonstrates what we have said many times: the layered architecture of IEC 61850 can leverage the progress in communication systems. The same is true for 1 GBit/s Ethernet and time synchronization according to IEC 61588 (IEEE 1588).

The last two papers introduce IEC 61850 for condition monitoring – quite interesting and good examples for the application of IEC 61850 in power distribution.

The last but one paper from ABB (On-line condition monitoring ...) says:

“This new circuit breaker (CB) is a highly integrated device that combines measurement, protection and control capability with the primary power disconnection, switching and interruption technology. The CB embeds a protection and control Intelligent Electronic Device (IED) **designed to unleash the full potential of the IEC 61850 standard for communication and interoperability.** ...

Fast delivery

The high technology production line and component standardization enable to guarantee the **same delivery** time for the new CB series **as the standard** circuit breaker.”

Fast delivery means fast development. Embedded Controllers with IEC 61850 software already integrated into the platform could provide an easy to use and fast to go API (Application Program Interface). You can start right away with your application development – skip the IEC 61850 software integration that usually may take six to 12 months!!

The first small footprint embedded controller with an integrated IEC 61850 stack providing a simple API is the Beck IPC 61850@CHIP. There will be two other controllers running LINUX available soon that have the same IEC 61850 stack from SystemCorp and the same simple API.

Many IED vendors are already developing their HW and SW applying the Beck IPC Chip for various applications (protection, control, measurements, charging stations, ...).

Stay tuned to this Blog to get information on the two new powerful LINUX based embedded controllers with IEC 61850. Product announcements will be released this summer (2011). More to come.

Last but not least: There is still confusion what the Edition 1 and Edition 2 of IEC 61850 mean.

Click [HERE](#) to read what Edition 1 and Edition 2 means.

Posted by [Karlheinz Schwarz](#) at [6:02 AM](#) [0 comments](#) 

Labels: [Beck Chip](#), [condition monitoring](#), [distribution automation](#), [Edition 2](#), [Ethernet](#), [GOOSE](#), [IEC 61850](#), [IEC61850](#), [merging unit](#), [monitoring](#), [smart solution](#), [Synchrophasor](#), [time synchronization](#)

The Parts of IEC 61850 – Status 2011-06

The status (2011-07-15) of the various parts of IEC 61850 is as follows
(blue means: Edition 2 of the corresponding document):

System Aspects

- 1 Introduction and Overview
- 2 Glossary
- 3 General Requirements (EMC, ...)
- [4 System and Project Management](#)
- 5 Comm. Requirements for Functions and Device Models (reaction time ...)

Configuration

- [6 Configuration Language for electrical Substation IED's \(App., IEDs, System, ...\)](#)

Abstract Communication Services

- 7-1 Principles and Models
- [7-2 Abstract Communication Services \(ACSI\)](#)

Mapping to real Communication Networks (SCSM)

- [8-1 Mapping to MMS and ISO/IEC 8802-3](#)
- 9-2 Sampled Values over ISO/IEC 8802-3

Testing

- 10 Conformance Testing
- 10-2 Interoperability test for hydro equipments based on IEC 61850

Data Models und usage of models

- [7-3 Common Data Classes](#)
- [7-4 Compatible Logical Node and Data Classes](#)
- 7-410 Hydroelectric power plants
- 7-420 Distributed energy resources (DER)
- 7-5 Usage of information models SAS
- 7-500 Use of LN to model functions (SAS)
- 7-510 Use of LN (hydro power plants)
- 7-520 Use of LN (DER)
- 7-10 Web-based access to the IEC 61850 models

Use-cases and network infrastructure

- 80-1 Guideline ... CDC-based data model using IEC 60870-5-101 or IEC 60870-5-104
- 90-1 Using IEC 61850 for SS-SS communication
- 90-2 Using IEC 61850 for SS-CC communication
- 90-3 Using IEC 61850 for Condition Monitoring
- 90-4 Network Engineering Guidelines
- 90-5 Exchange of synchrophasor information
- 90-6 Use of IEC 61850 for Distribution Automation
- 90-7 Object Models for PV, Storage ... inverters, ...
- 90-8 Object Models for Electrical Transportation
- 90-9 Object Models for Batteries

The number of Information Models are:

- 7-3 Common Data Classes [40]
- 7-4 Compatible Logical Node / Data Classes [158 LN /982 DO]
- 7-410 Hydroelectric power plants [63/350]
- 7-420 Distributed energy resources (DER) [50/450]
- 90-3 Using IEC 61850 for Condition Monitoring [?]

90-5 Exchange of synchrophasor information [?]
90-6 Use of IEC 61850 for Distribution Automation [?]
90-7 Object Models for PV, Storage ... (important!) [5/50]
90-8 Object Models for Electrical Transportation [?]
90-9 Object Models for Batteries [?]
61400-25-2 Wind Turbines [16/250]

Posted by [Karlheinz Schwarz](#) at [1:02 AM](#) [0 comments](#) 

Labels: [asset management](#), [batteries](#), [communication](#), [distribution automation](#), [IEC 61850](#), [Information Model](#), [logical node](#)


Tuesday, July 12, 2011

The first Commercial IEC 61850-9-2 Installation by ABB

ABB is implementing the first commercial installation of IEC 61850-9-2 LE process-bus technology (exchanging sampled values), according to a publication from early 2011.

ABB: "Powerlink (Brisbane, Australia) awarded the contract for upgrading the first iPASS substation to ABB. This project represents the world's first commercial implementation of a process bus according to IEC 61850-9-2 LE. Its implementation is now well under way."

Click [HERE](#) for the complete 5 page ABB publication.
Click [HERE](#) for further information provided by Powerlink.

Posted by [Karlheinz Schwarz](#) at [11:01 AM](#) [1 comments](#) 

Labels: [ABB](#), [IEC 61850-9-2](#), [process bus](#), [sampled value](#)

Can IEC 61850-7-2 Edition 2 be used to build Agents?

There are more and more discussions on the question if IEC 61850 could be applied to build an Agent. Some understand this as IEC 61850 versus Agent.

What is an Agent? There are as many answers when you ask experts.

I found a very interesting definition of an (special) Agent on [Wikipedia](#):

"Monitoring and surveillance agents (also known as predictive agents) are a type of intelligent agent software that **observes and reports** on computer equipment. Monitoring and surveillance agents are often used **to monitor complex** computer networks to predict when a crash or some other defect may occur. Another type of monitoring and surveillance agent works on computer networks **keeping track of the configuration of each computer connected to the network**. It tracks and updates the central configuration database when anything on any computer changes, such as the number or type of disk drives. An important task in managing networks lies in prioritizing traffic and shaping bandwidth."

More generally [Wikipedia](#) provides a definition of an Agent:

"In computer science, a software agent is a piece of software that **acts for a user or other program**".

IEC 61850 can be used for many applications: **Protection and Control** in Substations, **SCADA, monitoring** any simple and complex computer based applications in the (power system) Automation or assets like

transformer, etc. This covers also network components like Ethernet Switches – there is work underway to model the **network management MIB onto Logical Nodes and DataObjects** and use the IEC 61850 services!. An IEC 61850 Server can **act for a Client** (and its User – a person or program). Crucial characteristics of Agents can be found in IEC 61850, too. You are not (yet) convinced!?

Let me point to the Edition 2 of IEC 61850-7-2 (ACSI) published in August 2010. What is new there? A lot great stuff for more secure systems!

Edition 1 had already the service model of Reporting and Logging observing (monitoring) **application information** like status or limit violations – allowing to send and log spontaneous events. There was also a possibility to monitor **attributes of the various control blocks** (Reporting, Logging, GOOSE, SMV); allowing to report or log the enable request of a control block. This last application has been extended in Edition 2 to **keeping track of all ACSI services**.

Edition 2 of IEC 61850-7-2 introduces the concept of the **Service tracking** in clause 14:

The reporting and logging functions of process and function related data objects as defined in Edition 1 of IEC 61850-7-x and IEC 61400-25-2 are extended in Edition 2 of IEC 61850-7-2 to **keep track of changes, event, or actions in the process related information** modeled as Logical Nodes and DataObjects. IEC 61850-7-2 Edition 2 provides the possibility to **keep track of all services**, even those with negative responses. The services are classified as follows:

- Control block related services
- Command related services
- Other services

IEC 61850-7-2 Edition 2 defines additional **specific common data classes** for each type of service to be reported or logged. For a given Server, a single data object instance (tracking data object) needs to be instantiated in the object model for each kind of service, that will mirror the value of the service parameters exchanged and its acceptance by the server. This allows that a service can be logged or reported to any client. This requires that the tracking data object is a member of the data-set referenced by a LCB, BRCB, or URCB.

The following additional Common Data Classes (CDC) are defined in IEC 61850-7-2 Edition 2:

- Common service tracking (CST)
- Buffered report Tracking Service (BTS)
- Unbuffered report Tracking Service (UTS)
- Log control block Tracking Service (LTS)
- GOOSE control block Tracking Service (GTS)
- MSVCB Tracking Service (MTS)
- USVCB Tracking Service (NTS)
- SGCB Tracking Service (STS)

The tracking of services could be used to record the “manipulation” of the process and the information exchange control block attributes, e.g., the settings of relays or other functions. The FERC CIP (Critical Infrastructure Protection) requires to keep logs (records) of many information changes. The reporting and logging of IEC 61850-7-2 and the extended common data classes could be used to implement such a “Recorder” or “Data Logger”.

IEC 61850 (IEC 61400-25) provides a reach suite of **service-oriented, event-driven or agent-oriented** application and information exchange models.

The answer of the question in the headline is simply: YES, IEC 61850 can.

Posted by [Karlheinz Schwarz](#) at [4:14 AM](#) [0 comments](#) 

Labels: [61850](#), [ACSI](#), [CIP](#), [IEC 61400-25](#), [IEC 61850](#), [IEC 61850 edition 2](#), [IEC 61850-7-2](#), [logging](#), [recording](#), [Reporting](#), [tracking](#)

Sunday, July 10, 2011

Is IEC 61850 Plug&Play or like DNP4.0 or IEC 60870-5-105?

There are many different expectations I heard from protection and control experts all over. Some people guess that IEC 61850 provides Plug&Play capabilities – meaning: Utilities just purchase IEC 61850 IEDs and (all in a sudden) their protection and control systems are up and running! There is a group of other people that expects that IEC 61850 is just another protocol – a bit more than today's solutions ... something like "DNP4.0" or "IEC 60870-5-105" [of course DNP4.0 and 105 are not real!].

IEC 61850 is **much more** than DNP3.0 and IEC 60870-5-104, and it does **NOT** provide Plug&Play. Building substation protection and control systems requires to **understand the applications** (the many protection and protection related requirements) and to **find a way how to apply IEC 61850 compliant IEDs and tools to solve their many needs**.

IEC 61850 is a **suite of tools** that can be used to solve application needs. How to use the tools and when, is NOT defined in the standard! Utilities have to find their (step by step) way to get started with IEC 61850 based solutions. It is important to get started – don't wait until IEC 61850 solves all your needs and problems. This will never happen!

Some US experts have discussed in 2005 or early 2006 what IEC 61850 provides and what needs to be done to apply the standard and standard based solutions. They show that IEC 61850 has an impact on many aspects in system design and deployment.

IEC 61850

A Practical Application Primer for Protection Engineers

Bogdan Kasztenny, James Whatley, Eric A. Udren, John Burger, Dale Finney, Mark Adamiak

Click [HERE](#) for the 43 page paper – worth to read.

My hope is that readers of the paper (hopefully readers from the utilities – or students finishing their education soon) understand that IEC 61850 requires **utility people that are well educated in IEC 61850** – in order **to understand what the big vendors have commissioned and how to use the various features of the new design**.

Today I received an email from one the international biggest transmission utilities asking for help in better understanding what is needed and what has been commissioned:

"Karlheinz, As you probably know, there are more and more digital substations in XXX, provided by XXX and XXX for the time being. Even if our contracts does not specify explicitly the use of 61850, they are based on this standard. Today, these substations can be viewed as black boxes, without really taking into consideration the advantages of new digital technologies. ..."

One of the crucial needs is: MORE EDUCATION FOR UTILITY EXPERTS!!

I have met many utility people that were responsible for the substations based on IEC 61850 – but DID NOT any clue how to use IEC 61850 build in functions.

IEC 61850 has a crucial impact on the WHOLE system and the engineers that build systems.

Finally, **SCADA applications** (to get status changes, limit violations, measurements, statistical information, historical information, ...) can apply IEC 61850 right away with commercially available Off-The-Shelf (COTS) solutions like the well appreciated Windows DLL for IEC 61850 (applicable for servers, clients, publishers, and subscribers).

Click [HERE](#) for a Windows DLL evaluation kit with an C# application example including source code of the client and server applications (that use the DLL).


Posted by [Karlheinz Schwarz](#) at [10:20 PM](#) [0 comments](#) 

Labels: [61850](#), [DNP3](#), [IEC 61400-25](#), [IEC 61850](#), [Migration](#), [peopleware](#), [protection](#), [RTU](#), [Training](#), [utilities](#), [workforce](#)

Basics of IEC 61850 Control Blocks and Communication

The standards IEC 61850 and IEC 61400-25 provide a reach suite of information exchange mechanisms. The basis of all exchanges are the information models (e.g., Logical Node "QE3XSWI1.Pos" that represent the real world information. The information models are shown on the right side of the following figure. DataObjects can be read at any time.

The next level on-top of the information models are the DataSets. A DataSet is a list of references to attributes of DataObjects (e.g., Pos). DataSets can be read – which is an optimization: instead of a list of references, there is only a single name to be provided (the DataSet name) for reading.

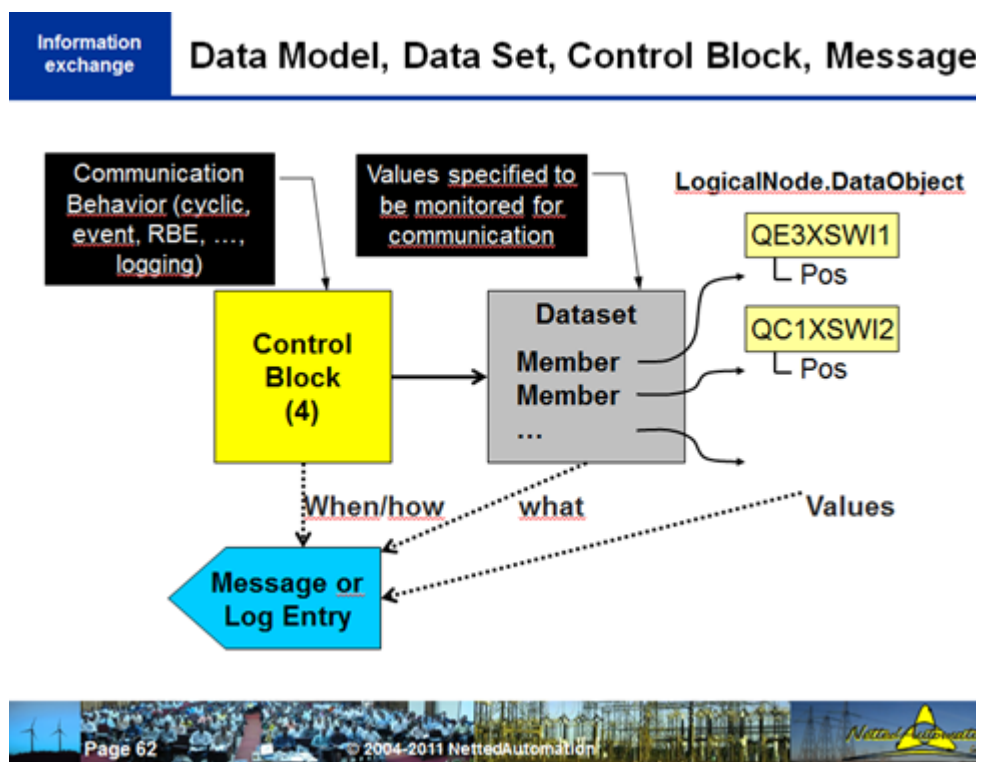

The third level are the Control Blocks (for reporting, Logging, GOOSE,

and Sampled Values). All three levels constrain the way how values are communicated.

Details are presented, discussed and trained in the hands-on trainings of NettedAutomation.

Note that all four control blocks provide appropriate services for SCADA, real-time control, and protections. Applications in distributed automation (for power distribution automation) are likely to require additional features (communication between hundreds of devices, ...).

One of the real crucial approaches is that the Data Objects are independent of the Data Sets, which are independent of Control Blocks. The SystemCorp IEC 61850 API provides almost everything discussed in this post! The API supports any Logical Node (standardized and extended!). The API runs smoothly on the BECK IPC 61850@CHIP.

If you want to know which of the above options you should apply, please let me know WHAT YOU NEED !!

Posted by [Karlheinz Schwarz](#) at [12:44 PM](#) [0 comments](#) 

Labels: [ACSI](#), [control block](#), [data set](#), [distribution automation](#), [GOOSE](#), [IEC 61400-25](#), [IEC 61850](#), [logging](#), [Reporting](#), [SystemCorp](#)

The four Keep-alives in IEC 61850

IEC 61850 uses several mechanisms to **monitor the communication** between two devices (Client/Server) or between a publisher and many subscribers and to **monitor functions – in order to increase the overall reliability of the information exchange**.

The four mechanisms allow to check connected devices and determine whether the connection and the devices are still up and running or not. Reactions on failures are a local matter of applications.


The two mechanisms for Client/Server are:

- Keep-alive in TCP connections (used by MMS) [RFC 1122]
- Reporting of Report Control Block attribute "IntgPd" [ACSI, 7-2]

The two mechanisms for Publisher/Subscriber (Layer 2 multicast) are:

- Time-Allowed-to-Live in GOOSE messages (next message in) [8-1]
- Sample Rate in SMV message (sampled measured value) [ACSI, 7-2]

The following figure shows how Integrity Period (communicated in a Report message) could be used to cyclically inform the client that the Reporting mechanism is up and running. Integrity Period is often used in cases where events happen very seldom and where the client wants to have a "heart beat" from the reporting server.

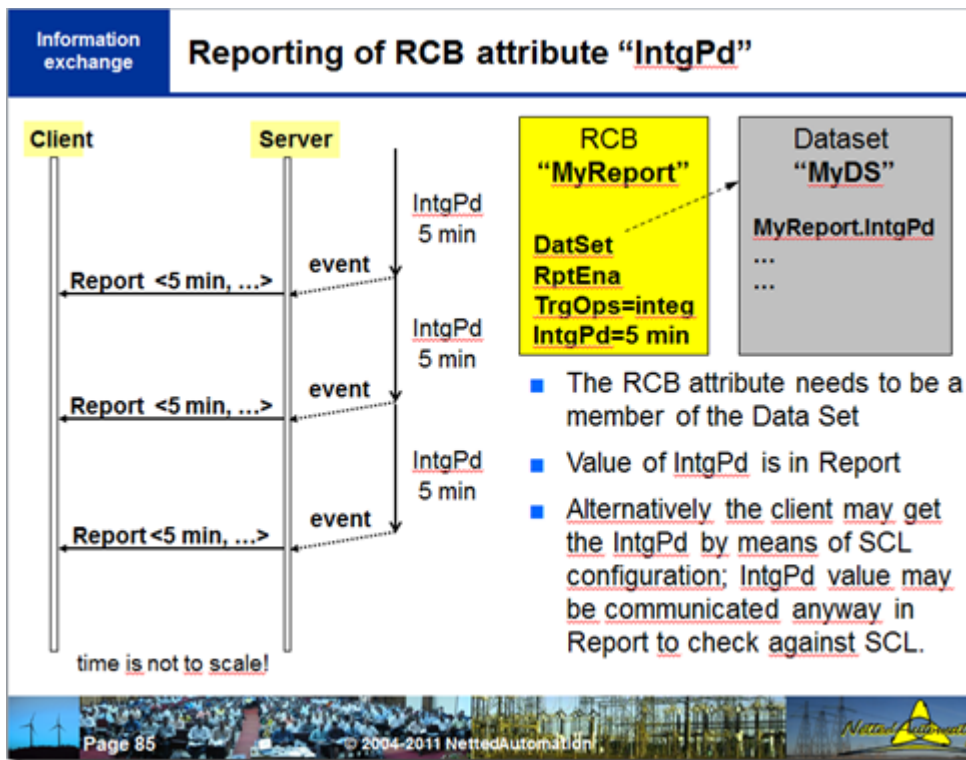

The configuration of the DataSet and the Report Control Block is usually provided by a SCL file. In the case of SystemCorp's IEC 61850 API it is easily be done by uploading the corresponding SCL File to the IED, e.g., the Beck IPC IEC61850@CHIP.

Click [HERE](#) to evaluate the "Keep-Alives" with Reporting and GOOSE and real software running under Windows.

Click [HERE](#) in case you are looking for education and training about the possibilities, philosophy, and details of IEC 61850 and IEC 61400-25.

I have educated more than 2.500 people from more than 60 countries and more than 600 companies. More to come ... see you soon.

Posted by [Karlheinz Schwarz](#) at 8:37 AM 0 comments

Labels: [61850](#), [communication](#), [hands-on Training](#), [IEC 61400-25](#), [IEC 61850](#), [Reporting](#), [sampled value](#), [seminar](#), [TCP/IP](#)

[Newer Posts](#)

[Home](#)

[Older Posts](#)

Subscribe to: [Posts \(Atom\)](#)

News on IEC 61850 and related Standards

Daily news concerning the standards IEC 61850, IEC 61400-25, IEC 61970 (CIM), IEC 60870-5, ...

Friday, July 8, 2011

Use of IEC 61400-25 to secure access to key O&M data

Vattenfall (one of the big European power utilities) plans to use IEC 61400-25 (an extension of IEC 61850) for operational and maintenance (service) applications.

Here is the conclusion of the paper:

"The IEC 61400-25 series of standards provides the means to get open and easy **access to key O&M data [operation and maintenance data]**. This data is a necessity for making the evaluations and analysis needed **to improve operation and maintenance of the wind power plants**. The paper has shown how the standard can be implemented and what benefits are associated with its use.

The standard does not restrict nor mandate specific customer-supplier roles, but provides a solution that supports the whole range of business cases where the different actors can cooperate. **Both the customer and the supplier can benefit from IEC 61400-25 through decreased costs for data access and system integration.** Time and money can instead be put on the development of applications, functions and methods that increase the performance of the wind turbines. Vattenfall considers standards such as IEC 61400-25 to be an important part in the development of the wind power business. The IEC 61400-25 series of standards is therefore part of Vattenfall technical requirements for future procurements."

The same is true for any other energy resource feeding electric energy into the grid – at any voltage level. The renewable resources and – more general – distributed energy resources (DER) are key for the future electric power delivery system. A government funded project in Germany (EUMONIS: Innovationsallianz zur Entwicklung einer Software- und Systemplattform für Energie- und Umweltmonitoringsysteme) is looking for accessing, storing and using information from the sheer unlimited number of power resources in the near future: PV, CHP, hydro, wind, flying wheels, ... One objective is to have information about the status and availability of the resource in a central database, in order to operate and maintain the "distributed Power Plant". This seems to be one of the crucial challenges in the years to come.

Click [HERE](#) to access the complete Vattenfall paper [pdf].
Click [HERE](#) for the website of EUMONIS [German].

Did you know that **IEC 61400-25 covers also Condition Monitoring** needs?

Wind turbines - Part 25-6: Communications for monitoring and control of wind power plants - Logical node classes and data classes for condition monitoring

Click [HERE](#) for the preview of part IEC 61400-25-6

Posted by [Karlheinz Schwarz](#) at [10:41 PM](#) [0 comments](#) 

Subscribe To IEC 61850 News

 Posts 

 All Comments 

Blog Archive

► [2012](#) (11)

▼ [2011](#) (159)

► [December](#) (5)

► [November](#) (11)

► [October](#) (22)

► [September](#) (11)

► [August](#) (11)

▼ [July](#) (23)

[Hannover \(Germany\)
Black Out Caused by
Aging Infra...](#)

[What Do You Need to
Know to Retrieve
Process Value...](#)

[What About Siemens
Simatic S7 and IEC
61850?](#)

[Siemens Energy Sold
more than 170.000 IEC
61850 IE...](#)

[IEC 61850 Hands-on
Training Course in Sao
Paulo \(B...](#)

[Another Discussion on IEC
61850 versus DNP3](#)

[High Level of
Interoperability of
Devices in the P...](#)

[Workshop IEC 61850 und
IEC 61400-25 für die
Energi...](#)


Labels: [condition monitoring](#), [electric power system](#), [IEC 61400-25](#), [IEC 61400-25-6](#), [IEC 61850](#), [maintenance](#), [Power Automation](#), [Power Plants](#), [Vattenfall](#), [wind power](#)

Thursday, July 7, 2011

Wireshark Analyzer and IEC 61850 Messages (MMS, GOOSE, SAV)

When you use Wireshark (I run Version 1.6.0) you may have had a problem to see GOOSE and MMS messages. There is a simple solution how to visualize the MMS and GOOSE messages:

You have to start the Wireshark first, start analyzing and THEN connect from a IEC 61850 client to a server to open a MMS association. Now you see the messages ... strange but it works ... as you can see:

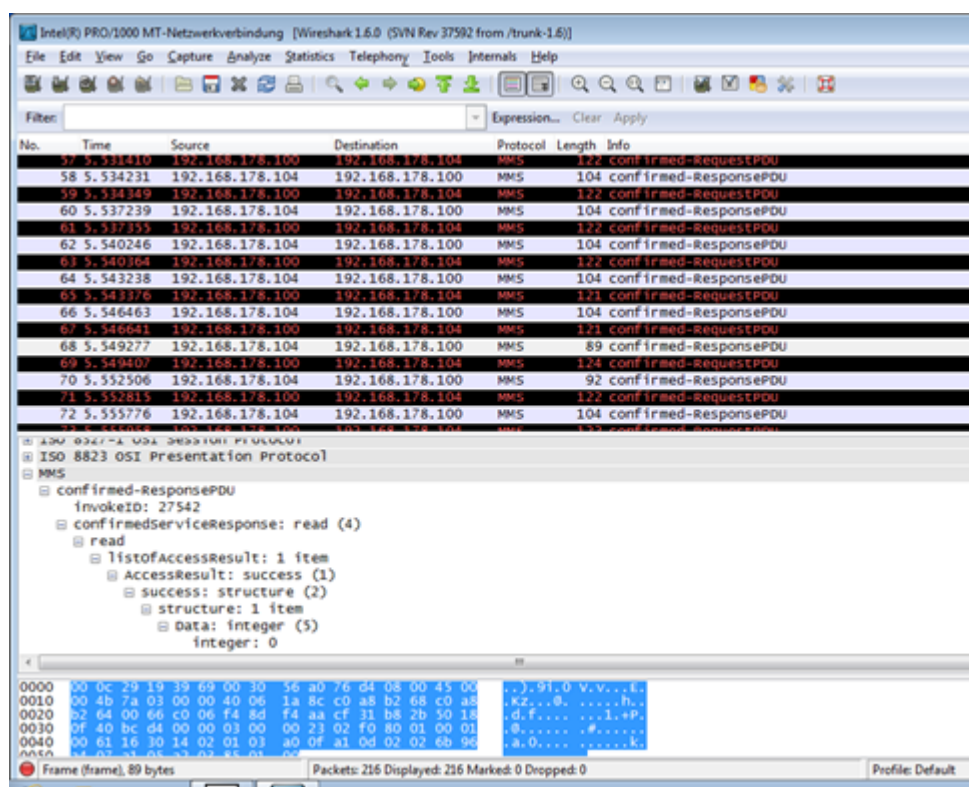

Posted by [Karlheinz Schwarz](#) at 5:09 AM 2 comments

Labels: [61850](#), [Encoding](#), [GOOSE](#), [IEC 61850](#), [MMS](#), [network analyzer](#), [wireshark](#)

Monday, July 4, 2011

Another Dissertation dealing with IEC 61850: Secure Multicast

JIANQING ZHANG has analyzed the multicast services in power system communications. His dissertation discusses one of the crucial issues in distributed power automation. He "proposes an application-aware approach to setting up secure multicast for power grid communications that automatically derives group memberships and verifies configuration conformance from data dependencies in system specifications ... To evaluate the approach, we present a case study of IEC 61850 power substation networks and have developed a demo system, SecureSCL. ..."

Click [HERE](#) for the dissertation.

[Getting Started with SystemCorp's IEC 61850 API on...](#)

[FERC and the five IEC Standard Families](#)

[News from the IEC TC 57 Standardization Work](#)

[2,500 Experts Educated in IEC 61850 and other IEC ...](#)

[IEC 61850 in Papers at the CIRED 2011 Conference i...](#)

[The Parts of IEC 61850 – Status 2011-06](#)

[The first Commercial IEC 61850-9-2 Installation by...](#)

[Can IEC 61850-7-2 Edition 2 be used to build Agent...](#)

[Is IEC 61850 Plug&Play or like DNP4.0 or IEC 60870...](#)

[Basics of IEC 61850 Control Blocks and Communicati...](#)

[The four Keep-alives in IEC 61850](#)

[Use of IEC 61400-25 to secure access to key O&M da...](#)

[Wireshark Analyzer and IEC 61850 Messages \(MMS, GO...](#)

[Another Dissertation dealing with IEC 61850: Secur...](#)

[Dissertation on IEC 61850-9-2 Merging Unit](#)

- June (20)
- May (10)
- April (6)
- March (16)

More to come ...

Posted by [Karlheinz Schwarz](#) at [1:06 PM](#) [0 comments](#) 

Labels: [GOOSE](#), [IEC 61850](#), [Multicast](#), [real-time](#)

Dissertation on IEC 61850-9-2 Merging Unit

Marcin Adam Gurbiel received her Dr.-Ing. (PhD) with the Dissertation on "Definition and Testing of a Digital Interface of a Power Substation". Her findings are quite interesting. She writes in the summary: "... it is possible to apply the common information exchange protocol based on IEC 61850 to the process level of the substation automation system by implementing a digital interface or so called "Merging Unit".

ISSN 16-12-2526

ISBN 978-3-940961-54-9

Click [HERE](#) for some interesting results of her work.

Posted by [Karlheinz Schwarz](#) at [2:42 AM](#) [4 comments](#) 

Labels: [61850](#), [IEC 61850](#), [IEC 61850-9-2](#), [merging unit](#)

Friday, June 24, 2011

E3 Group for Studies on IEC 61850 Went Public

I have reported earlier on the very appreciated "Teamwork" of Spanish utilities in working together to reach a higher level of interoperability in IEC 61850 multivendor projects.

Their objective is (from their website):

- Share information among companies and walk together through IEC 61850
- Generate a minimum common specification (available for download at the [Documents](#) page) of an IEC 61850 substation automation system (SAS) that should be valid for the companies in the group
- Lead the technological gap between now-available IEC 61850 systems and the desired final picture
- Improve efficiency and optimise IEC 61850 deployment

The E3 group went public:

Click [HERE](#) for their group Website.

Posted by [Karlheinz Schwarz](#) at [2:02 PM](#) [0 comments](#) 

Labels: [E3](#), [education](#), [IEC 61850](#), [interoperability](#), [peopleware](#), [Power Automation](#), [power systems](#), [Smart Grid](#), [utilities](#)

Thursday, June 23, 2011

Mapping IEC 61850 on Web Services

Just a few hours after my post on

► [February](#) (16)

► [January](#) (8)

► [2010](#) (153)

► [2009](#) (162)

► [2008](#) (82)

Contributors

[Karlheinz Schwarz](#)

[Michael Schwarz](#)

Message Specification and Encoding – A Never Ending Story

earlier today I received an email with a very interesting contribution on the mapping of IEC 61850 on Web Services from my friend Wolfgang Maerz (Dortmund/Germany). Wolfgang is one of the few senior utility experts involved in IEC TC 57 – even after he retired from RWE many years ago, he is still very active in IEC TC 57 standardization work. He has implemented protocols on his own ... to study the details! He “hired” me as a consultant in the early nineties to support IEC 60870-6 (ICCP) and later IEC 61850.

Please find his very detailed contribution on the Web Service mapping (I post this information with his permission):

“Here are some fundamentals to IEC 61850 over MMS versus IEC 61850 over Web Services:

As I wrote in my last email Web Services is a strongly typed communication system using a WSDL (Web Service Definition Language) XML type and service specification for mainly two purposes: (1) check the correct syntax of XML-messages, (2) allow the creation of the SEI (Service Endpoint Interface) including the binding (or mapping) of XML to the application business object types of any language (Java, C#, ..).

Fundamental of Web Services is the strict separation of XML message values and their XML type schema which is part of the type declaration of the WSDL implemented at both sides of the communication system using document / literal style. This means that for Web Services the types of communicated values must be known “before” any communication takes place by its WSDL.

The problem is that some services of IEC 61850 are of dynamic nature as shown by the example of the 61850 Report-Control-Block (RCB) class model. The report service of the RCB sends reports from the server to the client based on the dynamic structure of the Report Format Specification to allow spontaneous transmission of altered event-driven objects of any type. The receiving application to decode this dynamically created type must know this type!

This cannot be mapped to static WSDL specifications. Possible would be a WSDL with a sequence of choice types as in MMS but a possible implementation is not known and is even conceptual impossible. Of course you can use any-type in the WSDL and use Web Services as a simple type transparent messaging service but that only moves the problem with no communication interface as SEI directly to the application.

So, what is then the fundamental difference between IEC 61850 over MMS and IEC 61850 over Web Services when it comes to dynamically created types? The point is the encoding!

MMS is written in ASN.1 using the Basic Encoding Rules (BER). With BER, the encoding of every data value in an abstract syntax is constructed in TLV-style (Tag, Length, Value): The three parts here are actually termed identifier (I), length (L) and contents (C). The important thing to mention here is the identifier part which consists of one single octet with three parts: tag class (2 bit for universal, application-wide, context-specific, private-use), form (1 bit for primitive or constructed), and INCLUDES the tag number defining the type (5 bit, e.g. decimal 16 means type Integer)!

THAT MEANS:

With MMS / BER the type information is INCLUDED in the message and allows the client / server to even understand dynamical event-driven or service created messages of any type not even known before runtime!

This is in contrast with Web Services / WSDL where the type of XML-message values is defined separately BEFORE runtime in the WSDL's XML type and service definition used to implement the (static) SEI (Service Endpoint Interface).

If all this is true this would mean that IEC 61850 over Web Services would be restricted to a specific domain or to certain use cases with reduced requirements where only a subset of IEC 61850 can be used. Most think Web Services is simple compared with MMS, I do not think so."

Comments are welcome.

Posted by [Karlheinz Schwarz](#) at [7:50 AM](#) [1 comments](#) 

Labels: [Encoding](#), [IEC 61850](#), [MMS](#), [Web Service](#), [webservice](#), [XML](#)

IEC 61850, IEC 61400-25 and DNP3 at Remote Conference


2 day Seminar (NettedAutomation) on Power System Automation, Configuration, and Communication covering IEC 61850, IEC 61400-25, DNP3, NIST Interoperability Roadmap, Smart Grids, ...

Nashville (TN, USA) at Remote Conference

20.-21. September 2011

Click [HERE](#) for more detail and registration information.

Become smart before your system will become smarter!

Posted by [Karlheinz Schwarz](#) at [6:55 AM](#) [0 comments](#) 

Labels: [Backnet](#), [DER](#), [distribution automation](#), [DNP3](#), [electric power system](#), [embedded system](#), [engineering](#), [Gateway](#), [GOOSE](#), [IEC 61400-25](#), [IEC 61850](#), [interoperability](#), [power distribution](#), [power systems](#), [RTU](#), [seminar](#), [Smart Grid](#), [Substation Automation](#)

Message Specification and Encoding – A Never Ending Story

Some 30 years ago I started studying digital communication like IEEE 802.4 (Token Passing) and IEC 802.3 (Ethernet) when I worked for Siemens. The "war" between the Token Passing supporters and the Ethernet friends caused a lot of struggle and generated many solutions to find a common way for information exchange in automation systems. One of the approaches was to make Ethernet deterministic. I invented a simple algorithm that used the three states of the transmission line: no-carrier, carrier and collision. The solution allowed a semi-deterministic behavior of Ethernet ... the solution was patented in 1985.

Click [HERE](#) for the European Patent EP 0110015.

Unfortunately Siemens did not implement the patent – the direction was towards Token Passing

The international project MAP (Manufacturing Application Protocols) preferred Token Passing ... then fieldbusses arrived ... MAP opened the way for Ethernet – too late (or too early).

Ethernet "came" back some 10 years later, when it was obvious that

traditional fieldbusses were quite limited in many aspects. Today Ethernet is the preferred solution in automation systems (industrial and power domain). Switched Ethernet has ended – to some extent – the wars on Data Link Layer solutions.

The communication wars for crucial automation domains are still ongoing! There are two issues discussed again and again: the approach of services and message encoding. What services are required (Get, Set, Event reporting, Event logging, Control, ...) and what is the best message encoding method (abstract/concrete, XML schema, ASN.1, XML encoding or binary encoding like ASN.1 BER)?

The questions that are most crucial: What should be carried in a message? How many implicit or explicit content is needed to be carried in each message? How often has a message be sent/repeated? ... and many other questions have a huge impact on the SYSTEM behavior. The focus should be on the **SYSTEM** and not on the encoding or message schema.

The most efficient encoding is to send an empty message! Really!

Click [HERE](#) for the story about a very efficient message.

It is quite interesting that old standards like Ethernet, TCP/IP and MMS have survived – even they are not the most efficient ways to communicate!

Why are they so successful – even in the electric power automation world, which is one of the most conservative markets? These standards are open and accepted globally!

I hope that the developer and users of automation systems will focus on the APPLICATION and SYSTEM ASPECTS – and not on communication layers 1 to 7!! The systems and applications based on open international standards will help to keep the power – more efficiently – flowing. IEC 61850 is one of the most crucial open standard.

The fastest way to get your information flowing with IEC 61850 information models, services and messages is: Develop your application using a simple IEC 61850 API. I have trained many experts in how to use IEC 61850 and a simple API to solve their APPLICATION needs!

Click [HERE](#) to evaluate such a simple API.

The power industry is short of experts – hope the remaining resources will focus on the applications and not on questions like: How can we optimize the message encoding, how can we save bits on the wire, ... ?

Focus on the Applications!

Posted by [Karlheinz Schwarz](#) at [5:17 AM](#) [0 comments](#) 

Tuesday, June 21, 2011

IEC 61850-8-1 Edition 2 Published

IEC 61850-8-1 Edition 2 has been published (English/French):

Communication networks and systems for power utility automation - Part 8-1: Specific communication service mapping (SCSM) - Mappings to MMS (ISO 9506-1 and ISO 9506-2) and to ISO/IEC 8802-3

Click [HERE](#) for a Preview of IEC 61850-8-1.

Other parts with status Edition 2:


[Preview Part 4 Edition 2](#)

[Preview Part 6 Edition 2](#)

[Preview Part 7-2 Edition 2](#)

[Preview Part 7-3 Edition 2](#)

[Preview Part 7-4 Edition 2](#)

Posted by [Karlheinz Schwarz](#) at [11:52 AM](#) [0 comments](#) 

Labels: [61850](#), [GOOSE](#), [IEC 61850](#), [IEC 61850 edition 2](#), [IEC 61850-8-1](#), [MMS](#)

Monday, June 20, 2011

What is a Stack?

The term **Stack** has many meanings, flavors, ... ask 10 experts and you may get 11 definitions. People talk about an IEC 61850 stack, an OPC UA stack, What do these mean? Are they comparable?

Let's start with the general definition:

According to the [Wikipedia](#): "The protocol **stack** is an **implementation** of a computer networking **protocol suite**. The terms are often used interchangeably. Strictly speaking, the suite is the definition of the protocols, and the **stack is the software implementation of them.**"

So, the **software that processes the protocols** is called the (protocol) **stack**.

With regards to IEC 61850 this can mean many things: Session, Presentation, ACSE, MMS, ACSI, MMS-SCSM, Model management and configuration language, API to the application, ... let's have a look at the server side of the communication:

	"Protocol" aspects	Remarks and Explanations
1	API to application	Control of Server SW, local services for write, events, control, ... "Protocol" that defines how the application can communicate with the underlying IEC 61850 software
2	Models, model management and model and ACSI configuration language	Describe the server's information model binding to application (LDs, LNs, DO, ...). Be aware that LNs have also services protocols (see below for LN GLOG). The information models have to be organized in the IED's software (including retrieving self-description of the model)
3	ACSI (Abstract Communication Service Interface)	The (protocol) software has to implement services Association control, retrieve self-description (Server, Client, Publisher, Subscriber, LD, LN, DO, DA, ControlBlock ...), Get, Set, DataSet services, Report (events), Logging (events; historian), Sampled Values, Control, File services, synchronization, ... The implementation of the protocols that define the dynamical behavior of the stack are one of the crucial parts of IEC 61850

4	MMS SCSM	The ACSI services use MMS to carry the payload between client and server. MMS provides the serialization of (service) messages. Example: A Buffered Report Control Block requires a bit of a software!
5	MMS	Simple classes like NamedVariables, NamedDataSets, Journal, ... Messages (encoding using ASN.1)
6	ACSE	Kind of a remote procedure call
7	Presentation	Concrete encoding: ASN.1 BER
8	Session	Session between client and server
9	RFC 1006	Binding OSI upper layers to TCP
10	Security	Security according to IEC 62351 ... TLS
11	TCP/IP	you know ...!!
12	Lower layers	...

Note: GOOSE and Sampled Value messages are mapped directly to Ethernet!

What is the Logical Node **GLOG**? An application or a model with services and protocol (messages)? **The GLOG is a standardized application that defines a model, services and a protocol!** Guess you did not expect this ... others may not agree with me ...

IEC 61850-7-4 Edition 2 defines:

"5.7.4 LN: Generic log Name: GLOG

The LN GLOG refers to a **function** which **allows to log** not only changed data itself but also **any related data** being defined in the settings of LN GLOG. The logging is **started** by the **changed data object (TrgRef1) or by the operator (LogTrg)**. The **logged data are identified by the references** to the related source data objects in the data model." This in short the state machine of the GLOG service model and protocol (in abstract terms). The GLOG communicates with a client via services and a protocol ...

The logged Data Values will be stored in an IEC 61850 Log ... it can be queried by services from a client.

Let's come back to our question, what is implemented in a stack?

Stacks from different vendors may be for free, may be reasonable priced, or may be expensive! What does this mean? Almost nothing! Because the CRUCIAL question is: **WHAT would you get for your Euros or Dollars?**

A stack of vendor X may cover the implementation described under bullets 1, 2, 3, 4, 5, 6, 7, 8, 9, and 10.

A stack of vendor Y may cover only 5, 6, 7, 8, 9, and 10.


The difference is tremendous: The efforts to implement the requirements listed in bullets 1, 2, 3, and 4 are (to my experience) **likely more than 90 ... 95 per cent** of what needs to be implemented with regard to IEC 61850!

If you hear something like **"the stack so-and-so is cheaper ..."** **listen twice** and then **think about what you have heard three times** and **ask what that stack really provides four times AND ASK PEOPLE WITH EXPERIENCES WHAT IS LEFT FOR YOU TO DO** to get a compliant IED !!! I have talked to many experts that were surprised that it took sooo long ... and cost sooooo ... much to get a compliant IED.

When it comes to the comparison of OPC UA and IEC 61850: Listen very carefully, and ask questions ... and then ... and then you may understand the difference from a standard and from an implementation point of view.

Click [HERE](#) if you want to experience what could be provided by a specific stack providing integrated software for issues 1 to 10 ... with little left for you [German].

A workshop in English may be set up when you are interested ... let Beck IPC know that you would attend a workshop in English.

Posted by [Karlheinz Schwarz](#) at [11:56 AM](#) [0 comments](#) 

Labels: [applications](#), [ASN.1](#), [Automation](#), [BER](#), [communication](#), [configuration](#), [cost saving](#), [DER](#), [electric power system](#), [engineering](#), [GOOSE](#), [IEC 61850](#), [implementation](#), [Information Model](#), [interoperability](#), [MMS](#), [OPC UA](#), [Power Automation](#), [TASE.2](#), [webservice](#)

Sunday, June 19, 2011

Open Position for Protection Engineer with IEC 61850 Knowledge at Stadtwerke München

Stadtwerke München (Germany) has an open position for planning of substation automation and protection as well as telecontrol ... experiences in IEC 61850 and IEC 60870-101/104 are required.

Click [HERE](#) for the job description [German].

Posted by [Karlheinz Schwarz](#) at [5:35 AM](#) [0 comments](#) 

Labels: [61850](#), [Automation](#), [communication](#), [Fernwirktechnik](#), [IEC 60870-5-101](#), [IEC 60870-5-104](#), [IEC 61850](#), [Power Automation](#), [Stationslettechnik](#), [Substation Automation](#)

Saturday, June 18, 2011

Open Position for Development Engineer with IEC 61850 Knowledge at Phoenix Contact

Phoenix Contact (Bad Pyrmont, Germany) has an open position for a Development Engineer for applications in embedded systems. If you have knowledge in programming embedded platforms, in substation automation, in IEC 61850 ... you may be the right person for that job.

Click [HERE](#) for the job description Job-ID: 1145 [German]

Posted by [Karlheinz Schwarz](#) at [10:01 PM](#) [0 comments](#) 

Labels: [61850](#), [Automation](#), [distribution automation](#), [electric power system](#), [embedded system](#), [IEC 61850](#), [implementation](#), [Phoenix Contact](#), [Power Automation](#), [Substation Automation](#)

Friday, June 17, 2011

Network Rail (UK) to improve reliability and cutting cost with IEC 61850

The Head of Electrification of Network Rail (UK) talks about the benefits of applying IEC 61850 for the electrification the other day. Please find an excerpt below:


"Ah, indeed. I'm personally really excited about this [IEC 61850] because I think it **represents a huge step forward.**" followed by statements like:

"IPC 61850 allows us to distribute the power – still enabling us to switch – but limiting the number of fault breaking devices we need. This has two benefits. The first is that this **makes the switching less costly.**"

"But the second benefit is that we will no longer have to compromise between the electrical distribution needs of the system and the railway operations needs of the train operating people."

"It will enable us to think very carefully about using switching to focus on achieving **better reliability** for the operators while still maintaining that essential feature of distributing power ... all at what looks to be at a **considerable saving.**"

Click [HERE](#) to read the interview.

Posted by [Karlheinz Schwarz](#) at [12:43 AM](#) [0 comments](#) 

Labels: [61850](#), [cost saving](#), [IEC 61850](#), [power distribution](#), [Smart Grid](#)

Tuesday, June 14, 2011

Schnelleinstieg in die Produktentwicklung IEC 61850 und IEC 61400-25 konformer Geräte

Beck IPC (Pohlheim bei Gießen) bietet eine eintägige Schulung für den Schnelleinstieg in die Produktentwicklung von Geräten mit einer Schnittstelle nach IEC 61850 und IEC 61400-25 an. Neben einer konzentrierten Einführung in IEC 61850 und IEC 1400-25 lernen die Teilnehmer, wie sie während kurzer Zeit (Stunden anstatt Wochen!) die Normenreihen integrieren und sich auf die Implementierung ihrer Anwendungen konzentrieren können.

Mit den Beck IPC Lösungen gelingt der schnelle Einstieg in IEC 61850 und IEC 61400-25.

Die Schulung findet am 05. Juli 2011 statt.

Klicken Sie [HIER](#) für weitere Details.

Posted by [Karlheinz Schwarz](#) at [4:56 AM](#) [0 comments](#)

Labels: [Beck](#), [Beck Chip](#), [IEC 61400-25](#), [IEC 61850](#), [seminar](#), [stack](#), [starter kit](#), [Training](#)

Monday, June 13, 2011

White House Policy Framework for 21st Century Grid

The White House has published today "A Policy Framework for the 21st Century Grid: Enabling Our Secure Energy Future".

"The report delineates four overarching pillars that the Administration will pursue in order to ensure that all Americans benefit from investments in the Nation's electric infrastructure. These pillars describe how we can move forward to secure benefits of a smarter grid:

1. "Scale what works" to enable cost-effective smart grid investments
2. Unlock the innovation potential in the electricity sector with a **continued focus on open standards**
3. Empower consumers with education, access to their own energy usage information in consumer- and computer- friendly formats, and improved privacy safeguards and consumer protections
4. Continue to secure the grid against natural or other disasters."

Click [HERE](#) to download the report [PDF].

The speakers of the event "**Building the 21st Century Grid**" focused on the need to change the way how we generate, transport, store, distribute, and use electric power. There is a high potential for convert to a more efficient electric power system. One key player in this regard is to **apply open standards**.

Secretary Mr Chu (DoE) said: "We have no authority ..." to force the market to do this or that ... all the Government can do is keep the R&D and discussions going on – and expect that the most efficient solutions (on how to generate, transport, store, distribute, and use electric power) will win the battle.

Several global "winners" are already known: Standards published by IEC TC 57 and TC 88 like IEC 61968/61970 CIM, IEC 60870-6 ICCP, IEC 62351 on Security, IEC 61850 on utility automation, and IEC 61400-25 on Wind Turbine Communication. These "standards will [according to the report] **not be mandatory**. In short, regulators should publicly **embrace the interoperability standards with the understanding that they will continue to develop** with the ongoing evolution in smart grid technology ..." [page 29].

In some cases the continuation of development will be very slow, e.g., in ICCP. While other standards, like the information models in CIM and IEC 61850 will continue to grow while we go. The technology will not be frozen (it cannot stop to develop)! That's good news!!

One of the crucial aspects is that NIST and the DoE do obviously not expect that myriads of competing (de jure) standards should be embraced! ... like in other industries.

Today is a good day for the standardization efforts!

Keep going!

I hope that the power industry will now stop discussing protocols ... and start or continue to focus on APPLICATIONS using these standards. The standards are just a vehicle or a tool box. Meters, models and protocols

do not make a Grid Smart! It is the Smart People that will use the standards and build many applications using them!

Posted by [Karlheinz Schwarz](#) at [1:10 PM](#) [0 comments](#) 

Labels: [61850](#), [cost saving](#), [Cyber Security](#), [DER](#), [distribution automation](#), [IEC 60870-6](#), [IEC 61850](#), [IEC 61968](#), [IEC 61970](#), [IEC 62351](#), [interoperability](#), [NIST Roadmap](#), [Smart Grid](#), [smart solution](#), [TASE.2](#), [TASE.2 ICCP](#), [wind power](#)

Sunday, June 12, 2011

Building the 21st Century Grid – The White House reports today

On June 13, 2011, the White House will hold an event on **"Building the 21st Century Grid."** Starting at 10 a.m., the event can be watched live at <http://www.whitehouse.gov/live>.

Federal Smart Grid Initiatives highlights key government-sponsored programs and activities related to the development and modernization of the electric grid in the United States.

One of the four pillars of the future grid is:


Unlock the innovation potential in the electricity sector with a continued focus on **open standards**.

I hope that the electric power industry will follow a few open standards instead of a myriad of solutions. Could you imagine a situation where each state or county would have a different frequency and voltage of the electric system!??

There are two main standards: 230V/50Hz and 110V/60Hz ... but there should be one standard to exchange information (measurements and statuses, ...). The MMXU (a measurement model of 3 phase electrical system defined in the open standard IEC 61850-7-4) could be used for any kind of 3 phase system.

Click [HERE](#) for some more models.

If you are interested you may watch the event today.

Posted by [Karlheinz Schwarz](#) at [10:49 PM](#) [0 comments](#) 

Labels: [models](#), [NIST](#), [North America](#), [open standards](#), [Smart Grid](#), [standards](#)

Comment on second Draft Release Smart Grid Roadmap of NIST

The Draft **NIST Framework and Roadmap for Smart Grid Interoperability Standards, Release 2.0** is now available for public comments.

NIST solicits comments on the draft Release 2.0 document.

Due to the fast growth in various aspects of Smart(er) Grids, it is required to speed up in the selection of the needed and recommended standards. IEC 61850 is one of the crucial standards for Smart(er) Grids!!

Click [HERE](#) for the SGIP website with more details on the draft.

The list of standards comprises also DNP3 as a new IEEE standard.

Click [HERE](#) for the draft list of standards ... which states on page 2:

“Because the Smart Grid is evolving from the existing power grid, NIST has also included **standards that support widely deployed legacy systems**. Priority Action Plans (PAPs) have been established with the goal of resolving interoperability issues between the standards for legacy equipment and those others identified for the Smart Grid. For example, PAP12 seeks to **enable implementations of the Distributed Network Protocol, DNP3.0 as specified in IEEE 1815, to work with implementations of the IEC 61850 standard ...**”

This will definitely help to tap the information provided by the running systems! ... without replacing one protocol (DNP3) by another (IEC 61850-8-1, MMS).

IEC 61850 and DNP3 are becoming good FRIENDS ... keep going!

Posted by [Karlheinz Schwarz](#) at [12:16 PM](#) [0 comments](#) 

Labels: [61850](#), [DNP3](#), [Gateway](#), [IEC 60870-5-104](#), [IEC 61850](#), [NIST Roadmap](#), [Smart Grid](#)

IEC 61850-9-2 FDIS of Edition 2 open for Ballot

The IEC 61850-9-2 Edition: Communication networks and systems for power utility automation – Part 9-2: Specific communication service mapping (SCSM) – Sampled values over ISO/IEC 8802-3

is open for FDIS ballot until 2011-07-29.

Changes comprise:

- Addition of an optional Link redundancy layer
Link Redundancy:
Parallel redundancy protocol and high availability seamless ring
IEC 62439-3, Amendment 1
- Redefinition of “reserved” fields in link layer
- USVCB and MSVCB components
- Encoding for the transmission of the sampled value buffer

Posted by [Karlheinz Schwarz](#) at [11:00 AM](#) [0 comments](#) 

Labels: [61850](#), [IEC 61850](#), [IEC 61850-9-2](#), [IEC61850](#), [message encoding](#), [redundancy](#), [sampled value](#), [time synchronization](#)

[Newer Posts](#)

[Home](#)

[Older Posts](#)

Subscribe to: [Posts \(Atom\)](#)



Teilen

Missbrauch melden

Nächstes Blog»

Blog erstellen

Anmelden

News on IEC 61850 and related Standards

Daily news concerning the standards IEC 61850, IEC 61400-25, IEC 61970 (CIM), IEC 60870-5, ...

Sunday, June 12, 2011

IEC 61850-8-1 Edition 2 approved as International Standard

The 2nd Edition of IEC 61850-8-1 has been approved with 100 per cent support by the national committees of IEC TC 57.

IEC 61850-8-1 Ed. 2.0: Communication networks and systems for power utility automation - Part 8-1: Specific communication service mapping (SCSM) - Mappings to MMS (ISO 9506-1 and ISO 9506-2) and to ISO/IEC 8802-3

The standard will be published soon.

This mapping has been implemented in many IEDs. Even in the wind power market, this mapping is the most crucial mappings ... the other four mappings defined in IEC 61400-25-4 may be implemented as well.

Please note that most of the changes and corrections have been implemented by many IEDs, because many of them have been made during the edition 1 Tissue process. The first Tissue goes back to 2005.

Click [HERE](#) for the list of Tissues for part IEC 61850-8-1 Edition 1. The green Tissues are those that have been solved already – most of them are required for conformance testing. IED's TICS (Tissue Implementation Conformance Statement) have to indicate which of the green Tissues have been implemented.

Click [HERE](#) for a sample TICS document.

8-1

#116 GetNameList with empty response?

#165 Improper Error Response for GetDataSetValues

#183 GetNameList error handling

Click [HERE](#) for further details on Edition 2 of IEC 61850-8-1.

Posted by [Karlheinz Schwarz](#) at [10:37 AM](#) [0 comments](#)

Labels: [61850](#), [ACSI](#), [conformance test](#), [Ethernet](#), [IEC 61400-25](#), [IEC 61850](#), [IEC 61850-8-1](#), [mapping](#), [protocol](#), [TICS](#)

Thursday, June 9, 2011

New Version of SystemCorp's IEC 61850 Software

After the first certified IED using the SystemCORP Embedded Technology IEC61580 Library (PIS10) SystemCorp has published information and documentation about the latest Version (1.36.02) today. This version comprises all modifications, fixes and extensions that take many experiences and the successful conformance test at KEMA into account.

Subscribe To IEC 61850 News

Posts

All Comments

Blog Archive

► [2012](#) (11)

▼ [2011](#) (159)

► [December](#) (5)

► [November](#) (11)

► [October](#) (22)

► [September](#) (11)

► [August](#) (11)

► [July](#) (23)

▼ [June](#) (20)

[E3 Group for Studies on IEC 61850 Went Public](#)

[Mapping IEC 61850 on Web Services](#)

[IEC 61850, IEC 61400-25 and DNP3 at Remote Confere...](#)

[Message Specification and Encoding – A Never Endin...](#)

[IEC 61850-8-1 Edition 2 Published](#)

[What is a Stack?](#)

[Open Position for Protection Engineer with IEC 618...](#)

[Open Position for Development Engineer with IEC 61...](#)

[Network Rail \(UK\) to improve reliability and](#)

A comprehensive set of easy to browse web html pages are available.

Click [HERE](#) for more details on the updated stack software and documentation of version 1.36.02.

More details can be found [HERE](#) and [HERE](#).

This new version runs smoothly on the Beck IPC Chip and other embedded controllers on LINUX, ...

The interest in IEC 61850 Chips is growing very fast – all over.

Posted by [Karlheinz Schwarz](#) at [11:19 AM](#) [0 comments](#) 

Labels: [Beck Chip](#), [certificate](#), [DNP3](#), [embedded system](#), [IEC 60870-5-101](#), [IEC 60870-5-104](#), [IEC 61400-25](#), [IEC 61850](#), [Power Automation](#), [power distribution](#), [SCADA](#), [Smart Grid](#), [Substation Automation](#), [SystemCorp](#)

Transformer Protection and Monitoring IED with IEC61850@Chip

C&S Electric Ltd (India) has developed a Transformer Protection and Monitoring IED with an IEC 61850 interface build on the Beck IPC Chip "IEC61850@CHIP" with SystemCorp's IEC 61850 solution integrated.

Click [HERE](#) for more technical information.

Posted by [Karlheinz Schwarz](#) at [2:12 AM](#) [0 comments](#) 

Labels: [Beck Chip](#), [IEC 61850](#), [IEC 61850-8-1](#), [measurements](#), [monitoring](#), [protection](#), [SystemCorp](#)

Wednesday, June 8, 2011

Podcast from Black and Veatch on IEC 61850 in the U.S.

A podcast provided by Black & Veatch reports how IEC 61850 is expected to be accepted in the U.S. power industry. It is also reported how American Electric Power uses the GE BRICK solution for the interface between the control room and the switch yard.


There is no doubt about the trend towards IEC 61850 in North America!

The GE Brick solution is based on IEC 61850 concepts. Many benefits provided by IEC 61850 are offered by the Bricks – except one crucial issue that is not supported: The Brick solution is NOT interoperable with fully IEC 61850 compliant IEDs like protection and control devices or merging units according to IEC 61850-9-2.

An IED with an IEC 61850 interface can NOT communicate with the Brick! So, the Brick is a vendor specific solution using mainly fiber optic cables and Ethernet and message formats from IEC 61850 to replace copper wires to the switch yard. The idea of an open international standard for multi-vendor systems is supported by fully IEC 61850 compliant merging units and other IEDs (as publisher) and other IEDs (as subscribers).

Click [HERE](#) for listening the podcast [some 14 minutes].

Click [HERE](#) for more information on the concept.

Posted by [Karlheinz Schwarz](#) at [5:10 AM](#) [1 comments](#) 

[cutti...](#)

[Schnelleinstieg in die Produktentwicklung IEC 6185...](#)

[White House Policy Framework for 21st Century Grid...](#)

[Building the 21st Century Grid – The White House r...](#)

[Comment on second Draft Release Smart Grid Roadmap...](#)

[IEC 61850-9-2 FDIS of Edition 2 open for Ballot](#)

[IEC 61850-8-1 Edition 2 approved as International ...](#)

[New Version of SystemCorp's IEC 61850 Software](#)

[Transformer Protection and Monitoring IED with IEC...](#)

[Podcast from Black and Veatch on IEC 61850 in the ...](#)

[Certified IEC 61850 compliant IEDs](#)

[Telecontrol and IEC 61850](#)

- [May](#) (10)
- [April](#) (6)
- [March](#) (16)
- [February](#) (16)
- [January](#) (8)

- [2010](#) (153)
- [2009](#) (162)
- [2008](#) (82)

Contributors

[Michael Schwarz](#)

[Karlheinz Schwarz](#)

Labels: [61850](#), [IEC 61850](#), [IEC 61850-9-2](#), [merging unit](#)


Tuesday, June 7, 2011

Certified IEC 61850 compliant IEDs

KEMA has published a Test Register for conformance tested IEDs:

- IEC 61850 Client Systems
- IEC 61850 Server Devices
- IEC 61850 Ethernet Switches
- IEC 61850 Sampled Value Publishers (Merging Units)

Click [HERE](#) to access the test register dated 2011-01-27

Posted by [Karlheinz Schwarz](#) at [11:50 PM](#) [0 comments](#) 

Labels: [certificate](#), [conformance test](#), [IEC 61850](#)

Thursday, June 2, 2011

Telecontrol and IEC 61850

IEC 61850 is used in many applications inside substations and other domains. RTUs from many vendors provide IEC 61850 support for Telecontrol.

Click [HERE](#) for a set of 27 slides of an applications of ABB RTUs (used as substation control system) in 12 substations of Stadtwerke München [German].

Click [HERE](#) for Information about ABB's RTU 560 [English]

Click [HERE](#) for a description of a programmable device from WAGO that can be used for Telecontrol (RTU) [German]

Posted by [Karlheinz Schwarz](#) at [2:41 AM](#) [0 comments](#) 

Labels: [ABB](#), [Fernwirktechnik](#), [GOOSE](#), [IEC 60870-5-101](#), [IEC 60870-5-104](#), [IEC 61400-25](#), [IEC 61850](#), [RTU](#)

Thursday, May 26, 2011

Photos from the AWEA WINDPOWER 2011 Anaheim, CA, May 22-25

Click [HERE](#) for some photos from the exhibition provided by Oscar Naval ... see IEC 61850 (IEC 61400-25) in action for the wind industry and other application domains.

Posted by [Karlheinz Schwarz](#) at [6:30 AM](#) [0 comments](#) 

Labels: [61850](#), [IEC 61131-3](#), [IEC 61400-25](#), [IEC 61499](#), [IEC 61850](#), [ISaGRAF](#)

TÜV Süd – Getting involved in IEC 61850 Conformance Testing

The well known [TÜV Süd](#) has announced that it will offer Conformance Test services for IEC 61850 ... for Smart Grids and for Smart Metering.

Click [HERE](#) to access the corresponding webpage at TÜV Süd.

Posted by [Karlheinz Schwarz](#) at [6:21 AM](#) [0 comments](#) 

Labels: [conformance test](#), [IEC 61850](#), [interoperability tests](#)

Sunday, May 22, 2011

IEC 61400-25 & IEC 61850 at AWEA WINDPOWER 2011 Anaheim, CA, May 22-25

The interest in the International Standards IEC 61400-25 and IEC 61850 is picking-up globally and also in North America. Some 45 experts from BCIT (British Columbia Institute of Technology) and BC Hydro had been in a 3 day seminar and hands-on training in Vancouver, BC (Canada). More people were interested to attend – the meeting room just had 45 seats.

This week (Sunday – Wednesday, May 22-25) there is another step towards simple, powerful and easy to use automation devices that support at the

[AWEA WINDPOWER 2011, Anaheim, CA, May 22-25:](#)

1. Standardized information and information modeling (IEC 61400-25-2, IEC 61850-7-x),
2. Information exchange (IEC 61400-25-4, IEC 61850-8-1),
3. System configuration language (IEC 61850-6), and
4. Function programming (IEC 61131-3 and IEC 61499):

Booth 185 (Hall D) exhibits the full range of the above standards:

- **Beck IPC** (IEC 61400-25, IEC 61850, IEC 61131-3, ...): Chips, Devices, charging station, PLC, ...
- **SystemCorp** (IEC 61400-25, IEC 61850, IEC 61131-3, ...): Stack Software, Devices, Tools, ...
- **ISaGRAF** (IEC 61131-3, IEC 61499, IEC 61400-25, IEC 61850): Programming language/tool running on the Beck IPC Chip

See below the Booth 185 in Hall D:



A video of some 15 MB shows the steps in programming IEC 61131-3 using IEC 61400-25 and IEC 61850 on a Beck IPC Chip:

www.nettedautomation.com/download/isagraf/IEC61850_2011-05-18.mp4

Posted by [Karlheinz Schwarz](#) at 1:28 PM 1 comments 

Labels: [61850](#), [61850-7-420](#), [Beck Chip](#), [charging station](#), [DER](#), [distribution automation](#), [Functionblock](#), [IEC 61131-3](#), [IEC 61400-25](#), [IEC 61499](#), [IEC 61850](#), [ISaGRAF](#), [wind power](#)

Wednesday, May 18, 2011

Remote Service Forum und IEC 61850

Das 19. Remote Service Forum findet vom 6.-7. Juli 2011 bei der IHK Karlsruhe unter dem Titel "Von der Technologie zu neuen Dienstleistungen" statt. Neue Dienstleistungen im Bereich der erneuerbaren Energien und intelligenten Energieversorgungs-Netze sind unumgänglich, um die Flut der Informationen zum Überwachen, Steuern und Regeln des Energieflusses zu beherrschen. Industrielle Kommunikationsnetze (Feldbusse) sind kaum als Basis geeignet, weil es zu viele gibt: mehrere hundert!

In der elektrischen Energieversorgung haben sich die Normen **IEC 60870-5-10x** (Telecontrol), **IEC 60870-6 TASE.2** (Inter-control center communication), **IEC 61850** (substation automation and protection, DER, Hydro power plant monitoring and control), **IEC 61400-25** (monitoring and control of wind turbines), und **IEC 61131-3** (open PLC programming language) durchgesetzt.

Herr Dipl.-Ing. Karlheinz Schwarz (SCC) wird am 7.Juli 2011 einen Vortrag unter dem Titel "Genormter Remote-Zugriff auf Informationen elektrotechnischer Erzeugungs-und Verteilungsanlagen mit IEC 61850" halten.

NettedAutomation GmbH wird in der begleitenden Ausstellung über die neuesten Trends bei der Realisierung von IEC 61850 basierten Komponenten berichten und Realisierungsmöglichkeiten für embedded controller und vieles mehr vorstellen.

[HIER klicken](#), um das Programm und die Anmeldeinformationen herunterzuladen.

Posted by [Karlheinz Schwarz](#) at [6:53 AM](#) [0 comments](#) 

Labels: [condition monitoring](#), [conference](#), [Feldbus](#), [IEC 60870-5-101](#), [IEC 60870-5-104](#), [IEC 61131-3](#), [IEC 61400-25](#), [IEC 61850](#), [monitoring](#), [Power Automation](#), [RTU](#)

Tuesday, May 17, 2011

Electro Mobility, Substation Automation and IEC 61850

The basics for the infrastructure needed for the Electro Mobility have already been standardized – the electrical power delivery system: generation – transmission – distribution of electric A.C. power. The standardization of the electrical system has a long tradition. The monitoring, protection and control of electric power is automated in many higher voltage levels. There are mainly five international standards used all over: **IEC 60870-5-10x** for telecontrol, **IEC 60870-6 TASE.2** for inter-control center communication, **IEC 61850** for substation automation and protection, DER, Hydro power plant monitoring and control, **IEC 61400-25** for monitoring and control of wind turbines, and **IEC 61131-3** for a open PLC programming language.

These standards cover most of the needs for information modeling, information, system configuration, information exchange, and function programming for substations and power generation.

Mr Roland Bent (CEO of Phoenix Contact) stated the other day in the Open Automation magazine that **EV charging stations are small low voltage substations**. He is absolutely right! It is crucial to understand that the above mentioned standards are applicable in all voltage levels. [What is the difference of a three phase Y-system for 400.000 V and 400 V?](#) The multiplier of factor 10^3 . There is no need to re-event the wheel again.

Here is an excerpt of Mr Bent's statement in German:

"Ein noch wesentlich größeres, neues Marktfeld findet sich in der Infrastruktur für Elektromobilität. **Ladestationen für Elektrofahrzeuge sind kleine Niederspannungsschaltanlagen mit all den Komponenten und Steuerungskonzepten aus diesem Bereich.** Sie müssen auch informationstechnisch in die intelligenten Netzstrukturen integriert werden und stellen neue Anforderungen an IKT-Strukturen, zum Beispiel im Bereich der Abrechnungssysteme. Auch hier werden wieder Kompetenzen und Know-how aus der Industrieautomation benötigt."

Click [HERE](#) to read the complete statement from Mr Bent.

Posted by [Karlheinz Schwarz](#) at [6:47 AM](#) [0 comments](#) 

Labels: [Automation](#), [distribution automation](#), [E-Energy](#), [E-Mobility](#), [IEC 60870-5-101](#),

[IEC 60870-5-104](#), [IEC 60870-6](#), [IEC 61131-3](#), [IEC 61400-25](#), [IEC 61850](#), [IEC 61850-7-420](#), [Phoenix Contact](#), [Power Automation](#), [Stationslettechnik](#), [Substation Automation](#)

Wednesday, May 11, 2011

New Date for Seminar and Hands-on Training in Frankfurt


Please note that due to the huge fair IAA 2011 in Frankfurt mid-September 2011 we have **deferred the date for the seminar** on IEC 61850 Seminar and Hands-on Training from

14.-16. September **to 05.-07. October 2011**

The seminar will be held at the NH Hotel Frankfurt/Moerfelden.

Click [HERE](#) for the program.

Click [HERE](#) for the registration information.

Posted by [Karlheinz Schwarz](#) at [12:13 PM](#) [0 comments](#) 

Labels: [hands-on Training](#), [IEC 61400-25](#), [IEC 61850](#), [seminar](#), [Training](#)

ICD Documents for programmable and modular IEDs

If you have a modular 61850 product that can be shipped with a variable number of I/O cards, this may have a number of consequences:

1. The number of LNs this product can support depends on the hardware configuration.
2. LNs use shared resources, so if the user adds an LN of one type, he may not be able to add an LN of another type.

Be aware: everything is limited!

These tradeoffs are complex. If you produced an ICD file with the maximum number of LNs of every type your IED supports, for the maximum hardware configuration, the resulting file would be ridiculously large and unwieldy.

How to solve this issue?

All IEDs with a fixed functionality have definitely an easy to build icd file.

IEDs that are programmable or that are modular with one or more I/O cards are different. When the IED comes from the factory, you do not know what the application will be – so you do not know the information model and therefore you cannot provide an icd file for an application running on an IED.

What you could do is to provide an icd file that specifies the communication capabilities (services) and the DataTypeTemplates with all LNTypes that can be instantiated in that IED.

Once it is decided which functions (and LNs) will be running on a particular IED (with one, two, ... or five I/O cards), then the IED Configurator (as a manufacturer-specific tool) can create the "final" ICD file for a particular function.

The icd must have exactly one IED section. I would put the LN instances

of LLN0 and LPHD in the IED section. The other (functional LNs) would be added by the IED Configurator later ... when the number of I/O cards etc are known and selected.

Posted by [Karlheinz Schwarz](#) at [2:24 AM](#) [0 comments](#) 

Labels: [61850](#), [applications](#), [configuration](#), [I/Os](#), [ICD](#), [IEC 61850](#), [SCL](#)

Sunday, May 8, 2011

Is the Protocol Stack for IEC 61850 important?

No and Yes! **No**, compared to the many other aspects covered by IEC 61850, the protocol issue of IEC 61850-8-1 (upper layers like MMS and transport layers ...) are relatively of minor importance. There are the two crucial areas defined in IEC 61850: Information Models and System Configuration Language. I usually put it that way: SCL, engineering and configuration is 51 per cent of the importance ... may be 52 now ...

There is no real need to discuss other protocols and mappings from the view point of importance.

Yes, the protocols are very crucial!! ... when it comes to the question how and how fast and for what cost can I get IEC 61850 information communicated? To **exchange even the value of a single bit position** of a digital input requires the **implementation of the various protocols** like MMS, Presentation, Session, RFC 1006, TCP/IP, ...

This was – and still is – in many cases a quite expensive and time consuming effort! Yes, the availability of the protocol software is very IMPORTANT!

The other day I received an email with the following: "Although we have a ... license, we wanted to get started with SystemCorp's stack. The reason was simple: some manufacturers came to us asking what to do to incorporate IEC 61850 to their products. When we told them about ..., what it costs, how big it's API is, etc, they got frightened and said that it wasn't worth by now. When we first saw SystemCorp's solution in your blog, we realized that it was an excellent product for companies that wanted to "explore" IEC 61850."

A lot of people have made similar statements during the last months.

Posted by [Karlheinz Schwarz](#) at [8:09 AM](#) [0 comments](#) 

Labels: [ACSI](#), [IEC 61850](#), [IEC61850Li](#), [mapping](#), [protocol](#), [SystemCorp](#)

Impact of User Application on the Conformance of an IEC 61850 IED

One of the latest conformance tests has shown quite interesting results. An IED developed by SystemCorp (Perth, Western Australia) was successfully tested by KEMA recently. The IED uses a Beck IPC Chip as the core component. The SystemCorp IEC 61850 software (PIS-10 Stack) is running on this Chip platform as an integrated part – encapsulated and thus a given component.

In a paper SystemCorp has published a table of 120 test cases and shown which tested Functions are integrated in the PIS-10 Stack (integrated on the Chip) and which Functions are in the User Application that impact the conformance test.

More than 75 per cent of the test cases are of the first category (integrated in the Stack software) and less than 25 per cent of the test cases are directly depending on the User Application.

It is likely that other IEDs with the same Beck Chip and the same integrated PIS-10 stack will pass the 91 test cases of the first category easily.

Click [HERE](#) to access the table [PDF].

Posted by [Karlheinz Schwarz](#) at [8:08 AM](#) [0 comments](#) 

Labels: [61850](#), [Beck Chip](#), [communication](#), [conformance test](#), [IEC 61850](#), [implementation](#)

THE END: INTERBUS Club now part of Profibus User Organization

Ethernet has become THE major solution for future field busses – as has been suggested more than 20 years ago. It took many years before enough users requested Ethernet based field busses.

Interbus is one of successful conventional field busses – in strong competition with Profibus and other solutions. Finally, Ethernet wins over Interbus and many other standard field busses. The Interbus Club released this: “Within users a strong change by the field bus technologies in the **direction of Ethernet** is to be recognized. Hence, the INTERCBUS club had promptly decided to set on ... **ethernet based standard**.”

Click [HERE](#) for more information on the end of the Interbus Club.

There are (too) many Ethernet based international field bus standards specified in IEC 61158.

On the other side, IEC 61850 has – from the very beginning – decided to use **native Ethernet** and ICP/IP as specified in IEC 61850-8-1. There is an IEC 61850-8-1, where is the IEC 61850-8-2? The mapping of the ACSI and the information models to Profibus FMS was intended to be published as 8-2. Fortunately it was decided very some 15 years ago (!) to rely on Ethernet, TCP/IP and MMS – and not on a field bus.

Posted by [Karlheinz Schwarz](#) at [7:18 AM](#) [0 comments](#) 

Labels: [61850](#), [communication](#), [fieldbus](#), [IEC 61158](#), [IEC 61850](#), [Interbus](#), [Profibus](#)

Thursday, April 28, 2011

Back on writing Blog postings

You may have wondered that I haven't posted information on this blog for some three weeks. The reason simply was this: I was traveling internationally conducting comprehensive seminars and hands-on trainings in Harare (Zimbabwe; attendees from 10 Southern African countries!!), near Birmingham (UK), near Zurich (Switzerland), and presenting IEC 61850 at a fair in Darmstadt (Germany).

And now getting prepared for the next training in Frankfurt (Germany) mid of next week. See next post.

Hope to see a few people of the readers there.

Posted by [Karlheinz Schwarz](#) at [11:11 AM](#) [1 comments](#)

Labels: [61850](#), [education](#), [IEC 61850](#), [seminar](#), [Training](#)

Final Call for IEC 61850 Seminar and Hands-on Training in Frankfurt on May 04-06, 2011

There are a few seats left for the upcoming 3 day IEC 61850/61400-25 Seminar/Hands-on Training (NettedAutomation):

Frankfurt (Germany)

04.-06. May 2011

Click [HERE](#) for the program and registration information.

I allow a discount for the remaining seats!!

Please contact us as soon as possible to get one of the few remaining seats.

Click [HERE](#) to send an email to get a special offer.

Posted by [Karlheinz Schwarz](#) at [11:03 AM](#) [0 comments](#) 

Labels: [education](#), [hands-on Training](#), [IEC 61400-25](#), [IEC 61850](#), [IEC 61850 edition 2](#), [SCADA](#), [seminar](#)

[Newer Posts](#)

[Home](#)

[Older Posts](#)

Subscribe to: [Posts \(Atom\)](#)

News on IEC 61850 and related Standards

Daily news concerning the standards IEC 61850, IEC 61400-25, IEC 61970 (CIM), IEC 60870-5, ...

Thursday, April 28, 2011

Process and Factory Automation – And Electric Power Automation?

The Process and Factory/Manufacturing Automation domain is quite well developed since the nineties. Many communication solutions and standards have been developed since the MAP days in the eighties. The Automation of Electric Power Systems has been progressed independently of most other domain – maybe because of the fear of the danger of the high voltage!?

Usually there is very little exchange of information between the domain of Electric Power Automation and other areas. Also in the standardization world there is very little cooperation between these domains ... with a few exceptions: IEC 60870-6 TASE.2 and IEC 61850 (standards for Power Systems) are using a Manufacturing specific communication solution: Manufacturing Message Specification (MMS, ISO 9506). On the other side IEC 61850 is referring to the Redundancy standard developed for Factor Automation (IEC 62439 – developed in cooperation between experts from IEC TC 65 and TC 57).

More and more experts are understanding the need to exchange information between all three domains. In the future it will be quite crucial for the Process and Factory/Manufacturing Automation domain to get information from the Power Automation systems – in order to use the electric power more efficiently!

Fortunately there is an easy way to retrieve the information from the Power Automation to an other domain that uses power: IEC 61850.

At the ABB Power and Automation Conference in Orlando, "ARC analyst Barry Young said industry is the number one U.S. consumer of energy by end use sector, followed by transportation, residential and commercial entities.

Process heating (fired heaters) and machine drives are the two biggest energy consumers in the manufacturing sector, and represent the best areas for energy savings opportunity.

Savings as high as 10 percent can be realized with no major investment, said Young, but a major roadblock exists. "Automation and electrification are **separate islands**, and **operators have no view into the power side**. They cannot identify or take advantage of energy savings," he said. ...

For 49 percent of companies, energy is not part of active process control. **"IEC 61850 is an Ethernet-based solution that provides tight integration between automation and power systems,"** said Young. "It is the **fieldbus for electrical [systems]**. Adoption, however, has been slow due to the learning curve." ... Hm, it is much more than a fieldbus!!

Click [HERE](#) for the report from the ABB conference.

It is easier to look into the Power Automation System (with a single solution: IEC 61850) than into the other systems (with the many many

Subscribe To IEC 61850 News

 Posts 

 All Comments 

Blog Archive

► [2012](#) (11)

▼ [2011](#) (159)

► [December](#) (5)

► [November](#) (11)

► [October](#) (22)

► [September](#) (11)

► [August](#) (11)

► [July](#) (23)

► [June](#) (20)

► [May](#) (10)

▼ [April](#) (6)

[Back on writing Blog postings](#)

[Final Call for IEC 61850 Seminar and Hands-on Trai...](#)

[Process and Factory Automation – And Electric Powe...](#)

[SEL Reduces Prices for their IEC 61850 Option by 6...](#)

[IEC 61850 at Smart Grid Symposium and Exhibition](#)

[IEC 61850 Certificate issued](#)


► [March](#) (16)

► [February](#) (16)

field busses in IEC 61158 ...).

Want to look into the Power Automation System? Just use a simple IEC 61850 DLL (Dynamic Link Library) and a very simple client software that uses the DLL ... and talk to an IEC 61850 compliant power protection or control device:

Click [HERE](#) to let YOUR Application speak IEC 61850 in hours.

Posted by [Karlheinz Schwarz](#) at [10:52 AM](#) [0 comments](#) 

Labels: [Automation](#), [communication](#), [control center](#), [distribution automation](#), [DLL](#), [electric power system](#), [Ethernet](#), [fieldbus](#), [IEC 61158](#), [IEC 61850](#), [MAP](#), [MMS](#), [Power Automation](#), [SCADA](#), [TASE.2](#)

Sunday, April 3, 2011

SEL Reduces Prices for their IEC 61850 Option by 60 percent

One crucial result of the standardization work is that prices of standard based solutions are lowered! A good proof of this expectation is the announced price reduction of IEC 61850 based communication for SEL protection and control IEDs:

SEL reduced the price for the IEC 61850 option by 60 (SIXTY!) percent !!

““Utilities in Brazil, Mexico, the United States, India, Vietnam, Namibia, and many other countries rely on SEL solutions with IEC 61850 technology to maximize their power systems’ reliability and safety,” said Erik Newman, SEL vice president of Sales and Customer Service. “We look forward to offering this new option price to our customers who choose IEC 61850 as a method of communication and integration.” IEC 61850 was created to be an internationally standardized method of communication and integration and to support systems built from multivendor intelligent electronic devices (IEDs) that are networked to perform protection, monitoring, automation, metering, and control.”

This is what the market expected in the MAP days (during the early nineties). The MAP (Manufacturing Automation Protocols) were just too early ... it took another 20 years to get here! It’s not too late – we are still at the beginning of the Journey IEC 61850 and IEC 61400-25.

Click [HERE](#) for the press release [PDF].

Click [HERE](#) for more information on IEC 61850 provided by SEL.

Read a paper published by Karlheinz Schwarz in November 1991 on the [Use of Ethernet instead of Token passing in the MAP 3.0 specification](#) [PDF, 720 KB] - at that time the author did not know about Gigabit Ethernet; and a paper published by Karlheinz Schwarz in March 1991 on the [Use of Ethernet as a Fieldbus](#) [PDF, 720 KB].

It just takes time – the waiting for the right standard solution for information exchange, modeling and configuration is over: IEC 61850 is here!

Posted by [Karlheinz Schwarz](#) at [9:53 AM](#) [0 comments](#) 

Labels: [IEC 61400-25](#), [IEC 61850](#), [SEL](#)

Friday, April 1, 2011

► [January](#) (8)

► [2010](#) (153)

► [2009](#) (162)

► [2008](#) (82)

Contributors

[Karlheinz Schwarz](#)

[Michael Schwarz](#)

IEC 61850 at Smart Grid Symposium and Exhibition

NettedAutomation GmbH (Karlsruhe/Germany) will present the latest developments in products for IEC 61850 during the

Symposium and Exhibition - Power Distribution Systems of the Future:

Novel solutions of the information and communication technology as the backbone of Smart Distribution

12.-13. April 2011

darmstadtium
Wissenschafts- und Kongresszentrum
Schlossgraben 1
64283 Darmstadt
Germany

organized by
HEAG Südthessische Energie AG
NTB Technoservice
VDE

Click [HERE](#) for information on the event and registration:

What NettedAutomation GmbH will present at both 12:

- **Lite Stack implementation** for IEC 61850 and IEC 61400-25
- **IEC61850@CHIP** - THE most efficient way to let devices speak IEC 61850 and IEC 61400-25
- **IEC61850 DLL** - THE most efficient way to let PCs speak IEC 61850-25
- **SCL Configuration Tool** (System Configuration Language)
- **Ready to GO!** ruggedized devices like Gateways, RTUs, generic controller [programmable in IEC 61131-3 (CoDeSys and ISaGRAF) and C/C++], ...
- **Experience** and international trends in IEC 61850
- **Training material**

Objectives of the event:

- Exchange of experience between the European and German lighthouse projects.
- Information of the public, of vendors, grid operators and other stakeholders of the energy market, of universities and research institutes about the running lighthouse projects
- Discussion of the broad dissemination of the project results and how to overcome the existing barriers.

IEC Standards like IEC 61850 play a key role in the future Power Generation, Transmission and Distribution Systems. Several presentations and a workshop deal with THE Global accepted and used standard IEC 61850 in the context of Distribution Systems.


Posted by [Karlheinz Schwarz](#) at [11:04 AM](#) [0 comments](#) 

IEC 61850 Certificate issued

SystemCorp's IEC 61850 device has successfully been conformance tested. The SystemCorp device was based upon SystemCorp's independently developed IEC 61850 source code and was implemented on the Beck IPC Chip SC143.



Click [HERE](#) for a copy of the certificate [PDF, 1MB].

Posted by [Karlheinz Schwarz](#) at [12:09 AM](#) [0 comments](#) 

Labels: [Beck Chip](#), [certificate](#), [conformance test](#), [IEC 61850](#), [stack](#), [SystemCorp](#)

Wednesday, March 30, 2011

North America - IEC 61850 is riding the leading edge of progress

Progress of IEC 61850 has arrived in North America according to the March 2011 Newton-Evans Research report "Market Trends Digest, March 2011".

The report found out interesting figures, e.g., "Within the Substation, IEC 60870-5-103 was the most frequently used protocol (40%). IEC 61850 (31%) fell close to serial protocols Modbus (31%) and DNP3 (33%), **however, 24% indicated that they plan on implementing IEC 61850 within the substation by YE 2013. If that becomes the case, IEC 61850 will become the most used protocol by far.**"

Click [HERE](#) to download the report [PDF, 1 MB].

Posted by [Karlheinz Schwarz](#) at [10:32 PM](#) [0 comments](#) 

Labels: [IEC 61400-25](#), [IEC 61850](#), [North America](#), [Substation Automation](#), [USA](#)

IEC 61850 Training opportunities

NettedAutomation GmbH offers several public training opportunities in 2011.

Please find the current schedule for 2011:

Frankfurt (Germany)

04.-06. May 2011 [*****STILL SEATS AVAILABLE*****]
14.-16. September 2011

3 day IEC 61850/61400-25 Seminar/Hands-on Training (NettedAutomation) with Measurement IED and free evaluation software (DLL etc. fully functional - free to take home).

<http://nettedautomation.com/seminars/uca/sem.html#standard>

Toronto (ON, Canada)

10-13 May 2011

4 day IEC 61850 Seminar/Hands-on Training in cooperation with Kinectrics

<http://www.kinectrics.com/Training/Pages/IEC-61850-Hands-on-Training-Protection-Control-And-IEC61850.aspx>

Cincinnati (OH, USA)

21-24 June 2011

4 day IEC 61850 Seminar/Hands-on Training in cooperation with Kinectrics

<http://www.kinectrics.com/Training/Pages/IEC-61850-Hands-on-Training-Protection-Control-And-IEC61850.aspx>

Shanghai (China)

05. September 2011

1 day Developers Workshop for IEC 61850 similar to the successful event at Myong Ji University, Yongin (RP of Korea)

<http://blog.iec61850.com/2011/03/developers-workshop-for-iec-61850-at.html>

Contact us for details please.

Nashville (TN, USA) at Remote Conference

20.-21. September 2011


2 day Seminar (NettedAutomation) on Power System Communication covering IEC 61850, IEC 61400-25, DNP3, NIST Interoperability Roadmap, Smart Grids, ...

<http://nettedautomation.com/seminars/uca/sem.html#nash>

For further information and updates visit:

<http://nettedautomation.com/seminars/uca/sem.html#standard>

NettedAutomation is confident, that their experience and service would meet all your expectations! You would get first-hand, very comprehensive, vendor neutral and up-to-date knowledge, experience, and guidance; learn how to reach interoperability of devices. NettedAutomation has trained more than 2.300 experts from more than 60 countries from more than 500 companies – all over.

Posted by [Karlheinz Schwarz](#) at [12:38 PM](#) [0 comments](#) 

Labels: [61850](#), [DER](#), [education](#), [GOOSE](#), [IEC 61400-25](#), [IEC 61850](#), [Power Automation](#), [programming](#), [sampled value](#), [Smart Grid](#), [Substation Automation](#), [TASE.2 ICCP](#), [Training](#)

SystemCorp's IEC 61850 SCL ICD Designer available for Online Purchase

The "ICD Designer" is SystemCORP Embedded Technology's Intelligent Electronic Device (IED) Capability Description designer application. This ICD Designer application is used to define and edit substation configuration descriptions for IEC 61850 through a graphical user

interface to create an XML formatted file.

Correctly speaking, the "ICD Designer" (as a product name) is a tool that has many functions for creating "IID Documents" – "Instantiated IED Description". IIDs have been defined in edition 2 of IEC 61850-6 (SCL).

The tool supports also the instance specific binding of the model to the real world data points, e.g., referenced by DNP3 or 101/104 points. The tool uses an XML document with the TypeTemplates. Any extended model can easily be added to that XML document to define your own model. It is really that easy.

Click [HERE](#) for an example of the binding (fourth slide).

The full version of the ICD Designer is now available for online purchase.

Click [HERE](#) for more information on the product and how to order online.

Posted by [Karlheinz Schwarz](#) at [12:29 PM](#) [0 comments](#) 

Labels: [configuration](#), [ICD](#), [IEC 61400-25](#), [IEC61850](#), [IID](#), [mapping](#), [model designer](#), [model extensions](#), [SCL](#)

Conformance Certificate for SystemCorp's IEC 61850 Device using Stack PIS-10 on Beck IPC Chip

SystemCorp has implemented their stack software on the Beck IPC Chip SC143 in their IED "IEC 61850 WebCAN Substation Monitoring & Control System". The IED is a multifunctional monitoring and control system.

KEMA (Arnhem, Netherlands) tested the IEC 61850 conformance successfully:



Click [HERE](#) for a copy of the certificate [PDF, 1MB].

Test has been conducted according to the PICS, PIXIT, TICS, and MICS Documents that can be accessed through:

<http://www.systemcorp.com.au/component/content/article/24-user-manuals/63-iec-61850-pics-pixit-tics-mics.html>

Details of the IED can be found here:

<http://www.systemcorp.com.au/component/content/article/24/74-webcan-rtu-system-description.html>

This is a major step towards the widespread use of the IEC 61850 stack from SystemCorp for small devices. The IEC 61850 software and the IEC 61850 communication behavior is almost completely implemented on the Beck IPC Chip SC143. Products that use the same chip with the software used for the conformance test would - by default - pass most crucial parts of the IEC 61850 conformance test.

This allows a short time-to-market IED development for all devices that apply the Beck IPC Chip.

Please contact SystemCorp for more details.

A flyer on the Beck Chips can be found here:

<http://nettedautomation.com/download/IEC61850Li.pdf>

Posted by [Karlheinz Schwarz](#) at [12:01 PM](#) [0 comments](#) 

Labels: [61850](#), [certificate](#), [conformance test](#), [IEC 61400-25](#), [IEC 61850](#), [implementation](#), [PICS](#), [PIXIT](#), [RTU](#)

Saturday, March 19, 2011

GPS Time Synchronization - A Single Point of Failure?

The GPS time synchronization is one of the crucial underlying solutions for time synchronization in power system information sharing: in substations, between substation, and wide area applications (with or without applying IEC 61850).

A paper published by SEL discusses the issue of GPS time synchronization - and especially when it may become a single point of failure in a power system.

Click [HERE](#) for a paper that discusses the issue.

Posted by [Karlheinz Schwarz](#) at [1:30 AM](#) [0 comments](#) 

Labels: [GPS](#), [IEC 61850](#), [time stamp](#), [time synchronization](#)

IEC 61850 - Common Format for Event Data Exchange

Event data can be logged in an IED by a Log according to IEC 61850-7-2 (IEC 61850-8-1, MMS Journal). The Log can be queried by time (before, between, after). This query returns MMS messages.

Logged event data in an IEC 61850 IED could now additionally be retrieved by an XML file called "COMFEDE":

Common Format for Event Data Exchange (COMFEDE) for Power Systems (IEEE Std C37.239™-2010).

This file may optionally rely on the information models defined by IEC 61850 Logical Devices, Logical Nodes, DataObjects, DataAttributes. An example of a file is shown here:

```
<Entry entryId="4294967292" timeOfEntry="2011-03-11T14:38:13Z">
  <EntryData t="2011-03-11T14:38:12.423834Z">
    <DataRef>MyLogicalDevice/MyMMXU1.A</DataRef>
    <DA name="phsA.cVal.mag.f" val="1023" valType="xs:double"/>
  </EntryData>
</Entry>
```

```
<DA name="phsB.cVal.mag.f" val="1022" valueType="xs:double"/>

<DA name="phsC.cVal.mag.f" val="1019" valueType="xs:double"/>

</EntryData>
</Entry>
```

Even that standard is an IEEE standard, it could be understood as an extension of IEC 61850 - it extends the use of the information model, information exchange and system configuration language.

From a 40,000 ft point of view it is a kind of a SCSM (Specific Communication Service Mapping). I guess it is also easy in an IEC 61850 client to transform the ReadJournal response messages according to MMS into an COMFEDE file - it is the same payload carried.

Click [HERE](#) for more information.

Posted by [Karlheinz Schwarz](#) at [1:20 AM](#) [0 comments](#) 

Labels: [61850](#), [COMFEDE](#), [IEC 61850](#), [IEEE](#), [MMS](#), [XML](#)

Wednesday, March 16, 2011

President of German Federal Network Agency recommends IEC Standards for Smart Grids

Matthias Kurth, President of the German Federal Network Agency, is very supportive of IEC standards. In a short video he stated that "IEC can help put the innovative potential of industry on the right track **so that we don't have island solutions**: proprietary solutions that can hinder the growth of the market".

IEC can, according to Mr. Kurth, "help us to bring the different industry players together on **common platforms which are transparent, open, and which are the basis of the individual innovation** ... we need not to wait to renovate our own infrastructure [editor: meant is the energy sector] in Europe."

Click [HERE](#) to read the report and watch the video posted at the IEC website.

IEC has listed the crucial standards for Smart Grids in an Excel table. IEC 61850 seems to be understood as THE most crucial standard series for Smart Grids.

Click [HERE](#) for the Excel table.

Click [HERE](#) for the Smart Grid page.

Mr. Kurth is right in requesting **open standards** as basis of innovation. The key innovations in the energy market needed will be the **many SMART applications** that keep the energy supply at a high level of availability - IEC 61850 and other IEC standards can help to support this objective! The **easier it is to USE these standards** the faster we can reach smart(er) applications.

One innovation is the simple IEC 61850 API developed by SystemCorp (Perth, Australia). The API can be used by application programmers immediately to develop SMART innovations for the energy market.

Posted by [Karlheinz Schwarz](#) at [10:59 PM](#) [0 comments](#) 

Labels: [communication](#), [IEC](#), [Smart Grid](#), [standards](#), [sustainable interoperability](#)

Developers Workshop for IEC 61850 at Myong Ji University, Yongin (RP of Korea) was successful

A successful Developers Workshop for IEC 61850 Client/Server and Publisher/Subscriber Applications was conducted at the Myong Ji University, Yongin/Korea, on 11 March 2011.

The interest was beyond expectations: 45 experts from all over of the RP of Korea attended the Workshop:



The attendees followed the instructions of Karlheinz Schwarz, who used the black board to explain the approach of IEC 61850 and the use of the simple API (Application Program Interface):



He explained the use of the API for different architectures (HW and SW) ... questions were discussed in English and Korean:



Professor Hyuk Soo Jang from the Myong Ji University (left) helped to explain the API in Korean.

The attendees used the PCs of the lab and partly their own notebooks to run the API evaluation software. They exercised to configure the IEC 61850 server and to check the effect of SCL file modifications ... a

great tool to work with.

After the workshop attendees told me that they have learned a lot about the standard, the stack software, the API, how easy it is to develop applications, and how to use the Beck Chip (with IEC 61850 @ Chip) in many different architectures. One crucial result was, that they figured out that the Beck Chip is a complete PC or PLC that can be used to implement applications (in C, C++ or IEC 61131-3) using IEC 61850 API. The Chip is much more than just a communication chip!!

The objective of the training was:

Students will learn how to use an API for IEC 61850 (IEC 61400-25) for Client, Server (C/S), Publisher, and Subscriber (P/S) Applications. The API provides an IEC 61850 Stack (included in a Windows DLL) that is used by application software written in C, C++ and C#. Prior to the event, students will receive the DLL and sample executable and source code for the applications. Students that bring their own Notebooks will be trained to modify and extend the application examples. After the training sessions students can continue to write their own application software.

Click [HERE](#) for the complete program of the workshop [pdf].

It is planned to repeat this workshop and provide more help for developers of IEC 61850 applications - the open and easy to use IEC 61850 platform is a crucial basis for the **fast-to-market innovations of sustainable interoperable applications** in the energy market.

It's never been easier or faster to get your applications speak IEC 61850.

Posted by [Karlheinz Schwarz](#) at [10:55 PM](#) [2 comments](#) 

Labels: [61850](#), [applications](#), [Beck](#), [Chip](#), [condition monitoring](#), [distribution automation](#), [education](#), [electric power system](#), [IEC 61850](#), [implementation](#), [interoperability](#), [Smart Grid](#), [tools](#)

IEC TC 57 to take action in Smart Grids

The IEC TC 57 has proposed a new work with the title "**System interfaces and communication protocol profiles** relevant for systems connected to the Smart Grid".

The ballot closes on May 09, 2011.

Click [HERE](#) for the proposal.

The proposal states: "In order to achieve **interoperable** interfacing between the components, the consistent, cost efficient and unambiguous **integration of the new domains** into the **IEC TC57** methods of energy management, architecture, **data models and protocols** is crucial."

The most prominent IEC TC 57 Data Models and Protocols are those defined in IEC 61850! New Domains are, e.g., Industry, Home and Building Energy Control Systems. My guess is that the various components in these domains have to communicate directly (interoperable) with IEDs in power systems. The Client/Server communication in IEC 61850 seems to be the most useful communication model applicable in the communication between power system IEDs and IEDs in the new domains. The application profile according to IEC 61850-8-1 requires just native TCP/IP !!

Since IP networks are (to be) installed everywhere, it is easy to apply

IEC 61850-8-1 without any change in most applications. Many existing IEDs like the [COM.TOMs from Beck IPC](#) and others could be used right away! They can be used as IEDs for monitoring and control in the new domains or they can be used as gateways between IEC 61850 and protocols in the new domains like Backnet, Profibus, Interbus, EtherCAT, CAN, Modbus, ...

This will accelerate the application of IEC 61850! ... in order to make systems more energy efficient and smarter by seamless:

- **System configuration** (IEC 61850-6),
- **Information** (IEC 61850-7-4xx, IEC 61400-25-2), and
- **Information exchange** (IEC 61850-7-2)
- **Communication protocol** (IEC 61850-8-1).

Posted by [Karlheinz Schwarz](#) at [6:25 AM](#) [0 comments](#) 

Labels: [Backnet](#), [building automation](#), [CAN](#), [EtherCAT](#), [IEC 61850](#), [Interbus](#), [interoperability](#), [Power Automation](#), [Profibus](#), [seamless](#), [Smart Grid](#)

What is the ACSI?

The ACSI is the "Abstract Communication Service Interface" defined in IEC 61850-7-2.

The ACSI was invented during a meeting of some experts that met here in Europe at the beginning of the project IEC 61850 (between 1995 and 1997). The reason was quite simple: We had TWO proposals for protocol profiles: (1) MMS TCP/IP and Ethernet (2) Profibus FMS. Each solution was supported by some 50 per cent of the members.

What to do now? I was deeply involved in the fieldbus standardization. We had so many fights since the late 80s ... which damaged the reputation of the standardization in the early 90s. I suggested NOT to fight in IEC 61850 but to define an abstract service model that could be mapped to MMS and to FMS. The first was specified in IEC 61850-8-1 and the second in IEC 61850-8-2. Even no official IEC draft has ever been published for IEC 61850-8-2.

Later we had a similar discussion in the project IEC 61400-25-4 in IEC TC 88 (Wind Turbines). We agreed to follow the approach of the abstract model of IEC 61850-7-2, to use the 8-1 MMS mapping, to add mappings for OPC XML DA, IEC 60870-5-101/104 and DNP3, and to define a concrete webservice for each abstract service of the ACSI.

The services of the ACSI and some explanation could be found here:

Click [HERE](#) for C/S and P/S
Click [HERE](#) for Data Acquisition
Click [HERE](#) for Webservices
Click [HERE](#) for MMS

By the way, the services in IEC 61850 are very general ... applicable almost everywhere!

My observation is, that (with some exceptions) ALL applications of IEC 61850 apply the MMS mapping ... that does not mean that everybody likes MMS ;-)

Most people using IEC 61850 do not care about MMS - and ALL should not care!

Posted by [Karlheinz Schwarz](#) at [4:16 AM](#) [0 comments](#) 

Labels: [61850](#), [ACSI](#), [fieldbus](#), [IEC 61850](#), [MMS](#), [webservice](#)

Thursday, March 10, 2011

Do you know what a PIXIT or a TICS is?

The conformance of devices with IEC 61850 has several aspects that are mainly specified in the following documents:

PICS	<i>Protocol Implementation Conformance Statement:</i> Which Communication services are supported ...	Click HERE for a complete example (all examples shown here are for A specific IED: RTU of SystemCorp); the stack software from SystemCorp offers more.
PIXIT	<i>Protocol Implementation Conformance Extra Information</i> for Testing: Restrictions and Limitations found in a device ...	Click HERE for a complete example
MICS	<i>Model Implementation Conformance Statement:</i> Models supported ...	Click HERE for a complete example
TICS	<i>Tissue Implementation Conformance Statement:</i> Which tissues have been implemented: www.tissue.iec61850.com	Click HERE for a complete example
SICS	<i>SCL Implementation Conformance Statement:</i> Which aspects of SCL have been implemented in a Tool	

Please ask your vendor of the IEDs or tools (you want to apply) for these documents. They provide you a good level of details you need to know when building multi-vendor systems.

Excerpt of a PICS:

3 ACSI Models conformance

Table 2 – ACSI models conformance statement

		Client	Server	Value/ Comments
M1	Logical Device	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
M2	Logical Node	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
M3	Data	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
M4	Data Set	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
M5	Substitution	<input type="checkbox"/>	<input type="checkbox"/>	
M6	Setting group control	<input type="checkbox"/>	<input type="checkbox"/>	
M7	Buffered Report Control	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
M7-1	Sequence-numbered	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
M7-2	report-time-stamp	<input type="checkbox"/>	<input checked="" type="checkbox"/>	

Excerpt of a PIXIT:

2.1 (6.2.4.6) – PIXIT for Application Association Model

Description	Value/ Clarification
Maximum number of clients that can set-up a 2-party association simultaneously	16
TCP_ KEEPALIVE value	10 seconds
Lost connection detection time	20 seconds
Is authentication supported	N
What association parameters are necessary for successful association	Y Transport selector Y Session selector Y Presentation selector Y AP Title Y AE Qualifier
If association parameters are necessary for association, describe the correct values e.g.	Transport selector 0001 Session selector 0001 Presentation selector 00000001 AP Title 1,1,999,1,1 AE Qualifier 12
What is the maximum and minimum MMS PDU size	Max MMS PDU size: 16000bytes Min MMS PDU size: 2 bytes
What is the typical startup time after a power supply interrupt	40 sec

Excerpt of a MICS:

2 Logical Node List

The following table contains the list of logical nodes implemented in the device:

L: System Logical Nodes
LPHD (Physical device information)
LLN0 (Logical node zero)
G: Logical Nodes for Generic references
GGIO (Generic process I/O)
M: Logical Node for metering and measurement
MMXU(Measurement)

Excerpt of a TICS:

2 Mandatory IntOp TISSUES

Part	TISSUE Number	Description	Implement
8-1	116	GetNameList with empty response?	Y
	165	Improper Error Response for GetDataSetValues	Y
	183	GetNameList error handling	Y
7-4		None	
7-3	28	Definition of APC	Y
	54	Point def xVal, not cVal	Y
	55	Ineut = Ires ?	Y
	60	Services missing in tables	Y
	63	mag in CDC CMV	Y
	65	Deadband calculation of a Vector and trigger option	Y
	219	operTm in ACT	Y
	270	WYE and DEL rms values	Y

Excerpt of a SICS (Template from IEC 61850-6):

Table G.2 – System configurator conformance statement

		Mandatory/ optional	Value/ comments
ICD&IID import and usage		M	
S11	IED data model	M	
S12	Predefined data sets	M	
S13	Predefined control blocks	M	
S14	Support MustUnderstand concept (8.2)	M	
S15	Support SCL version ____ as input	C1	Version 2003 input is always mandatory
S16	Substation bay template with LN links, if it exists	O	
S17	Reuse already imported DataTypeTemplates for identical types	O	
S18	Keep attributes and elements of unknown XML name spaces outside Private elements for SCD export	O	
S19	Import single line layout coordinates defined in C.1	O	For own usage, or just for later export

For smooth system integration it is quite crucial to read and understand these documents!!

Posted by [Karlheinz Schwarz](#) at 4:41 AM 0 comments 

Labels: [61850](#), [ACSI](#), [communication](#), [conformance test](#), [IEC 61850](#), [interoperability](#), [interoperability tests](#), [MMS](#), [PICS](#), [PIXIT](#), [RTU](#), [SystemCorp](#)

Tutorial of the 5 IEC 61850 Gurus in Sydney was very successful


After the Meeting of the IEC TC 57 WG 10 (Core IEC 61850) in Noosa (Queensland, Australia) four IEC 61850 Gurus of the Working Group 10 went down to Sydney to meet another IEC 61850 Guru to conduct a 3 day Tutorial and hands-on Training on 07.-09. March 2011.

The tutorial was a great Success! **48 attendees from 15 Utilities (!!)** and 5 from 4 other companies attended the four half-day sessions in four parallel streams from Monday noon-time to Wednesday noon-time.


After this event it is likely that Australian utility engineers are ahead of the market - in most countries utility engineers are - more or less - watching the vendors commissioning and "turning on" TURN-KEY substation automation systems in their substations!! Usually - to my observation and experience - utility engineers have NO IDEA what they got delivered. Australian utilities are quite serious in getting deeply involved in specification, engineering, system integration, ...

More to come.

Some photos from the WG 10 meeting and from the event in Sydney:

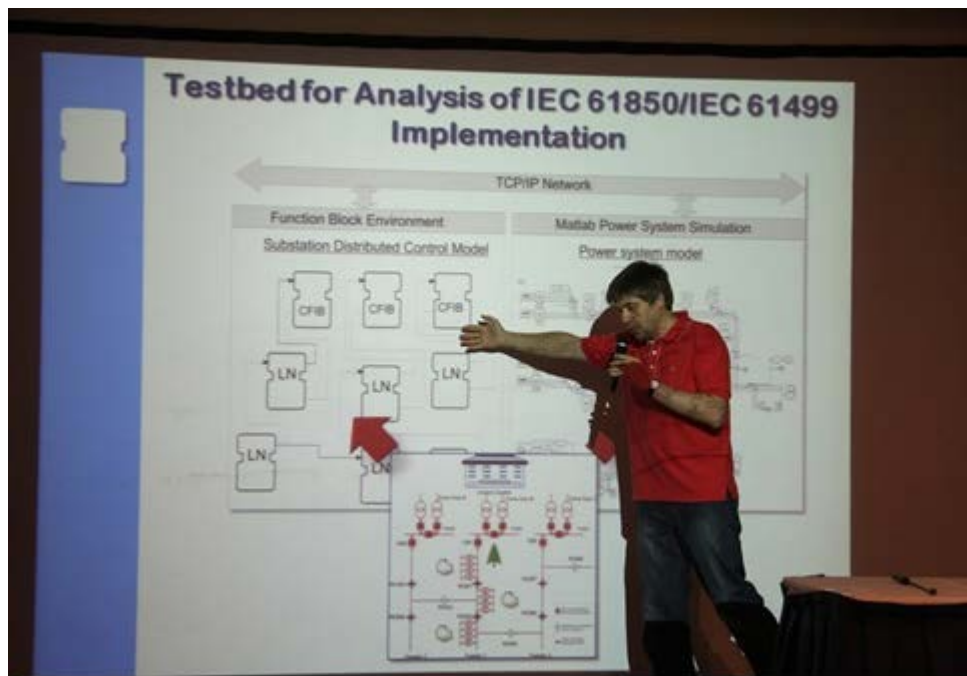

Professor Valeriy Vyatkin (Auckland) presents IEC 61499 ...

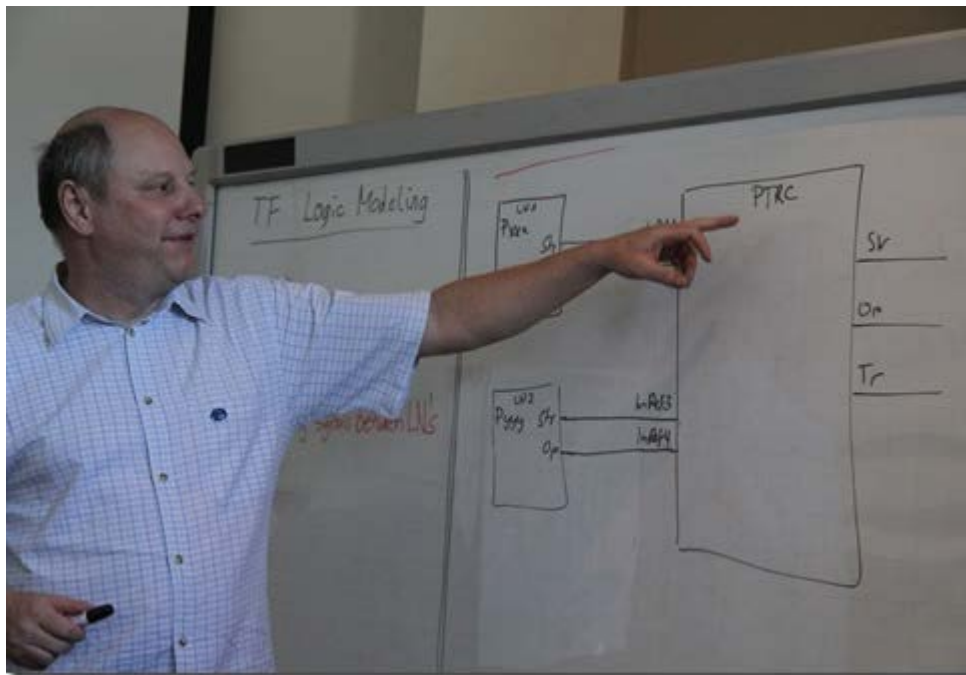

Convenor of WG 10 (Christoph Brunner - one of the 5 IEC 61850 Gurus)



Alex Apostolov (another IEC 61850 Guru) discussing requirements for definition of Logic in IEC 61850



Reflections during the excursion in the Noosa River Everglades



The Gurus (Christoph and Alex) reflecting the quality of the Native

GOOSE ... Wine



The other 3 Gurus discuss and enjoy during the reception (from left):
Joerg Reuter, Rod Hughes and Karlheinz Schwarz

Posted by [Karlheinz Schwarz](#) at [4:31 AM](#) [0 comments](#) 

Labels: [Australia](#), [IEC 61850](#), [peopleware](#), [Substation Automation](#), [utilities](#)

IEC 61850 at Smart Grid Symposium and Exhibition

NettedAutomation GmbH (Karlsruhe/Germany) will present the latest developments in products for IEC 61850 during the

Symposium and Exhibition - Power Distribution Systems of the Future:

Novel solutions of the information and communication technology as the backbone of Smart Distribution

12.-13. April 2011

darmstadtium
Wissenschafts- und Kongresszentrum
Schlossgraben 1
64283 Darmstadt
Germany

organized by
HEAG Südheissische Energie AG
NTB Technoservice
VDE

Click [HERE](#) for information on the event and registration:

What NettedAutomation GmbH will present at both 12:

- **Lite Stack implementation** for IEC 61850 and IEC 61400-25
- **IEC61850@CHIP** - THE most efficient way to let devices speak IEC 61850 and IEC 61400-25
- **IEC61850 DLL** - THE most efficient way to let PCs speak IEC 61850-25
- **SCL** Configuration Tool (System Configuration Language)
- **Ready to GO!** ruggedized devices like Gateways, RTUs, generic controller [programmable in IEC 61131-3 (CoDeSys and ISaGRAF) and C/C++], ...
- **Experience** and international trends in IEC 61850
- **Training material**

Objectives of the event:

- Exchange of experience between the European and German lighthouse projects.
- Information of the public, of vendors, grid operators and other stakeholders of the energy market, of universities and research institutes about the running lighthouse projects
- Discussion of the broad dissemination of the project results and

how to overcome the existing barriers.

IEC Standards like IEC 61850 play a key role in the future Power Generation, Transmission and Distribution Systems. Several presentations and a workshop deal with THE Global accepted and used standard IEC 61850 in the context of Distribution Systems.

Posted by [Karlheinz Schwarz](#) at [4:28 AM](#) [0 comments](#) 

Labels: [61850](#), [communication](#), [conference](#), [distribution](#), [distribution automation](#), [E-Energy](#), [E-Mobility](#), [embedded system](#), [IEC 61499](#), [IEC 61850](#), [implementation](#), [interoperability](#), [Power Automation](#), [Smart Grid](#)

Friday, March 4, 2011

IEC 61850 certificate for ABB's 800xA Automation System

ABB's 800xA Automation System has been successfully tested for compliance with IEC 61850 recently. Bringing the world of process and power automation together is more than just a "nice to have". It is key to cost saving.

"**The IEC 61850 standard** ... has lowered the investment barrier for customers to **integrate** the **process and power devices** on their plant floors. The demand for integrated process and power automation is growing in traditional markets that are **heavy energy users**, such as Oil and Gas, Power Generation, Pulp and Paper, Minerals and Metals industries.

By **integrating power and process systems** on the common 800xA platform, customers optimize the design and performance of their electrical and automation systems and see additional benefits in reduced maintenance, engineering and overall lifecycle costs. According to ARC, typical savings can result **in a 20% reduction** in CAPEX (capital expenditures) and OPEX (operating expenditures) by integrating these two, usually separate, automation infrastructures."

IEC 61850 is THE crucial "link" within power automation systems and **between** power automation systems and any other automation system - it is likely that it will impact the whole process automation world. Why? Because it meets many crucial requirements in the cooperation of automation and SCADA devices by defining **information objects** like "circuit Breaker, XCBR" or "electrical measurement of 3-phase system, MMXU", a **system configuration language** (SCL) and **information exchange services** (read/write, reporting and logging events, control, real-time exchange, file transfer, ...). And it's based on native protocols like Ethernet, TC/IP, MMS, ... Any device that has Ethernet and TC/IP connectivity could use IEC 61850.

Click [HERE](#) for the ABB press release.

Posted by [Karlheinz Schwarz](#) at [5:14 PM](#) [0 comments](#) 

Labels: [800xA](#), [ABB](#), [certificate](#), [electric power system](#), [IEC 61850](#), [Power Automation](#)

[Newer Posts](#)

[Home](#)

[Older Posts](#)

Subscribe to: [Posts \(Atom\)](#)

News on IEC 61850 and related Standards

Daily news concerning the standards IEC 61850, IEC 61400-25, IEC 61970 (CIM), IEC 60870-5, ...

Tuesday, March 1, 2011

Let YOUR Application speak IEC 61850 in hours


IEC 61850 has been implemented in hundreds of devices. The UCA Users Group lists some 181 certified devices with server functionality, 3 certified clients, and 2 Merging units (as per 2011-03-02; UCAIug Testing Quality Assurance Program).

Almost all of these devices provide a certain functionality like protection or control. Usually the devices do not provide a simple API (application program interface) that can easily be used by an application program written by a programmer. There is usually nor access to "IEC 6150 Stack". Some test tools may provide restricted access by manually entering values for a data attribute, or using a configurable simulation or providing a CSV (comma separated values) file for a profile. The evaluation licenses are usually quite restricted.

In contrast to this quite limited access to an API there is a free available server and client DLL (from SystemCorp) that runs for six (6) months. The DLL evaluation package comes with various client and server applications. The applications are provided in exe code and source code (C/C++ and C#). You have FULL control over the functionality YOU want to have for your client and server application.

Click [HERE](#) for details.

Any application YOU write could easily speak IEC 61850:

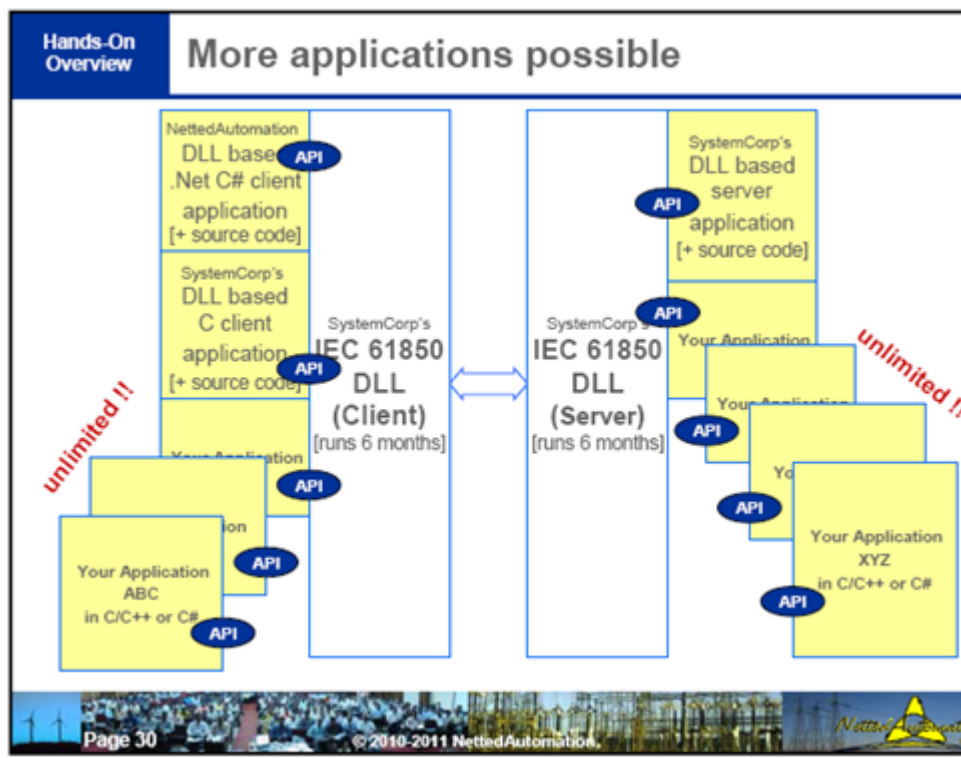

Subscribe To IEC 61850 News


 Posts 

 All Comments 


Blog Archive

- 2012 (11)
- ▼ 2011 (159)
 - December (5)
 - November (11)
 - October (22)
 - September (11)
 - August (11)
 - July (23)
 - June (20)
 - May (10)
 - April (6)
 - ▼ March (16)
 - [North America - IEC 61850 is riding the leading ed...](#)
 - [IEC 61850 Training opportunities](#)
 - [SystemCorp's IEC 61850 SCL ICD Designer available ...](#)
 - [Conformance Certificate for SystemCorp's IEC 61850...](#)
 - [GPS Time Synchronization - A Single Point of Failu...](#)
 - [IEC 61850 - Common Format for Event Data Exchange](#)

The following example shows the .Net / C# client application provided by NettedAutomation GmbH. The received sequence of values can easily be copied and pasted:

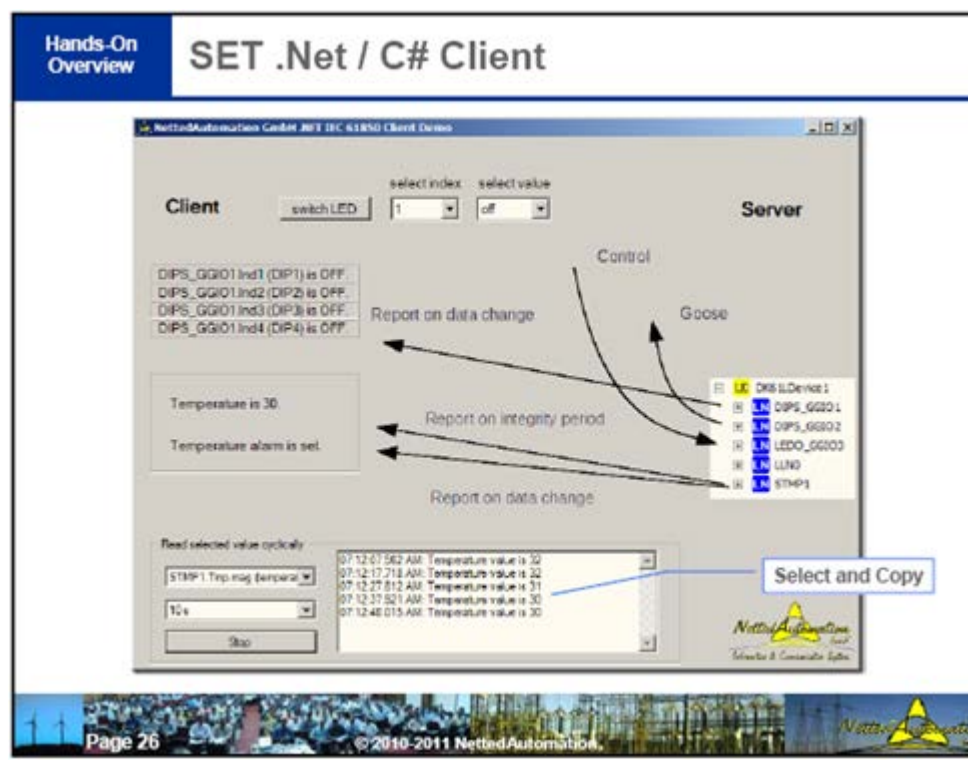

e.g., pasted into an Excel table and converted to a diagram:

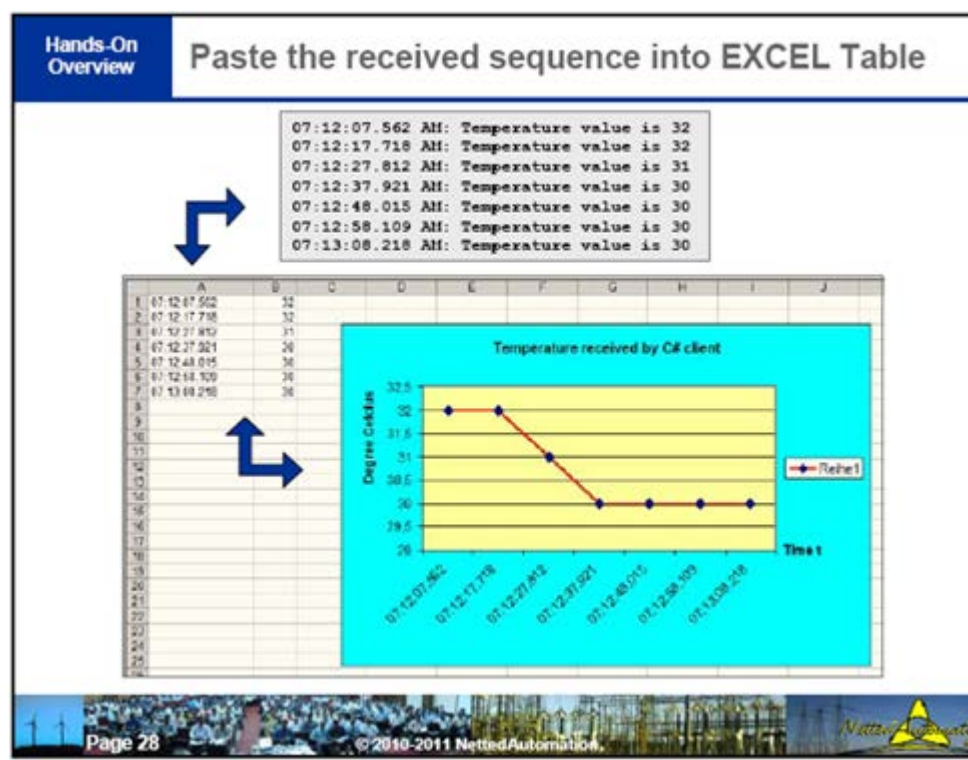

Whatever you need - JUST program it ... or link the client and server applications to **your real applications** ... which may also be masters to any communication slaves like DNP.3, IEC 60870-5-101/103/104, Modbus, Profibus, CAN, ... This way you can easily and fast build your own GATEWAY. Just link the DNP.3 or 104 points to the DLL by YOUR IEC 61850 server application that is bound to corresponding Model. See next figure:

[President of German Federal Network Agency recomme...](#)

[Developers Workshop for IEC 61850 at Myong Ji Univ...](#)

[IEC TC 57 to take action in Smart Grids](#)

[What is the ACSI?](#)

[Do you know what a PIXIT or a TICS is?](#)

[Tutorial of the 5 IEC 61850 Gurus in Sydney was ve...](#)

[IEC 61850 at Smart Grid Symposium and Exhibition](#)

[IEC 61850 certificate for ABB's 800xA Automation S...](#)

[Let YOUR Application speak IEC 61850 in hours](#)

[Triangle Microworks has very comprehensive IEC 618...](#)

► February (16)

► January (8)

► 2010 (153)


► 2009 (162)

► 2008 (82)

Contributors

[Michael Schwarz](#)

[Karlheinz Schwarz](#)

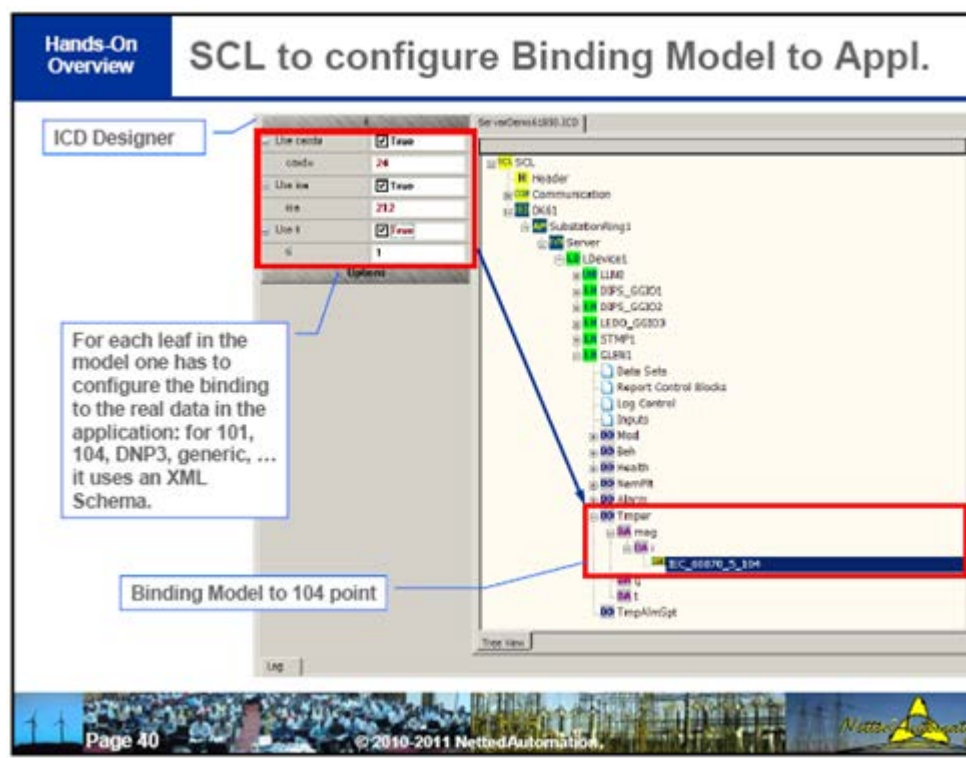

It is that easy. Just give it a try.

By the way, the API (and the underlying IEC 61850 stack) is also available on the [embedded controller from Beck IPC](#) for simple and FAST TO MARKET applications. All you program in C/C++ on a PC could be done on the Chip platform ... the Chip also supports IEC 61131-3 (CoDeSys) and soon ISaGRAF.

[NettedAutomation offers public and in-house training courses](#) using a comprehensive set of crucial evaluation tools - including the one shown here.

Posted by [Karlheinz Schwarz](#) at 4:19 PM 0 comments

Labels: [applications](#), [CAN](#), [communication](#), [cost saving](#), [Data concentrator](#), [DLL](#), [DNP3](#), [Evaluation](#), [Gateway](#), [GOOSE](#), [IEC 61400-25](#), [IEC 61850](#), [ISaGRAF](#), [merging unit](#), [peopleware](#), [programming](#), [SCADA](#), [Smart Grid](#), [smart metering](#)

Triangle Microworks has very comprehensive IEC 61850 Test Tools

The 61850 Test Harness (one big package) has been divided in to three separate products, functionally extended and renamed to **IEC 61850 Test Suite**:

Hammer – **IEC 61850 CLIENT** to test IEC 61850 & 60870-6 servers; and validate GOOSE, Report, Log, Control, and File Services.

Anvil - **IEC 61850 SERVER** to test IEC 61850 & 60870-6 clients; provides GOOSE, Report, Log, Control, and File Services; and generate simulation data automatically, manually, or table driven.

SCL Forge – Substation Configuration Language (SCL) **editor**.

Click [HERE](#) for downloading a 21 day test license.

Enjoy.


Posted by [Karlheinz Schwarz](#) at 1:56 PM 0 comments 

Labels: [IEC 61850](#), [testing](#), [tools](#)

Wednesday, February 23, 2011

Extended C# Client Application for IEC 61850 Evaluation Kit based on DLL

NettedAutomation has updated the C# Client application (GUI) of the [IEC 61850 Evaluation Kit \(DLL\)](#); the server is still the same. The new GUI supports polling values, e.g., the temperature, status or alarms, from the server provided earlier:

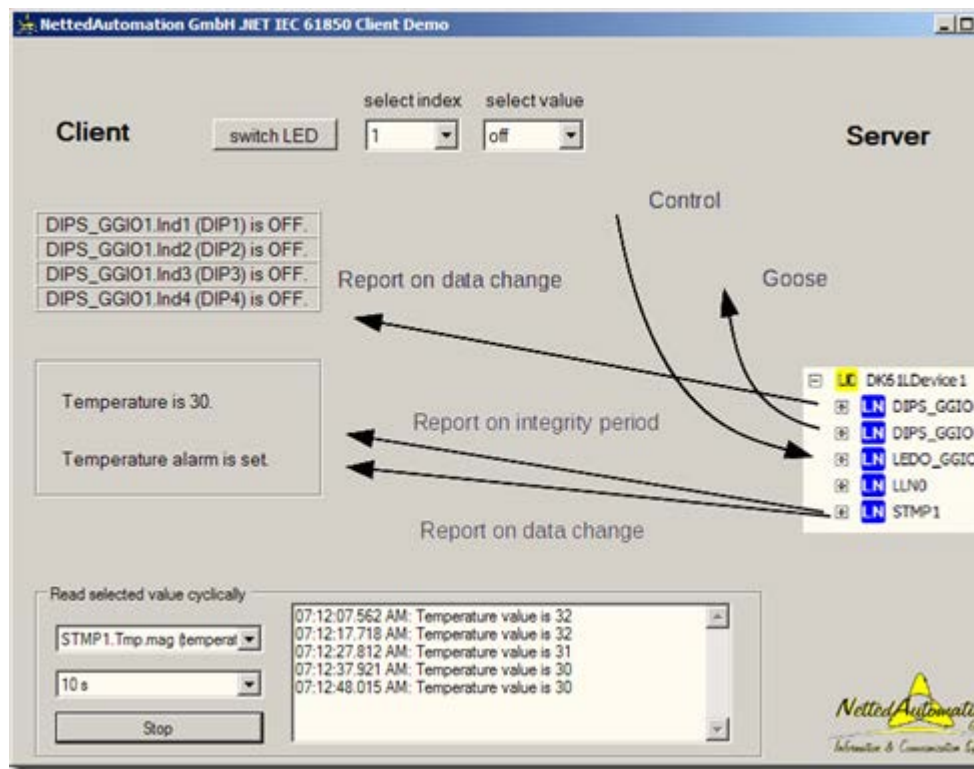

The API allows manual copy and paste (just select the range of values and copy them) as well as storing the values in a database, Excel sheet, or ...


Values copied and pasted:

```
07:12:07.562 AM: Temperature value is 32
07:12:17.718 AM: Temperature value is 32
07:12:27.812 AM: Temperature value is 31
07:12:37.921 AM: Temperature value is 30
07:12:48.015 AM: Temperature value is 30
07:12:58.109 AM: Temperature value is 30
07:13:08.218 AM: Temperature value is 30
...
```

Different polling rates can be selected.

Note that this GUI comes as **executable program** and in **source code** (.Net project)! You can use the example and modify as you want ... it is just so easy to use the IEC 61850 Client API ...configured by an SCL file.

The server console (very easy to run and use!) from the existing Kit looks like this: Changes entered, e.g., t29 changes the temp value to 29 in the server ... this is sent to the client and polled by the client ...

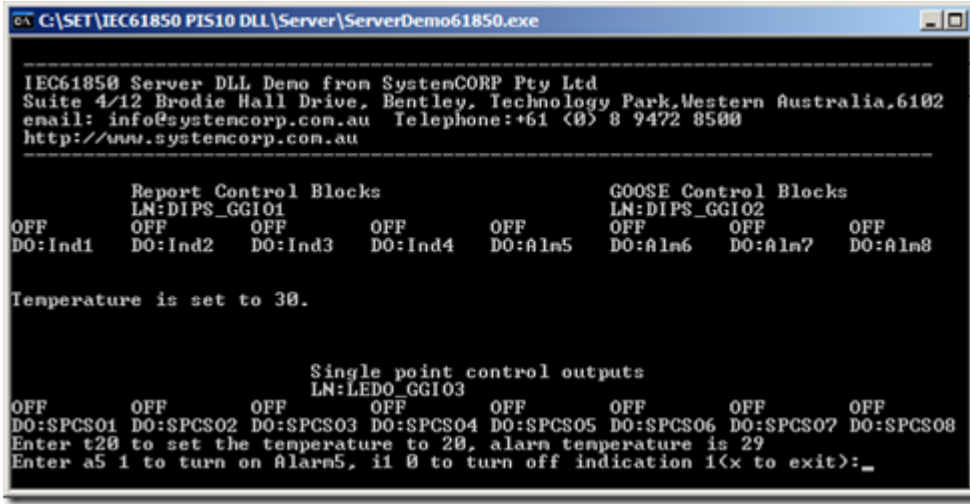

Click [HERE](#) to download the new C# client application (exe and source code). You will be asked to enter your Email and Password -> "Sign in ...". OR if you **don't have an account** or **forgot your password**: Just enter your Email (required) in the middle of the form and click at "I agree with ...". You will immediately receive a new or your current password:

A screenshot of a web form titled "Download area (of NettedAutomation) for the requested files". The form has a yellow background and contains the following sections:
1. Login section: "If you already have an account please enter your email address and your password:". It includes fields for "Email" and "Password", and a "Sign in..." button.
2. Registration section: "Please enter your email address to create an account or if you have forgotten your password. You will receive your password immediately via email." It includes a required "Email" field, radio buttons for "Mr." and "Mrs.", and fields for "First Name", "Family Name", "Company", "Street", "ZIP City", "Country", and "Homepage".
3. Footer: A blue "Disclaimer" link and a button labeled "I agree with the disclaimer - continue".

Please find the three (3) updated files as shown here:

[UPDATED] Readme (III) -- IEC 61850/61400-25 FREE Evaluation/Starter Kit using a DLL [Updated 2011-02-23]	4KB	23.02.2011
<small>SystemCorp (Perth, Australia) and NettedAutomation offer an IEC 61850/61400-25 DLL (Dynamic Link Library) and three Application examples using the DLL: server and client app in C, client app in C#, see below.</small>		
[EXE/SOURCE CODE: Simple Server and Client -- IEC 61850/61400-25 FREE Evaluation/Starter Kit using a DLL: Server and Client]	4975KB	02.09.2010
<small>IEC 61850 DLL + Server and Client Console Applications in C (exe files); C-Source code of client and server Applications included</small>		
[UPDATED] EXE: Simple DotNet Client GUI -- IEC 61850/61400-25 FREE Evaluation/Starter Kit using a DLL: Client [Updated/extended 2011-02-23]	1074KB	23.02.2011
<small>Client application in C# (exe files)</small>		
[UPDATED] SOURCE CODE: Simple DotNet Client GUI -- IEC 61850/61400-25 FREE Evaluation/Starter Kit using a DLL: Client [Updated/extended 2011-02-23]	1158KB	23.02.2011
<small>C# Source code of client application; Visual Studio 2008 project</small>		

The exe code can be used as soon as you have the corresponding server from the server running (see figure above: EXE/SOURCE CODE: Simple Server and Client -- IEC 61850/61400-25 FREE Evaluation/Starter Kit using a DLL: Server and Client).

Click [HERE](#) for a list of supported Server services that is almost completely implemented in the DLL ; the Client (same DLL) provides complementary services.

Enjoy the extended C# application.

Note that the **same API** is provided by the **IEC61850@CHIP** from Beck (see next post).


Posted by [Karlheinz Schwarz](#) at [4:47 AM](#) [2 comments](#) 



Labels: [61850](#), [API](#), [applications](#), [DER](#), [DLL](#), [Evaluation](#), [IEC 61400-25](#), [IEC 61850](#), [PLCS](#), [wind power](#)

Tuesday, February 22, 2011

IEC61850@CHIP - Flyer

A new flyer from Beck IPC, SystemCorp and NettedAutomation explains the architecture of the IEC61850@CHIP. The platform is very powerful, offering a lot of integrated functions, modules, and services like TCP/IP, SSL, IPsec, HTTP(S) server, IEC 61850, CAN Bus, IEC 61131-3, ...

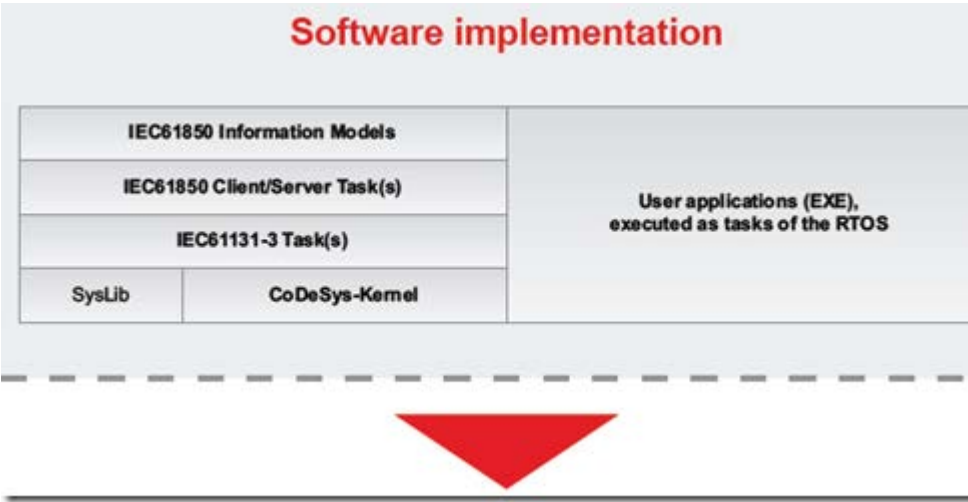

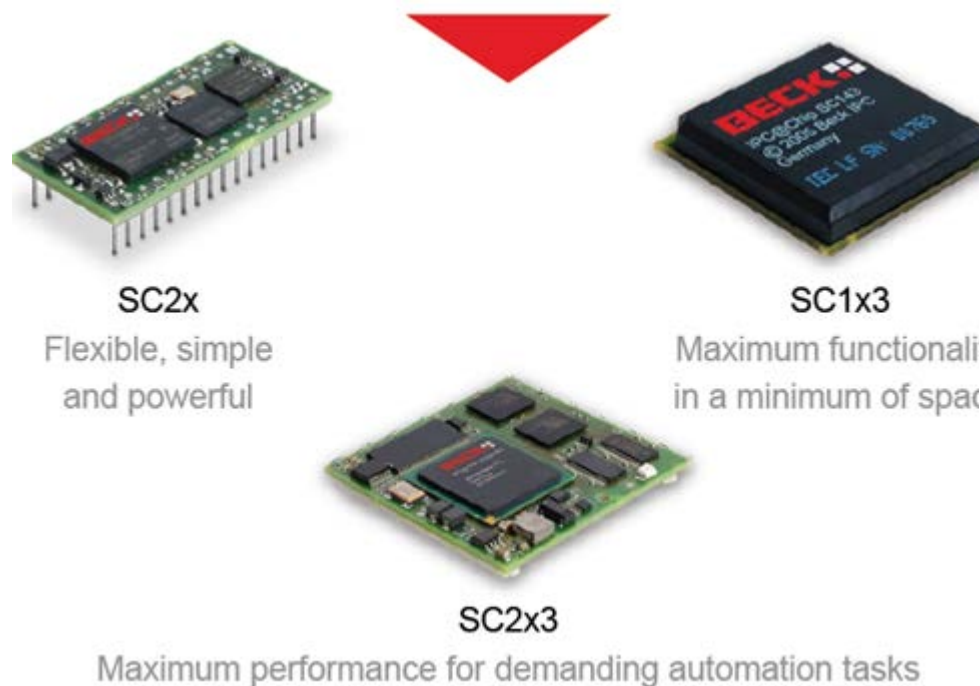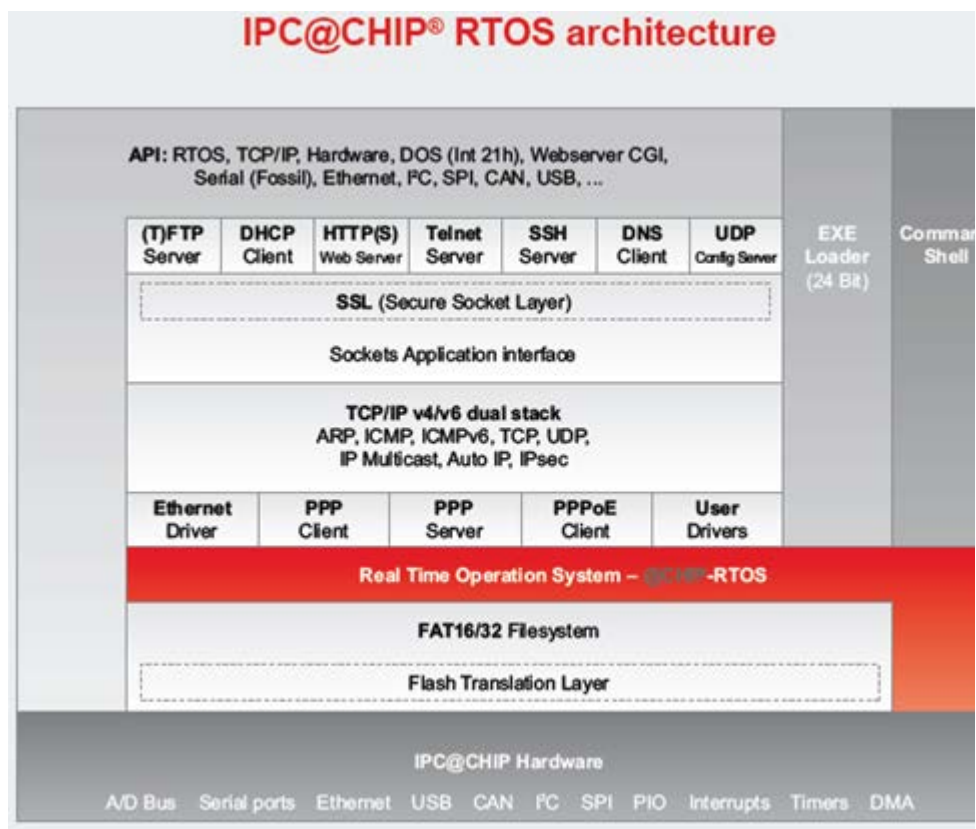

Additional components like the following ones are available for EASY integration ... because the integration is already done by Beck IPC:



More to come

Click [HERE](#) for the flyer [pdf, 0.9 MB].

Posted by [Karlheinz Schwarz](#) at [10:05 PM](#) [0 comments](#) 

Labels: [61850](#), [Beck](#), [CAN](#), [Chip](#), [DER](#), [embedded system](#), [Feldbus](#), [Gateway](#), [IEC 61131-3](#), [IEC 61400-25](#), [IEC 61850](#), [Power Automation](#), [security](#), [TCP/IP](#)

Monday, February 21, 2011

IEC 61850 - Reduces Time to Configure System

It has been said again and again, that the crucial benefit of IEC 61850 is the configuration of IEDs and Systems. Several publications have reported on this issue. E.g., Ralph Mackiewicz, SISCO Inc., reports the following small Co-op experience [see slide 27]:

- Substation Modernization Pilot did 2 substations
- DNP3.0 over TCP and UDP
- UCA2.0 (subset of IEC61850)
- Time to get DNP3 relay configured and communicating: ~ **8 hours**
- Time to get UCA/IEC61850 relay configured and communicating: **20 minutes**
- **\$325K Cost Savings for overall deployment**

Click [HERE](#) for the complete presentation [pdf]

Posted by [Karlheinz Schwarz](#) at [4:58 AM](#) [0 comments](#) 

Labels: [61850](#), [configuration](#), [cost saving](#), [DNP3](#), [IEC 61850](#), [implementation](#)

Friday, February 18, 2011

Are Standards changing too fast?

There are many SCADA users that think standards are changing too fast. I guess this is true for the many interface standards for sensors and actuators (the so-called fieldbuses and sensor interfaces). Lets

have a look on the most crucial communication standards used in IEC 61850 and IEC 61400-25:

Layer 7	MMS (ISO 9506)	some 20 years; likely to stay unchanged
Layer 5-6	ISO Presentation and Session	some 20 years
Layer 4	TCP	some 30 years; likely to stay for a long time
Layer 3	IP	some 30 years v4; likely that v6 will stay for decades
Layer 2	Ethernet	basics: 30 years

One crucial is that wide area monitoring seems to be build on top of TCP/IP - all over. There is no difference in the many different solutions from the transport layer viewpoint. **IEC 61850-8-1 (mapping to MMS) is stable since UCA 2.0 (mid of the 90's)**. RTU protocols like DNP3 or IEC 60870-5-101 **have changed** from serial links to TCP/IP - became more convergent to IEC 61850!! Guess these protocols will be extended to become convergent at model and configuration levels.

When it comes to the application layers, there seems to be mainly ONE standard profile stable: The profile shown above - which is QUITE STABLE.

There were (and are still) many people criticizing that the communication protocols in IEC 61850 are not following new developments faster (e.g., in the application of webservices)! Most people like what we have. When discussing webservices, the question is: **Which one??** There is not an "old" solution like MMS that is around for 20 years. What is discussed is: use IEC 61400-25-2 dedicated webservices, use OPC UA webservices or use DPWS, or ... Reaching consensus in the selection of webservices may take some time. In the meantime we have the stable stack in IEC 61850-8-1. That is what I call: **Sustainable Interoperability**.

Posted by [Karlheinz Schwarz](#) at [8:49 PM](#) [0 comments](#) 

Labels: [DNP3](#), [Feldbus](#), [IEC 60870-5-101](#), [IEC 61400-25](#), [IEC 61850](#), [IEC 61850-8-1](#), [interoperability](#), [ipv4](#), [ipv6](#), [MMS](#), [OPC](#), [standards](#)

Does IEC 61850 require special Ethernet Switches?

NO and Yes! It depends which services you are looking for. The communication profiles for client/server and GOOSE messaging are defined in IEC 61850-8-1.

The services and protocols for client/server communication are defined in the "TCP/IP T-Profile":

Transport	ISO Transport on top of TCP	RFC 1006	
Internet Control Message Protocol (ICMP)	RFC 792		
Transmission Control Protocol (TCP)	RFC 793		
Network	Internet Protocol	RFC 791	
	An Ethernet Address Resolution Protocol (ARP)	RFC 826	
Link Redundancy	Parallel Redundancy Protocol and High Availability Seamless Ring	IEC 62439-3	
Rapid Spanning Tree Protocol (RSTP)	IEEE 802.1D		
DataLink	Standard for the transmission of IP datagrams over Ethernet networks	RFC 894	
	Carrier Sense Multiple Access with collision detection (CSMA/CD)	ISO/IEC 8802-3:2001	

This table shows that the mandatory services and protocols are "standard" Ethernet ... you may purchase in a shop round the corner. There is no need for a special Switch etc.

In case you want to run GOOSE (or sampled values) messages, this requires IEEE [802.1Q](#) (VLAN and Priority Tagging):

DataLink: Priority Tagging/ VLAN IEEE 802.1Q (mandatory)

Ethernet Switches for rugged applications in substations have also to conform to IEC 61850-3 (EMC, EMI, Temp range, ...).

For applications outside substations you may use "standard" Ethernet switches.

Posted by [Karlheinz Schwarz](#) at 7:42 AM 0 comments 

Labels: [Ethernet](#), [IEC 61850](#), [IEC 61850-3](#), [IEC 61850-8-1](#), [real-time](#), [redundancy](#), [TCP/IP](#)

Wednesday, February 16, 2011

How to Secure the Smart Grid Network Infrastructure?

Andrew K. Wright, Paul Kalv, and Rodrick Sibery have published an excellent paper with the title "Interoperability and Security for Converged Smart Grid Networks".

The conclude: " While modern computing and technologies are now widely used throughout control centers and utility enterprise environments, **field communications equipment largely uses outdated technologies**. By deploying a converged smart grid network, utilities like ... can modernize their communications infrastructure, deploy new applications such as AMI and Distribution Automation, and **adopt an architecture that is based on standards and supports interoperability based on Internet Protocol**. **Interoperability** will allow them to replace individual subsystems that become out of date as technology evolves, without requiring forklift upgrades. **Converged smart grid networks** will require strong logical separation of traffic to ensure security of smart grid applications, and this will be best provided by a defense-in-depth architecture that considers security across all layers of the IP stack."

Click [HERE](#) for downloading the excellent paper [pdf, 1.5MB]

Recall the following statement I posted the other day "NAMUR expects that this clear statement and the requirements formulated will enable all

those involved in the standardisation process to work together constructively with a view to achieving a **converged** [added by Karlheinz - Wireless Fieldbus] **standard**.")

Click [HERE](#) for the discussion of the Wireless Fieldbus (NAMUR, ...).

From the view point of information models, configuration Language, information exchange services and (IP-based) protocols we have reached a **very high level of convergence** with IEC 61850 - including the security measures as defined in IEC 62351.

Posted by [Karlheinz Schwarz](#) at [1:46 AM](#) [0 comments](#) 

Labels: [communication](#), [Critical Infrastructure Protection](#), [Cyber Security](#), [IEC 61850](#), [IEC 62351](#), [security](#), [Smart Grid](#), [TCP](#), [TCP/IP](#)

Tuesday, February 15, 2011

SCADA Systems Benefit from IEC 61850 - Test it on your own

Survalent Technology (MISSISSAUGA, ON), reported the completion of the Princes' Islands **IEC 61850 based SCADA system** project for Ayedas Energy Distribution Company that serves more than 1.8 million customers on the Asian side of Istanbul (one of Turkey's largest utilities).

"The project was implemented using IEC 61850 protocol for electrical substation automation, and communicates with 47 SEL protection relays."

""Being able to run our SmartHMI software on the SEL 3354 platform allows customers to take advantage of the features of IEC 61850," states Bijana Dimitrievska, General Manager, Survalent Europe. "IEC 61850 allows protection and control functionality in the substation to be modeled into different logical nodes, and grouped under different logical devices. **This saves considerable time in implementing new protection devices because you do not have to map device points to SCADA points as in the case of DNP protocol.**""

Click [HERE](#) for the complete news release.

Click [HERE](#) for an example of a typical logical node (MMXU) for electrical characteristics (current, voltages, frequency, active power, ...).

Following you find a **brief tutorial** explaining why you could save "considerable time in implementing new devcies".

You can specify a typical LN MMXU type for your project and re-use this type in any protection or control device. A new protection device added in the future will provide the same model!! There is no need for new points mappings. The LN type could formally specified in an SCL DataTypeTemplate (IEC 61850-6).


Here is a special DataTypeTemplate (I just designed for this post) with phase voltages (PhV) and frequency (Hz) only: InType="MyMMXU-Type_0" (see below):


```
<IED type="RTUType" manufacturer="SystemCORP Pty Ltd" configVersion="1.0" name="MyDevice">
  <Services/>
  <AccessPoint name="SubstationRing1">
    <Server timeout="30">
      <Authentication/>
      <LDevice inst="Measurements" desc="">
        <LN0 lnClass="LLNO" inst="" lnType="LLNO_1"/>
        <LN lnClass="LPHD" inst="1" prefix="" lnType="LPHD_1"/>
        <LN lnClass="MMXU" inst="1" prefix="" lnType="MyMMXU-Type_0"/>
      </LDevice>
    </Server>
  </AccessPoint>
</IED>
<DataTypeTemplates>
  ...
  <LNNodeType lnClass="MMXU" id="MyMMXU-Type_0">
    <DO name="Mod" type="ENC_1"/>
    <DO name="Beh" type="ENS_0"/>
    <DO name="Health" type="ENS_0"/>
    <DO name="NamPlt" type="LPL_0"/>
    <DO name="Hz" type="MV_0"/>
    <DO name="PhV" type="WYE_0"/>
  </LNNodeType>
</DataTypeTemplates>
```

The logical device "Measurements" uses one or more instances of this lnType:

```
<LN lnClass="MMXU" inst="1" prefix="" lnType="MyMMXU-Type_0"/>
```

representing MMXU1 (the first instance). The hierarchical model looks like this:

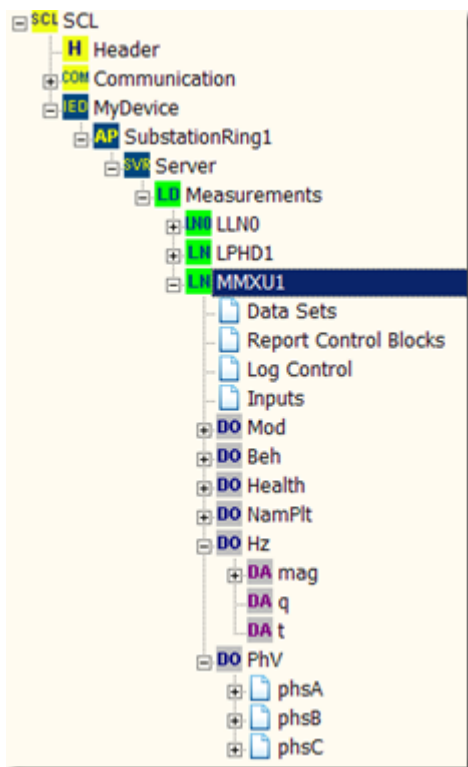

The same lnType can be used for devices from any vendor ... from a SCADA point of view all measurements (Hz and PhV) of all devices have the same structure and names. The values have to be mapped internally in the devices to the real data values of the devices' applications (encapsulated/hidden).

A SCADA system would need mainly to know the IP address. The LD names and LN instances could be figured out by retrieving the self-description from the device. In our example the device would respond: I am a device that contains one LD "Measurements" with a LN "Measurements"; the LN has a DataObject "Hz" and a DataObject "PhV" with "phsA", "phsB" and "phsC".

Or the SCADA system just reads the SCL file to get the model. The SCL document of the model of the IED can be used to simulate this device

...

The IEC 61850 Evaluation Kit provided by SystemCorp could be used to easily implement this (or any other) model, create a server and a client running under Windows. And use the services: GetDaaObjecValues, Reporting, GOOSE ... It is just that easy.

If you want to expose emulated or real voltage values through IEC 61850 you have just to emulate them in your server application or bind them to real values you have on your PC. The application software of the kit comes in exe and source code ... you can start right away to get your data exposed in IEC 61850. For six months FREE evaluation. The kit has two clients (C and C#) and a server (C).

Click [HERE](#) for a link to download the evaluation kit. Enjoy!

Click [HERE](#) for a comprehensive set of slides on the IEC 61850 Evaluation Kit with step by step explanation on how to use the various tools [pdf, 2 MB]

Posted by [Karlheinz Schwarz](#) at 8:31 PM [0 comments](#) 

Labels: [configuration](#), [control center](#), [Data concentrator](#), [DNP3](#), [IEC 61400-25](#), [IEC 61850](#), [interoperability](#), [logical node](#), [model extensions](#), [monitoring](#), [SCADA](#), [starter kit](#)

Shell seems to like IEC 61850 - for Good Reasons

Shell run an assessment of ABB's System 800xA with IEC 61850 capability. In a recent note it has been reported that

""ABB's System 800xA performed very well in wide range of simulated operating conditions during our assessment," commented Audun Gjerde from Shell Global Solutions. "We found that it can integrate multiple systems and processes, while maintaining a high level of system security and process safety."

Shell's evaluation noted several strengths for System 800xA, including its ability to **integrate process and power automation on a single platform with related integration and control of IEC 61850 devices**. This capability further enhances System 800xA's fully integrated power management capability, and the ability to remotely access and control switchgear. This capability reduces commissioning time, while allowing for faster online modifications during operation."

Click [HERE](#) for the report.

Click [HERE](#) for a comprehensive brochure on the 800xA ... with explanations on the benefit of IEC 61850 like:


"IEC 61850 defines **interoperable function** blocks which communicate over a network **with other functions regardless on which suppliers' device they are implementing**. System 800xA's **IEC 61850 communications module is a key** addition to AC 800M communications that enables users to finally **optimize the use of their electrical subsystems within a facility relative to the power utilization required by the process manufacturing needs in real time**."

The interoperability (**ONE protocol stack for client/server** and **ONE for real-time information exchange publisher/subscriber**) between devices from different suppliers is one of the crucial benefits of IEC 61850.

The brochure states on the many fieldbusses:

"System 800xA not only provides **freedom of choice** of fieldbus protocol, but of Foundation Fieldbus networks as well."

There are too many choices - the fieldbus standards are far away from a [convergent solution](#).

Posted by [Karlheinz Schwarz](#) at [12:35 AM](#) [0 comments](#) 

Labels: [ABB](#), [Automation](#), [communication](#), [fieldbus](#), [IEC 61850](#), [Power Automation](#), [process control](#), [Substation](#), [Substation Automation](#)

Sunday, February 13, 2011

IEC 61850 Test Tools for SCADA Applications

The other day I was asked for some guidance in the availability of IEC 61850 test tools for SCADA applications. Here is what I have responded (extended in this blog).

First of all, there are dedicated test tools for protection and control testing of the real-time application behavior (from Omicron, Megger, ...)

I guess you are looking non-real-time application issues. To my knowledge, there are no test tools available for SCADA functions that could run test sequences automatically. What I have so far recommend to experts is to develop their own application test tool that exactly provides what they need.

What you may need for your application test (for non-real-time functions) is to test the information exchange between a SCADA IEC 61850 client and an IEC 61850 IED server (protection, control, ...). This would comprise mainly the following tests:

1. Connect client to the server
2. Browse the model of IED
3. Read status and measurements and store the values in a client test application
4. Control outputs from/to a client/server test application
5. Reporting control and receive reports and store the values in a client test application
6. GOOSE control and sending/receiving GOOSE messages and store the values in a subscriber test application

The most known browser software is the IEDScout from Omicron. This can run tests 1 and 2. It would allow you to do a lot of manually tests for tests 3-6.

I guess what you need is a client that has an IEC 61850 API that allows your client and server Test Application to generate and receive messages automatically - in the order you want.

I would recommend to evaluate the IEC 61850 DLL from SystemCorp (Perth, Western Australia). The evaluation kit comes with two simple client applications (including application source code). You could easily extend the client application to implement a test application that could run your test cases automatically.

The evaluation kit is briefly introduced in the following presentation (from my seminars):

Click [HERE](#) to download the presentation [pdf, 2 MB]

The complete evaluation kit be downloaded form the following page:

<http://nettedautomation.com/iec61850li/dll/index.html>

I guess this is the most efficient way!

This kit also allows to build a server ... in order to test your SCADA application.

The kit runs for six months for free. The DLL could be purchased from SystemCorp later for a reasonable price.

NettedAutomation is developing more client and server applications using the DLL - additional applications will be announced on this block.

Posted by [Karlheinz Schwarz](#) at [8:20 PM](#) [0 comments](#) 

Labels: [61850](#), [applications](#), [DLL](#), [download](#), [Evaluation](#), [IEC 61400-25](#), [IEC 61850](#), [implementation](#), [SCADA](#), [test set](#), [testing](#), [Training](#)

Five IEC 61850 Gurus Conduct Tutorial in Sydney, March 07-09

The comprehensive Tutorial with five world renown professionals is **filling up very fast - to get a seat register NOW**. The IEC 61850 Tutorial is scheduled for Sydney (Australia), 7-9 March 2011.



Click [HERE](#) for the program and other details [pdf].

Click [HERE](#) for the registration form [word].

Click [HERE](#) for additional events ... all over.

NettedAutomation will provide an Evaluation Kit for IEC 61850 clients/server and publisher/subscriber - DLL that runs under Windows. The kit can be used after installation for six months.

By the way, Karlheinz Schwarz is a member of IEC TC 57 WG 10, 17, 18, 19 and IEC TC 88 PT 25, ... he received the [IEC 1906 Award for his engagement](#) in bringing IEC 61850 to the wind power industry.

Posted by [Karlheinz Schwarz](#) at 7:47 PM 0 comments 

Labels: [hands-on Training](#), [IEC 61850](#), [IEC61850Li](#), [IED](#), [MMS](#), [peopleware](#), [programming](#), [SCADA](#), [Smart Grid](#), [Training](#)

Friday, February 11, 2011

Wireless Sensor Networks: Users Want ONE and ONLY ONE Standard

Some 20 (!) years after the publication of the first field bus standards, the acceptance of field busses in the process industry is still behind expectations! The current IEC Field Bus Standards comprise about 100 (!) parts - specifying some 50 solutions under one Standard number:

IEC 61158. No wonder that the users are still looking for a convergent solution.

The German Association [NAMUR](#) (representing some 120 users and vendors involved in process automation) has published a very strong requirement document on the convergence of wireless sensor networks: NE 133 "Wireless Sensor Networks - Requirements for the convergence of existing standards" ("Wireless Sensor Netzwerke: Anforderungen an die Konvergenz der verfügbaren Standards")

NAMUR requires to get coexistence, interoperability and Interchangeability for wireless based technologies.

The press release states that NAMUR is **expecting to get ONE International Wireless Standard** for the process automation domain. ("Die NAMUR erwartet, dass diese klare Meinungsäußerung und die formulierten Anforderungen alle am Standardisierungsprozess Beteiligten zu einer konstruktiven Zusammenarbeit mit dem Ziel **eines konvergierten Standards** bringt." / "NAMUR expects that this clear statement and the requirements formulated will enable all those involved in the standardisation process to work together constructively with a view to achieving **a converged standard**.")

Click [HERE](#) for some details listed in the press release of the annual conference of NAMUR (Nov 2010) [pdf, German].

Click [HERE](#) for the abstract (Zusammenfassung) of NE 133. [Word, de/en]

Click [HERE](#) for the **order form to order a free of charge copy of the requirements document NE 133** [order form, de/en] ... you will get a free copy sent to your email address.

Click [HERE](#) for a list of IEC 61158 standards (Edition 2).

The far too many IEC standardized protocol stacks of the Field Busses (comprising some 12.000 pages) are causing still a lot of headaches and pain.

IEC 61850 provides **JUST ONE Client/Server** and **two Publisher/Subscriber** protocol stack solutions - This is what the Utility domain appreciates very much all over! Many vendors of industrial automation systems have already or will soon implement IEC 61850 - especially for their need to communicate over TCP/IP.

The Protocol stack defined in IEC 61850-8-1 using ISO 9506 (MMS) is not the crucial focus of IEC 61850 at all - BUT when it comes to **interoperability** at device level, then this is very crucial! IEC 61850 has more than protocols: **information models and a configuration language** ...

Posted by [Karlheinz Schwarz](#) at [4:41 AM](#) [0 comments](#) 

Labels: [de](#), [en](#), [exchangeability](#), [Feldbus](#), [IEC 61158](#), [IEC61850](#), [implementation](#), [interoperability](#), [MMS](#), [process control](#), [TCP](#)

Wednesday, February 9, 2011

Working in Australia: IEC 61850 Engineer Wanted

Sinclair Knight Merz (SKM) is looking for a Global Substation Automation Specialist with a "**deep knowledge in the IEC61850** standard protocol suite". You may be interested to work in Australia.

Click [HERE](#) to apply online to this position.

Posted by [Karlheinz Schwarz](#) at 6:07 AM 0 comments 

Labels: [Australia](#), [IEC 61850](#), [Substation Automation](#)

Friday, February 4, 2011

DistribuTech 2011 was a big Success for IEC 61850

The 2 1/2 day DistribuTech 2011 Exhibition in San Diego (USA, CA) from 01.02.-03.02.20011 was a big show of IEC 61850 software, devices, components and training services.

Many experts from all over came to visit the booth 2822 of SystemCorp - many more visitors stopped at the booth than SystemCorp expected.

The experience of the Exhibition is: IEC 61850 IS A CRUCIAL ISSUE in the North American market - and all over!! No Question: IEC 61850 picks-up very fast! During 2011 you will see a big push for IEC 61850 and IEC 61400-25!

The booth presented the following products many people were looking for:

- IEC 61850 stack software (source code, libraries, Windows DLL) from [SystemCorp](#)
- Tools, Gateways (DNP2, 101/104, Modbus, ...) from SystemCorp
- IEC 61850 at Chips from [Beck IPC](#)
- IEC 61850 in small devices (gateways, bay controller, general purpose IEDs, ...) from Beck IPC
- Consultancy services, education and hands-on training from NettedAutomation



SystemCorp Booth at DistribuTech 2011 in San Diego



... Booth setting-up



... Booth waiting for visitors



... a happy expert ... after receiving his Beck Chip Development Kit DK61




... Questions?



... Yes ... Aha, now I understand ... it is that simple, fast to market and powerful!

Click [HERE](#) for more information on the software ... DLL, tools, ...

Posted by [Karlheinz Schwarz](#) at [10:11 AM](#) [0 comments](#) 

Labels: [Beck](#), [DNP3](#), [education](#), [embedded system](#), [IEC 61850](#), [implementation](#), [lite](#), [NettedAutomation](#), [seminar](#), [SystemCorp](#)

Solar Integration System with IEC 61850 Connectivity

Sunverge optimizes the value of solar power by leveraging the practical advantages of distributed generation and energy storage. Their cost-effective energy management system captures solar energy and stores it for use when it's needed most, thereby shifting electrical loads, flattening peak electricity demand and maximizing return on renewable energy investments. With an innovative grid-tied model that fully integrates the latest in lithium-ion energy storage, **an open standards data processing gateway leveraging IEC 61850 and NIST-SGIP interoperability protocols** and a unique hybrid inverter/converter, Sunverge aligns the goals of residential consumers, commercial and industrial customers and electricity utilities to help solve the energy problems of today and tomorrow.

Click [HERE](#) for more information [pdf]

Posted by [Karlheinz Schwarz](#) at [7:20 AM](#) [0 comments](#) 

Labels: [IEC 61850](#), [photo voltaic](#), [PV](#), [Smart Grid](#), [storage](#)

IPv4 address pool is empty - what to do?

As of 3 February 2011, the central pool of available IPv4 addresses

managed by the Internet Assigned Numbers Authority (IANA) is empty.

It means that the central pool of available IPv4 addresses managed by the IANA (www.iana.org/numbers) is empty. As of February 2011, most of the four billion IPv4 addresses available have been allocated for use or reserved for a specific technical purpose.

It is recommended to change to IPv6 in the near future.

Click [HERE](#) for more information [pdf].

One of the first IEC 61850 products that is able to support IPv4 and IPv6 is the [Beck Chip](#) - even it is not yet required in IEC 61850-8-1 Edition 2 FDIS.

Posted by [Karlheinz Schwarz](#) at [5:56 AM](#) [0 comments](#) 

Labels: [IEC 61850](#), [ipv4](#), [ipv6](#)

IEC 61850-8-1 Editon2 available for FDIS Ballot

The next parts out for FDIS (Final Draft International Standard) ballot are:

IEC 61850-8-1 Ed.2:

Communication networks and systems for power utility automation -
Part 8-1: Specific Communication Service Mapping (SCSM) - Mappings to MMS (ISO 9506-1 and ISO 9506-2) and to ISO/IEC 8802-3

Ballot closes: 2011-04-08

IEC 61850-4 Ed.2:

Communication networks and systems for power utility automation -
Part 4: System and project management

Ballot closes: 2011-03-18

The most crucial changes in IEC 61850-8-1 Edition 2 compared to the Edition 1 are:

- support of Gigabit Ethernet
- link layer redundancy
- extension of the length of the object reference: ObjectReference maps to a variable length MMS visible string with a maximum length of 129 octets.
- extension of the reason for inclusion type for comprehensive logging
- mapping of the tracking services
- a second mapping of the objectReference when used in the tracking services, or as linking
- extension of the AdditionalCause enumeration
- simulation of GOOSE telegram
- fixed-length encoded GOOSE message
- removal of the SCL Control Block
- mappings of ACSI service error codes and ISO 9506 error codes have changed. One change that should be noted is the change in usage of object-undefined. The object-undefined code has been replaced by object-non-existent in many responses.

Posted by [Karlheinz Schwarz](#) at [5:23 AM](#) [0 comments](#) 

Labels: [61850](#), [IEC 61850](#), [mapping](#), [MMS](#)

[Newer Posts](#)

[Home](#)

[Older Posts](#)

Subscribe to: [Posts \(Atom\)](#)

News on IEC 61850 and related Standards

Daily news concerning the standards IEC 61850, IEC 61400-25, IEC 61970 (CIM), IEC 60870-5, ...

Thursday, January 27, 2011

NettedAutomation and Kinectrics offer IEC 61850 training in USA and Canada (May/June 2011)

Kinectrics and NettedAutomation will be running two IEC 61850 Seminar/Hands-on Training:

1. **Toronto**, Canada - Week of **May 9th, 2011** at Kinectrics IEC 61850 labs
2. **Cincinnati**, Ohio – Week of **June 20th, 2011** in their U.S. Facility

To inquire more about the May and June Hands-on training sessions, email, Cherie Ferrari, Manager of Training at training@kinectrics.com

These will be presented with expert Karlheinz Schwarz, leader in 61850 technology and applications and featuring the BECK chip – 61850 on a chip. He will be assisted by Dr. Jian-Cheng (J.C.) Tan, Kinectrics expert in IEC 61850 Interoperability of Multi-vendor Devices and Systems.

Posted by [Karlheinz Schwarz](#) at [5:13 PM](#) [0 comments](#) 

Labels: [Beck](#), [distribution automation](#), [IEC 61850](#), [IEC61850](#), [Training](#)

Monday, January 24, 2011

What are Client/Server and Publisher/Subscriber in IEC 61850?

The terms Client/Server (C/S) and Publisher/Subscriber (P/S) in IEC 61850 are describing (communication) roles a real device may have. A device can play any of the four roles - even at the same time.

From an information flow point of view (independent of C/S and P/S) there are different levels of relations: (#1) the Application Layer Protocol or communication view (see first slide); (#2) the system view as seen from an IEC 61850-6 (SCL - System Configuration Language) point of view (see second slide).

(#1) First slide: A server exposes the Data (in a LD/LN) that can be accessed by the client over a TCP/IP connection - may be over Ethernet. Or the client will receive event-driven reports from the server over TCP/IP (Ethernet). This is a 1:1 connection at protocol level. A server may communicate with many clients (one TCP/IP connection between each client and server). The connection is opened by the client. Note: a real device could play both roles - in MMS an association (connection) allows both devices to play both roles (this is not yet used in IEC 61850)!

The slide also shows the publisher and subscriber. The publisher sends multicast messages that are picked-up by subscribers. The subscriber is (at communication level) NOT subscribing to the subscriber. The

Subscribe To IEC 61850 News

 Posts 

 All Comments 

Blog Archive

► [2012](#) (11)

▼ [2011](#) (159)

► [December](#) (5)

► [November](#) (11)

► [October](#) (22)

► [September](#) (11)

► [August](#) (11)

► [July](#) (23)

► [June](#) (20)

► [May](#) (10)

► [April](#) (6)

► [March](#) (16)

► [February](#) (16)

▼ [January](#) (8)

[NettedAutomation and Kinectrics offer IEC 61850 t...](#)

[What are Client/Server and Publisher/Subscriber in...](#)

[Experts of the USE61400-25 Users Group for IEC 614...](#)

[What does "IEC 61850 Lite" mean?](#)

[IEC 61850 in the Backbone of Smart Distribution](#)

message is just sent and any device that has a subscriber role picks-up the messages it wants to receive. Each multicast message has an identification (let's say number 277). The publisher does NOT know who is receiving the messages. This is like picking-up a newspaper at the red traffic light in the morning. You may also subscribe to the publishing house to get the newspaper delivered to your home every morning - this is the real publishing/subscribing).

[Applications of IEC 61850 in Europe and all over](#)


[Growth of Substation Automation with IEC 61850](#)

[IEC 61850 Training Opportunities in 2011](#)

- 2010 (153)
- 2009 (162)
- 2008 (82)


Contributors

[Karlheinz Schwarz](#)
[Michael Schwarz](#)

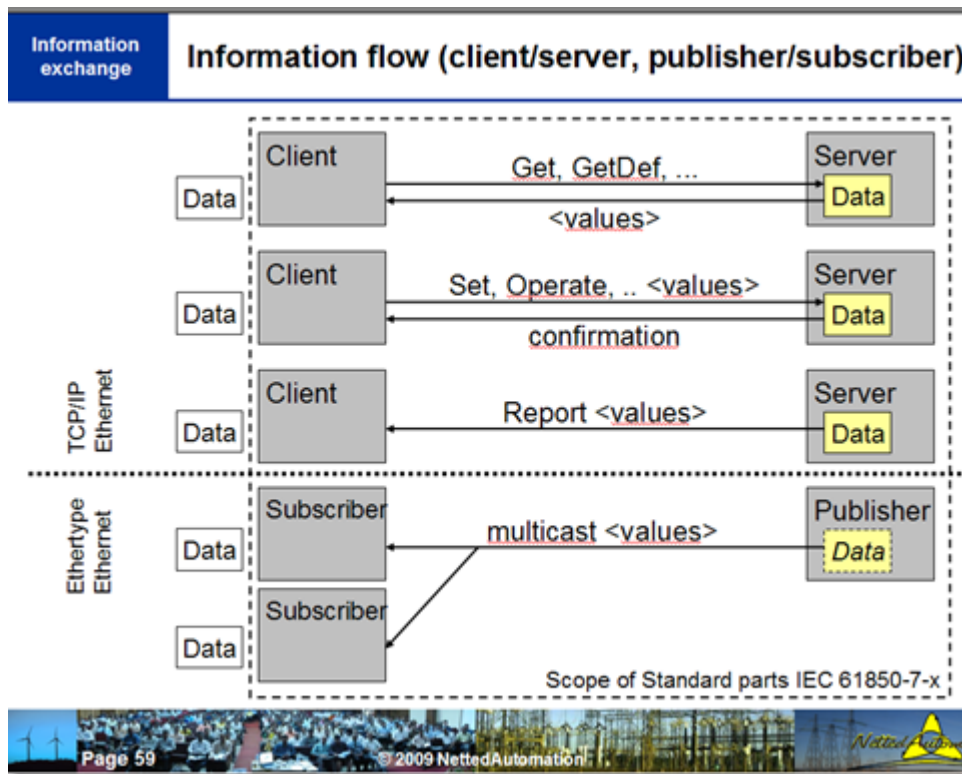


A device that has a Server can model Data (in LD/LN), e.g. status of a circuit breaker. This Data can be used for publishing values (by a DataSet and a Control block). Strictly speaking: a Publisher does not expose a data model. This is done by a server. The publishing service makes use of a server (explicitly or implicitly). Explicitly means: data - dataset - control block - message. Implicitly means: message - you don't see the model; it may be defined in SCL only.


(#2) From a SCL (system) point of view we can model the flow of information from a source (right), through a server/publisher, message, client/server, ... to a sink (see next slide). In SCL we are describing the information exchange between a Data in logical nodes - clients/servers are not in the main focus. SCL provides - in my words - the wiring plan of a whole system (from a source to a sink).

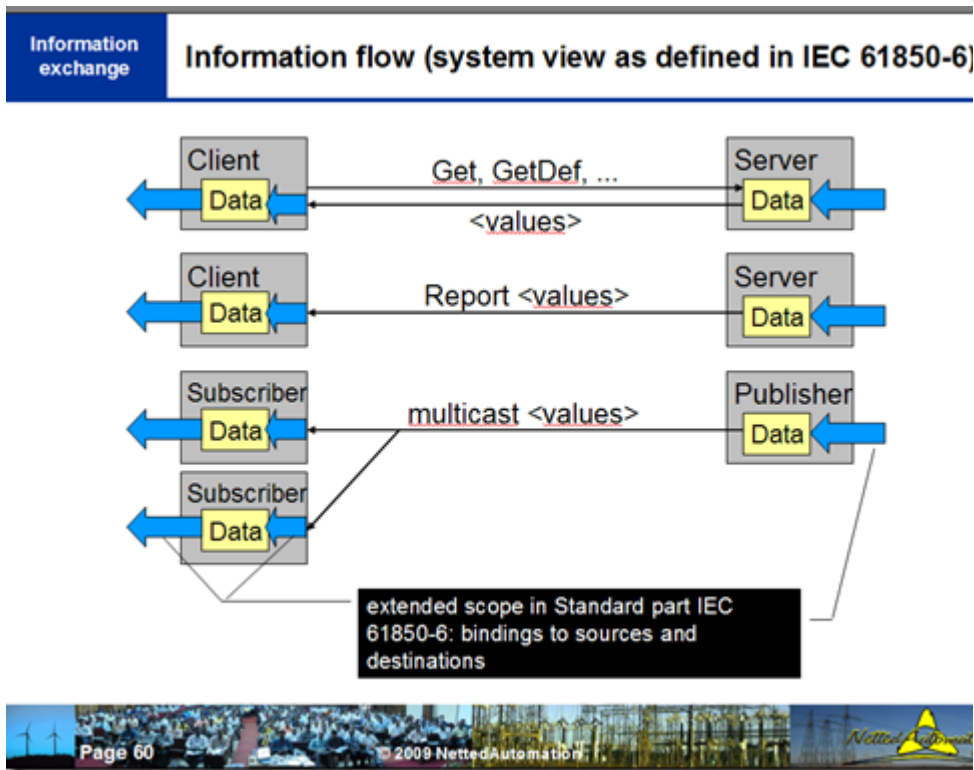

The services defined in IEC 61850 ACSI are listed in the third slide:

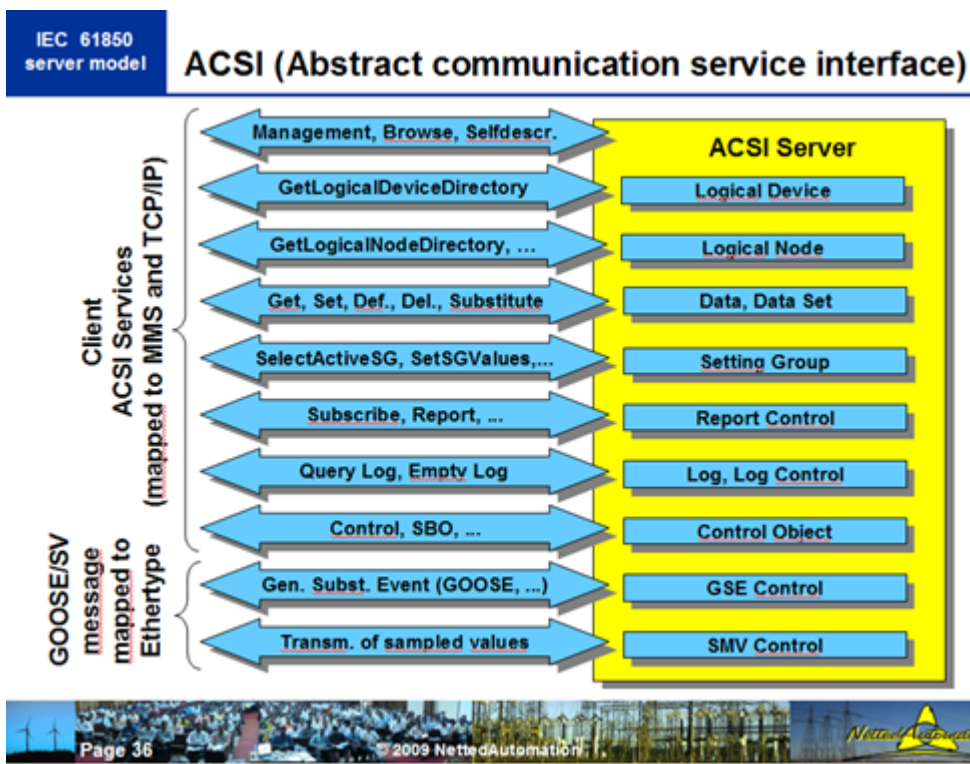

The last slide shows that clients and servers can be cascaded ... this is outside the protocols - but can be specified with SCL! SCL is a VERY powerful specification language!!

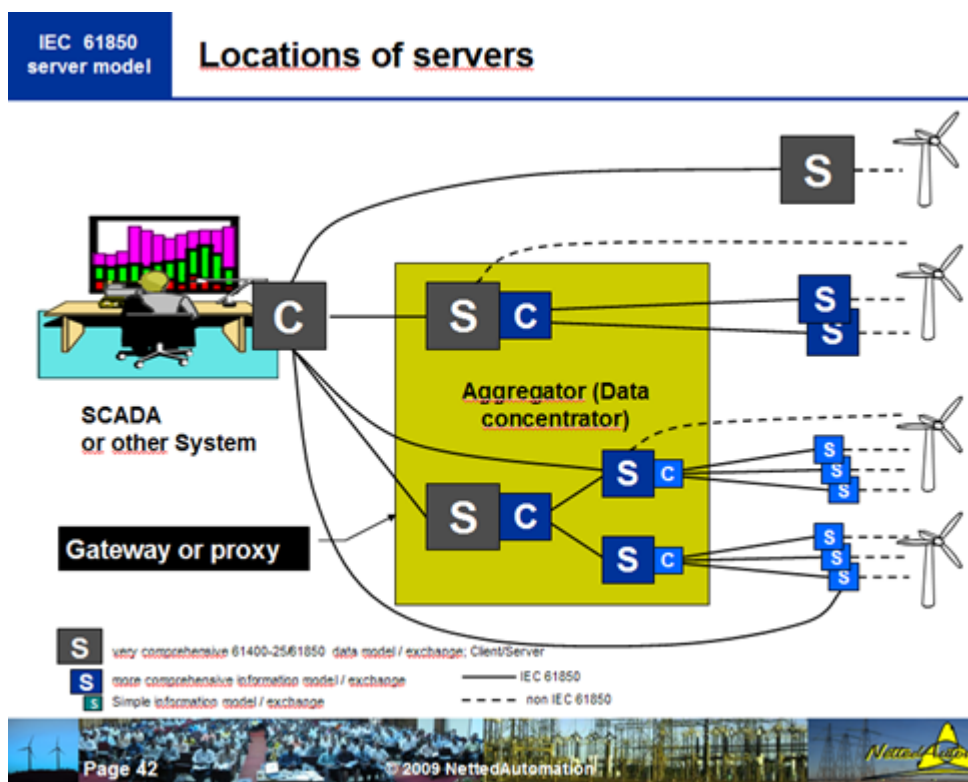

Examples of these cascaded relations are presented and discussed during the hands-on training courses of NettedAutomation ... and much more.

Summary: each device implementing all four roles defined in IEC 61850 can communicate with each other device as a client, server, publisher, and subscriber.

Posted by [Karlheinz Schwarz](#) at 1:34 PM 0 comments

Labels: [ACSI](#), [charging station](#), [Ethernet](#), [Gateway](#), [hands-on Training](#), [IEC 61850](#), [IEC 61850-6](#), [Training](#)

Friday, January 21, 2011

Experts of the USE61400-25 Users Group for IEC 61400-25 met in Fredericia (Denmark)

Many experts of the Wind Power Users Group "USE61400-25" for IEC 61400-25 (IEC 61850) met in Fredericia (Denmark) on Monday (2011-01-17) to report and discuss experiences with the application of IEC 61400-25/61850 for Wind Turbines. **28 experts** (!) from

ABB, AREVA Wind, Bachmann Electronic, DONG Energy
ENERCON, Ingeteam Technology, KEMA, Kenersys,
Mita-Teknik, Natcon7, NettedAutomation,
RE Power Systems AG, Siemens Wind Power,
Vattenfall, Vestas

met and shared the very positive experiences with the standards ... and discussed issues that need modifications and corrections.

<http://use61400-25.com>

Most of these experts met with IEC TC 57 WG 17 (DER) on Tuesday (2011-01-18): 39 people had been in the meeting on Tuesday to share their experiences on Wind Power and DER. WG 17 met until 2011-01-21.

Posted by [Karlheinz Schwarz](#) at [10:32 PM](#) [0 comments](#) 

Labels: [IEC 61400-25](#), [IEC 61850](#), [Users Group](#), [wind power](#)

What does "IEC 61850 Lite" mean?

IEC 61850 is a suite of standards. Implementations usually provide a subset of the various aspects of the many parts (IEC 61850-7-2, 7-3, 7-4, 8-1, 6, ...). There is a document in IEC 61850-7-2 that is used to list the service models and services supported by an implementation (PICS - Protocol Implementation Conformance Statement). The PICS give a good overview about the communication services.

There have been several discussions on specifying a minimum list of these PICS and name it "IEC 61850 Lite". Currently I do not see if there will ever be such a specification, because we have a variety of markets that would need different "Lite" specs. Most programmers (I have talked to the recent years) that want to integrate IEC 61850 software into their application are looking for a "lite" API (Application Program Interface) - for an easy and fast integration into their applications.

This was one of the crucial ideas SystemCorp (Perth, Western Australia, www.systemcorp.com.au) had when they started to implement a "lite" implementation. "Lite" means a - more or less - FULL set of services BUT an easy to use API accompanied by a SCL Design tool that supports designing ICD/CID documents that can directly be used to configure the information model and bind the model to the application program. The resulted easy to use package has gained a huge interest in the market all over.

The crucial issue is to help people to get started within hours and days - not weeks and months. There is a evaluation package available that can be used on Windows. This package comes with a DLL (IEC 61850 software) and a server application (including C source code of application) and two client applications (including C and C# source code of application). You can run the evaluation right away - it is useable for 6 months.

Here is the link to find more details and how to get the kit:
<http://nettedautomation.com/iec61850li/dll/index.html>

The feedback from several of the more than 1,000 users of the evaluation kits shows that this seems to be a "lite" solution many had been looking for. The software runs on other platforms as well.

One interesting platform is the Beck IEC61850@CHIP - to get a very "lite" implementation:
<http://nettedautomation.com/iec61850li/index.html#beck>

I will be at the DistribuTech 2011 (San Diego, Febr 01-03) at booth 2822. Here you can see what a specific "Lite implementation" looks like. Come by for a visit.

Posted by [Karlheinz Schwarz](#) at [10:25 PM](#) [0 comments](#) 

Labels: [API](#), [applications](#), [Beck](#), [download](#), [IEC 61850](#), [lite](#), [SCADA](#), [seminar](#), [Smart Grid](#), [Training](#)

Sunday, January 9, 2011

IEC 61850 in the Backbone of Smart Distribution

Symposium in Darmstadt (Germany), 12th -14th April 2011

"Novel Information and Communication technologies as the back bone for Smart Distribution" has the task to bring together the 12 project teams for a public exchange of experience and to consider solutions and results.

Objective of the Symposium: Exchange of experience between the European and German lighthouse projects.

- Information of the public, of vendors, grid operators and other stakeholders of the energy market, of universities and research institutes about the running lighthouse projects.
- Discussion of the broad dissemination of the project results and how to overcome the existing barriers.

Some key presentations will be on the implementation and application of IEC 61850.

Click [HERE](#) for the full program [pdf]

Posted by [Karlheinz Schwarz](#) at [9:15 PM](#) [0 comments](#) 

Labels: [E-Energy](#), [IEC 61850](#), [Smart Grid](#)

Wednesday, January 5, 2011

Applications of IEC 61850 in Europe and all over

The year 2011 started with some questions I received from an employee of a big distribution company:

1. How is the implementation of IEC 61850 here in Europe especially in German Utility Company?
2. Are there lots of substation using this IEC 61850?
3. Are there lots of success stories from utility companies around the world using this IEC 61850?
4. Will the standard IEC 61850 do lots of revisions (editions) again in the years to come?

Here is my answer [slightly revised]:

I am happy to assist you in the domain of a very new standard composed of some quite "old" standards. The various components of IEC 61850 are:

- Ethernet -> some 30 years old
- TCP/IP -> some 30 years old
- MMS -> some 25 years old
- XML -> some 15 years old
- Information Modeling -> some 25 years old

The crucial new thing is, that we have composed a comprehensive standard with many different aspects ... building a SYSTEM. This is more than a new communication protocol ...

Ok, here are my answers to your specific questions:

1. How is the implementation of IEC 61850 here in Europe especially in German Utility Company?

<KHS>

IEC 61850 is used in many utilities and many production sites like power plants, petrochemical plants, factories, ... usually turnkey substation automation systems from one vendor.

There is no question to use it or not - if there is a question then it is

this issue: How to specify what utilities want and how to use the standards (in some details).

</KHS>

2. Are there lots of substation using this IEC 61850?

<KHS>

Yes, the figures I have: more than 3000 worldwide.

I have a list of SICAM PAS-projects with IEC 61850. They list **433** projects with IEC 61850 (updated October 2010).

</KHS>

3. Are there lots of success stories from utility companies around the world using this IEC 61850?

<KHS>

Yes. Most stories are very positive. There are mainly issues with the question: What do utilities expect??!?

Utilities have to get more deeply involved in the specification of the requirements. Or they may get something they did not expect ... too much or too less ...

I have been invited many times to help utility engineers to understand what their company has ordered and what was commissioned. Often the engineers have no clue what they got - even after the substation automation systems were in operation!!

IEC 61850 is not IEC 61850 !!

In order to get what your utility want, your utility has to understand the big impact of IEC 61850 on almost everything !!! Then the people have to tell the vendor/system integrator what they want AND what they DO NOT what!!

This requires well educated utility experts ... that is usually the problem.

</KHS>

4. Will the standard IEC 61850 do lots of revisions (editions) again in the years to come?

<KHS>

No! There is little impact from new documents to be expected - the base technology is very stable, tested and in operation.

</KHS>

I highly recommend to you and your utility to receive education - this is the most crucial issue today!

The recent Newton-Evans study figured out:

"Utility manpower shortages continue to negatively impact the ability of technology supplier companies to engage utilities for other than short-term requirements. However, third party engineering and integration service firms have recently made significant strides in winning substation automation-related business, from planning to design to construction and installation."

Click [HERE](#) for the news report on the study.

This is exactly what I have learned for years: There is a **lack of smart people** to deal with the future technologies in power systems. So, we have to wait until the next generation of engineers arrives: people that will use what is advanced and available and that can be downloaded from the Web ... like the IEC 61850 Windows DLL evaluation Kit to get first results within hours ...

Click [HERE](#) for the IEC 61850 Windows DLL.

Click [HERE](#) for some discussion on the education of utility experts.

Posted by [Karlheinz Schwarz](#) at [2:00 AM](#) [1 comments](#) 

Labels: [education](#), [electric power system](#), [IEC 61850](#), [implementation](#), [Power Automation](#), [Substation](#), [Substation Automation](#)

Growth of Substation Automation with IEC 61850

There seems to be an ongoing interest in doing market studies in order to figure out what will be the technologies applied in power system automation in the next years or decades. One of the latest is the following report:

"The World Market for Substation Automation and Integration Programs in Electric Utilities: 2011-2013." by Newton-Evans Research Company

Click [HERE](#) for a brief news information found on the Newton-Evans website.

Click [HERE](#) for some details from the report from Business Wire.

The number of systems installed in the electrical power delivery systems is much bigger than what these kind of studies show. The news reports: "Respondents indicated a total of **1,567 transmission substations** and **5,154 distribution substations** in operation as of the 4th quarter of 2010. These represent a 9% sample of U.S. and Canadian combined totals of transmission voltage substations and nearly 10% of all distribution voltage substations."

The power market is a global market - the potential market for IEC 61850 is global as well! The numbers of applications is in the Millions! Check what Enel reported during the recent first European IEEE Smart Grid conference in Gothenburg (Sweden): Enel owns over 0.4 MILLION MV/LV Substations! HV and MV network are remotely operated, more than 0.1 MILLION MV substations remote controlled ... There is a potential of 0.3 MILLION LV substations where IEC 61850 one way or the other may be used in the next decade.

One of Enel's project deals with even more potential use cases of IEC 61850:

Active Control of Distributed Energy Resources (DER) connected to the Medium Voltage network: The project will deal with:

- Realizing an advanced control system
- Implementing an "always on" and standard-based communication solution connecting all the relevant nodes in the network, including DER locations.
- Implementing Voltage Control (at all nodes) and Power Flow Control in the MV network.

Click [HERE](#) for the complete presentation by Enel.

Take, for example, the number of PV inverter manufactured monthly by one vendor: SMA (Germany):

"On the reporting date, SMA had a maximum annual production capacity of approx. **11 GW** worldwide. This corresponds to a doubling in annual production capacity in comparison to the end of 2009. Owing to the better availability of electronic components, SMA was able to utilize almost fully its existing production capacities in the **third quarter of 2010** with an inverter output sold of nearly **2.6 GW**. In the first nine months, SMA sold inverter output of 5,738 MW in total" ... I guess this means some **500.000 PV Inverters** from one manufacturer (assuming average inverter of 20 kW) !!

Click [HERE](#) for the SMA news report.

Taking the monitoring, control and automation needs reported by Enel (above) into account means: there is a **potential global market of MILLIONS of devices per year that need "standard-based communication"**. IEC 61850 has almost everything needed.

In this light we have to look at what Newton-Evans figured out:

"Of 5,154 distribution substations in operation at participating utilities, nearly 36% were reported to be without any automation. Just over one-half (52%) of these distribution substations were classified as Stage 1 sites (having some IEDs, RTUs, and two-way communications). About 12% were reported to be "fully automated.""

When we talk about **"standard-based communication"**, we have to use a **wide-angle lens** - not a zoom lens to focus on some substations in the U.S. There are definitely a lot more of opportunities globally!

There is a bright future for IEC 61850!

Posted by [Karlheinz Schwarz](#) at [1:46 AM](#) [0 comments](#) 

Labels: [active power control](#), [Automation](#), [communication](#), [condition monitoring](#), [control](#), [DER](#), [distribution](#), [distribution automation](#), [electric power system](#), [IEC 61850](#), [interoperability](#), [medium voltage](#), [Power Automation](#), [Transmission Grid](#)

Tuesday, January 4, 2011

IEC 61850 Training Opportunities in 2011

We hope you had a smooth start into 2011. This year we will see a lot more applications of IEC 61850 on all voltage levels: high, medium and low voltage.

NettedAutomation has trained more than 2,200 experts from more than 500 companies and more than 60 countries. Thanks to all that have chosen these services.

Please find the updated list of opportunities for public events in 2011:

Sydney (Australia), 07.-09. March 2011 2 day IEC 61850 Training by 5 Gurus	Details
Frankfurt (Germany) 3 day IEC 61850/61400-25 Seminar/Hands-on Training (NettedAutomation) with Measurement IED and several demo software (fully functional)	04.-06. May 2011 14.-16. September 2011
Nashville (TN, USA), Remote Conference, 20.-21. September 2011 2 day Seminar (NettedAutomation) on Power System Communication covering IEC 61850, IEC 61400-25, DNP3, NIST Interoperability Roadmap, Smart Grids, ...	Details (preliminary)

Note that most training courses are conducted as in-house events - the most effective way to get what you need.

Posted by [Karlheinz Schwarz](#) at [12:04 AM](#) [1 comments](#) 

Labels: [education](#), [hands-on Training](#), [IEC 61400-25](#), [IEC 61850](#), [seminar](#), [Training](#)

Friday, December 31, 2010

Greetings from (C)old Germany

As 2010 comes to a close, I want to say "Thank You!" for visiting the IEC 61850 Blog. We wish you and your family a happy, healthy and prosperous New Year 2011.

I look forward to serving you with a lot of news during the next year - there will be a lot to be reported in 2011.

Best Regards,
Karlheinz

Early morning winter impressions in our backyard ... the palm tree is protected by some lights - we hope that it will survive:



A very cold morning ... the fish pond is frozen ... the sun is very low:



We have more snow as usual ... even here in the Rhine river valley we have a lot.

... and some greetings from my IEC 61850 dolls explaining the modeling approach of IEC 61850 and IEC 61400-25:

An IED contains a Logical Device ...



... a Logical Device contains a Logical Node, a Logical Node contains a DataObject, a DataObject contains ...



To access the specific DataObject ("Tmp", Temperature Value) you have

to "open" an IED ("MyDevice" at, e.g., 198.168.178.99), open a Logical Device ("MyLD"), open a Logical Node ("STMP1") and get the "Tmp.mag.i"

Any question?

Posted by [Karlheinz Schwarz](#) at 4:54 AM 4 comments 

Labels: [IEC 61850](#), [logical node](#), [Object model](#)

Thursday, December 30, 2010

Some applications of SCL (IEC 61850-6)

The System Configuration Language serves many applications in substations and in distributed automation in general. Often people are a little bit confused ... they read here and there - but do not get the full story.

The following list is intended to help people to find a way to get a better understanding:

1. To understand SCL (System Configuration Language) I recommend to read/study IEC 61850-6 Edition 2.

2. There are many applications of SCL files (some may not be found in any standard):

- System design → single line diagram (re-useable designs in library)
- IED development → IED capabilities
- System engineering → System configuration (re-useable config.)
- IED configuration/parameterization → running IEDs
- Documentation → provides view of system
- Plausibility/verification → check if system is able to run
- Self description of IEDs → Retrieve IED section from IED
- Validation of Device content → Check model against standard
- Simulate I/Os of IEDs for testing → Fieldbus driven remote I/O
- Simulate IEDs → Generate virtual IEDs on computer from SCL file
- Message interpretation → Use SCL file to get semantic of the model
- ...

One or the other tool is needed for all of these applications. Some tools are available, other tools are under development ... the good thing is: the files are all written in ASCII-Code !! so that your 16 year old son or daughter can write simple but powerful tools by just searching and comparing TEXT !!

Example: It is easy to check if for every control block in an Input section (Sink) there is an IED with exactly that control block (Source) ... and so on.

3. SCL is not complex - it is very comprehensive. I have conducted many seminars and training sessions on IEC 61850 ... SCL is very crucial to understand ... SCL is 51 per cent of the standard in the long run ... in my opinion.


4. The blue sky is the limit of the use of SCL.

5. Today's implementations of IEDs and Tools is quite limited ... but wait ...

6. A two-page overview of IEC 61850 can be found here:
http://nettedautomation.com/standardization/IEC_TC57/WG10-

12/iec61850/What-is-IEC61850.pdf

I wish you and your family a healthy and happy new year.

Posted by [Karlheinz Schwarz](#) at [11:21 PM](#) [0 comments](#) 

Labels: [configuration](#), [IEC 61850](#), [IEC 61850-6](#), [SCL](#)

Thursday, December 23, 2010

IEC 61850 provides a lot for the Smart Electrification

The recently published IEC white paper :

Coping with the Energy Challenge

The IEC's role from 2010 to 2030

Smart electrification – The key to energy efficiency

discusses the need of standards! No surprise, or?

Click [HERE](#) to download the white paper [pdf, 1,9 MB]

The paper concludes on page 51:

"The standards should cover connection (especially of fluctuating sources), stability, "intelligence" (required functions of the IT applications controlling the grid), and minimum systemic efficiency as well as how to measure it. Aspects to deal with include balancing **demand and generation, power quality, harmonic current emissions, voltage flicker, voltage fluctuation and islanding prevention**. The standards should allow for the necessary differences in approach and choices made in different countries; thus some of the resulting publications may be non-normative.

In order to facilitate implementation, the MSB [IEC Market Strategy Board] further recommends the IEC and cooperating organizations to **organize a public symposium on what the necessary standards and other IEC publications on the "smart grid" should contain.**"

The paper states at very beginning:

"As the first IEC President, Lord Kelvin, always said: **"If you cannot measure it, you cannot improve it!"**. This statement is especially true here: without measurement you can't credibly demonstrate energy efficiency improvements. The IEC provides and will continue to provide many of the **measuring standards** that are the basis for benchmarking, energy audits and compliance assessments."

The edition 2 of IEC 61850-7-4 (Information models) covers already many models **of these measurements**:

5.10 Logical nodes for metering and measurement LN Group: M

5.10.2 LN: Environmental information Name: MENV

5.10.3 LN: Flicker measurement name Name: MFLK

5.10.4 LN: Harmonics or interharmonics Name: MHAI

5.10.5 LN: Non-phase-related harmonics or interharmonics Name: MHAN

5.10.6 LN: Hydrological information Name: MHYD

5.10.7 LN: DC measurement Name: MMDC

5.10.8 LN: Meteorological information Name: MMET

5.10.9 LN: Metering Name: MMTN

5.10.10 LN: Metering Name: MMTR

5.10.11 LN: Non-phase-related measurement Name: MMXN

5.10.12 LN: Measurement Name: [MMXU](#)

5.10.13 LN: Sequence and imbalance Name: MSQI

5.10.14 LN: Metering statistics Name: MSTA

5.12 Logical nodes for power quality events LN Group: Q

5.12.2 LN: Frequency variation Name: QFVR

5.12.3 LN: Current transient Name: QITR

5.12.4 LN: Current unbalance variation Name: QIUB

5.12.5 LN: Voltage transient Name: QVTR

5.12.6 LN: Voltage unbalance variation Name: QVUB

5.12.7 LN: Voltage variation Name: QVVR

Click [HERE](#) for the preview of IEC 61850-7-4 (first 20 pages) to see the complete list of Logical Nodes defined.

If there is any (measurement) information found in real electrical system not yet modeled and standardized, you can define extension according to well defined extension rules in IEC 61850-7-1 (name space concept).

There is no need to define another series of (information models and information exchange) standards for electrical grids.

Posted by [Karlheinz Schwarz](#) at [9:54 PM](#) [0 comments](#) 

Labels: [Automation](#), [IEC 61850](#), [Information Model](#), [low voltage](#), [measurements](#), [medium voltage](#), [model extensions](#), [models](#), [monitoring](#), [NIST Roadmap](#), [Power Automation](#), [Smart Grid](#)

IEC 61850-7-3 published as International Standard

The second edition of IEC 61850-7-3 Ed.2 has been published early December 2010:

Communication networks and systems for power utility automation – Part 7-3: Basic communication structure – Common data classes

The second edition replaces the first edition, published in 2003.

The second edition:

- defines new common data classes used for new standards defining object models for other domains based on IEC 61850 and for the representation of statistical and historical data, and
- provides clarifications and corrections to the first edition of IEC 61850-7-3.

Click [HERE](#) for the preview of the standard (first 20 pages).

Posted by [Karlheinz Schwarz](#) at [9:29 PM](#) [0 comments](#) 

Labels: [Edition 2](#), [IEC 61850](#), [IEC 61850 edition 2](#), [model extensions](#), [models](#)

IEC's role from 2010 to 2030 - And IEC 61850

As 2010 comes to a close, I want to say "Thank You!" for visiting my blog.

We wish you and your family a happy, healthy and prosperous New Year 2011.

I look forward to providing useful information on IEC 61850 and related standards ... like the following:

While the big organizations are looking for the next 20 years to convert electrical grids to make them smarter, we (several working groups within IEC) are already working on it.

An IEC white paper discusses the need of standards:

Coping with the Energy Challenge
The IEC's role from 2010 to 2030
Smart electrification – The key to energy efficiency

Click [HERE](#) to download the white paper [pdf, 1,9 MB]

The white paper recommends "IEC, in close cooperation with CIGRÉ, NIST and other relevant organizations, to **develop** rapidly a full and detailed set of standards giving minimal performance rules and a full set of options for the operation of grids. This should be conceived as a part of the set of standards needed by "smart grids".

I guess that we **have crucial parts of the "set of standards" already** in use for some time: IEC 61850. IEC 61850 is definitely part of the future of a smarter grid !! Also in 2010 I have not seen any competing solution! IEC 61850 is a unique standard.

In 2010 I have seen a lot of requirements from the low voltage application domain (power distribution) in utility grids and in many other areas like buildings and factories.

One major step towards a broader use of IEC 61850 is the publication of the simple and very efficient free "Evaluation and Starter Kit for IEC 61850". The Kit has been downloaded several times per day ...

Click [HERE](#) for more information.

Posted by [Karlheinz Schwarz](#) at 9:17 PM 0 comments 

Labels: [61850](#), [Automation](#), [communication](#), [IEC 61850](#), [low voltage](#), [NIST Roadmap](#), [Power Automation](#), [Smart Grid](#), [standards](#)

Saturday, December 11, 2010

VDE fordert zügigen Ausbau der Stromnetze

Laut einer Pressemitteilung des VDE haben Experten der Energiebranche in Mannheim die **Roadmap** für den Umbau der deutschen Stromnetze diskutiert. Mittlerweile gehört es zur Pflichtübung aller möglichen Organisationen eine Roadmap für den Einzug der Informations- und Kommunikationstechnik in die Energieverteilung zu erstellen. Längst bevor die ersten Normungs-Roadmaps erschienen, war die wichtigste Norm bereits veröffentlicht und im Einsatz.

Laut obiger Diskussion in Mannheim, "erfolgt die Aufrüstung zum Smart Grid im Wesentlichen durch Einbau und Nutzung von **Sensoren** und **Aktoren** sowie **Informationstechnologie**, um möglichst viele Informationen über den Zustand zu erhalten, also den Beobachtungs- und Steuerungsgrad deutlich zu steigern. Um zu einem smarten Verteilungsnetz zu kommen, werden die **Ortsnetzstationen im ersten Schritt mit Mess- und Kommunikationseinrichtungen ausgerüstet.**"

Das gilt für die Energieversorgung in allen Regionen dieser Erde, in öffentlichen Netzen, in Gebäuden, Fabriken und anderen Liegenschaften - und für alle Spannungsebenen! Während an vielen Ort gerade begonnen wird, eine Normungs-Roadmap für die Kommunikations- und Informationstechniken zu erarbeiten - **fahren viele bereits** auf einer gut ausgebauten Autobahn für die Energieversorgung: **Auf dem Highway "Route 61850".**

IEC 61850 ist DIE internationale Norm für die (elektrische) Energieversorgung!

Hier [KLICKEN](#), um zur VDE-Pressemitteilung zu gelangen.

Posted by [Karlheinz Schwarz](#) at [7:04 PM](#) [0 comments](#) 

Labels: [de](#), [IEC 61850](#), [monitoring](#), [SCADA](#), [sensoren](#), [Smart Grid](#), [Substation](#), [Substation Automation](#)

NERC - Supports IEC 61850 to keep the Transmission and Distribution Grid reliable

NERC (North American Reliability Corporation) has just published an interesting comprehensive analysis of the impact of Smart Grids on the reliability of the transmission grids:

Reliability Considerations from Integration of Smart Grid

December 2010

The report recommends that the **interoperability of devices and systems** is one of the crucial issues in future electric power systems - including industrial sites and buildings. There is obviously one standard that supports the interoperability to a high extend on all voltage levels: **IEC 61850**.

On page 82 the report states: "An important example of why smart grid standards need to recognize the interoperability between equipments used in **transmission and distribution**, is the requirement of mapping of Distributed Network Protocol 3 (DNP3) with IEC 61850. **DNP3 is the legacy communication protocol** that is followed for large volume data exchanges between equipment. **However, IEC 61850 is recognized to be a better standard suited for smart grid communications.** To bridge the gap between the legacy DNP3 protocols and the newer IEC 61850, a mapping is required when exchanging certain data types. The goal is to ensure that data are seamlessly transported between devices regardless of their adopted communication standards. DNP3 has recently been adopted in IEEE Standard 1815. An IEEE standard and an SGIP PAP working group are currently supporting the mapping effort between IEC 61850 and the IEEE 1815/DNP3 standards."

Click [HERE](#) to download the full NERC report.

Posted by [Karlheinz Schwarz](#) at [4:40 PM](#) [0 comments](#) 

Labels: [Critical Infrastructure Protection](#), [distribution](#), [distribution automation](#), [DNP3](#), [IEC 61850](#), [NIST](#), [Transmission Grid](#)

Wednesday, December 1, 2010

Normungs-Roadmap für E-Mobilität und IEC 61850

Über die Webseite des DIN (Berlin) wurde am 30.11.2010 die "Deutsche Normungs-Roadmap Elektromobilität" veröffentlicht:

Die deutsche Normungs-Roadmap
Elektromobilität – Version 1
Version 1 - 30. November 2010

Die Normungs-Roadmap referenziert auch die Normenreihe IEC 61850 als Bestandteil der zukünftigen Ladeinfrastruktur! Das war zu erwarten, weil in diesem Kontext beispielsweise auch das drei-phasige Drehstromnetz eine Rolle spielt, das bereits seit Jahren in einem Standard-Modell definiert ist: [MMXU nach IEC 61850-7-4](#).

Als engagierter Normer (seit 25 Jahren) sehe ich mit den Smart(er)-Grid-Aktivitäten eine große Chance für die Normung!! Ich hoffe, dass alle betroffenen Kreise in Deutschland die **bereits BESTEHENDEN** Normen anwenden, und nicht - wie im Bereich der industriellen Feldbusnormung - in die [Vielfalt verfallen](#)!!

„Wir streben eine weltweite Normung an, um möglichst viele Synergien von nationalen und internationalen Konzepten zu erreichen – vor allem auch im Sinne des Kunden“, sagt Michael Dick in der Pressemitteilung zur Roadmap. Liegt hier der Schwerpunkt auf "weltweite Normung" oder "**EINE** weltweite Normung"?

Das ist ein lobenswertes Ziel! Die EINE Norm ist mit IEC 61850 für den Bereich der Ladeinfrastruktur im Wesentlichen bereits erreicht. Alle grundlegenden Teile der Normenreihe IEC 61850 und IEC 61400-25 sind seit mehreren Jahren bereits International Standard. Diese Normen sind zum guten Teil ohne Änderungen anwendbar!

Klicken Sie [HIER](#) zur Pressenotiz mit dem Link zur Normungs-Roadmap.

Posted by [Karlheinz Schwarz](#) at [11:02 PM](#) [0 comments](#) 

Labels: [de](#), [E-Mobility](#), [electric power system](#), [electric vehicles](#), [Fieldbus](#), [IEC 61850](#), [Power Automation](#), [Roadmap](#)

Sunday, November 21, 2010

Cost for IEC 61850 versus DNP3 or IEC 60870-5-104

Very often people ask me: "What is the cost for implementing of the **protocols** IEC 61850, DNP3 and IEC 60870-5-104? Isn't DNP3 cheaper?". First of all, IEC 61850 is much more than another protocol! IEC 61850 comprises communication services and protocols for SCADA and REAL-TIME applications. It offers metadata in the devices and self-description services, many information models and a very crucial System Configuration Language.


IEC 61850
in brief

What are the differences?

IEC 61850	DNP3, IEC 60870-5-104, Fieldbus, ...
<ul style="list-style-type: none">■ Information models■ Configuration language■ Abstract Services■ Communication protocols<ul style="list-style-type: none">– TCP/IP based SCADA [Polling, spontaneous messages (events, reporting), logging, control, ...]– Real-time (GOOSE, SMV)– Selfdescription	<ul style="list-style-type: none">■ Communication protocol<ul style="list-style-type: none">– TCP/IP based SCADA [Polling, spontaneous messages (events), control, ...]

Page 30

© 2004-2010 Netted Automation



If we compare the SCADA services and protocols, we can expect that the efforts to implement one or the other communication protocol is

more or less the same - when we implement a subset in IEC 61850 that is functionally equivalent to DNP3 and 104.


The other features of IEC 61850 (Real-time services and protocols, self-description services, many information models, and System Configuration Language) are NOT defined in DNP3 and 104. So, what does it mean to state that it is easier and cheaper to implement DNP3 and 104 than IEC 61850? If we want compare them, we should state exactly, what we compare!

If we compare just the **underlying services and protocols**: all three solutions require TCP/IP, ... -> no real difference!

Lets look at the messaging: All three require to encode and decode a variety of messages and sequences ... may be slightly different.

The basic data types like Double-Point, Status, Time-Stamp, Quality, ... are more or less the same.

What else do we want to compare? The other features are defined in IEC 61850 only. Comparison means: **IEC 61850 HAS them - the others don't HAVE them. That's it.**

Posted by [Karlheinz Schwarz](#) at [11:49 PM](#) [0 comments](#) 

Labels: [DNP3](#), [embedded system](#), [GOOSE](#), [IEC 60870-5-104](#), [IEC 61850](#), [implementation](#), [sampled value](#)

SCL - For Substations or Systems?

The official title of IEC 61850-6:2009 Edition 2 (SCL) is:


Communication networks and systems for power utility automation –
Part 6: Configuration description language for communication in
electrical
substations related to IEDs

What does SCL stand for: "Substation Configuration Language" or
"System Configuration Language"?

The official Abbreviation in the Edition 2 of part 6 is as follows:

SCL = "System Configuration description Language"

Except the substation section all other sections and definitions can be
used for any application domain: hydro power, DER, wind power, power
quality, SCADA, ...

Posted by [Karlheinz Schwarz](#) at [11:12 PM](#) [1 comments](#) 

Labels: [configuration](#), [Edition 2](#), [IEC 61850](#), [IEC 61850 edition 2](#), [SCL](#)

[Newer Posts](#)

[Home](#)

[Older Posts](#)

Subscribe to: [Posts \(Atom\)](#)

News on IEC 61850 and related Standards


Daily news concerning the standards IEC 61850, IEC 61400-25, IEC 61970 (CIM), IEC 60870-5, ...

Sunday, November 21, 2010

CISCO to deliver IP Communication Infrastructure including Substations

EnergyAustralia selected Cisco's Connected Grid solution to build the core of its smart grid infrastructure with greater security, reliability, and operational efficiency, while complying with regulatory mandates and industry standards such as **IEC 61850** and supporting new energy supply sources.

Click [HERE](#) for the news.


Posted by [Karlheinz Schwarz](#) at [11:02 PM](#) [0 comments](#) 

Labels: [applications](#), [Australia](#), [Cisco](#), [communication](#), [electric power system](#), [IEC 61850](#), [Power Automation](#)

IEC 61850 Timestamp to overflow in 2038?

In 61850-7-2 Edition 1 the definition of TimeStamp.SecondSinceEpoch is an INT32, which represents seconds since 1/1/1970. This will overflow in **2038**, at which time equipment now being developed will be in use.

The Timestamp type in IEC 61850-7-2 Edition 2 is INT32U. The timestamp will not overflow until 2106.

Posted by [Karlheinz Schwarz](#) at [10:16 PM](#) [0 comments](#) 

Labels: [ACSI](#), [IEC 61850](#), [IEC 61850 edition 2](#), [implementation](#)

Saturday, November 13, 2010

IEC 61850 also for industrial applications?!

Karlheinz Schwarz (SCC) presented IEC 61850 to some 50 experts from the industrial automation domain at the KommA Colloquium in Lemgo (Germany) on Thursday (2010-11-11): 1. Jahreskolloquium „Kommunikation in der Automation ([KommA 2010](#))“ Centrum Industrial IT (CIIT)

The title and paper are in German: "IEC 61850 nur für Schaltanlagen und Smart Grids – oder Kernmodell für die Automatisierung?"

Click [HERE](#) for the slides presented (almost all of the 32 slides are in **English**).

The presentation showed that IEC 61850 has been developed by experts from the electric power domain - especially substation engineers (protection, control, asset management, ...). The standard defines by

Subscribe To IEC 61850 News

 Posts 

 All Comments 

Blog Archive

► [2012](#) (11)

► [2011](#) (159)

▼ [2010](#) (153)

► [December](#) (8)

▼ [November](#) (9)

[Cost for IEC 61850 versus DNP3 or IEC 60870-5-104](#)

[SCL - For Substations or Systems?](#)

[CISCO to deliver IP Communication Infrastructure i...](#)

[IEC 61850 Timestamp to overflow in 2038?](#)

[IEC 61850 also for industrial applications?!](#)

[IEC 61850-4 CDV for Edition 2 has been accepted](#)

[IEC 61850-7-3 Edition 2 approved](#)

[Free Cyber Security Training](#)

[One day "Getting Started Event" on IEC 61850 in Or...](#)

► [October](#) (19)

► [September](#) (18)

► [August](#) (24)

the end of 2010 **many information models that are applicable in any application domain**. Example: the Logical Node STMP (Supervision of Temperature, according to IEC 61850-7-4 Ed2). The following excerpts of the presentation show the LN STMP and the implemented subset - check out the [Evaluation/Starter Kit](#) and the [Beck IPC IEC61850@Chip](#) that use this and other LNs.

IEC 61850
für Smart Grids
und ...?

Model (Standard) – IEC 61850-7-4/7-3

LN: STMP.Tmp.mag.i

LN: STMP.Tmp.mag.i

LN: STMP.Tmp.mag.i

GetDataValues

Domain/NV & Read

Read Protocol

Message-Schema

Basic Encoding

Layer 6 and 5

Layer 1 to 4 (TCP)

Read Messages

STMP class				
Data object name	Common data class			Expl
LNName	instMag	AnalogueValue	MX	
	mag	AnalogueValue	MX	dchg
Data objects	range	ENUMERATED	MX	dchg
Descriptions	q	Quality	MX	qchg
EENName	t	TimeStamp	MX	

Status information

EEHealth	ENS	External equipment health
Alm	SPS	Temperature alarm level reached
Trip	SPS	Temperature trip level reached

Measured and metered values

Tmp	MV	Temperature
-----	----	-------------

Controls


OpCntRs	INC	Resettable operation counter
---------	-----	------------------------------

Settings

TmpAlmSpt	ASG	Temperature alarm level set-point
TmpTripSpt	ASG	Temperature trip level set-point

Page 26
© 2004-2010 NettedAutomation

The information model offers a build-in supervision functionality. The STMP1.Alm (Alarm) is spontaneously sent to a dedicated client (HMI, SCADA, Gateway, ...) as soon as the TMP value reaches the TmpAlmSpt (Alarm Setpoint Value - configured, programmed or set by a communication service):

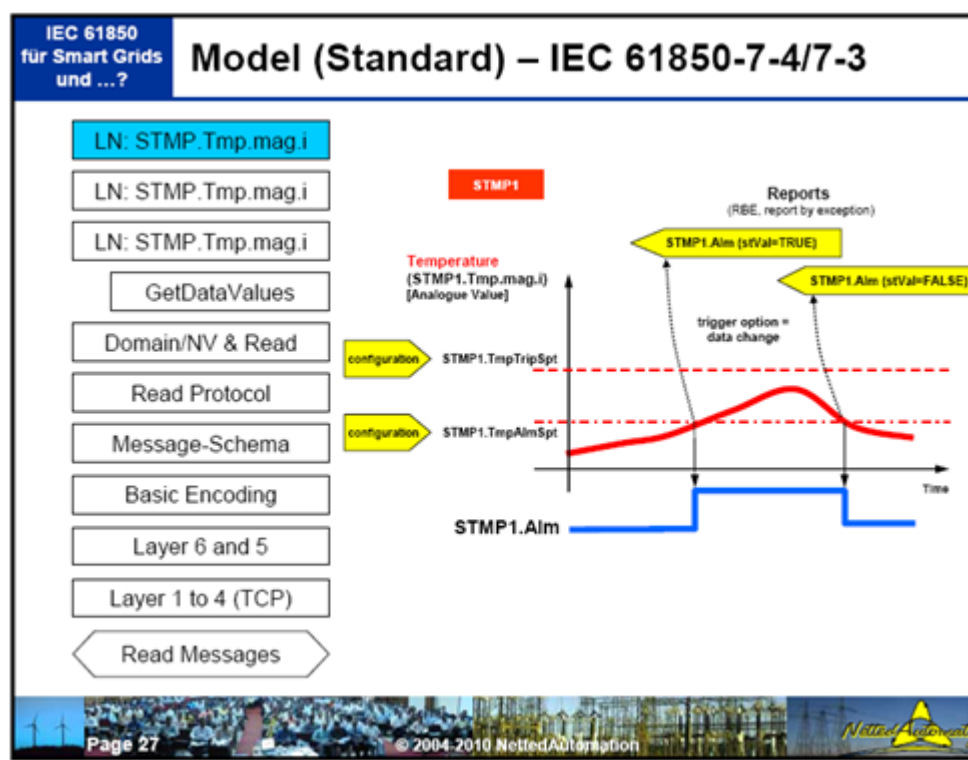

The information model and its binding to the real application is

- July (17)
- June (12)
- May (7)
- April (8)
- March (9)
- February (10)
- January (12)
- 2009 (162)
- 2008 (82)

Contributors

[Karlheinz Schwarz](#)

[Michael Schwarz](#)

described in a SCL file (System Configuration Language, IEC 61850-6). The SCL file is uploaded per FTP to the Beck Chip. After resetting the Chip, the application reads the SCL file, builds the model and binds it to the application.

IEC 61850
für Smart Grids
und ...?

Model (IED) – Implementation

LN: STMP.Tmp.mag.i

LN: STMP.Tmp.mag.i

LN: STMP.Tmp.mag.i

GetDataValues

Domain/NV & Read

Read Protocol

Message-Schema

Basic Encoding


Layer 6 and 5

Layer 1 to 4 (TCP)

Read Messages

Binding:
Model-Application

```
<LN inst="1" prefix="" InType="STMP_0">
+ <DOI name="Alm">
+ <DOI name="Ttmp">
+ <DOI name="man">
- <DAI name="T">
- <Private type="SystemCorp_Generic">
  <SystemCorp_GenericPrivateObject Field1="99" Field2="2" Field3="1" Field4="0"
  Field5="0">
    xmlns:SystemCorp_Generic="http://www.systemcorp.com.au/61850/SCL/Generic"
  </Private>
</DAI>
</DOI>
+ <DAI name="q">
+ <DAI name="t">
</DOI>
+ <DOI name="TtmpAlmSpt">
</LN>
```

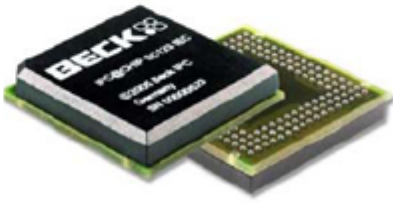

Page 28

© 2004-2010 NettedAutomation

NettedAutomation

The API between the IEC 61850 Stack (provided by [SystemCorp, Perth, Western Australia](#)) and the application is quite simple:

API: Client/Server and Object Managemen

No	API	Purpose
1	IEC61850_Create	API to create a client or server object with call-backs for reading, writing and updating data objects
2	IEC61850_LoadSCLFile	API to read the SCD XML data to get the configuration of server or client
3	IEC61850_Start	API to start the server or client
4	IEC61850_Stop	API to stop the server or client
5	IEC61850_Free	API to delete a client or server object created


No	API	Purpose
1	IEC61850_Read	Read the value of a specified data attribute
2	IEC61850_Write	Write the value to a specified data attribute
3	IEC61850_Update	Update the value of a specified data attribute

Page 38

© 2004-2010 NettedAutomation

NettedAutomation

The underlying layers are presented and discussed during the [Hands-on Training offered by NettedAutomation](#) - **Training "Made in Germany"**.

Posted by [Karlheinz Schwarz](#) at [6:55 AM](#) [0 comments](#) 

Labels: [Automation](#), [communication](#), [configuration](#), [education](#), [embedded system](#), [IEC 61400-25](#), [IEC 61850](#), [MMS](#), [model extensions](#), [Smart Grid](#), [Training](#)

Tuesday, November 9, 2010

IEC 61850-4 CDV for Edition 2 has been accepted

A further part of IEC 61850 has been approved as FDIS Edition 2:

IEC 61850-4 Ed.2.0: Communication networks and systems for power utility automation - Part 4: System and project management

The CDV ballot closed last Friday (2010-11-05).

All votes were positive.

Posted by [Karlheinz Schwarz](#) at [8:54 PM](#) [0 comments](#) 

Labels: [Edition 2](#), [IEC 61850](#), [Substation](#), [Substation Automation](#)


IEC 61850-7-3 Edition 2 approved

Another part of IEC 61850 has been approved as Edition 2:

IEC 61850-7-3 Ed.2: Communication networks and systems for power utility automation - Part 7-3: Basic communication structure - Common data classes

The FDIS ballot closed last Friday (2010-11-05).

All votes were positive.

Posted by [Karlheinz Schwarz](#) at [8:50 PM](#) [0 comments](#) 

Labels: [Edition 2](#), [IEC 61850](#), [Information Model](#), [interoperability](#), [standards](#)


Free Cyber Security Training

Several Cyber-Security Training courses are now available on the TEEEX Domestic Preparedness Campus. This DHS/FEMA Certified Cyber-Security Training is designed to ensure that the privacy, reliability, and integrity of the information systems that power our global economy remain intact and secure.

The 10 courses are offered through three discipline-specific tracks targeting everyday non-technical computer users, technical IT professionals, and business managers and professionals.

These courses are offered at no cost and students earn a DHS/FEMA Certificate of completion along with Continuing Education Units (CEU) at the completion of each course.

Click [HERE](#) for more information and how to use the material.

Posted by [Karlheinz Schwarz](#) at [8:41 PM](#) [0 comments](#) 

Labels: [Critical Infrastructure Protection](#), [security](#), [Training](#)

Tuesday, November 2, 2010

One day "Getting Started Event" on IEC 61850 in

Orlando and San Diego end of January 2011

NettedAutomation GmbH /Karlsruhe, Germany) is offering a one day "Getting Started Event" on IEC 61850 and related standards. The program comprises the **basics of Edition 1 and 2**, an overview on **global acceptance and use** of the standard, and presentation one of the **most efficient and easy to use stack software** developed by [SystemCorp](#) in Perth (Western Australia).

Dates and Locations:

- **Friday, 28. January 2011** in Orlando (Florida)
- **Monday, 31. January 2011** in San Diego (California) - just prior to the DistribuTECH 2011

Attendance Fee:

- **US\$ 295** (including course material, evaluation software, food and beverages).

Students will learn what the standard is all about and **how to use** the free **of charge fully functional evaluation stack software (DLL)** for implementing IEC 61850 client/server and publisher/subscriber under Windows. Various application examples written in C, C++ and C# (executable and source code) will be provided to the attendees. This is the FASTEST, EASIEST, and CHEAPEST way to get your devices' data modeled and right away communicated with IEC 61850.

This event is recommended for every person that is interested in IEC 61850 and IEC 61400-25 ... one way or the other. There is no pre-knowledge needed.

IEC 61850 is **THE** International Standard series for information modeling, information exchange and system configuration to support Smart(er) Automation. Smart(er) Automation comprises application domain like Power Generation, Power Transmission, Power Distribution, Factory Automation, Building Automation, and many other domains.

The new title of IEC 61850 (Communication networks and systems **for power utility automation**) is definitely wider than the old (Communication networks and systems **in substations**). IEC does not allow to use the right title that would really describe its application domain: Communication networks and systems **for automation**.

All basic concepts of IEC 61850 (and IEC 61400-25) are applicable in any automation system:

- **native Ethernet** for real-time information exchange (GOOSE) and client/server communication,
- **TCP/IP** including **transport layer security** for client/server,
- application messaging according to MMS (**Manufacturing** Message Specification, ISO 9506),
- **XML** for describing **information objects** and **system configuration**,
- many common information objects and functions like **"Temperature Supervision"**, **"PID loop control"**, **"device nameplate"**, etc

Tentative program:

09:30 – 09:45	Welcome, roll call of attendees, expectations
09:45 – 10:45	Introduction into information modeling, models, information exchange and protocols, configuration language SCL ... IEC 61850 and IEC 61400-25
10:45 – 11:00	Coffee break
11:00 - 11:15	The role of the standards in the U.S. NIST SGIP (Sm


	Grid Interoperability Panel)
11:15 – 12:00	Implementations and global market penetration of IEC 61850 and IEC 61400-25
12:00 - 13:00	Lunch break
13:00 – 14:30	Presentation of SystemCorp's IEC 61850 Stack PIS-10 IEC 61850 DLL running under Windows, integration of the stack on an embedded controller, SCL tools, network analyzers, etc
14:30 – 14:45	Coffee break
14:45 - 16:00	How to model and interface your application data with the PIS-10 stack API? Sample source code in C, C++ and C# (.Net) will be presented and discussed. Application Source code will be provided on a CD ROM
16:00 – 17:00	Question & Answer Session
17:00	End of the event

The event will be conducted by Mr. Karlheinz Schwarz. He has trained more than 2.200 people, from more than 50 countries and more than 400 companies since 2004 - all over. Recent training sessions: Frankfurt (DE), Sydney (AU), Montreal (CAN), Dallas (US), Gothenburg (SE), Manila (Phil), Stockholm (SE).

Tap the reach experience of Mr. Schwarz. After the event you or your programmer can continue to use the evaluation software for your real applications!

If you are interested to attend, please let us know. I look forward to seeing you in Orlando or San Diego. Visit [SystemCorp and NettedAutomation at the DistribuTECH 2011](#) (San Diego).

Click [HERE](#) to contact us for more information on the "Getting Started Events" in Orlando and San Diego.

Posted by [Karlheinz Schwarz](#) at [11:04 PM](#) [0 comments](#) 

Labels: [applications](#), [Automation](#), [communication](#), [configuration](#), [DER](#), [distribution automation](#), [DNP3](#), [Edition 2](#), [Edition1](#), [electric power system](#), [engineering](#), [IEC 61400-25](#), [IEC 61850](#), [peopleware](#), [SCADA](#), [security](#), [Smart Grid](#)

Thursday, October 28, 2010

System Control & Supervision - and Peopleware

The Washington Post reported on October 23, 2010, that the **lack of training** could cause very severe situations in the energy transmission and distribution systems. The recent event of the San Bruno gas pipeline burst (that killed several people) has "**speed up adoption of a rule** to ensure that workers doing similar jobs at companies across the country **are well-trained** ...".

"**If somebody is not trained**, it could be very dangerous. If they don't properly respond to an alarm situation, it can cause an explosion. It can

cause leaks. The damage could be very large."

"Although pipeline companies **boast an impressive array of technology**, he said, at many such firms, "there **is a lack of recognition that people have to operate that equipment**.""

My experience after training of more than 2.000 people from more than 500 companies and more than 50 countries with regard to advanced

communication and information systems using IEC 61850 is this: **There is a very huge lack of recognition that people have to design, engineer, commission, operate, diagnose, and maintain these comprehensive and complex systems in substations and many other applications. More often I see the following: Utilities purchase turnkey systems - without having their own technical people (from the field with many years experience in the power system) consulted or trained to work with the new technology. One year later when the warranty is finished, they have to take over the full responsibility for the whole system! Good luck!**

Impact of IEC 61850 on System Engineering, Tools, Peopleware and the Role of the System Integrator: more on that issue in a [[paper](#)] and on [[slides](#)]

Click [HERE](#) for the full report in the Washington Post.

Posted by [Karlheinz Schwarz](#) at [3:14 PM](#) [0 comments](#) 

Labels: [Automation](#), [Critical Infrastructure Protection](#), [education](#), [IEC 61850](#), [maintenance](#), [process control](#), [Substation Automation](#), [Training](#), [utilities](#), [workforce](#)

Monday, October 25, 2010

Beck IPC - Workshop IEC 61850 (IEC 61400-25) und Programmierung des Beck Chip für IEC61850-Anwendungen

Die Schulung findet am 10.-11. November 2010 in Pohlheim bei Gießen statt. Sie vermittelt die wichtigsten Schritte zur schnellen und kostengünstigen Implementierung von IEC 61850 und IEC 61400-25 konformen Geräten und Systemen basierend auf dem Beck IPC@Chip.

[Was ist der Beck Chip?](#)

Click [HIER](#) für mehr Informationen zum Workshop.

Posted by [Karlheinz Schwarz](#) at [2:32 AM](#) [0 comments](#) 

Labels: [Automation](#), [Beck](#), [education](#), [GOOSE](#), [IEC 61400-25](#), [IEC 61850](#), [SCADA](#), [Smart Grid](#), [Substation Automation](#), [Training](#), [wind power](#)

Friday, October 22, 2010

IEC 61850-7-410 and IEC 61850-7-510 are out for comments

The CDV (Committee Draft for Vote) of IEC 61850-7-410 Ed.2:

Communication networks and systems for power utility automation -
Part 7-410: **Hydroelectric power plants - Communication for monitoring and control**

is out for official comments and voting until 2010-03-11. Contact your TC 57 National Committee for a copy for comments.

A **companion document** has also been published yesterday:

Draft IEC TR 61850-7-510:

Communication networks and systems for power utility automation -
Part 7-510: Hydroelectric power plants - **Modeling concepts and guidelines** (developed by WG 18: Hydropower plants, communication

for monitoring and control).

The publication of IEC 61850-7-410 introduces the general modeling concepts of IEC 61850 to hydroelectric power plants. This Technical Report is intended to provide explanations on how to use the Logical Nodes defined in IEC 61850-7-410 as well as other documents in the IEC 61850 series to model complex control functions in power plants.

Contact your TC 57 National Committee for a copy for comments.

Posted by [Karlheinz Schwarz](#) at [9:20 PM](#) [0 comments](#) 

Labels: [Automation](#), [hydro power](#), [IEC 61850](#), [models](#), [monitoring](#)

IEC 61850-6 SCL (System Configuration Language) in Operation

One of the most crucial aspects of IEC 61850 is defined in part 6 "Configuration description language for communication in electrical substations related to IEDs". The abbreviation is SCL; SCL stands for "System Configuration Language". One example of a system is a Substation. But it could be any automation system. IEC did not support the request to change "Substation" in the title to "System".

An increasing number of vendors is understanding the impact of SCL on the configuration of a single IED (Intelligent Electronic Device) but also of a whole system. In my training courses I usually say that SCL represents 51 per cent of the importance of the standard ;-)

Invensys uses a SCL tool to configure their SCADA system.

Click [HERE](#) to read a brief description what SCL does for their SCADA system.

Posted by [Karlheinz Schwarz](#) at [9:03 PM](#) [2 comments](#) 

Labels: [Automation](#), [configuration](#), [IEC 61850](#), [SCADA](#), [SCL](#), [Smart Grid](#)

Thursday, October 21, 2010

Siemens uses Trilliant for IEC 61850 based Smart Grids - ABB invests in Trilliant

Trilliant Incorporated and Siemens Energy, Inc., announced product **interoperability for integrating distribution automation** solutions for utility customers. Available immediately, Trilliant's SecureMesh™ WAN, a **Smart Grid communication solution** for distribution networking, is interoperable with Siemens' SIPROTEC® Compact line/feeder protection devices.

Trilliant's SecureMesh WAN provides low latency communications required of **distribution automation protocols including DNP3, IEC 61850, and Modbus**. It supports low latency peer-to-peer generic object oriented substation event (**GOOSE**) messaging !!! **GOOSE all over!** This Fall is a good time for GOOSE ... ;-)

Trilliant raises \$106 Million of Capital: Investor Growth Capital, VantagePoint, **ABB**, and **GE** invest in Trilliant

When winds of change blow, some build walls, others build windmills - or **Invest in Interoperable IEC 61850 Communication**

Infrastructures. And you!?

Click [HERE](#) for the press release for the cooperation Trilliant/Siemens.
Click [HERE](#) for the press release on ABB's investment in Trilliant.

Posted by [Karlheinz Schwarz](#) at [6:27 AM](#) [0 comments](#) 

Labels: [ABB](#), [distribution automation](#), [DNP3](#), [GOOSE](#), [IEC 61850](#), [interoperability](#), [Siemens](#), [Smart Grid](#)

Saturday, October 16, 2010

Honeywell offers RTU with IEC 61850

Honeywell RTUs are IEC 61850 compliant. According to Honeywell this reduces time and engineering to complete a project, reduces wires, enhances security and simplifies system structures.

Click [HERE](#) to download a technical specification [pdf, 1.5 MB]

Posted by [Karlheinz Schwarz](#) at [3:32 AM](#) [0 comments](#) 

Labels: [IEC 61850](#), [RTU](#)

IEC 61400-25-6 has been Approved as International Standard

The 6th part of **IEC 61400-25 has been approved** as International Standard on October 15, 2010. The final draft (FDIS) has been approved by **100 per cent** of the IEC TC 88 national committees. The Standard will be published in some weeks.

IEC 61400-25-6 Ed.1: Wind Turbines - Part 25-6: Communications for monitoring and control of wind power plants - Logical node classes and data classes for condition monitoring

The new International Standard defines new information models.

Click [HERE](#) for the preview of the FDIS.

Posted by [Karlheinz Schwarz](#) at [3:14 AM](#) [0 comments](#) 

Labels: [condition monitoring](#), [IEC 61400-25-6](#), [IEC 61850](#)

ISaGRAF Supports IEC 61499 and IEC 61850

ISaGRAF has released the version 6 of their Workbench.

The company's flagship product ISaGRAF is fully compliant with both **IEC 61499 and IEC 61131** industrial standards and can be used to build a variety of automation products including embedded μ controllers, PAC, PLC, DCS, RTU, CNC, Motion Controllers and Safety Systems. Supporting **IEC 61850** ... ISaGRAF sustains a high level of standardization, integration and communication within modern automation systems, resulting in high-end, real-time open control systems with crash-proof reliability, powerful performance and flexibility.

Click [HERE](#) to visit the Newsletter at ISaGRAF.

Posted by [Karlheinz Schwarz](#) at [1:57 AM](#) [0 comments](#) 

Labels: [Automation](#), [IEC 61499](#), [IEC 61850](#), [real-time](#), [RTU](#)

Thursday, October 14, 2010

IEC 61850 in Australia - Some up-to-date Information

The Australiasien Power Technologies Magazine "Transmission & Distribution" published a couple for brief papers on IEC 61850 in the latest issue (05/2010). The following papers are contained:

- What Is IEC 61850?
- Collaborative Engineering within Electrical Utilities
- Relay Application with IEC 61850 GOOSE Messages
- Scalable IEC 61850 Software Stack ([Need Evaluation Software?](#))
- IEC 61850-9-2LE Process Bus Interface ([more information](#))
- Digital Instrument Transformers with 9-2LE Interface

Please [CLICK](#) here to read the magazine.

Posted by [Karlheinz Schwarz](#) at 5:57 AM 0 comments 

Labels: [IEC 61850](#), [IEC 61850-9-2](#), [process bus](#), [sampled value](#), [Smart Grid](#)

Tuesday, October 12, 2010

Customers talk Much to Vendors - Less to Standardization Groups

The IEEE PES Power & Energy Magazine stated recently "in my view" that "At a recent stakeholder workshop on **smart grid interoperability standards** sponsored by the National Institute of Standards and Technology (NISIST), the **electric utility industry** accounted for **less than 15% of the total attendance**. If the industry continues to be severely underrepresented as the process moves to the various standards development organizations, the utility industry will have little say over the final standards as they are developed without its significant input. ... For all of these reasons, it is critical that electric utility knowledge and vision are a part of the standard setting process."

On the other hand Dr. Lemmer (Siemens Power Automation) stated at the CIGRE in Paris event end of August 2010 with regard to innovation that "our customers tell us where we are going" ([see video at 05:35 minutes](#)).

I hope that more utility domain experts will get involved - one was or the other - in the future standardization work. Especially in IEC TC 58 and related groups. As well as in the various "users groups" - that are in fact "vendors groups". Dear Utility Domain expert, you are welcome to join one or the other group ... which also brings you around to see many airports ... and meet a lot of Smart People!

Click [HERE](#) for the full text of the "time to speak up! get involved in developing smart grid standards".

Posted by [Karlheinz Schwarz](#) at 11:49 PM 1 comments 

Labels: [IEEE](#), [NIST](#), [standards](#), [utilities](#)

SISCO's AX-S4 MMS is now AX-S4 61850

AX-S4 61850 ("Access for 61850" - former: "Access for MMS") is a complete IEC 61850 interface for host applications supporting OPC on the Microsoft Windows platform. AX-S4 61850 supports both IEC 61850 client and server to interface with Windows applications supporting OPC and/or DDE interfaces.

Even the name of the product has changed, inside there is the same IEC 61850 SCSM (Specific Communication Service Mapping - IEC 61850-8-1) to [MMS \(Manufacturing Message Specification - ISO 9506\)](#).

Click [HERE](#) to read more about the AX-S4 61850 ("Access for 61850").

Posted by [Karlheinz Schwarz](#) at [9:45 PM](#) [0 comments](#) 

Labels: [IEC 61850](#), [implementation](#), [MMS](#), [SISCO](#)

[Newer Posts](#)

[Home](#)

[Older Posts](#)

Subscribe to: [Posts \(Atom\)](#)

News on IEC 61850 and related Standards

Daily news concerning the standards IEC 61850, IEC 61400-25, IEC 61970 (CIM), IEC 60870-5, ...

Tuesday, October 12, 2010

Siemens talks about IEC 61850 at the CIGRE 2010

Dr. Englert from Siemens Energy Automation talks about the success story of IEC 61850 at the CIGRE 2010. According to his statement Siemens has sold more than 100.000 IEC 61850 compliant IEDs running in more than 1.000 systems; and IEC 61850 is THE solution that is requested in almost all tenders.

Two interesting videos are online - worth to watch.

Click [HERE](#) to see and listen to Dr. Englert (Siemens Energy Automation) on IE 61850.

Click [HERE](#) to see and listen to Dr. Lemmer (Siemens Energy Automation) on SIPROTEC IEDs .

Posted by [Karlheinz Schwarz](#) at [7:04 PM](#) [0 comments](#) 

Labels: [IEC 61850](#), [interoperability](#), [protection](#), [Relays](#), [Siemens](#)

Monday, October 11, 2010

Final Call: IEC 61850 Hands-on Training with Protection Relays and other IEDs in Stockholm, 2-5 November 2010

NIST has recommended to FERC that IEC 61850 is among the first set of six crucial International Standards for Smart Grids. The upcoming IEC 61850 Hands-on Training in Stockholm, 2-5 November 2010 conducted by STRI and NettedAutomation is **THE** opportunity to learn more about this Standard and how vendors have implemented the various parts of the standard. The course is also applicable for those people that are interested in IEC 61400-25 (Wind Power Extensions of IEC 61850). The lessons presented are also applicable for any other application domain like factory or process automation or building automation.

We will intensively use the FREE IEC 61850 DLL Evaluation Kit. You will get copies of the Evaluation Kit for the training - if you do not yet have them.

There are still seats available - Get two seats for the price of one seat!

Click [HERE](#) to check the program etc.

Posted by [Karlheinz Schwarz](#) at [11:57 AM](#) [0 comments](#) 

Labels: [education](#), [hands-on Training](#), [IEC 61400-25](#), [IEC 61850](#), [IEDScout](#), [interoperability](#), [NIST](#), [NIST Roadmap](#), [Smart Grid](#)

Subscribe To IEC 61850 News

 Posts 

 All Comments 

Blog Archive

- [2012](#) (11)
- [2011](#) (159)
- ▼ [2010](#) (153)
 - [December](#) (8)
 - [November](#) (9)
 - ▼ [October](#) (19)
 - [System Control & Supervision - and Peopleware](#)
 - [Beck IPC - Workshop IEC 61850 \(IEC 61400-25\) und P...](#)
 - [IEC 61850-7-410 and IEC 61850-7-510 are out for co...](#)
 - [IEC 61850-6 SCL \(System Configuration Language\) in...](#)
 - [Siemens uses Trilliant for IEC 61850 based Smart G...](#)
 - [Honeywell offers RTU with IEC 61850](#)
 - [IEC 61400-25-6 has been Approved as International ...](#)
 - [ISaGRAF Supports IEC 61499 and IEC 61850](#)
 - [IEC 61850 in Australia - Some up-to-date Informati...](#)

Panel Session on IEC 61850/61400-25 at first European IEEE PES Smart Grid Conference in Gothenburg (Sweden)

Panels are technical sessions to **exchange experience** and to discuss around an actual topic. Prominent speakers have been invited to speak at the panel sessions. The presentations are followed by a panel discussion involving, comments and discussion from the audience.

The first Panel Session of the conference in Gothenburg (Sweden) on 2010-10-11 was titled **"Standards for Smart Grid"** chaired by Lars Nordström, Royal Institute of Technology, Sweden

Session summary:

ICT is a core component in the smart electricity networks of the future. Implementing the Smart Grids requires integration of distributed control systems at different levels across the power industry. This requires that information from different domains such as markets, control, automation and load management can be shared seamlessly. For this cause, standardized interfaces and information models is a very important building block for the Smart grid. In the panel session, a broad overview of existing standardization efforts, including IEC, IEEE and NIST initiatives as well as their area of application are described. In addition more in-depth studies of specific implementations using the main standards, specifically the IEC 61850, are presented.

Invited speeches were:

- "Standards for interoperability make the grids smart", Lars Nordström, Royal Institute of Technology, Sweden
- **"IEC 61850 Lite Implementation - Low cost micro controller chip with IEC 61850 (IEC 61400-25) and IEC 61131-3"**, Karlheinz Schwarz, Netted Automation, Germany
- "Results from Surveys on Smart Grid Standardization Initiatives", Mathias Uslar, OFFIS, Germany
- "A case study on Multi-agent Interoperability in IEC 61850 Environments", Arshad Saleem, Technical University of Denmark, Denmark

Click [HERE](#) to download the presentation "IEC 61850 Lite Implementation" [pdf, 700 KB]

Posted by [Karlheinz Schwarz](#) at [11:41 AM](#) [0 comments](#) 

Labels: [embedded system](#), [IEC 61131-3](#), [IEC 61850](#), [IEC61850Li](#), [implementation](#), [interoperability](#), [NIST](#), [Smart Grid](#)

Sunday, October 10, 2010

Slides of IEC 61850/61400-25 Workshop at Hydro Quebec (Canada) available for Download

NettedAutomation GmbH successfully conducted a one day Workshop on IEC 61850 IEC 61400-25 at Hydro Quebec in Montreal (Canada) on Thursday, September 30, 2010

Some feedback:

"Thank you for the opportunity you provided to Canadian experts. I received good comments from attendees and surely, this will help the 61850 cause."

"It was a pleasure meeting you in Montreal. Your workshop made 61850 real for most of us. And I am looking forward to build an installation based on the protocol. As discussed, we are planning to upgrade two of

[Customers talk Much to Vendors - Less to Standardi...](#)

[SISCO's AX-S4 MMS is now AX-S4 61850](#)

[Siemens talks about IEC 61850 at the CIGRE 2010](#)

[Final Call: IEC 61850 Hands-on Training with Prote...](#)

[Panel Session on IEC 61850/61400-25 at first Europ...](#)

[Slides of IEC 61850/61400-25 Workshop at Hydro Que...](#)

[NIST recommends IEC 61850 and other IEC TC 57 Stan...](#)

[Seats available for Two Day IEC 61850 Training in...](#)

[Understanding IEC 61850 Concepts, Basics and Solut...](#)

[NIST SGIP Provides Useful Information About IEC 61...](#)

► [September \(18\)](#)

► [August \(24\)](#)

► [July \(17\)](#)

► [June \(12\)](#)

► [May \(7\)](#)

► [April \(8\)](#)

► [March \(9\)](#)

► [February \(10\)](#)

► [January \(12\)](#)

► [2009 \(162\)](#)

► [2008 \(82\)](#)

Contributors

our substations on the campus to be fully compliant with IEC 61850."

[Michael Schwarz](#)

[Karlheinz Schwarz](#)

Click [HERE](#) to download the set of the 100+ slides presented [pdf, 3 MB]. *If you **have an account** please use your email address and password. If you don't, just enter your email address and you will immediately receive an email with the password.*

Posted by [Karlheinz Schwarz](#) at 9:16 PM 0 comments 

Labels: [communication](#), [embedded system](#), [IEC 61400-25](#), [IEC 61850](#), [IEC61850Li](#), [NIST Roadmap](#), [peopleware](#), [Power Automation](#), [Smart Grid](#)

Saturday, October 9, 2010

NIST recommends IEC 61850 and other IEC TC 57 Standards for Regulation

The US Commerce Department's National Institute of Standards and Technology (NIST) has recommended the Federal Energy Regulatory Commission (FERC) that five "foundational" sets of IEC TC 57 standards for smart grid interoperability and cyber security should be considered by federal and state energy regulators.


- **IEC 61970 and IEC 61968**: Provide a Common Information Model (CIM) necessary for exchanges of data between devices and networks, primarily in the transmission (IEC 61970) and distribution (IEC 61968) domains.
- **IEC 61850**: Facilitates substation automation and communication as well as interoperability through a common data format.
- **IEC 60870-6**: Facilitates exchanges of information between control centers.
- **IEC 62351**: Addresses the cyber security of the communication protocols defined by the preceding IEC standards.

These standards are identified because they are **essential to uniform and interoperable communication systems throughout the grid and will accommodate the evolution of the grid and the integration of new technologies**. They focus on the information models and protocols important to efficient and reliable grid operations.

This is a big step forward in the use of these standard series! More to come.

The power utility domain all over has decided to use these standards. In 2010 I have seen a lot of interest in the general automation domain (**factory and process automation**) to check if IEC 61850 could be used to replace the myriads of field busses. IEC 61850 could be used instead of the 30+ Ethernet based field busses - and IEC 61850 has to offer much more than any of these field busses. IEC 60870-6 and IEC 61850 rely on MMS (Manufacturing Message Specification) as the messaging standard developed in the late 80s during the MAP 3.0 project (Manufacturing Automation Protocols). Field busses haven been understood since the 90s to be used instead of MAP 3.0. With IEC 60870-6 and IEC 61850 we see that the basic concepts and solutions of MAP 3.0 are back in operation - first in the power utility domain and soon in factories and other domains.

Click [HERE](#) to download the letter from NIST to FERC [pdf]

Posted by [Karlheinz Schwarz](#) at 12:57 AM 0 comments 

Labels: [electric power system](#), [fieldbus](#), [IEC 60870-6](#), [IEC 61850](#), [IEC 61968](#), [IEC 61970](#), [IEC 62351](#), [MMS](#), [NIST](#), [NIST Roadmap](#), [Smart Grid](#), [Substation](#), [Substation Automation](#), [TASE.2 ICCP](#)

Tuesday, October 5, 2010

Seats available for Two Day IEC 61850 Training in Dallas (TX)

A two-day special seminar and training on IEC 61850, IEC 61400-25 and DNP3 will be conducted by Karlheinz Schwarz (Editor of IEC 61850, IEC 61400-25, member of NIST PAP16, ...) at:

Remote 2010 Conference & Expo
October 19-20, 2010 - Dallas, Texas

Who should attend? All experts that are looking for a real standardized method to model and exchange information from any process application domain (power systems, factories, process control, ...). If you are tired of the discussions which one of the 100+ field busses to use: come by and learn that **you can now easily implement and use a TRUE International standard (IEC 61850) that uses message standards on TCP/IP and standard Ethernet - no special Ethernet needed!**

You will get the latest in the NIST SGIP development and in the international standardization world of IEC, IEEE, ...

You will receive a CD ROM with some 500 MB of useful information on standards, products, tools, and demo software. You will also learn what the IEC 61850 Lite implementation Starter Kit is all about ... and you will get a copy of the Evaluation / Starter Kit.

Click [HERE](#) for a description of the Evaluation / Starter Kit.

There are still seats available. See you there soon.

Click [HERE](#) for more information.

Click [HERE](#) to contact me if you need more information on the program and what you would get.

Posted by [Karlheinz Schwarz](#) at [7:37 PM](#) [0 comments](#) 

Labels: [education](#), [fieldbus](#), [hands-on Training](#), [IEC 61400-25](#), [IEC 61850](#), [IEC61850Li](#), [interoperability](#), [Power Automation](#), [starter kit](#)

Understanding IEC 61850 Concepts, Basics and Solutions is Crucial for Smart(er) Grids

There is still a lack of understanding of IEC 61850 concepts, basics and solutions. During a September 30th **IEC 61850 Workshop** at Hydro Quebec in Montreal (Canada) 20+ participants from Canada, USA, Japan, Denmark, South Korea, and Germany received a bunch of useful information with regard to IEC 61850.

Here is some feedback from attendees:

"Thank you for the opportunity you provided to Canadian experts. I received good comments from attendees and surely, this will help the 61850 cause."

"It was a pleasure meeting you in Montreal. Your workshop made 61850 real for most of us. And I am looking forward to build an installation based on the protocol. As discussed, we are planning to upgrade two of our substations on the campus to be fully compliant with IEC 61850."

Click [HERE](#) to contact me if you are interested in the course material I have provided at the workshop. Please let me know what your needs are.

Posted by [Karlheinz Schwarz](#) at [7:19 PM](#) [0 comments](#) 

Labels: [DER](#), [electric power system](#), [IEC 61400-25](#), [IEC 61850](#), [IEC61850Li](#), [interoperability](#), [peopleware](#), [Smart Grid](#)

Monday, October 4, 2010

NIST SGIP Provides Useful Information About IEC 61850

The latest information on IEC 61850 provided by SGIP (Smart Grid Interoperability Panel) is a summary of the background of IEC 61850 - quite interesting information.

The contents provided:

- Identification and Affiliation
- Level of Standardization
- Areas of Use
- Relationship to Other Standards or Specifications
- Dept of Energy Smart Grid Characteristics
- Priority Areas Previously Mentioned by FERC and NIST
- Openness
- Support, Conformance, Certification and Testing
- Functional Description of the Standard
- Architectural Principles

Click [HERE](#) to download the 12 page document.

Posted by [Karlheinz Schwarz](#) at [8:18 PM](#) [0 comments](#) 

Labels: [conformance test](#), [IEC 61850](#), [IEC 62351](#), [interoperability](#), [NIST](#), [Smart Grid](#), [standards](#)

Tuesday, September 21, 2010

Utility Grid Communication Network in Electric Vehicle Charging Infrastructure takes IEC 61850 into Account

The IEC TC 69 (Electric road vehicles and electric industrial trucks) has proposed a new project to define "Utility grid communication network in electric vehicle charging infrastructure" - 69/176/NP. The New work proposal refers to IEC 61850 as standard that should be considered as base standard. It could be assumed that IEC 61850 has already a lot of definitions that can be re-used by the experts that will define this standard. It is likely that IEC 61850-7-420 has already many information models defined for that application.

Voting is open between 2010-09-17 and 2010-12-17

Click [HERE](#) for a the official IEC announcement. Contact your national body to get a copy of the proposal.

Posted by [Karlheinz Schwarz](#) at [5:42 AM](#) [0 comments](#) 

Labels: [batteries](#), [charging station](#), [Extensions](#), [IEC 61850](#), [IEC 61850-7-420](#), [Power Automation](#), [Smart Grid](#)

Free One Day Workshop on IEC 61850 (IEC 61400-25) in Montreal

A free Workshop on IEC 61850 (IEC 61400-25) will be conducted in Montreal (Canada) next week:

Thursday, September 30, 2010; 8:30 a.m. – 3:00 p.m.

The Workshop will take place at Hydro-Québec head office in Montreal.

The workshop will be an open presentation and discussion of crucial aspects of the standard IEC 61850 and especially of IEC 61850-7-420; a demonstration of the latest development of the "IEC61850@CHIP" and first experiences with the small platform especially for PV systems will be given.

08:30 – 09:00	Welcome, roll call of attendees, expectations
09:00 – 09:30	The standardization organizations (IEC TC 57, IEEE, TC 88, ...)
09:30 – 10:30	Introduction into information modeling, models, information exchange, configuration language (IEC 61850-7-x and IEC 61400-25)
10:30 – 10:50	Coffee break
10:50 – 11:30	Implementations and market penetration of IEC 61850
11:30 – 12:30	Presentation of SystemCorp's IEC 61850 Stack PIS-1 integration of the stack on Beck IPC Chip, and demonstration of Development Kit DK61 (HW and SW) and IEC 61850 DLL running on PCs
12:30 – 13:30	Lunch (invited by H-Q)
13:30 – 15:00	Question & Answer Session
15:00	End of workshop

There are a very few seats left.

If you are interested to attend, please let me know as soon as possible (latest by Friday, 24 September 2010) - schwarz@scc-online.de

Posted by [Karlheinz Schwarz](#) at [4:47 AM](#) [0 comments](#) 

Labels: [IEC 61400-25](#), [IEC 61850](#), [implementation](#), [interoperability](#), [peopleware](#), [seminar](#), [Smart Grid](#), [starter kit](#), [Substation Automation](#), [Transmission Grid](#), [wind power](#)

Monday, September 20, 2010

High-pressure system called "Karlheinz" brings warm temperatures

While low pressure system "Joleen" has been pushing **cool, wet weather** into the country from Scandinavia, a high-pressure system called **"Karlheinz"** is moving up from the south with **warmer temperatures**. "That means for the next few days there will be dry and especially warm weather during the day in central Europe, which naturally means us too," **Temperatures could reach up to 25 degrees Celsius in the Upper Rhine region** (like in Karlsruhe - the home town of Karlheinz Schwarz, Expert on IEC 61850).

Karlheinz (Schwarz) brings good weather and good news on IEC 61850 to you ;-)

Click [HERE](#) for the full weather report.

Posted by [Karlheinz Schwarz](#) at [11:26 PM](#) [0 comments](#) 

Labels: [IEC 61850](#)

Update on IEC 61850 Hands-on Training with Multivendor IEDs in Stockholm, 2-5 November 2010

STRI and NettedAutomation offer a 4-day comprehensive Seminar and Hands-on Training providing both theory and practice on the application of IEC 61850 in a substation (and IEC 61400-25 in wind power plants) by following the planning, specification, design and engineering process. Based on real applications and multivendor test installation we follow the engineering process all the way through configuration and testing. The 4 day Comprehensive System Integration Course to be held in Stockholm (Sweden) on 2-5th of November 2010 consists of:

- **Module 1** gives an independent and detailed presentation of the IEC 61850 standard and demonstration of STRI multivendor interoperability training and test system.
- **Module 2** presents the Substation Configuration Language and use of a vendor independent tool, to demonstrate specification of IEC 61850 systems.
- **Module 3** presents possible functional allocations and architectures for typical substation automation systems. How should one apply IEC 61850 reporting and GOOSE messaging for protection and control schemes? How to configure Ethernet Networks and test IEC 61850 systems?
- **Module 4** is divided in two parallel workshops. Module 4a – covers engineering of a small interoperable IEC 61850 system with protection and control devices from ABB, Areva and Siemens. Module 4b focuses instead on SCADA and gateway engineering.

Just a few seats left - check for availability soon.

Click [HERE](#) for the updated Program and Registration information.

Posted by [Karlheinz Schwarz](#) at [10:46 AM](#) [0 comments](#) 

Labels: [Automation](#), [education](#), [GOOSE](#), [IEC 61400-25](#), [IEC 61850](#), [interoperability](#), [Power Automation](#), [SCADA](#), [SCL](#), [Substation Automation](#)

Thursday, September 16, 2010

The Best Corporate Brochure on IEC 61850 ever seen

ABB has published the other day the **Best Brochure on IEC 61850** I have ever seen! The 60+ page Corporate Technical Journal presents the strategy, vision, and experience of ABB. The Brochure contains the following topics:

- IEC 61850: The new approach
- Products for the standard
- Verification and validation
- Case studies of IEC 61850

This Journal is absolutely worth to read!

Click [HERE](#) to download the Journal [pdf, 2.9 MB].

Posted by [Karlheinz Schwarz](#) at [4:52 AM](#) [0 comments](#) 

Labels: [800xA](#), [ABB](#), [GOOSE](#), [IEC 61850](#), [Power Automation](#), [Smart Grid](#), [Substation Automation](#)

Sunday, September 12, 2010

Interoperability and Replacement of an IED by another one

The other day somebody from the user community posted a comment on this blog. The issue discussed is on Interoperability and Replacement of an IEC 61850 compliant IED by another one:

"That is exactly what we users want: not just be able to have different IEDs from (possibly) different vendors cooperating in our substations, but also be able to **replace an IED by another one** that is **functionally equivalent** (or superior, or maybe just similar, this being the utility's internal issue) regardless of what the other system components are, **and in the easiest possible way.**"

First of all, the Replacement of an IEC 61850 compliant IED mainly depends on the **implementation** of the standard (which subsets, ..., restrictions) and on the **configuration of the system**.

Replacement could be very easy but also be a bit complicated. One example shows the impact of the implementation (restriction) and one shows the impact of the configuration.

Restricted implementation: Suppose that an IED A (to be replaced) has 10 Logical Devices to model the application. IED B (to replace IED A) has only the possibility to support five (5) Logical Devices; the restriction is done during the design of the IED.

The system engineer has configured the IEDs and the **information flow** between them, e.g., the flow from IED A to other IEDs. The designed information flow between IED A and other IEDs is like a **Contract**. This contract says that IED A has 10 LDs and underlying LNs and DataObjects. The LD name are used to designate the DataObjects; the LN-Reference contains the LD-Name. A DataSet could have members from all 10 LDs (this could be "written" in the contract).

If the IED B has only five (5) LDs then the designation of the DataObjects will likely be different - it requires a modified Contract! The Clients (Subscriber) have to take these changes of the designation into account. This may require a re-configuration of the Clients (Subscriber).

Click [HERE](#) for a PIXIT document providing some information about an IED, e.g. restriction of GOOSE messages that can be sent (≤ 16) ...

Don' forget: Everything is limited!!


Configuration of the system: Even if IED A and IED B have the same signal designations (same model) it could be that the "old contract" defines a flow as follows: the information to be reported or goosed is defined in a very big DataSet (e.g. of 100+ members). IED B may only support DataSets with a maximum of 50 members. As a consequence the "contract" has to be modified to create two (or more) DataSets and two or more ControlBlocks. The Clients (Subscriber) have to take this into account.

The **"easiest possible way"** means to apply the same "contract" (flow configuration) for IED A and IED B. If IEDs would be quite flexible with regard to the "contracts" then a replacement would be quite easy.

By the way, the question, which "contract" we could write depends on the vendors' implementations and the way how people configure

systems, BUT not on the standard!

The utility requirement could be modified as follows: "to **replace an IED by another one** that is **functionally equivalent** (or superior, or maybe just similar, this being the utility's internal issue) **AND that uses the same "Contract" of the information flow between the two IEDs**, regardless of what the other system components are."

Posted by [Karlheinz Schwarz](#) at [11:14 AM](#) [4 comments](#) 


Labels: [configuration](#), [engineering](#), [IEC 61850](#), [interchangeability](#), [interoperability](#), [maintenance](#), [PIXIT](#)

Friday, September 10, 2010

ABB's Entry Points for IEC 61850 related Information

ABB has posted a huge source of information about IEC 61850 and applications in Substations all over. It's a nice starting point to see what they are doing with regard to IEC 61850.

Click [HERE](#) or [HERE](#) for two ABB web pages with many good explanations and links to useful papers and other documents.


Posted by [Karlheinz Schwarz](#) at [11:05 PM](#) [0 comments](#) 

Labels: [ABB](#), [IEC 61850](#), [Power Automation](#)

GOOSER - Prüfungen von Anlagen mit GOOSE-Nachrichten

Ein echtes universelles IEC 61850-Prüf-Interface ist verfügbar. Der Gooser von Megger verbindet konventionelle Relais-Prüfgeräte mit IEC 61850 basierten Systemen. Der "Gooser" wird also eine echte Alternative zu aufwendigen, neuen Schutz-Prüfsysteme mit integrierter IEC-61850-Schnittstelle gesehen.

Click [HIER](#) zum Download einer aktuellen Veröffentlichung über den GOOSER in der np.

Posted by [Karlheinz Schwarz](#) at [12:15 PM](#) [0 comments](#) 

Labels: [GOOSE](#), [IEC 61850](#), [protection](#), [Relays](#), [testing](#)


FREE IEC 61850/61400-25 DLL - One Download per Hour

The FREE IEC 61850/61400-25 Evaluation/Starter Kit is now available for download since August 31, 2010. The kit provides a DLL for simple IEC 61850 Client, Server, Publisher, and Subscriber Applications running on a PC under Windows.

In average **one kit has been downloaded per hour since then!** This DLL and its API seems to be one of the crucial Highlights of Standardized Information Models, Information Exchange Methods, and Configuration Language! It brings you the Best **after** the holiday season (in many countries in the northern hemisphere - or **before** in the southern).

You simply can't get it for less - Its's FREE.

DO NOT Click [HERE](#) if you want to keep going with your legacy solution.


Posted by [Karlheinz Schwarz](#) at [11:44 AM](#) [0 comments](#) 

Labels: [Automation](#), [communication](#), [DLL](#), [download](#), [embedded system](#), [Evaluation](#), [IEC 61400-25](#), [IEC 61850](#), [IEC61850Li](#), [Windows](#)

Phoenix Contact is Hiring a Software Developer with IEC 61850 Experience

Phoenix Contact is hiring a Software Developer for Embedded Systems with IEC 61850 experience!
Good Luck!

Click [HERE](#) for the job offering [German].

Posted by [Karlheinz Schwarz](#) at [11:11 AM](#) [0 comments](#) 

Labels: [electric power system](#), [IEC 61850](#), [Phoenix Contact](#), [Power Automation](#)

[Newer Posts](#)

[Home](#)

[Older Posts](#)

Subscribe to: [Posts \(Atom\)](#)

News on IEC 61850 and related Standards

Daily news concerning the standards IEC 61850, IEC 61400-25, IEC 61970 (CIM), IEC 60870-5, ...

Friday, September 10, 2010

Automation goes Power: Phoenix Contact starts Road Show "Energy Management"

Electric Power systems are on the radar screen of companies that - traditionally - did their business in the factories. One of the well known German companies is **Phoenix Contact**. What are these companies looking for? More revenue? Very likely.

During the last 20 years there was very little automation in the power industry influenced by factory automation vendors and their solutions. This will change in a fast pace: One of the leading experts (Roland Bent, CEO of **Phoenix Contact**) stated during the VDI Congress that the market for automation systems in the utility domain (electric power, water, ..., clean and green technologies) will be three times bigger in 2030 than today's factory automation. Wow.

Click [HERE](#) for some more details ... what they are looking for ...

Click [HERE](#) to read the announcement for an Energy Management Road Show [German].

Posted by [Karlheinz Schwarz](#) at [11:03 AM](#) [0 comments](#) 

Labels: [Phoenix Contact](#), [Power Automation](#), [Power Plants](#), [process control](#)

Thursday, September 9, 2010

Substation Automation Handbook

The electrical Grid is about to be transformed into a Smart(er) Grid. The most crucial aspect is still (and I hope for ever) the **electrical system** - a system of generators, wires, transformers, switches, etc bound together by some laws. Substations are important elements in the system. For all people that need to understand the challenge of the automation of electrical systems should read the

The **Substation Automation Handbook** written by *Dr. Klaus-Peter Brand, Volker Lohmann, Dr. Wolfgang Wimmer*


Subscribe To IEC 61850 News

 Posts 

 All Comments 

Blog Archive


- [2012](#) (11)
- [2011](#) (159)
- ▼ [2010](#) (153)
 - [December](#) (8)
 - [November](#) (9)
 - [October](#) (19)
 - ▼ [September](#) (18)
 - [Utility Grid Communication Network in Electric Veh...](#)
 - [Free One Day Workshop on IEC 61850 \(IEC 61400-25\) ...](#)
 - [High-pressure system called "Karlheinz" brings war...](#)
 - [Update on IEC 61850 Hands-on Training with Multive...](#)
 - [The Best Corporate Brochure on IEC 61850 ever seen...](#)
 - [Interoperability and Replacement of an IED by anot...](#)
 - [ABB's Entry Points for IEC 61850 related Informati...](#)
 - [GOOSER - Prüfungen von Anlagen mit GOOSE-Nachricht...](#)

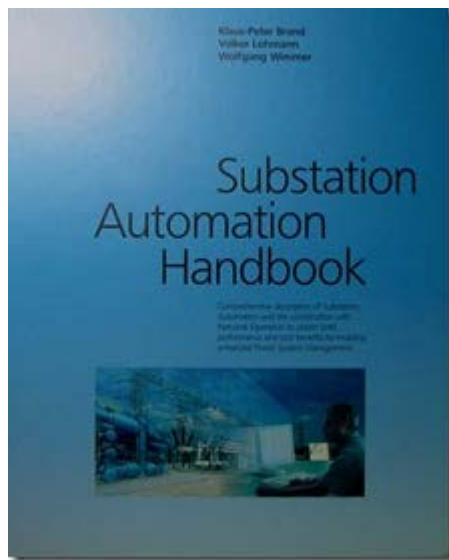

This book is a comprehensive description of Substation Automation and the coordination with Network Operation to obtain both performance and cost benefits by enabling enhanced Power System Management ... **including the new standard IEC 61850.**

Over the past decade the electricity supply industry has been subjected to dramatic changes. World-wide the trend is to restructure vertically integrated utilities catering for generation, transmission and distributions into smaller "unbundled" companies. The new plant owners are pushed to minimize costs through greater utilization of assets. The book helps to understand the needed solutions to get there.

Click [HERE](#) to read more about the book and how to order it.

Posted by [Karlheinz Schwarz](#) at [10:53 PM](#) [1 comments](#) 

Labels: [electric power system](#), [IEC 61850](#), [Substation Automation](#)

Wednesday, September 8, 2010

IEC61850@CHIP - Forum for API usage open

Beck IPC has opened a Forum for the IEC 61850 Stack API. What to do if the client does not start? What if ...?

Click [HERE](#) to proceed to the IEC 61850 Forum at the website of Beck IPC

Posted by [Karlheinz Schwarz](#) at [9:15 PM](#) [0 comments](#) 

Labels: [API](#), [Beck](#), [IEC 61850](#)

Special Course on Key Standards for Smart Grids in Dallas (TX): IEC 61850, IEC 61400-25 and DNP3

A two-day special seminar and training on IEC 61850, IEC 61400-25 and DNP3 will be conducted by Karlheinz Schwarz (Editor of IEC 61850, IEC 61400-25, member of NIST PAP16, ...) at:

Remote 2010 Conference & Expo
October 19-20, 2010 - Dallas, Texas

In this comprehensive 2-day workshop students learn the fundamental

[FREE IEC 61850/61400-25 DLL - One Download per Hou...](#)

[Phoenix Contact is Hiring a Software Developer wit...](#)

[Automation goes Power: Phoenix Contact starts Road...](#)

[Substation Automation Handbook](#)

[IEC61850@CHIP - Forum for API usage open](#)

[Special Course on Key Standards for Smart Grids in...](#)

[Redundant Ethernet for Communication in Substation...](#)

[NIST Smart Grid - Cyber Security Guidelines Releas...](#)

[IEC 61850 Tissue Database for Edition 2](#)

[Update: NIST SGIP - Special Cross-PAP Session on I...](#)

- ▶ August (24)
- ▶ July (17)
- ▶ June (12)
- ▶ May (7)
- ▶ April (8)
- ▶ March (9)
- ▶ February (10)
- ▶ January (12)

concepts and vision of the NIST Smart Grid activities and of the IEC 61850 standard series. Students compare well known solutions like DNP3 and the new OPC UA with IEC 61850 (IEC 61400-25, Wind Turbines) and discuss the strength each method offers. All the IEC 61850 standards, their extensions, and many application domains are briefly discussed and the class delves into IEC 61850 real-time and client/server solutions. Each student (that brings his own PC) will do some hands-on training with IEC 61850 client/server communication and GOOSE messaging. We are using freely available evaluation software running under Windows. Two PCs could be connected to see messages on the Ethernet wire.

Click [HERE](#) for more details and registration information.

Posted by [Karlheinz Schwarz](#) at 8:57 PM 0 comments 

Labels: [DER](#), [DNP3](#), [electric power system](#), [embedded system](#), [Ethernet](#), [IEC 61850](#), [interoperability](#), [NIST Roadmap](#), [OPC](#), [Smart Grid](#), [Training](#)

Tuesday, September 7, 2010

Redundant Ethernet for Communication in Substation Automation Systems according to IEC 61850

The **High-availability Seamless Redundancy** protocol (HSR) was designed to meet the highest availability requirements of industrial applications (such as substation automation or motion control) with an Ethernet based communication infrastructure. IEC 61850-90-4 "Network Engineering Guidelines" recommends to use HSR for particular applications.

In the context of the project supported by the Swiss innovation promotion agency CTI, ZHAW is evaluating the feasibility of HSR. Project partners are ABB, Hirschmann, and Siemens. These companies have demonstrated the new solution during the recent Cigré Exhibition in Paris (end of August 2010).

Click [HERE](#) for a report in English.

Click [HERE](#) for a report in German.

Posted by [Karlheinz Schwarz](#) at 3:03 AM 0 comments 

Labels: [Ethernet](#), [GOOSE](#), [hirschmann](#), [IEC 61850](#), [implementation](#), [redundancy](#)

Saturday, September 4, 2010

NIST Smart Grid - Cyber Security Guidelines Released

The three volumes of the "Guidelines for Smart Grid Cyber Security (NISTIR 7628)" have been published by NIST end of August 2010.

The report presents an analytical framework that organizations can use to develop effective cyber security strategies tailored to their particular combinations of Smart Grid-related characteristics, risks, and vulnerabilities. Organizations in the diverse community of Smart Grid stakeholders—from utilities to providers of energy management services to manufacturers of electric vehicles and charging stations—can use the methods and supporting information presented in this report as guidance for assessing risk and identifying and applying appropriate security requirements.

This document is a companion document to the NIST Framework and Roadmap for Smart Grid Interoperability Standards, Release 1.0 (NIST

► [2009](#) (162)

► [2008](#) (82)

Contributors

[Karlheinz Schwarz](#)

[Michael Schwarz](#)

SP 1108), which NIST issued on January 19, 2010.

Click [HERE](#) to download Volume 1

Click [HERE](#) to download Volume 2

Click [HERE](#) to download Volume 3

Click [HERE](#) to download the NIST Framework and Roadmap for Smart Grid Interoperability Standards, R1.0

[Does IEC 61850 provide Security Measures? - Yes](#)

Posted by [Karlheinz Schwarz](#) at [3:27 AM](#) [0 comments](#) 

Labels: [Cyber Security](#), [IEC 61850](#), [IEC 62351](#), [NIST](#), [NIST Roadmap](#), [security](#), [Smart Grid](#)

Friday, September 3, 2010

IEC 61850 Tissue Database for Edition 2

The first four (4) parts of IEC 61850 have been published as Edition 2: Part 6, Part 7-4, Part 7-3, and Part 7-2.

The Tissue Database (technical issues) is now open for posting tissues on these four new parts (Edition 2):

www.tissue.iec61850.com

The first tissues have already been posted for Edition 2 documents. If you have any tissue to be reported to the editors of the standards please check with the tissue database - maybe your issue has already been posted.

The Tissue Database for IEC 61400-25 is also open:

www.tissue.iec61400-25.com

Click [HERE](#) for some general remarks on Edition 1 and Edition 2.

Posted by [Karlheinz Schwarz](#) at [3:58 AM](#) [0 comments](#) 

Labels: [conformance test](#), [Edition 2](#), [Edition1](#), [IEC 61400-25](#), [IEC 61850](#), [IEC 61850 edition 2](#), [tissues](#)

Update: NIST SGIP - Special Cross-PAP Session on Information Models for Generators and Storage

Please find the agenda for the upcoming meeting of the special group in St. Louis (MS):

Special Cross-PAP Session:
Coordinated Object Modeling for Generators and Storage
SGIP Fall Meeting
September 15, 2010, St. Louis, Missouri
12:30 to 3:00 PM

This Cross-PAP issues session is your chance to participate in discussions on coordinating consistent object models and information exchange requirements for different generator types (e.g., wind turbines, hydro power plants, PV systems, and storage) across multiple domains (consumer, distribution, and transmission). This session is expected to aid in producing consistent object model requirements (where possible) being developed for example by PAPs 7 and 16 for IEC 61850-7-420 (DER), IEC 61850-7-410 (hydro) and IEC 61400-25

(wind). The consistent generator control, monitoring and protection requirements are to be coordinated and combined with requirements of other PAPs including 3, 4, 9, and 10. There are several areas in which the various application domains highly benefit from consistent information models, consistent information exchange and security steps. The interface between power generation and the control center and between aggregators and distributed generators are obvious examples. This session is intended to provide overviews of and to initiate coordination of activities required to develop consistent object models for different generator/storage types across different Smart Grid domains.

Topics presented and discussed include:

- Status of object models for wind turbines, hydro power plants, PV systems, other distributed energy resources – (Karlheinz Schwarz, editor of IEC 61850 and IEC 61400-25) – 30 minutes
- IEC 61400-25-2 transmission level wind generator standard with first two logical nodes that define active power control and reactive power control (Bill Moncrief) – 20 minutes
- Key ES-DER Use Cases - The necessity of establishing a set of core functions as a foundation for standard protocols and device interoperability. Results from a collaborative industry activity. (Brian Seal) – 20 minutes
- IEC 61850-7-420 for ES-DER functions, focusing on pricing signals, volt/var schedules, direct control, and broadcast control, as well as cyber security (Frances Cleveland, editor of IEC 61850-7-420 and IEC 62351) – 20 minutes
- Common modeling concepts, key services like "report-by-exception" and configuration language – Mapping of 61850 to Webservices (IEC 61400-25-4), to DNP3 and to SEP 2.0 (Frances) – 30 min
- IEC 61850-on-a-chip (Karlheinz Schwarz) – 15 minutes

Related standards and PAPs:

- **IEC 61850-7-420, IEC 61400-25, IEC 62351**
- **IEEE P 1547.8, IEEE P174**
- **DNP3, SEP 2.0, MultiSpeak, CIM**
- **PAPs: Developed by 7 and 16; used by 3, 4, 9, 10, 8 and 14**

Posted by [Karlheinz Schwarz](#) at [3:22 AM](#) [0 comments](#) 

Labels: [DER](#), [distribution](#), [distribution automation](#), [IEC 61400-25](#), [IEC 61850](#), [IEC 61850-7-410](#), [IEC 61850-7-420](#), [NIST](#), [PAP](#), [PAP16](#), [wind power](#)

Tuesday, August 31, 2010

FREE IEC 61850/61400-25 Evaluation/Starter Kit


A FREE IEC 61850/61400-25 **Evaluation/Starter Kit** is now available for immediate **download and use**. The wait for a FREE IEC 61850/61400-25 Evaluation/Starter Kit is over - here it is for immediate use.

SystemCorp (Perth, Australia) and NettedAutomation offer an IEC 61850/61400-25 DLL (Dynamic Link Library) and three Application examples using the DLL (PIS10.dll; providing a simple stack API):

- C Server Application (simple Console)
- C Client Application (simple Console)
- C#/.Net Client Application (runs under XP, Vista, Windows 7)

The Kit contains executable software and the source code of the C and .Net Applications (projects) as well as "Getting started manuals". The

PIS10.dll is based on the IEC 61850 stack developed by [SystemCorp](#). The client and server (publisher/subscriber - GOOSE) run on one machine or on different machines as depicted below:

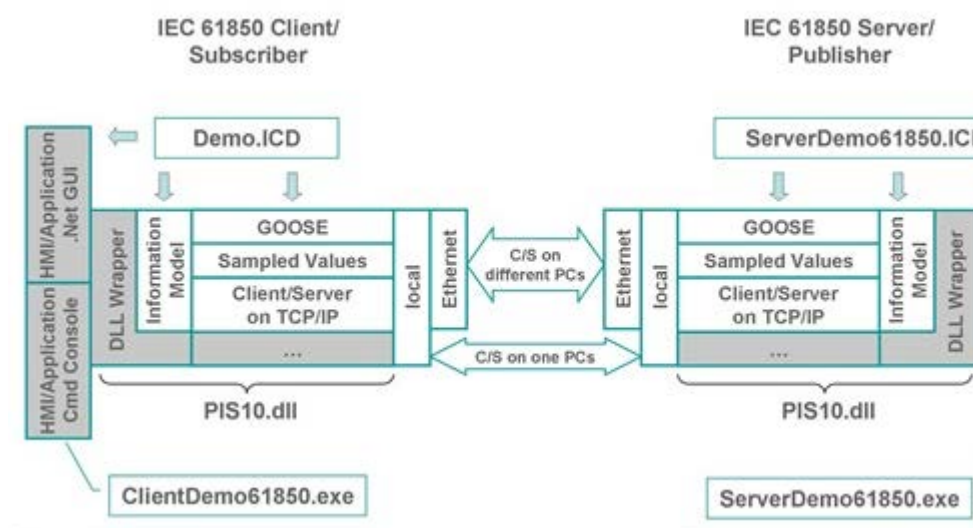

You can use these source code of the application examples and modify them according to your needs. The configuration of the Server AND the Client done by ICD files (according to IEC 61850-6, SCL) - no need for self-description; the model is build at start time. This client/Server package is applicable for M2M (machine to machine) communication. The IEDScout could be used as a Browser-Client as well. Modified applications would require a modified ICD file as well. The "ICD Designer" - a tool to design ICD files - will be available within a week or so.

The services supported are: Association, GetDataObjectValues, SetDataObjectValues, Control, Reporting, GOOSE, ...

NettedAutomation GmbH offers a new services for the integration of the PIS10 stack (DLL, ...) into your application:

Support will be provided by our experienced application programmer: Andreas Pfefferle. Andreas is familiar with Substation Automation, RTUs, IEC 60870-5-10x, protocol integration, ... SystemCorp PIS10-Stack API and many other power utility applications.

Click [HERE](#) to Download the IEC 61850/61400-25 Evaluation/Starter Kit (The Kit comprises first a readme.txt file and four (4) zip files - each file can be downloaded individually; **You need at least the <<Console-Server-Client_2010-08-31>> to get the server**; to run the client with another server you need to change the ICD file accordingly).

IF you have an Account for downloading content from www.nettedautomation.com then you can use your email address and password. If you have forgotten the password, just enter your email address in the field "Email (required)" and click on the button "I agree ... continue" at the end - you will receive your password. Or just enter your email and further information and you will receive a password immediately.

Enjoy.

Posted by [Karlheinz Schwarz](#) at 1:15 PM 0 comments

Labels: [API](#), [applications](#), [configuration](#), [DLL](#), [embedded system](#), [Evaluation](#), [IEC 61400-25](#), [IEC 61850](#), [implementation](#), [interoperability](#), [starter kit](#)

Monday, August 30, 2010

NIST SGIP - Special Cross-PAP Session on Coordinated Information Modeling for Generators and Storage


The fall face-to-face meeting of the NIST SGIP (Smart Grid Interoperability Panel) will take place in St. Louis (MS) from September 14-16, 2010.

A Special Cross-PAP Session on Coordinated Information Modeling for Generators and Storage is intended to provide overviews of and to initiate coordination of activities required to develop consistent information models for different generator/storage types across different Smart Grid domains. This Cross-PAP issues session is your chance to participate in discussions on coordinating consistent information models and information exchange requirements for different generator types (e.g., wind turbines [IEC 61400-25-2], hydro power plants [IEC 61850-7-410], PV systems, and storage [IEC 61850-7-420], ...) across multiple domains (consumer, distribution, and transmission).

Session is scheduled for Wednesday, Sept. 15th (12:30-15:00)

Click [HERE](#) for the full program and other details of the meeting.

Please note that **Mr. Karlheinz Schwarz** (member of PAP16, editor IEC 61850, IEC 61400-25) will be in St. Louis on Sept. 15 and 16 ... to meet you ...

Posted by [Karlheinz Schwarz](#) at [11:42 AM](#) [0 comments](#) 

Labels: [IEC 61400-25](#), [IEC 61850-7-4 Ed2](#), [IEC 61850-7-410](#), [IEC 61850-7-420](#), [Information Model](#), [interoperability](#), [interoperability tests](#), [models](#), [NIST](#), [Power Automation](#), [seamless](#), [standards](#), [wind power](#)

Friday, August 27, 2010

SystemCorp and NettedAutomation exhibit at DistribuTech 2011

SystemCorp Embedded Technology Pty Ltd (Perth, WA/Australia) and **NettedAutomation** GmbH (Karlsruhe/Germany) will exhibit the latest developments in lite implementations of IEC 61850 and IEC 61400-25, gateways between IEC 61850/61400-25, DNP3, IEC 60870-5, Modbus, RTUs, Bay controller, PLC programming IEC 61131-3, starter kits, ... training opportunities, training tools at **booth 2822** at the DistribuTech 2011 Exhibition in San Diego (CA), 1.-3. February 2010.

Please plan for a meeting the "IEC 61850 Lite" experts.

Click [HERE](#) for the floor plan and booth 2822.

Posted by [Karlheinz Schwarz](#) at [6:42 AM](#) [0 comments](#) 

Labels: [DER](#), [Distributech](#), [DLL](#), [embedded system](#), [Gateway](#), [IEC 61131-3](#), [IEC 61400-25](#), [IEC 61850](#), [Power Automation](#)

Thursday, August 26, 2010

Draft Technical Report - IEC 61850 for Synchrophasor

Draft IEC 61850-90-5 TR Ed. 1 – Use of IEC 61850 to transmit synchrophasor information according to IEEE C37.118 has been published as draft Technical Report (57/1086/DC). Comments by 2010-10-01.

This technical report describes how to use IEC 61850 to transmit synchrophasor information according to IEEE C37.118. Later, once the report is approved and published, results will be integrated as amendments in the relevant parts of the IEC 61850 standard. This document contains a first draft of that report. As a significant part, it includes new mappings of the IEC 61850 GOOSE and sampled value services that can be used for a wide area communication.

Two new control blocks are defined for IP networks:

- The sending of stream information (e.g. Sampled Values)
- The sending of event driven information (e.g. GOOSE)

Two possibilities are drafted:

The streams for SMV and GOOSE will be transmitted over a transport profile that utilizes IPv4 or IPv6, and TCP as well as UDP.

Once these models are extended in the ACSI (IEC 61850-7-2) they may also be used for Reporting over UDP.

Posted by [Karlheinz Schwarz](#) at [11:59 PM](#) [0 comments](#) 

Labels: [communication](#), [distribution automation](#), [GOOSE](#), [IEC 61850](#), [SMV](#), [Synchrophasor](#), [UDP](#)

FDIS of IEC 61850-7-3 Edition 2 out for final Ballot

IEC Central Office has published the FDIS of IEC 61850-7-3 Edition 2 (57/1087/FDIS). The **ballot closes 2010-10-29**.

The second edition comprises 39 Common Data Classes (CDC):

- defines new common data classes used for new standards defining object models for other domains based on IEC 61850 and for the representation of statistical and historical data,
- provides clarifications and corrections to the first edition of IEC 61850-7-3.

Common data class specifications for status information

1. Single point status (SPS)
Double point status (DPS)
Integer status (INS)
2. Enumerated status (ENS) - **NEW**
3. Protection activation information (ACT)
4. Directional protection activation information (ACD)
5. Security violation counting (SEC)
6. Binary counter reading (BCR)
7. Histogram (HST) - **NEW**
8. Visible string status (VSS) - **NEW**

Common data class specifications for measurand information

1. Measured value (MV)
2. Complex measured value (CMV)
3. Sampled value (SAV)
4. Phase to ground/neutral related measured values of a three-phase system (WYE)
5. Phase to phase related measured values of a three-phase system (DEL)
6. Sequence (SEQ)
7. Harmonic value (HMV)
8. Harmonic value for WYE (HWYE)
9. Harmonic value for DEL (HDEL)

Common data class specifications for controls

1. Controllable single point (SPC)
2. Controllable double point (DPC)
3. Controllable integer status (INC)
4. Controllable enumerated status (ENC) - **NEW**
5. Binary controlled step position information (BSC)
6. Integer controlled step position information (ISC)
7. Controllable analogue process value (APC)
8. Binary controlled analog process value (BAC) - **NEW**

Common data class specifications for status settings

1. Single point setting (SPG)
2. Integer status setting (ING)
3. Enumerated status setting (ENG) - **NEW**
4. Object reference setting (ORG) - **NEW**
5. Time setting group (TSG) - **NEW**
6. Currency setting group (CUG) - **NEW**
7. Visible string setting (VSG)- **NEW**

Common data class specifications for analogue settings

1. Analogue setting (ASG)
2. Setting curve (CURVE)
3. Curve shape setting (CSG) - **NEW**

Common data class specifications for description information

1. Device name plate (DPL)
2. Logical node name plate (LPL)
3. Curve shape description (CSD)

Posted by [Karlheinz Schwarz](#) at [11:39 PM](#) [0 comments](#) 

Labels: [IEC 61400-25](#), [IEC 61850](#), [IEC 61850 edition 2](#), [models](#)

ICS-CERT Advice on STUXNET Maleware Mitigation

In July, ICS-CERT published an advisory and a series of updates regarding the Stuxnet malware entitled "ICSA-10-201- USB Malware Targeting Siemens Control Software."

Stuxnet makes use of a previously unpatched Windows vulnerability. Since then, ICS-CERT has continued analysis of the Stuxnet malware in an effort to determine more about its capabilities and intent. As the analysis has progressed, understanding of the malware sophistication has continued to increase.

Click [HERE](#) for the complete report [pdf].

Click [HERE](#) for details published by Symantec.

Click [HERE](#) to visit the website (in German) of GAI NetConsultant (Berlin), a well experienced team of security experts.

Posted by [Karlheinz Schwarz](#) at [11:09 PM](#) [0 comments](#) 

Labels: [Automation](#), [malware](#), [process control](#), [security](#), [Siemens](#)

Friday, August 20, 2010

Kostengünstige IEC-61850-Lösung für kurze Entwicklungszeiten

Ein hoher finanzieller und zeitlicher Aufwand bei der Realisierung der IEC 61850 und IEC 61400-25 in Steuerungen und andere Geräten hat bisher die breite Anwendung in den unteren Spannungsebenen, in der Energieerzeugung und weiteren Bereichen gebremst oder gar blockiert. Seit der Hannover Messe 2010 ist jedoch eine kostengünstige Komplettlösung auf Basis des Beck IPC@Chip verfügbar, welche die Entwicklung von IEC-61850-konformen Schnittstellen innerhalb kurzer Zeit ermöglicht. Die Stack-Software auf dem Chip (von SystemCorp, Perth, Australien) bietet ein sehr einfaches IEC-61850-API an - MMS (ISO 9506) und weitere Definitionen sind verborgen. Das API hat neben einigen Management-Funktionen **nur drei Call-Back-Funktionen als Schnittstelle zwischen IEC 61850 und Anwendung: Read, Write, Update.**

Click [HERE](#) for the paper in German recently published by etz / VDE Verlag.

Click [HERE](#) to access the pdf version of the paper.

Click [HERE](#) for the API documentation in English.

Click [HERE](#) for the description of the starter kit DK61 (development kit).

Posted by [Karlheinz Schwarz](#) at [1:32 AM](#) [0 comments](#) 

Labels: [Beck](#), [CIP](#), [communication](#), [IEC 61400-25](#), [IEC 61850](#), [implementation](#), [MMS](#), [Power Automation](#), [Smart Grid](#)

Wednesday, August 18, 2010

IEC 61850 Test Labs and Certified IEDs

The UCA International Users Group (UCAIug) has approved seven IEC 61850 Test Labs (as of 21 July 2010):

ABB Switzerland Ltd
Server: Level B

American Electric Power (AEP)
Dolan Technology/Testing Center
Client and Server: Level A

AREVA T&D UK Ltd,
Substation Automation Solutions
Server: Level B


KEMA Nederland BV
Client and Server: Level A

NARI-RELAYS Electric Co., Ltd., Nanjing, China
Server: Level B

Xuchang KETOP Electrical Apparatus
Testing & Research Institute, Henan, China
Server: Level B

Additional labs are underway.

A total of **155 certified products** are listed at the [UCAIUG website](#).

Posted by [Karlheinz Schwarz](#) at [10:00 AM](#) [0 comments](#) 

Labels: [conformance test](#), [IEC 61850](#), [testing](#), [UCA](#), [Users Group](#)

IEC 61850 Tutorial at IEEE PES Conference,

Gothenburg, 10-13 October 2010

Everybody talks about Smart Grid but what is interesting about standards? What is a "smart" standard? Come to the **IEEE PES Conference on Innovative Smart Grid Technologies Europe 2010**, Gothenburg, Sweden, 10-13 October 2010.


And join the tutorial **"IEC61850 and related standards for interoperability within Power Utility Automation"**:

Sunday 10th October, 3 sessions with 2 breaks (13:00 - 16:30):

- Requirements and challenges of a future proof migration towards a Smart Grid
- Smart Grid Standard Landscape
- Implementation of the Standards
learn about IEC for small devices, **Starter Kit IEC 61850 and IEC 61400-25**, Lite implementation, ... there is no excuse anymore for not implementing these standards!
- IED for Smart Grid

Click [HERE](#) for the Tutorial description and program.

Click [HERE](#) for the conference information and registration.

Posted by [Karlheinz Schwarz](#) at [9:18 AM](#) [0 comments](#) 

Labels: [communication](#), [distribution automation](#), [education](#), [IEC 61400-25](#), [IEC 61850](#), [interoperability](#), [Training](#)

European Roadmap - More Euros for Smart Grids

The European Electricity Grid Initiative (EEGI) has published a Roadmap for the years 2010-18 and a Detailed Implementation Plan 2010-12; with proposals how many Euros to spend.

The EEGI has proposed a nine-year European research, development and demonstration (RD&D) program initiated by electricity transmission and distribution network operators to accelerate innovation and the development of the electricity networks of the future in Europe.

The following statement is great: "The proposed RD&D program focuses on **system innovation** rather than on **technology innovation**." Yes, the time to develop crucial Technologies was during the years 2000 and 2010. Several basic Technologies like the international communication standards IEC 61850, IEC 61400-25, IEC 62351, IEC 61968, and IEC 61970 are **published AND IMPLEMENTED** in many devices - **ready to build SYSTEMS**.


The time has come to **USE these standards and devices** - rather than start again discussing protocols again and again ... like in the nineties ...

Planned investments for monitoring, communication, ... automation are:

Start	Function	Budge
2012	Improved planning, monitoring and control of LV networks	100 M€
2011	Automation and control of MV network	90 M€

2012	Integrated Communication Solutions	50 M€
2011	Joint Task force on IT system protocols and standards (DSO driven)	19 M€

Click [HERE](#) to download the Roadmap.

Posted by [Karlheinz Schwarz](#) at [8:44 AM](#) [0 comments](#) 

Labels: [communication](#), [condition monitoring](#), [control](#), [DER](#), [IEC 61400-25](#), [IEC 61850](#), [IEC 61968](#), [IEC 61970](#), [monitoring](#), [Smart Grid](#), [Transmission Grid](#)

[Newer Posts](#)

[Home](#)

[Older Posts](#)

Subscribe to: [Posts \(Atom\)](#)

News on IEC 61850 and related Standards

Daily news concerning the standards IEC 61850, IEC 61400-25, IEC 61970 (CIM), IEC 60870-5, ...

Wednesday, August 18, 2010

Chinese Strong and Smart Grid Roadmap available

The "State Grid Cooperation China" (SGCC) has published the 139 page "SGCC Framework and Roadmap for Strong and Smart Grid Standards". One of the key challenges is the standardization. Several IEC TC 57 and TC 88 standards are crucial for the Strong and Smart Grid. Among others the following standards are key: **IEC 61850** and **IEC 61400-25** (15+ times referenced), **IEC 61968/61970** (30+), **IEC 62351** (5+).

The first sentence of the three sentence summary states: "The release and implementation of SGCC Framework and Roadmap for Strong and Smart Grid Standards **will greatly boost the standardization** of smart grid technologies in all related areas, promote wide public involvement and facilitate technical innovation and industrial upgrading."

The preface reads: " ... Faced with new challenges in energy sector, State Grid Corporation of China (SGCC) officially put forward the strategy of building a **world-leading strong and smart grid with ultra high voltage grid as its backbone and subordinate grids coordinated at various voltage levels, featured as being IT-based, automated, interactive, based on independent innovation.** Up to now, remarkable progress has been made in this regard. **By 2020, a smart grid** that is robust and reliable, economical and efficient, clean and environmental-friendly, transparent and open, user-friendly and interactive **is to be established.** Since August 2009, SGCC has started 228 demonstration projects of 21 categories in 26 provinces and municipalities. By now, the demonstration projects have been progressing smoothly. ... Based on SGCC smart grid research findings and **standard framework**, taking IEC smart grid standardization roadmap and international standardization gap into consideration, **SGCC set priorities for international standards and prepared new working item proposals for IEC.** ..."

Click [HERE](#) to download the 9 MB framework and roadmap.

During the 11th Five-Year Plan period (2006-2010), SGCC promoted power grid technology upgrading from the following ten aspects, and accelerate the progressing of model projects that applies IEC 61850 among ten new technologies: **Substation Automation Conformed with IEC 61850.**

Click [HERE](#) for details.

Posted by [Karlheinz Schwarz](#) at [6:46 AM](#) [0 comments](#) 

Labels: [China](#), [distribution automation](#), [electric power system](#), [electric vehicles](#), [IEC 61400-25](#), [IEC 61499](#), [IEC 61850](#), [IEC 61968](#), [IEC 61970](#), [IEC 62351](#), [Smart Grid](#), [Substation](#)

Tuesday, August 17, 2010

Subscribe To IEC 61850 News

Blog Archive

- [2012](#) (11)
- [2011](#) (159)
- ▼ [2010](#) (153)
 - [December](#) (8)
 - [November](#) (9)
 - [October](#) (19)
 - [September](#) (18)
 - ▼ [August](#) (24)
 - [FREE IEC 61850/61400-25 Evaluation/Starter Kit](#)
 - [NIST SGIP - Special Cross-PAP Session on Coordinat...](#)
 - [SystemCorp and NettedAutomation exhibit at Distrib...](#)
 - [Draft Technical Report - IEC 61850 for Synchrophas...](#)
 - [FDIS of IEC 61850-7-3 Edition 2 out for final Ball...](#)
 - [ICS-CERT Advice on STUXNET Maleware Mitigation](#)
 - [Kostengünstige IEC-61850-Lösung für kurze Entwickl...](#)
 - [IEC 61850 Test Labs and Certified IEDs](#)

Bachmann M1 Automation System supports IEC 61850 Client

The Bachmann M1 Automation System runs also an IEC 61850 (MMS) Client. This allows the M1 to connect to any underlying IEC 61850 server, e.g., to connect to controllers for distributed power generation (wind power, PV, CHP, ...) or protection relays at the electrical connection point of the feeder.

Click [HERE](#) for the newsletter in English (doc).
Click [HERE](#) for the newsletter in German (doc).

Posted by [Karlheinz Schwarz](#) at 9:09 AM 0 comments 

Labels: [Bahmann](#), [communication](#), [electric power system](#), [IEC 61400-25](#), [IEC 61850](#), [MMS](#), [Smart Grid](#), [wind power](#)

Monday, August 16, 2010

Preview IEC 61400-25-6 FDIS

Please find the preview of the FDIS IEC 61500-25-6: Wind turbines – Part 25-6: Communications for monitoring and control of wind power plants –

Logical node classes and data classes for condition monitoring

This part defines further information models for IEC 61850 respectively for IEC 61400-25.

Click [HERE](#) for the preview.

Posted by [Karlheinz Schwarz](#) at 8:28 PM 0 comments 

Labels: [condition monitoring](#), [IEC 61400-25](#), [IEC 61400-25-6](#), [IEC 61850](#), [wind power](#), [wind turbine controller](#)

IEC Goes Twitter

IEC uses the latest communication channel: Twitter !!

Click [HERE](#) for visiting IEC on Twitter.

Posted by [Karlheinz Schwarz](#) at 8:21 PM 0 comments 

Labels: [IEC](#), [Twitter](#)

New Smart Grid Information Clearinghouse Web Portal open

A beta version of the **Smart Grid Information Clearinghouse** (SGIC) web portal has been posted by The Virginia Tech Advanced Research Institute to invite comments and suggestions on usability from both consumers and the smart grid community. The full version of the site will be released this fall. The Virginia Tech Advanced Research Institute (ARI) was awarded a \$1.25 million five-year contract by the Department of Energy (DOE) in October 2009 to develop the portal with content assistance from the IEEE PES and the EnerNex Corporation.

There is hope to receive more input from the public ... "Anyone visiting the portal is invited to contact the SGIC with comments and

[IEC 61850 Tutorial at IEEE PES Conference, Gothenb...](#)

[European Roadmap - More Euros for Smart Grids](#)

[Chinese Strong and Smart Grid Roadmap available](#)

[Bachmann M1 Automation System supports IEC 61850 C...](#)

[Preview IEC 61400-25-6 FDIS](#)

[IEC Goes Twitter](#)

[New Smart Grid Information Clearinghouse Web Porta...](#)

[Integration of Process and Power Control using IEC...](#)

[IEC 61400-25-6 FDIS Ballot](#)

[IEC 61850 Data Acquisition Options - An Overview](#)

[IEC 61850 and IEC 61400-25 Hands-On Training](#)

[IEC 61850 Workshop at Hydro Quebec, Montreal, Cana...](#)

[Smart Grid Interoperability Panel \(SGIP\) meets in ...](#)

[Security: Hackers to take control of Power System ...](#)

[The many Abstract and Concrete Layers in IEC 61850...](#)

[The "Beck-Bone" for Smart Grids Demonstrated at IE...](#)

► July (17)

► June (12)


suggestions by clicking on "Contact SGIC Team" in the Contact Us box located at the bottom middle of the home page."

Click [HERE](#) to visit the portal.

A very interesting paper provided by NEMA is posted on the portal - worth to read: Click [HERE](#) to open the paper.

The paper lists the **Factors of Intelligence** (see clause 4.2) The most crucial factor seems to be the following:

- **Communications** – the extent of interaction and exchange of data and control parameters between entities that can help in improving situational awareness, support for industry **standard communication protocol**.

Posted by [Karlheinz Schwarz](#) at 7:55 PM 0 comments 

Labels: [Automation](#), [communication](#), [IEC 61850](#), [peopleware](#), [Power Automation](#), [Smart Grid](#)

Friday, August 13, 2010

Integration of Process and Power Control using IEC 61850

Petrobras (Brazil) has decided to apply IEC 61850 for the integration of power system control into the process control system. ABB has been chosen to automate the production process and interface with the power delivery system using IEC 61850. IEC 61850 is a major standard to lower life-cycle cost of production facilities:

"One of the main benefits delivered to REPAR was optimal life-cycle management and **low life-cycle cost through the use of a future-proof system with IEC 61850 interoperability**. The reuse of engineering data and the use of a standard language for programming highlighted the power of IEC 61850 for REPAR projects and the associated costs savings through less need for training and reduced staff requirements."

Click [HERE](#) to access the interesting paper.

Posted by [Karlheinz Schwarz](#) at 1:15 AM 0 comments 

Labels: [800xA](#), [ABB](#), [IEC 61850](#), [interoperability](#), [Power Automation](#), [process control](#)

Saturday, August 7, 2010

IEC 61400-25-6 FDIS Ballot

The last step towards another International Standard for Information models (Logical Nodes; these LNs can be implemented using IEC 61850 compliant stacks) will start August 13, 2010:

IEC 61400-25-6 Ed.1

Wind Turbines - Part 25-6: Communications for monitoring and control of wind power plants - Logical node classes and data classes for condition monitoring (88/377/FDIS)

[The ballot is open](#) from August 13 to October 15, 2010.

This part of the IEC 61400-25 series specifies the information models related to condition monitoring for wind power plants and the

- [May](#) (7)
- [April](#) (8)
- [March](#) (9)
- [February](#) (10)
- [January](#) (12)
- [2009](#) (162)
- [2008](#) (82)

Contributors

[Karlheinz Schwarz](#)

[Michael Schwarz](#)

information exchange of data values related to these models.

Condition monitoring is mainly based on the following kinds of information:

- **Time waveform records** (samples) of a specific time interval to be exchanged in real-time or by files for analysis (e.g. acceleration, position detection, speed, stress detection).
- **Status information and measurements** (synchronized with the waveform records) representing the Turbine Operation Conditions.
- **Results of Time waveform record analysis** of vibration data (scalar values, array values, statistical values, historical (statistical) values, counters and status information).
- **Results of analysis** for example oil debris.

Contact your national IEC TC 88 committee to receive a copy.
Click [HERE](#) to visit the TC 88 website with links to national committees.

Posted by [Karlheinz Schwarz](#) at [2:30 AM](#) [0 comments](#) 

Labels: [condition monitoring](#), [IEC 61400-25](#), [IEC 61400-25-6](#), [IEC 61850](#), [wind power](#), [wind turbine controller](#)

Friday, August 6, 2010

IEC 61850 Data Acquisition Options - An Overview

IEC 61850 provides several options to access the values of modeled information in sever devices. The following slide lists all options of IEC 61850-7-2 (ACSI - Abstract Communication Service Interface):


Information exchange

Summary of values from data objects

- Get a value of single data object ([GetDataValues](#) – [Client driven](#))
- Get a list of values of data objects ([GetDataValues](#) with list sent in each request – [Client driven](#))
- Get the complete list values of data objects using a dataset object ([GetDataSetValues](#) – [Client driven](#))
- Get the complete list of values of data objects (of a dataset) using reporting ([reporting](#), [General Interrogation](#) – [Client driven](#))
- Get the complete list of values of data objects (of a dataset) using reporting ([reporting](#), [Integrity period](#) – [Server driven](#))
- Get one ([BufTm=0](#)) or more ([BufTm>0](#)) value(s) of data objects (of a dataset) using [reporting](#) on data and quality change and data update – [Server driven](#))
- GOOSE and Sampled Values ... exchanges complete list of values of data objects of a dataset (events: application specific – [Server driven](#))
- Get sequence of value(s) of data objects (of a dataset) using [logging](#) (on data and quality change and data update – [Client driven](#))

Page 75

© 2009 NettedAutomation



Depending on your needs you may use one or the the other option. Reporting is the most elaborated service. The behavior of reporting depends on the configuration of so-called Report Control Blocks. Reporting with Integrity Period set, e.g., to 1 second is more efficient than polling a list of data objects every second! Because polling needs two messages: request with then object references of all data to be polled and response with all values. Reporting with Integrity Period requires a single report with all values every second only. You **save 50**

per cent of the messages and a lot of processing resources. You can combine integrity period (e.g., 1 minute) with immediate transmissions of changes (events). This would save even more (in case there are events very seldom).

Before you can configure an optimized traffic (messages going back and forth in a Network in real-time or relaxed in seconds) you need to understand your needs - the arrival rate of values and the needs of the applications that access these values. And of course you need to understand the standard and what vendors have implemented. Some applications require information from other devices in the range of a few microseconds - this requires usually GOOSE. The various options serve different requirements with regard to the timeliness. It is easy to fill up the bandwidth of 10 GBit/s with wrong configurations. Monitoring for deadband changes (delta changes) of 0.001 per cent could cause a lot of messages ... ;-)

Smart Grids require smart systems and smart devices - all need smart people!

Posted by [Karlheinz Schwarz](#) at [10:27 PM](#) [0 comments](#) 

Labels: [communication](#), [engineering](#), [GOOSE](#), [IEC 61400-25](#), [IEC 61850](#), [IED](#), [peopleware](#), [Power Automation](#), [sampled value](#), [Smart Grid](#), [smart solution](#)

IEC 61850 and IEC 61400-25 Hands-On Training

A 3 day general IEC 61850/IEC61400-25 Seminar/Hands-on Training by Karlheinz Schwarz from NettedAutomation GmbH will be conducted in Frankfurt/M (Germany) from 22.-24. September 2010. He has trained more than 2,000 experts from more than 400 companies and more than 50 countries. You can tap a huge experience ...

For the hands-on training we will use the Beck IPC IEC61850@CHIP Development Kits, Client and Server DLL and several other demo software and free software.

There are still seats available.

Click [HERE](#) for the detailed program.

Click [HERE](#) for the registration information.

Posted by [Karlheinz Schwarz](#) at [3:29 AM](#) [0 comments](#) 

Labels: [distribution automation](#), [DLL](#), [electric power system](#), [engineering](#), [hands-on Training](#), [IEC 61400-25](#), [IEC 61850](#), [implementation](#), [interoperability](#), [MMS](#), [Power Automation](#), [Substation Automation](#), [Training](#), [wind power](#)

IEC 61850 Workshop at Hydro Quebec, Montreal, Canada

The IEC TC 57 WG 17 (DER) will meet in Montreal, Canada, on September 27-29, 2010. Experts from WG 17 invite interested experts from the power utility domain for a one day workshop on IEC 61850.

Date and Time: September 30, 2010, (Thursday); 8:30 -15:00 h
Venue: Hydro Quebec, Montreal, Canada

A couple of WG 17 members have suggested to organize an extra day for information dissemination of the results reached by WG 17 and the ongoing work. Another objective is to discuss common modeling issues with experts from other domains like hydro, wind, PV, ... one issue for

discussion is the remote monitoring and [control of power generation \(example of IEC 61400-25-2\)](#).

On Thursday (September 30) there will be an open presentation of crucial aspects of the standard IEC 61850 and especially of IEC 61850-7-420 and a demonstration of the latest development of the "IEC61850@CHIP" and first experiences with the small platform especially for PV systems.

The chip provides the complete IEC 61850 (IEC 61400-25) MMS, GOOSE and Sampled Value communication stacks. The stacks and the device data models are configurable by a standard SCL File (IEC 61850-6) uploaded to the chip. The stack provides a simple API for IEC 61850. Applications can be developed in C/C++ and IEC 61131-3. The focus shifts from communication (especially MMS) programming to your applications and system and device configuration. The chip supports SSL and other security standards.

The development of affordable standards-conformant interfaces for distributed energy resources can now be shortened to days or weeks - from months and years. The range of all crucial Beck IPC products (IPC@CHIP@s, modules, Development kits, ...SCL Designer, Application programming using the simple stack API) will be presented and discussed during the workshop. This extra workshop will be conducted by Karlheinz Schwarz.

The workshop is open to everyone interested in the presentation and demonstration free of charge. Breakfast and lunch breaks are on the attendees; drinks will be provided.

You may attend and invite other experts that may be interested to attend.

Please let Karlheinz Schwarz (schwarz@scc-online.de) know who will attend in order that we can confirm a seat. The number of seats is limited to 20 seats.

Posted by [Karlheinz Schwarz](#) at [2:53 AM](#) [0 comments](#) 

Labels: [communication](#), [DER](#), [education](#), [electric power system](#), [hands-on Training](#), [hydro power](#), [IEC 61400-25](#), [IEC 61850](#), [IEC 61850-7-420](#), [implementation](#), [interoperability](#), [interoperability tests](#), [Smart Grid](#), [wind power](#)

Smart Grid Interoperability Panel (SGIP) meets in September 2010

The next face-to-face meeting of the Smart Grid Interoperability Panel (SGIP) will be held in St. Louis (MO) on September 14-16, 2010.

Click [HERE](#) for the program and venue.

IEC 61850 and IEC 61400-25 will be an issue in PAP 16 (Wind Power) and several other PAPs. A joint meeting of PAPs that deal with these standards is planned. There are several areas in which the various application domains need consistent information models for real-time information exchange. E.g., for the interface between power generation and control center. There is a first standard available: IEC 61400-25-2 that defines two logical nodes - one for active power control and one for reactive power control.

These could be used as a basis for further work in other domains. I guess there is a need for a common core model that may have special data for the various resources like wind, hydro, CHP, PV, ...

[Karlheinz Schwarz](#) (Editor of IEC 61850 and IEC 61400-25) will be in St.

Louis on September 15 and 16.

The IEC TC 57 WG 17 (DER) will meet in Montreal, Canada, on September 27-29, 2010. Experts from WG 19 invite interested experts for a one day workshop on IEC 61850.

Click [HERE](#) for details on the Workshop.

Posted by [Karlheinz Schwarz](#) at [2:36 AM](#) [0 comments](#) 

Labels: [DER](#), [distribution automation](#), [electric power system](#), [IEC 61400-25](#), [IEC 61850](#), [Power Automation](#), [Smart Grid](#), [Training](#), [wind power](#)

Security: Hackers to take control of Power System Automation?

Security is one of most crucial aspects in Power System Automation - in order to keep to power flowing. Hackers have started to take over control of critical infrastructures like power plants using Windows operating systems.

According to AP "The latest computer worm, dubbed Stuxnet, was an even more alarming progression. Now hackers are creating codes to actually take over the critical systems."

Click [HERE](#) to read more details.

It is highly recommended that intelligent devices that will be used to make the Power Systems smarter use the needed security measures. One of the key issues is that people deciding on how much money should be spend to ruggedize the systems are willing to develop the measures; and people that purchase devices only when they are secure.

Posted by [Karlheinz Schwarz](#) at [1:59 AM](#) [0 comments](#) 

Labels: [Automation](#), [Critical Infrastructure Protection](#), [Power Plants](#), [security](#)


Monday, August 2, 2010

The many Abstract and Concrete Layers in IEC 61850 (61400-25)

A new Comprehensive Overview of the many different layers in the definition of IEC 61850 has been provided by Karlheinz Schwarz. The various levels of models, the services, the mappings to MMS services and protocols, mapping of MMS messages to ASN.1, ASN.1. BER, ... are confusing - if you don't understand them. This presentation provides a lot of details and examples. 15 Slides bring light to the - often not understood - IEC 61850 layering:

1. Abbreviations
2. Hierarchy of definitions, protocols, ...
3. Model (Standard)
4. Model (SCL)
5. Model (IED)
6. Services (ACSI)
7. Model and Service Mapping
8. Services and Protocols (MMS)
9. ASN.1 BER (Basic Encoding Rule)
10. Encoded MMS Message

Slide #1 of 15:

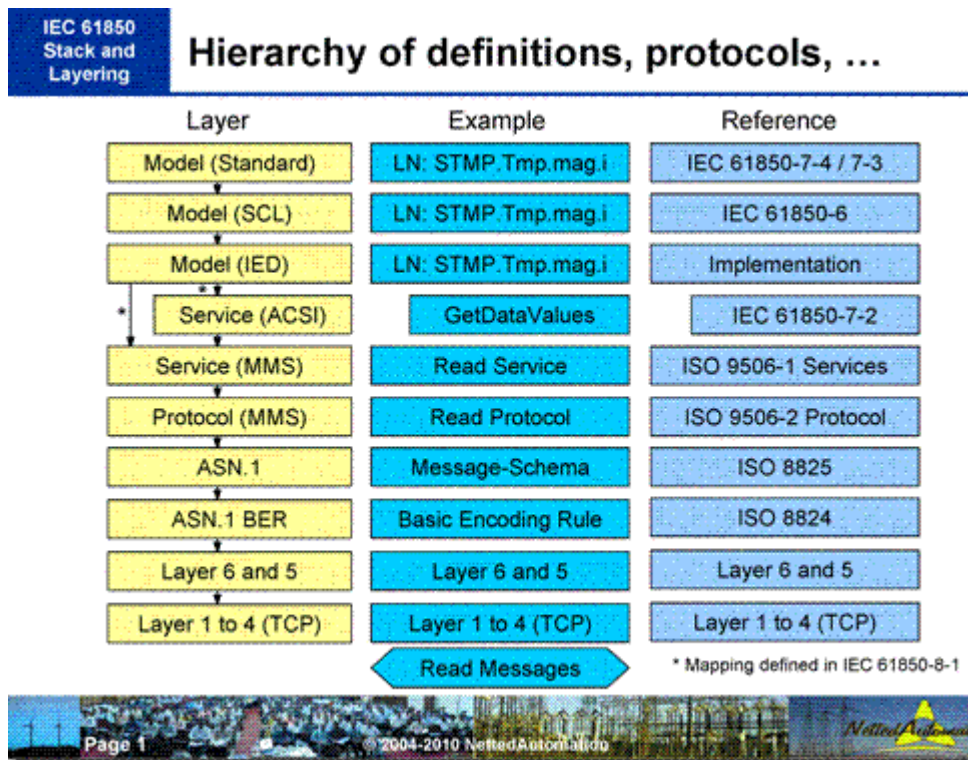

Click [HERE](#) to browse all 15 slides.

All these details are hidden in the implementation of IEC 61850 (IEC 61400-25) provided by [SystemCorp](#) (Perth, WA, Australia) and by the Smart Grid "Beck-Bone". The IEC 61850 API just needs 8 services:

IEC61850_Create	API to create a client or server object with callbacks for reading, writing and updating data
IEC61850_LoadSCLFile	API to read the SCL XML file to get the configuration of server or client
IEC61850_Start	API to start the server or client
IEC61850_Stop	API to stop the server or client
IEC61850_Free	API to delete a client or server object created
IEC61850_Read	Read the value of a specified data attribute
IEC61850_Write	Write the value to a specified data attribute
IEC61850_Update	Update the value of a specified data attribute

The three last API services are the crucial services an Application programmer has to deal with. The Beck Development Kit DK61 and the DLL demos provide application examples (in C/C++ source code).


Posted by [Karlheinz Schwarz](#) at 1:04 PM 1 comments 

Labels: [ACSI](#), [ASN.1](#), [BER](#), [hands-on Training](#), [IEC 61400-25](#), [IEC 61850](#), [implementation](#), [interoperability](#), [ISO](#), [programming](#), [real-time](#), [Training](#), [wind power](#)

The "Beck-Bone" for Smart Grids Demonstrated at IEEE PES GM in Minneapolis

BECK IPC (Pohlheim, Germany), SystemCorp (Perth, Australia) and NettedAutomation (Karlsruhe, Germany) successfully demonstrated the "Beck-Bone" for Smart Grids at the IEEE PES GA in Minneapolis (MN, USA):

The IEC61850@CHIP.

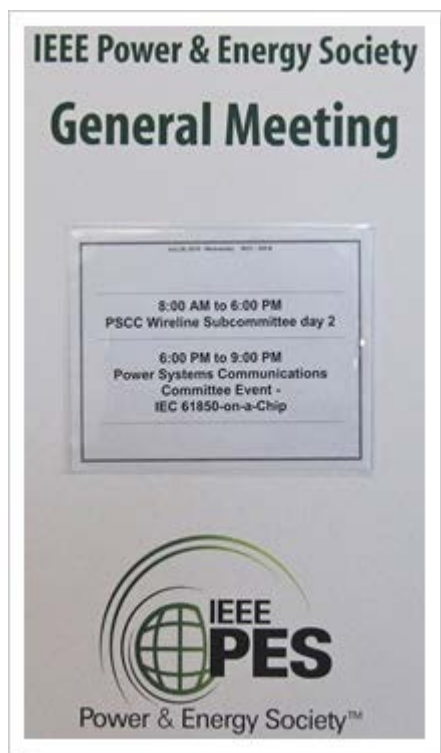

More than 2,500 experts attended the IEEE Power & Energy Societies General Meeting in Minneapolis (MN, USA) from 26 to 29 July 2010. One of the highlights of the Power System Communications Committee's Event was the demonstration of a breakthrough implementation of IEC 61850 (IEC 61400-25) on a Chip. Detlef Raddatz (SystemCorp) runs a last test prior to the big show:



Detlef demonstrates the benefits of the IEC 61850 software running on different HW platforms (all using the same Chip): Development Kit DK61 (middle of photo), ruggedized I/O modules (left), COM.TOM module (right):



The Development Kit DK61 comes with IEC 61850 (61400-25) stack software, an easy to use API with 13 functions only, with C/C++ and IEC 61131-3 programming languages, FTP, Telnet, TCP/IP, IPSec, sample C code and sample exe files that run immediately, and comprehensive documentation.

Click [HERE](#) for more details of the DK61.

Click [HERE](#) to download the order form to get the special fair offer of US\$ 1.250.

The stack software and sample code (source and exe) have been introduced in Minneapolis as **DLL demos** (client, server, publisher, and subscriber). The DLLs run for 6 months fully functional for up to 50 signals/points. The demo also contains the fully functional **SCL designer** to model up to 50 signals/points. The server runs the same model as provided with the DK61. You may use the DLLs for any other application you build around them. The given sample code runs on one PC (local host) and two PCs. The DLLs run under **Windows** - while the Beck Chip runs a very powerful real-time operation system (RTOS) **for real-time applications**.

Click [HERE](#) to download the DLLs to run under Windows (available end of August 2010; the availability will be announced in a new blog posting as soon as it is available).

During the many technical discussions experts had questions about the platform and functions. People had been quite surprised when they understood the performance of such a simple and small platform.



The Buffet offered a variety of food and beverages ... including Beck's Beer and Beck "Chips". The German brewery Beck and Beck IPC (the chip manufacturer) are not linked.



Professor Dr. John Newbury (The Open University, Manchester, GB) was quite happy to see the results of 15 years of standardization work in IEC TC 57 (WG 10, WG17, WG 18) and TC 88 PT 25 (IEC 61400-25, Wind Power) on such a small but powerful platform:




What are the steps towards a the "Beck-Bone" for Smart Grids and many other applications?


1. Many experts start with the **Development Kit DK61** to do hands-on exercises using the provided software examples to get a good understanding of the IEC 61850 models and services. One of the big vendors of controllers reported the other day that they were able to implement their network interconnection for connecting PV systems to the power grid within 2 weeks !! The grid connection is completely modeled in IEC 61850.
This is the easiest way to get your data communicated with IEC 61850 (IEC 61400-25). Another approach could be to start with DLLs on a PC and then use the DK61 for real-time requirements.
2. In case of implementing interfaces, e.g., for pilot projects, it is convenient to use one of the many ready to go **COM.TOM modules**:



3. After successful pilot projects it is recommended to use **one or the other Chip** in your specific hardware:

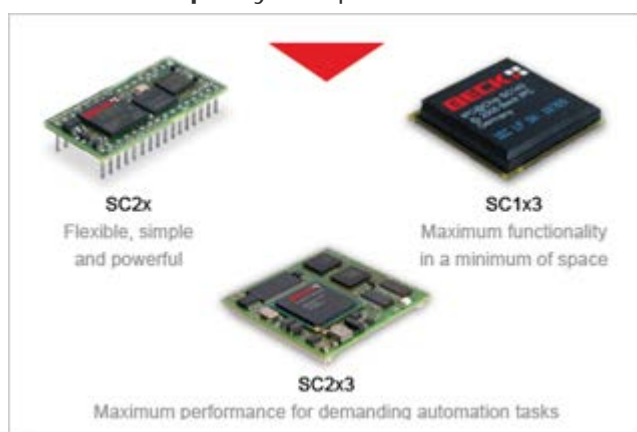

4. Other components hardened for higher EMC requirements are offered by SystemCorp: RTUs, Gateways, Protocol converter, ...

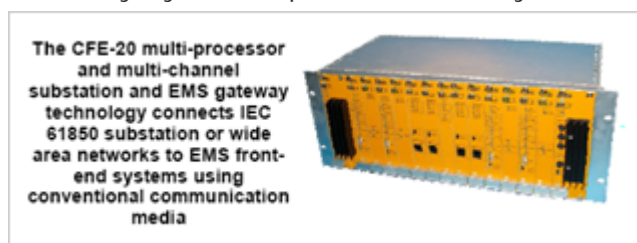

All these and other components implement IEC 61850 on the Beck Chip. The IEC 61850 stack software (developed by SystemCorp) runs on many other platforms:

Supported Platforms

Microsoft Windows XP, 2003/2008 and Vista

■ Ubuntu Linux (x86,x86-64)

■ Embedded Linux (ARM, Coldfire)

■ Beck @Chip SC1x3 RTOS

■ Other platforms available on request

Click [HERE](#) to visit the SystemCorp website (Perth, WA, Australia).

Posted by [Karlheinz Schwarz](#) at [12:06 AM](#) [0 comments](#)

Labels: [API](#), [Beck](#), [communication](#), [DLL](#), [example](#), [IEC 61400-25](#), [IEC 61850](#), [Power Automation](#), [RTU](#), [SCL](#), [stack](#)

Tuesday, July 27, 2010

DOE spends US\$ 615 Million for the Smart Grid Demonstration Program

The first presentation of the Session on "**Interoperability for a Smart Grid**" during the IEEE PES GA in Minneapolis yesterday (2010-07-26) was titled: "**Interoperability and the Federal Role**" (by Dan Ton; Chris Irwin and Steve Widergren).

Chris Irwin (a member of the Department of Energy team administering the Smart Grid Investment Grants, and is responsible for standards and interoperability activities, including participation in the NIST-led Smart Grid Interoperability Framework) pointed out that **INTEROPERABILITY** of devices and systems is key for building a smarter grid: "... given the importance of a smart electric system to meet national economic, societal, and environmental objectives, a **federal role is taking shape in the United States to improve the integration of automation elements** and thus make smart grid a reality."

He reported that the federal government will spend "**US\$ 615 million for the Smart Grid Demonstration Programs**". ... To ensure that these investments have a lasting, positive effect to the nation, great attention is being given to address the **interoperability**".

The standards IEC 61850 and IEC 61400-25 are crucial standards in this context - also in North America. I talked yesterday to many conference attendees. Most of them are convinced that these standards will have a big impact on the devices and systems - in order to make them interoperable. Interoperability has first to be understood by smart people. Peopleware is key to the success of interoperability and smart(er) grids.

Click [HERE](#) to read the abstract of the paper.

Posted by [Karlheinz Schwarz](#) at [6:06 AM](#) [0 comments](#) 

Labels: [IEC 61850](#), [interoperability](#), [peopleware](#), [Smart Grid](#), [standards](#)

Beck Chip with IEC 61850 in EV Charging Station

An electric vehicle charging station, designed by Rittal GmbH & Co (Herborn, Germany) and Beck IPC GmbH (Pohlheim, Germany) **with IEC 61850 inside**, is installed outside of the IBM Industry Solutions Lab in Ruschlikon, Switzerland.

This charging station is part of the EDISON project.

Click [HERE](#) for photo of the charging station at IBM.

Click [HERE](#) for more information on EDISON.

Posted by [Karlheinz Schwarz](#) at [5:09 AM](#) [0 comments](#) 

Labels: [batteries](#), [Beck](#), [charging station](#), [Chip](#), [IBM](#), [IEC 61850](#), [Smart Grid](#)

Sunday, July 25, 2010

3 Days until the Demo of Beck Chips implementing IEC 61850/61400-25 at IEEE PES GA in Minneapolis

In just 3 days Beck (Pohlheim, Germany - IEC 61850 Chip), SystemCorp (Perth, Australia - IEC 61850 software) and NettedAutomation (Karlsruhe, Germany - peopleware) will present the **Beck Chip for IEC 61850 and provide free Beck's Beer.**

The presentation and demonstration of a break-through implementation of the standards 61850 and IEC 61400-25 on a small footprint programmable microcontroller chip for simple to complex applications will show that these standards can be used right away ... the API can be used immediately by your C/C++ or IEC 61131-3 programs. Application examples come with the Development Kit (DK61). And the solutions are affordable!

SystemCorp will demonstrate a **free of charge Evaluation DLL providing fully functional** Client/Subscriber and Server/Publisher. The DLL supports 50 points that can be modeled with the ICD Designer. **The demo DLL licence runs for 6 months - long enough to test IEC 61850 and IEC 61400-25.** You will get a USB memory stick with the DLL.

Where and when:

Wednesday, July 28, 2010 18:00-21:00
Minneapolis Convention Center, Room 209B

Come in and learn the latest IEC 61850 and IEC 61400-25 technologies. You have also the chance to drop your business card and **win one of the two DK61.**

Karlheinz Schwarz (NettedAutomation) **will be available for a meeting with you during the PES GA.** Please contact me by posting a comment on this blog entry (at the end of this posting) and I will contact you. May be you will bump into me anyway on Monday, Tuesday or Wednesday.

A photo of me may help you to find me:

Click [HERE](#) for my profile including a photo of myself

Click [HERE](#) for more details.

Click [HERE](#) for the Floor plan of Level 2 of the MCC.

Posted by [Karlheinz Schwarz](#) at [5:26 AM](#) [0 comments](#) 

Labels: [Beck](#), [Chip](#), [communication](#), [IEC 61400-25](#), [IEC 61850](#), [implementation](#), [MMS](#), [Smart Grid](#), [smart solution](#), [wind power](#)

Wednesday, July 21, 2010

How to Spend \$45 Billion for Smart Grids by 2015?

Estimated spending for Smart(er) Grids during the next five (5) years will be more than \$45 Billion (45.000.000.000) - according to a forecast.

Some 40.000.000.000 "will be invested globally in the electrical Transmission and Distribution infrastructure through 2015, compared to \$4.8 billion for the purchase and installation of smart meters. This infrastructure spending will focus on grid automation and control, distribution automation, distributed generation and demand response programs."

If only five (5) per cent would go into smart(er) communication based on IEC 61850 then this would sum up to \$ 2.000.000.000 (\$2 Billion) !! ... \$ 400.000.000 per year.

Any question? ;-)

Hope there are enough smart engineers ...

Click [HERE](#) to read the news release from ABI.

Posted by [Karlheinz Schwarz](#) at [7:53 AM](#) [0 comments](#) 

Labels: [communication](#), [distribution](#), [distribution automation](#), [IEC 61850](#), [Smart Grid](#), [smart metering](#), [smart solution](#)

[Newer Posts](#)

[Home](#)

[Older Posts](#)

Subscribe to: [Posts \(Atom\)](#)

News on IEC 61850 and related Standards

Daily news concerning the standards IEC 61850, IEC 61400-25, IEC 61970 (CIM), IEC 60870-5, ...

Monday, July 19, 2010

Crucial Impact on Power System Automation

While the power industry is **struggling with the retiring workforce** as well as **educating and recruiting power system engineers** (see IEEE Power & Energy Magazine issue 7/8 2010) there are two other crucial influences on power systems on my radar screen:

- Manufacturers of (non-utility) Industrial Automation Systems
- Manufacturers of (non-utility) IP Network Infrastructures

Whoever wants to make his living from building a future Smart(er) Grids has to keep in mind that such smart(er) networks are power systems - that still need being designed, build, operated, and maintained by **smart power system engineers**.

The 11th VDI Congress on Automation Technology in Baden-Baden (Germany) May 2010 had a very interesting motto "**Leading through Automation**". Manufacturers of products and systems for industrial Automation applications are proud of their success in automation of factories (car production, machines of any kind, chemical processes, ...). There was not that much to automate in the power (distribution and distributed generation) systems - so far. That seems to change all in a sudden: The discussions and activities in the domain of power systems to implement smart(er) grids has infected the industrial automation experts.

During the last 20 years there was very little automation in the power industry influenced by factory automation vendors and their solutions. This will change in a fast pace: One of the leading experts (Roland Bent, CEO of Phoenix Contact) stated during the VDI Congress that the market for automation systems in the utility domain (electric power, water, ..., clean and green technologies) will be three times bigger in 2030 than today's factory automation.

There is the second crucial influence on the future of utility systems: The industry that offers the IP Network infrastructure for smart(er) grids. Read how, e.g., CISCO sees the future: "The smart grid promises a more efficient way of supplying and consuming energy. In essence, **the smart grid is a data communications network ...**".

CISCO states also that IEC 61850 plays a major role in the future: "The **existing** supervisory control and data acquisition (SCADA) and remote terminal unit (RTU) systems located inside the substation **cannot scale and evolve to support next generation intelligence**. Since flexible **IEC 61850-compliant** intelligent electronic devices (IEDs) and utility-grade rugged IP routers and Ethernet switches have become more widely available, many utilities are now ready to transform their communications networks from serial to IP-based communications." With a single standard they can sell their standard-compliant products all over! They do not need to develop and maintain tenth of solutions. This benefit of a single protocol stack (IEC 61850) is also what IBM and other IT companies like.

Subscribe To IEC 61850 News

 Posts 

 All Comments 

Blog Archive

- 2012 (11)
- 2011 (159)
- ▼ 2010 (153)
 - December (8)
 - November (9)
 - October (19)
 - September (18)
 - August (24)
 - ▼ July (17)

[DOE spends US\\$ 615 Million for the Smart Grid Demo...](#)

[Beck Chip with IEC 61850 in EV Charging Station](#)

[3 Days until the Demo of Beck Chips implementing I...](#)

[How to Spend \\$45 Billion for Smart Grids by 2015?](#)

[Crucial Impact on Power System Automation](#)

[Does IEC 61850 provide Security Measures? - Yes](#)

[IEC61850@Chip – Presentation of the break-through ...](#)

[IEC 61850 at IEEE PES Conference on](#)


Click [HERE](#) for the white paper from CISCO on their vision to build smart(er) grids.

So, the utility industry will soon see a lot of new solutions offered by companies experienced mainly in non-utility markets. I hope that the **management in the utility domains** understand that the future of the utility systems must be controlled by smart power system engineers!! And not mainly influenced by the focus on share holder value, general automation and network infrastructure.

The future of the automation in the smart(er) grids requires TEAMWORK of many disciplines - **led by smart power engineers**. One of the crucial tasks is to get more education on topics like Network Infrastructure and IEC 61850 for power engineers. Since IEC 61850 is much more than any of the field busses or DNP3 it requires comprehensive education by well experienced trainers.

The power engineers have to take care that the utility automation systems will not be flooded by a myriad of field busses from the industrial automation domain (see [discussion on IEC Fieldbus](#)). Getting cheap automation devices with one of the many different fieldbusses does not automatically mean to get low life-cycle cost!

[Smart People are the most crucial asset for Smart Power Systems](#)

Posted by [Karlheinz Schwarz](#) at 11:13 PM 0 comments 

Labels: [Automation](#), [communication](#), [Critical Infrastructure Protection](#), [distribution](#), [distribution automation](#), [education](#), [IEC 61850](#), [Information Model](#), [peopleware](#), [SCADA](#), [Smart Grid](#)

Wednesday, July 14, 2010

Does IEC 61850 provide Security Measures? - Yes

Some people had a concern that IEC 61850 does not define security measures. This is only half-way correct.

The fact is that IEC 62351 defines the Security for IEC 61850! IEC 61850 references IEC 62351. So, don't worry. Even the Beck Chip for IEC 61850 provides standard security.

IEC 62351-3:

Data and communications security: Communication network and system security – Profiles including TCP/IP

IEC 62351-4:

Data and communications security: Profiles including MMS

Part 3 specifies how to secure TCP/IP-based protocols through constraints

on the specification of the messages, procedures, and algorithms of Transport Layer Security (TLS) (defined in RFC 2246) so that they are applicable to the telecontrol environment of IEC TC 57. It is intended that this specification be referenced as a normative part of other IEC TC 57 standards that have the need for providing security for their TCP/IP-based protocol.

Click [HERE](#) for a preview of part 3.

Part 4 specifies procedures, protocol extensions, and algorithms to facilitate securing ISO 9506 – Manufacturing Message Specification (MMS) based applications. It is intended that this technical specification be referenced

[Innovative Sma...](#)

[Catalog of Control Systems Security: Recommendation...](#)

[IEC 61850-7-4 Edition 2: Insulation Medium Supervi...](#)

[IEC 61850 Information Models for Large Power Plant...](#)

[IEC 61850-7-2 Edition 2 approved](#)

[NIST Smart Grid Architecture and Interoperability ...](#)

[IEC 61850 IEDScout - Version 2.11 Available](#)

[GE Promotes International Standards like IEC 61850...](#)

[Danish Power System with 50 per cent Wind Energy -...](#)

[IEEE 1815 DNP3 - Old Wine in New Wineskins](#)

- ▶ June (12)
- ▶ May (7)
- ▶ April (8)
- ▶ March (9)
- ▶ February (10)
- ▶ January (12)

▶ 2009 (162)

▶ 2008 (82)

Contributors

[Karlheinz Schwarz](#)

[Michael Schwarz](#)

as a normative part of other IEC TC 57 standards that have the need for using MMS in a secure manner.

This technical specification represents a set of mandatory and optional Security specifications to be implemented for applications when using ISO/IEC 9506 (Manufacturing Message Specification).

Click [HERE](#) for a preview of part 4.

Posted by [Karlheinz Schwarz](#) at 4:33 AM 0 comments 

Labels: [Beck](#), [Chip](#), [IEC 61400-25](#), [IEC 61850](#), [IEC 62351](#), [MMS](#), [security](#)

IEC61850@Chip – Presentation of the break-through solution during IEEE PES GM in Minneapolis, MN, on the evening of July 28, 2010

Power System Communication Committee Event

Wednesday, July 28, 2010 18:00-21:00 MCC 209B

IEC 61850-on-a-Chip – Presentation and demonstration of a break-through implementation of the Standard 61850 on a small footprint programmable microcontroller chip for simple to complex applications by Beck IPC (Pohlheim, Germany)

Beck IPC (Pohlheim, Germany) invites to a Presentation and Demonstration of the low cost Beck Chip implementing IEC 61850 (IEC 61400-25):

Location: IEEE PES GM, Minneapolis Convention Center

Room: 209 B (Level Two)

Date and time: Wednesday, 28 July 2010, 6 p.m. – 9 p.m.

Food and drinks will be provided.

The IEC 61850 standard is the most successful standard for protection and substation automation communication for both HV and MV. The standard is intended to be used in centralized and distributed power generation as well as in distribution automation.

The high cost for the implementation of IEC 61850 is one of the crucial reasons the standard is currently being used in relatively few applications in DER systems and low voltage applications. Since the Hanover Fair 2010 (Hanover/Germany) in April 2010 this has been changed completely: A powerful and low price embedded and freely programmable Microcontroller implementing IEC 61850 has been demonstrated – the IPC@CHIP®.

The development of affordable standards-conformant interfaces for distributed energy resources can now be shortened from months or even years to days or weeks.

At this Wednesday evening event we will discuss the range of all crucial Beck IPC products (Chips, modules, Development kits, ...) and related products, e.g., IEC 61850, Modbus, IEC 60870-5, and DNP3 stack software from SystemCorp (Perth, Australia):.

Click [HERE](#) for more details.

Click [HERE](#) for the Floor plan of Level 2 of the MCC.

Please drop by to view the demonstration and discuss with the experts from Beck, SystemCorp and NettedAutomation - this event may accelerate your development of IEDs that speak IEC 61850 (IEC 61400-25).

Posted by [Karlheinz Schwarz](#) at 4:08 AM 0 comments 

Labels: [61850](#), [Beck](#), [Chip](#), [communication](#), [IEC 61400-25](#), [IEC 61850](#), [implementation](#), [Power Automation](#), [Smart Grid](#), [smart solution](#), [tools](#)

Saturday, July 10, 2010

IEC 61850 at IEEE PES Conference on Innovative Smart Grid Technologies Europe

Date and Location:

October 10-13, 2010 Chalmers Lindholmen, Gothenburg, Sweden

The first Conference on Innovative Smart Grid Technologies (ISGT) Europe, is sponsored by the IEEE Power & Energy Society (PES) and hosted by Chalmers University of Technology. The Conference will be a forum for the participants to discuss the state-of-the-art innovations in smart grid technologies. The Conference will feature paper sessions, panels and tutorials by international experts on smart grid. The organizing committees invite researchers, practitioners, decision makers and students, worldwide to participate and submit papers!

Tutorial 3 will be about IEC 61850.

Implementation of the standards IEC 61850 and IEC 61400-25 in **small devices** (14:15-15:15) by Karlheinz Schwarz ... See you there.

Click [HERE](#) for the program of the tutorial 3 on IEC 61850.

Click [HERE](#) for an overview on all three tutorials.

Click [HERE](#) to visit the conference home page

Posted by [Karlheinz Schwarz](#) at [12:56 AM](#) [0 comments](#) 

Labels: [communication](#), [distribution](#), [distribution automation](#), [education](#), [en](#), [IEC 61400-25](#), [IEC 61850](#), [interoperability](#), [SCADA](#), [Smart Grid](#), [wind power](#)

Thursday, July 8, 2010

Catalog of Control Systems Security: Recommendations for Standards Developers

The US Homeland Security has published a comprehensive list of recommendations for System Security of Control Systems like SCADA systems the other day.

Hope your system is secure - and hope that you have people you can trust ...

Click [HERE](#) for the 171 page list [pdf].

Posted by [Karlheinz Schwarz](#) at [1:29 PM](#) [0 comments](#) 

Labels: [en](#), [SCADA](#), [security](#), [standards](#)

IEC 61850-7-4 Edition 2: Insulation Medium Supervision Liquid Logical Node (SIML)

The edition 2 of IEC 61850-7-4 has new Logical Nodes (LN) and existing LNs that have been cleaned up. One of these LNs is the LN SIML (Insulation Medium Supervision Liquid).

The new Data Objects (DO) defined in Edition 2 are marked in yellow. One DO (marked in red) has changed its name from "H2" to "H2ppm".

LN SIML - IEC 61850-7-4 Edition 2

Status information	
InsAlm	Insulation liquid critical (refill insulation medium)
InsBlk	Insulation liquid not safe (block device operation)
InsTr	Insulation liquid dangerous (trip for device isolation)
TmpAlm	Insulation liquid temperature alarm
GasInsAlm	Gas in insulation liquid alarm (may be used for Buchholz)
GasInsTr	Gas in insulation liquid trip (may be used for Buchholz)
GasFlwTr	Insulation liquid flow trip because of gas (may be used for Buchholz)
InsLevMax	Insulation liquid level maximum
InsLevMin	Insulation liquid level minimum
H2Alm	H ₂ alarm
H2Wrm	H ₂ warning level
MstAlm	Moisture alarm
MstWrm	Moisture warning
Measured and measured values	
Tmp	Insulation liquid temperature
Lev	Insulation liquid level (usually in m)
Pres	Insulation liquid pressure
H2O	Relative saturation of moisture in insulating liquid (in %)
H2OPap	Relative saturation of moisture in insulating paper (in %)
H2OAir	Relative saturation of moisture in air in expansion volume
H2OTmp	Temperature of insulating liquid at point of H ₂ O measurement
H2ppm	Measurement of Hydrogen (H ₂) in ppm
N2ppm	Measurement of N ₂ in ppm
COppm	Measurement of CO in ppm
CO2ppm	Measurement of CO ₂ in ppm
CH4ppm	Measurement of CH ₄ in ppm
C2H2ppm	Measurement of C ₂ H ₂ in ppm
C2H4ppm	Measurement of C ₂ H ₄ in ppm
C2H6ppm	Measurement of C ₂ H ₆ in ppm
O2ppm	Measurement of O ₂ in ppm
CmbuGas	Measurement of total dissolved combustible gases (in %)
FitGas	Fault gas volume in Buchholz relay

LN SIML IEC 61

Measur
Tmp
Lev
Pres
H2O
H2OTmp
H2
Status
InsAlm
InsBlk
InsTr
TmpAlm
PresTr
PresAlm
GasInsAlm
GasInsTr
GasFlwTr
InsLevM
InsLevM
H2Alm
MstAlm

new in Edition 2
changed

Posted by [Karlheinz Schwarz](#) at 11:32 AM 0 comments

Labels: [Edition 2](#), [Edition1](#), [en](#), [IEC 61850](#), [Information Model](#), [monitoring](#)

Tuesday, July 6, 2010

IEC 61850 Information Models for Large Power Plants

Experts defining and using IEC 61850 for hydro power plants are working on the second edition IEC 61850-7-410 (Hydroelectric power plants – Communication for monitoring and control). This second edition will comprise quite comprehensive models for **large power plants** - the device models cover more or less the whole electrical side, while the mechanical side covers only hydro power plants.

It is intended **to use the existing definitions of the electrical side** (Power System Stabilizer functions, complete excitation systems, other controls, ...) for other Large (non-hydro) Power Plants. And further it is intended to convince experts of non-hydro Power Plants to start working on **extended/new models for mechanical components** of large plants.

Please post a comment (see below) on the above.

Posted by [Karlheinz Schwarz](#) at 5:58 AM 0 comments

Labels: [control](#), [Edition 2](#), [hydro power](#), [IEC 61850](#), [large power plants](#)


IEC 61850-7-2 Edition 2 approved

IEC 61850-7-2 Edition 2: "Communication networks and systems for power utility automation - Part 7-2: Basic information and communication structure - Abstract communication service interface (ACSI)" has been approved for publication as International Standard Edition 2 on July 02, 2010.

This edition 2 adds some minor new definitions, corrects errors of the first edition and aligns the content with other parts, e.g., 8-1. Here is a list of the most crucial issues:

- class diagrams have been updated (the modeling method is quite close to an UML model)
- data types not required have been removed, new types have been added,
- errors and typos have been corrected (see tissue database),
- substitution model has been moved to IEC 61850-7-3,
- service tracking for control blocks have been added; in edition 1 it was possible to treat control block instances in the same way as Data Objects. This has been changed - from a modeling point of view only. T
- the view concept (access restriction) will be implemented with the new work on role based access (RBA) as part of IEC 62351-8,
- security issues are solved by the IEC 62351 series, and
- several terms have been harmonized with those defined in other parts

Part 7-2 contains the basic definitions of the models and the services:

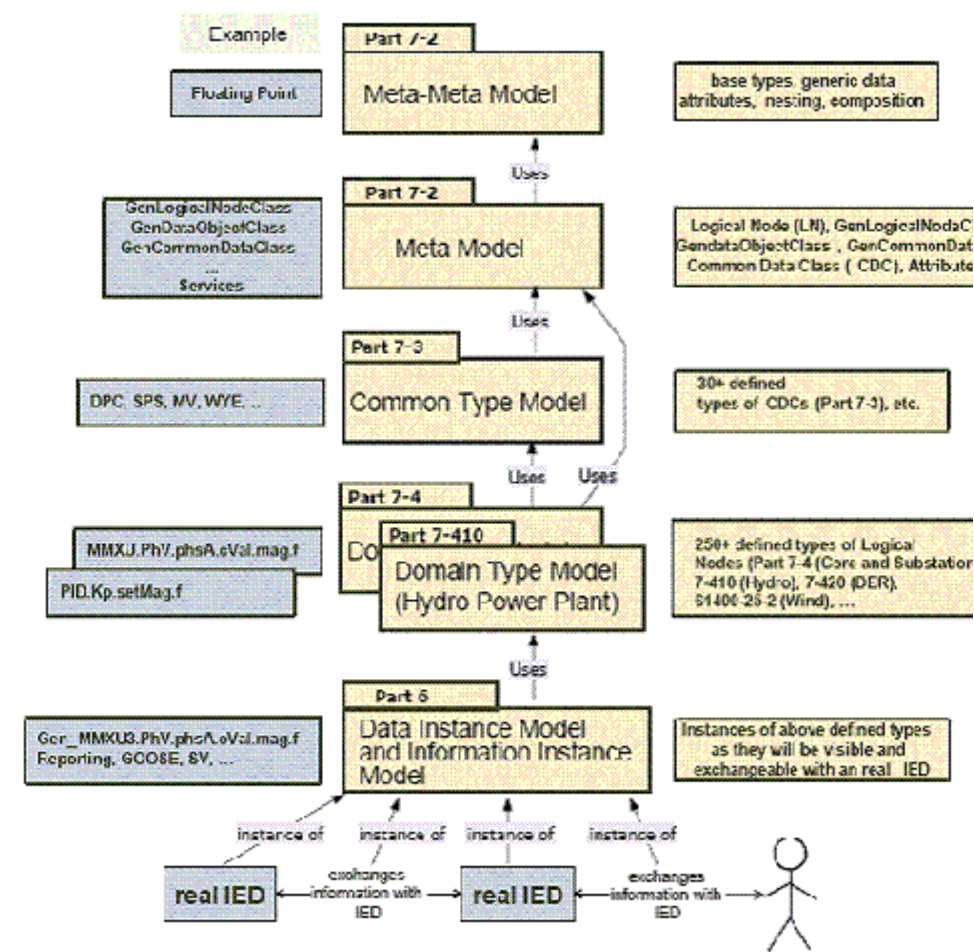

Labels: [communication](#), [Edition 2](#), [IEC 61850](#), [interoperability](#), [UML](#)

Saturday, July 3, 2010

NIST Smart Grid Architecture and Interoperability Standards - What has been accomplished?

The "Committee on Science and Technology's Subcommittee on Technology and Innovation" of the U.S. House of Representatives held a hearing on the NIST Smart Grid activities with regard to Interoperability Standards.

Read what the Witnesses have said:

- Dr. George Arnold: National Coordinator for Smart Grid, National Institute of Standards and Technology
- Mr. Mason Emnett: Associate Director of the Office of Energy Policy and Innovation, Federal Energy Regulatory Commission
- Mr. John McDonald: Director of Technical Strategy and Policy Development, GE Energy
- Mr. Conrad Eustis: Director of Retail Technology Development, Portland General Electric
- Ms. Lillie Coney: Associate Director, Electronic Privacy Information Center

A remarkable statement was made by Dr. George Arnold: "The basic structure of the **present grid has changed little over its hundred-year history**. The U.S. grid, which is **operated by over 3100 electric utilities** using **equipment and systems from hundreds of suppliers**, has **historically not had much emphasis on standardization and thus incorporates many proprietary interfaces and technologies that result in the equivalents of stand-alone silos**.

Transforming this infrastructure into an interoperable system capable of supporting the nation's vision of extensive distributed and renewable resources, energy efficiency, improved reliability and electric transportation may well be described by future generations as the **first great engineering achievement of the 21st century**."

One of THE KEY prerequisites for a smooth transformation is Peopleware - Only **smart and well educated people** can transform the system! Education usually has a low priority in the utility industry. Usually IT people in the utilities do not much care about monitoring, protection and control of the electric grid - may be they fear the high voltage ;-)

I have trained more than 2,000 people on IEC 61850 all over. Just a very few IT people have attended. IT people usually lack understanding of the electrical network. Many protection and control engineers have a good knowledge of information and communication technologies. Even Smarter Grids will be electrical networks.

In January 2010 I conducted a 3-day training on IEC 61850 for 30 experts in Reykjavik (Iceland). Iceland's population is some 300,000. Germany has a population of some 80,000,000. If I would train the same percentage of people in Germany I would need a soccer stadium for 8,000 attendees (for the U.S. I would need some 30,000 seats). That would not be a problem: Just do it ... like in Bangalore (India) for 350 attendees in 2006:

Click [HERE](#) for a brief report on the Bangalore event.


One show-stopper of the success of Interoperability Standards like IEC 61850 is the behavior of some employees from well known vendors making statements like: "Dear user, you do not need to understand IEC

61850 ... we do everything for you ... ". Another is the time and effort people have to invest to implement and use interoperable systems based on IEC 61850. With IEC 61850 running on a Chip and an affordable Development Kit experts can right start to use IEC 61850 and link their application to the IEC 61850 models, services and configuration language. Since the Kit is available (March 2010) I use several Kits for Hands-on Training.

Click [HERE](#) to get details on the Development Kit, Beck IPC (Pohlheim/Germany).

Click [HERE](#) on some discussion on Peopleware.

Click [HERE](#) for the Hearing Charter, Opening Statements and all Witness Statements

Posted by [Karlheinz Schwarz](#) at [5:55 AM](#) [0 comments](#) 

Labels: [communication](#), [distribution automation](#), [education](#), [electric power system](#), [en](#), [IEC 61400-25](#), [IEC 61850](#), [implementation](#), [interoperability](#), [lite](#), [NIST](#), [NIST Roadmap](#), [Training](#)

Friday, July 2, 2010

IEC 61850 IEDScout - Version 2.11 Available

Omicron has posted a new version (2.11) of their IEC 61850 IEDScout.

The new version supports Windows 7 (64 bit and 32 bit); some modifications resolve minor issues.

Click [HERE](#) to go to the IEDScout web page.

Posted by [Karlheinz Schwarz](#) at [3:41 AM](#) [0 comments](#) 

Labels: [en](#), [IEC 61850](#), [IEDScout](#), [SCL](#), [tools](#)

Thursday, July 1, 2010

GE Promotes International Standards like IEC 61850

John D. McDonald (P.E. Director, Technical Strategy and Policy Development Digital Energy GE Energy) - well known in the power industry - reported on the ongoing efforts under NIST SGIP to accelerate the definition and use of (international) Standards for information and communication to make the electric grid smarter.

According to John McDonald, the transformation of "our grid into a more automated, interactive and intuitive power delivery system has begun. Crucial to this undertaking are **system architecture and standards**, the foundation for **bringing together the electrical and communications infrastructure** and for evolving technology to meet many and disparate needs. **System architecture and standards that foster interoperability** provide a framework for development, a roadmap for progress and a catalyst for continued industry investment." He is right in stating that "The Smart Grid will be a system of interoperable systems."

He gives an overview of the work of the 16 PAPs and talks about the lack of use of international standards, mainly due to the lack in **awareness of the standards** like IEC 61850.


Mr. McDonald states also: "In the USA, **the transition from DNP 3.0 to IEC 61850 for substation automation and communications** is an excellent example of the challenge we have before us. IEC 61850 calls

for sending protection messages over Ethernet local area networks (vs. dedicated copper wires) and accessing measurements via a central process bus (vs. wired to the individual relays). These relatively small technology changes, but large process **and cultural changes**, have resulted in continued performance **with substantial savings for those deploying this new technology worldwide**. But there is enough concern and resistance to these changes here in the USA that IEC 61850 is not yet widely accepted or deployed."

Some 3 years ago I did a half day seminar on IEC 61850 for a North American utility. Half a year later I asked the engineer that had invited me: "How is IEC 61850 doing in your utility?" He answered: "**Hmm, we are still two retirements away**". This year he responded to the same question: "We are just one retirement away." What's about the young engineers? Let them learn what they need. Vattenfall (the biggest Scandinavian utility) recommends to utilities and vendors (and of course the system integrators) to do **much more education and training on IEC 61850!!**

Click [HERE](#) for the statement from Vattenfall.

Click [HERE](#) for the complete testimony of John McDonald (GE).

Posted by [Karlheinz Schwarz](#) at [11:49 PM](#) [0 comments](#) 

Labels: [communication](#), [DER](#), [DNP3](#), [education](#), [electric power system](#), [General Electric](#), [IEC 61850](#), [interoperability](#), [peopleware](#), [Power Automation](#), [Smart Grid](#), [standards](#), [Vattenfall](#)

Danish Power System with 50 per cent Wind Energy - with the help of IEC 61400-25

The Danish TSO Energinet is challenged by several questions like:

- How should the Danish power system be designed to **securely handle** 50 % wind power generation?
- What **technical solutions** can offer necessary system services in such a system? And how can the electricity market be designed to support the power system?
- Can Denmark expect neighboring countries to provide the present or even an increased contribution to our growing need for resources to balance supply and demand?
- And what can we do to mitigate the dependency on neighbors resources and interconnections?

The EcoGrid.dk project was initiated to find the best solutions to meet these requirements. One key issue is the information and communication technologies. Since Denmark is one of the key countries involved in the definition of the IEC Standard IEC 61400-25 (Communications for monitoring and control of wind power plants) it is no surprise that the report on phase 1 states:

The international "**communication standard for wind power is IEC61400-25**: the standard will provide a critical measure to manage the rapidly growing wind power penetration – **such a standard can really make a difference**. Through communication standards the current state of the individual wind plant can be controlled and monitored when required, and counter measurements can be enforced if needed, in order to meet the changing demand for energy and to provide support to the overall power system operation."

Click [HERE](#) for the complete Report on phase 1.

Click [HERE](#) for more information on EcoGrid.dk.

Posted by [Karlheinz Schwarz](#) at [1:25 PM](#) [0 comments](#) 

Labels: [en](#), [IEC 61400-25](#), [IEC 61850](#), [wind power](#)

IEEE 1815 DNP3 - Old Wine in New Wineskins

IEEE announced on June 28, 2010, that a "Collaboratively **developed** Distributed Network Protocol standard set to benefit worldwide Smart Grid, process automation industries". What is meant is the old standard DNP3 with a new brand label: **IEEE 1815**.

IEEE has ratified the IEEE 1815 Distributed Network Protocol (DNP3) standard. The **new standard**, which improves device interoperability and strengthens security protocols, was fast-tracked for completion and was **delivered in only seven months**; i.e. **re-labeled**. The development of DNP3 was done many years ago.

Click [HERE](#) for the full press release from IEEE.

Click [HERE](#) for the PAR that lead to the IEEE 1815.

Posted by [Karlheinz Schwarz](#) at [4:23 AM](#) [0 comments](#) 

Labels: [DNP3](#), [en](#), [IEC61850](#), [IEEE 1815](#), [standards](#)

Monday, June 28, 2010

Standard Rules for Extensions of Information Models for IEC 61850 and IEC 61400-25

IEC 61850 und IEC 61400-25 define already (or just) some hundreds of Information Models (LNs, Data Objects, and Common Data Classes).


Click [HERE](#) for a list of some 285 defined Logical Nodes.

The list will definitely grow while we go. Standards are defined based on consensus of experts and national committees involved. Very often the groups cannot agree on adding some useful information model - so it is often decided to NOT include the model into the standard. In other cases it is decided to just define the model as an optional definition.

A lot of information needed in real systems is not (yet) defined as part of the standards - and may never be standardized.

To allow the users of the standard to use the modeling method, the basic models like types and Common Data Classes, and Data Objects, IEC 61850-7-1 **defines a STANDARD Rule on how to cope with needed extensions**. The rule is named **"Name Space Concept"**.

The name space concept follows the needs of new models as depicted in the following figure from draft edition 2 of IEC 61850 (edition 1 already defined the name space concept):

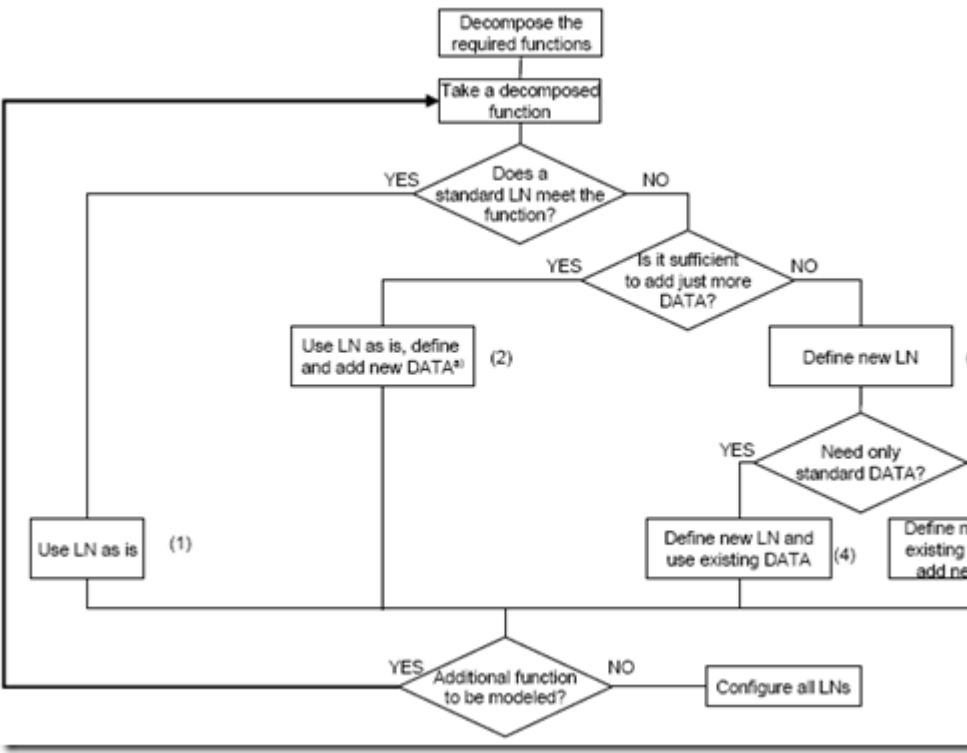

The rules defined allows:

- 1. To extend any existing standardized LN by **adding Data Objects from other LN classes** or by defining **new Data Objects**.
- 2. To extend any existing standardized Data Object by **adding Data Attributes** or by defining **new Common Data Classes**.

The following excerpt of Logical Node Name Plate Common Data Class (LPL) shows the corresponding attribute "InNs" (Logical Node Name Space). This is used to "tag" an extended Information Model. In this case an extended LN. Extended could mean a new LN or a LN that comprises new Data Objects.

LPL class					
Attribute name	Attribute type	FC	TrgOp	Value/value range	
DataSource	Inherited from Data Class (see IEC 61850-7-2)				
DataAttribute					
configuration, description and extension					
...	
IdNs	VISIBLE STRING255	EX		shall be included in LLNO only; for example "IEC 61850-7-4:2003"	A
InNs	VISIBLE STRING255	EX			A

Any Common Data Class has the following attributes:

Applied by all common data classes					
Attribute name	Attribute type	FC	TrgOp	Value/value range	
DataSource	Inherited from Data Class (see IEC 61850-7-2)				
DataAttribute					
...	
configuration, description and extension					
cdcNs	VISIBLE STRING255	EX			AC
dataNs	VISIBLE STRING255	EX			A

The "dataNs" is intended to identify (or reference) the extended Data Object.

The complete rules can be found in edition 1 of IEC 61850-7-1 - these

rules will be refined in edition 2 which will be published as International Standard later in 2010.


The current rules (edition 1) allow to define any extension needed for the Wind Power application in the US.

There is no need to wait until any future edition of IEC 61400-25-2 or any other standard models are published before people can use these standards in the US (and global wind power market). If models need to be extended this can be done on a **user** or **vendor** basis, on a **market** base (NIST, FERC, NERC, ...), **regional** base (North America), or a **global** (**UCA International Usersgroup**, or **IEC standard**) base.

It is very likely that the Information Models will grow while the industry goes.

If somebody would wait until **ALL** his currently needed information (in existing applications) is modeled as LNs, Data Objects and Common Data Classes and is standardized, then he would **NEVER START to use the standard**.

The crucial benefit of the IEC 61850 based standards is the independence of the models from the communication services, and the independence of the services from the communication protocols:

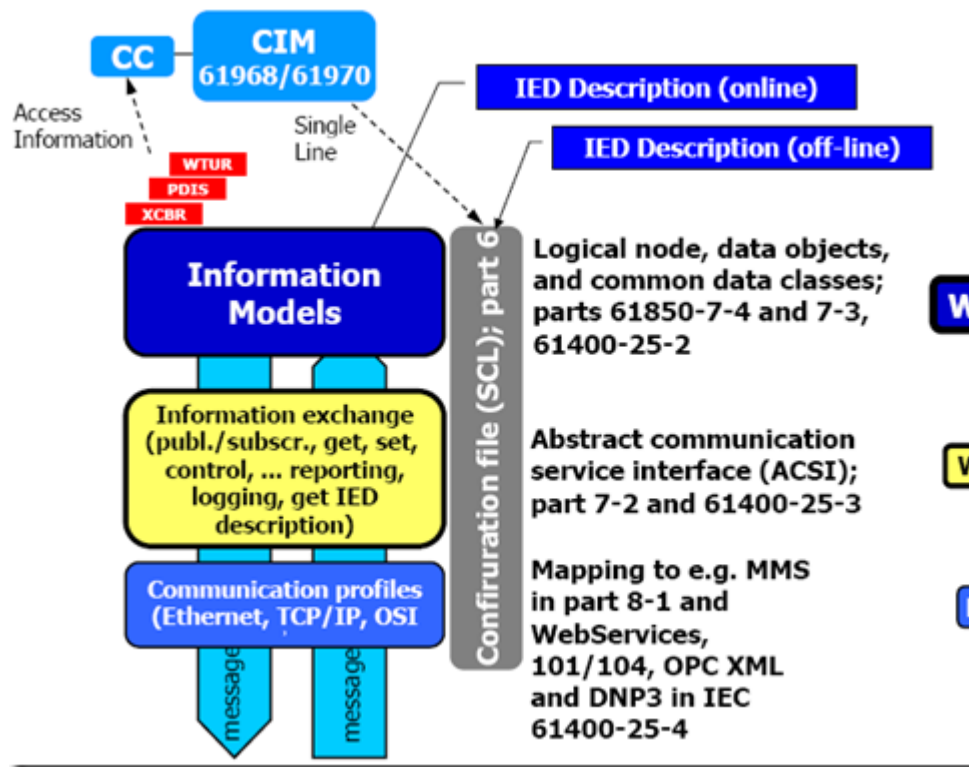

The Name Space Concept is a very **SMART solution** to make the grids smarter - **in a few steps**.

See also the next two blog postings.

Posted by [Karlheinz Schwarz](#) at 11:25 AM 0 comments

Labels: [communication](#), [IEC 61400-25](#), [IEC 61850](#), [Information Model](#), [interoperability](#), [logical node](#), [model extensions](#), [smart solution](#), [wind power](#)

Sunday, June 27, 2010

How to extend Models of IEC 61850 and IEC 61400-25?

Very often you can hear that IEC 61850 and IEC 61400-25 could be applied for new use cases only if new Logical Nodes would be standardized - which may take several years. Waiting years for new models is not what many companies and groups are looking for. Why to wait for years?

IEC 61850 has implemented a rule on how to extend and define new models: Name Space concept. This concept allows for defining extensions and new models (Logical Nodes, Data Objects, Common Data Classes).

Click [HERE](#) for an example of an extended Model: an new Logical Node (links to the next blog posting).

Posted by [Karlheinz Schwarz](#) at [1:15 PM](#) [0 comments](#) 

Labels: [Extensions](#), [IEC 61400-25](#), [IEC 61850](#), [Information Model](#), [wind power](#), [wind turbine controller](#)

Saturday, June 26, 2010

Adoption and Update of Wind Power Plant Communications Standard 61400-25


The NIST PAP 16 team (Wind Plant Communication) will gather use cases and requirements from wind industry stakeholders with a focus on those requirements associated with integrating bulk wind assets into wind plant operation and utility command and control systems. Special attention will be given to those use cases and requirements that differ from those developed by the IEC TC 88 61400-25 working group to quickly identify the gaps that are preventing ubiquitous application of the standard in the US. The PAP Team will seek out recent ARRA funding awardees involved in wind plant projects to ensure that their requirements are discovered and they are made aware of the existing portfolio of standards available.

The PAP 16 team will provide specific recommendations to the IEC TC 88 working group responsible for maintaining the 61400-25 standard to address the gaps identified.

Click [HERE](#) for the PAP Proposal [WORD document].

The standard IEC 61400-25-2 (Wind) mainly extends the information models of IEC 61850-7-4, 7-410 (DER) and 7-420 (Hydro). All objects of all four standards build a huge set of standard information models. ALL models can be used on generic IEC 61850-8-1 compliant communication stacks. Even new models not yet standardized but defined by anybody (!) can be configured and run on compliant communication stacks - the extended models just have to follow the well defined name space concept.

So, if you need a Logical Node, e.g., **LN FIZL = Fizzli Puzzli**, for your **Puzzli application**: just define the Data Objects you need: Fipu1, Fipu2, ... of common data class **SPS** (single point status) ... and you are done. Define the corresponding SCL file and run it with a communication stack. You need to know what the LN and its Data Objects mean - and you have to bind it to your Puzzli application. Here is how a client sees the corresponding server:

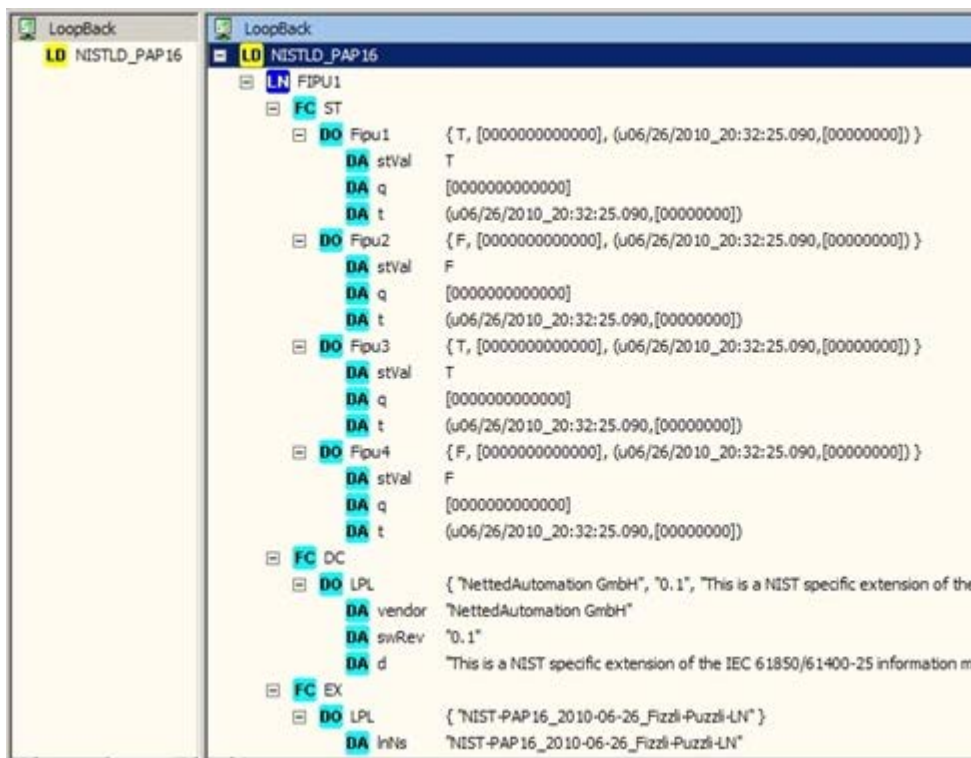

The value of the name space of the LN nameplate **FIPU1.EX.LPL.LnNs** is "**NIST-PAP16_2010-06-26_Fizzli-Puzzli-LN**" - indicates that this is a standard conformant Extension (Functional Constraint **FC=EX**).

The LN instance in SCL notation is:

```
<LN InType="FIPU_1" InClass="FIPU" inst="1">
  <DOI name="LPL">
    <DAI name="InNs">
      <Val>NIST-PAP16_2010-06-26_Fizzli-Puzzli-LN</Val>
    </DAI>
    <DAI name="vendor">
      <Val>NettedAutomation GmbH</Val>
    </DAI>
    <DAI name="swRev">
      <Val>0.1</Val>
    </DAI>
    <DAI name="d">
      <Val>This is a NIST specific extension of the IEC 61850/61400-25
information model.</Val>
    </DAI>
  </DOI>
</LN>
```

DataTypeTemplate for new LN class:

```
<LNNodeType id="FIPU_1" InClass="FIPU">
  <DO name="Fipu1" type="SPS_0" />
  <DO name="Fipu2" type="SPS_0" />
  <DO name="Fipu3" type="SPS_0" />
  <DO name="Fipu4" type="SPS_0" />
  <DO name="LPL" type="LPL_1" />
</LNNodeType>

<DOType id="LPL_1" cdc="LPL">
  <DA name="vendor" bType="VisString255" fc="DC" />
  <DA name="swRev" bType="VisString255" fc="DC" />
  <DA name="d" bType="VisString255" fc="DC" />
  <DA name="InNs" bType="VisString255" fc="EX" />
</DOType>
```

So, NIST or any other organization can quickly identify the gaps in the information models and **define any model that is needed for the application of the standard in the US (!!)**. Most use cases known so far may be implemented by extending the models or defining new models - private models, models defined by any other organization, or by IEC or ANSI or ...

Posted by [Karlheinz Schwarz](#) at [1:55 PM](#) [0 comments](#) 

Labels: [61850](#), [communication](#), [IEC 61400-25](#), [IEC 61850](#), [IEC 61850-7-410](#), [IEC 61850-7-420](#), [logical node](#), [NIST](#), [Smart Grid](#), [wind power](#), [wind turbine controller](#)

Thursday, June 24, 2010

IEC 61850 in the IEC Smart Grid Standardization Roadmap


IEC has published the "IEC Smart Grid Standardization Roadmap" for public access. It is a "technically oriented reference book which represents the standardization requirements" for Smarter Grids.

The core standards identified in this framework are mainly:

- IEC/TR 62357 – Framework of power automation standards and description of the SOA (Service Oriented Architecture) concept
- **IEC 61850 – Substation automation and beyond**
- IEC 61970 – Energy Management System – CIM and GID definitions
- IEC 61968 – Distribution Management System – CIM and CIS definitions
- IEC 62351 – Security

IEC 61850 is referenced more than 150 times in the Roadmap.

Click [HERE](#) to download the full report.

Posted by [Karlheinz Schwarz](#) at [11:16 PM](#) [0 comments](#) 

Labels: [CIM](#), [IEC 61400-25](#), [IEC 61850](#), [IEC 61850-7-410](#), [IEC 61850-7-420](#), [IEC 61968](#), [IEC 61970](#), [Smart Grid](#)

Wednesday, June 16, 2010

Congratulation - Spanish Utilities put their Heads together

Five Spanish utilities have shared their experience and ideas in trying to reach a high level of Interoperability of IEC 61850 devices from different vendors. The result of the many discussions, tests and projects has been made available the other day (Report of 182 pages full of good information). The group has granted me permission to post the result on this blog. Thanks to the companies:

RED ELÉCTRICA DE ESPAÑA, IBERDROLA, ENDESA DISTRIBUCIÓN, GAS NATURAL FENOSA and HIDRO CANTÁBRICO

"The "E3 - Spanish Electricity Companies for Studies on IEC 61850" is a working group formed by representatives and specialists from the main Spanish electricity companies, who have agreed on the urgent necessity to come to a set of unified criteria about **minimal requirements to comply with by the devices to be installed in their substations** under the IEC 61850 standard.

This is a result of the common standpoint reached by all participants

after the experience gathered through several pilot projects.
The E3 group feeling is that the future success of IEC 61850 will be based not only on filling, under common criteria, the gaps that are still contained within the standard, but also on driving the manufacturer's developments according to the user's needs. ..."

For many years I have told the utility industry to get more involved in the use and maintenance of the standards. Many managers in the utility industry have learned that it is worth that their experts share their experience and prepare for the future (build their muscles!). One result of this advice is the report you can download via the link below (after the photo).


There are still many people out that write specifications for an optimized use of IEC 61850 ... sometimes the result is like the car in the following photo:



Hope your specification is more than "Everything as before and use IEC 61850 - one way or the other". The above shown "Design" is good for VW promotion, it attracts people - but the product is not usable.

Click [HERE](#) for the full E3 report [6.9 MB, PDF]

Some utility experts are still in this comfortable position:



How long will this last? Some hope: at least until they retire ;-))

Be aware: There is something to do for everyone. Build your muscles for the next generation of technology - with or without IEC 61850 ... it will come. Hope you get strong enough to deal with it.

Posted by [Karlheinz Schwarz](#) at 2:34 PM [0 comments](#) 

Labels: [communication](#), [electric power system](#), [IEC 61850](#), [interoperability](#), [Power Automation](#), [standards](#), [Substation Automation](#), [sustainable interoperability](#)

[Newer Posts](#)

[Home](#)

[Older Posts](#)

Subscribe to: [Posts \(Atom\)](#)

News on IEC 61850 and related Standards

Daily news concerning the standards IEC 61850, IEC 61400-25, IEC 61970 (CIM), IEC 60870-5, ...

Tuesday, June 15, 2010

Analysis of Wind Power Plant Information Flow

A very interesting study of the many information flows in a wind power plant system has been done by a Swedish student:

Master Thesis

REFERENCE ARCHITECTURE FOR WIND POWER INTEGRATION

A wind power plant system structure based on analysis of wind power plant information flow

By Ivan Löfgren, Stockholm, Sweden 2009

The thesis provides an excellent overview and many useful details on the information flow in wind power plants! It is really worth to read - not only by wind power experts but also by experts of other application domains.

One of his findings are summarized in the following trend statement:

"The current trends in the architecture incorporate the following aspects:

- Standardization for both the **communication** (TCP/IP protocol), and also for the **information models** (IEC 61850, IEC 61400-25).
- Existence of a **unified information model** which allows a common language to be used between all the wind power plant components.
- **Access from any location to any element** of the wind power plant.
- Existence of an element dedicated solely to the management of communications

In definitive terms, the new architecture is designed to standardize not only the data access, but also the information from each one of the components that makes up the wind power plant. ..."

Click [HERE](#) for the full thesis [pdf].

Congratulation to Ivan Löfgren - he did a great job!!

Click [HERE](#) for all information on IEC 61400-25 on this blog.

Posted by [Karlheinz Schwarz](#) at [9:20 AM](#) [2 comments](#) 

Labels: [communication](#), [condition monitoring](#), [control](#), [IEC 61400-25](#), [monitoring](#), [Smart Grid](#), [Vattenfall](#), [wind power](#), [wind turbine controller](#)

AUD 100 million Government Smart Grid project awarded

Subscribe To IEC 61850 News

 Posts 

 All Comments 

Blog Archive

► [2012](#) (11)

► [2011](#) (159)

▼ [2010](#) (153)

► [December](#) (8)

► [November](#) (9)

► [October](#) (19)

► [September](#) (18)

► [August](#) (24)

► [July](#) (17)

▼ [June](#) (12)

[Standard Rules for Extensions of Information Model...](#)

[How to extend Models of IEC 61850 and IEC 61400-25...](#)

[Adoption and Update of Wind Power Plant Communicat...](#)

[IEC 61850 in the IEC Smart Grid Standardization Ro...](#)

[Congratulation - Spanish Utilities put their Heads...](#)

[Analysis of Wind Power Plant Information Flow](#)

[AUD 100 million Government Smart Grid project awar...](#)

EnergyAustralia has won the smart grid project. A CONSORTIUM led by EnergyAustralia has been named the other day the successful bidder in the federal government's **\$100 million smart grid, smart city project**.

Newcastle will be the main site for the country's first commercial-scale smart grid project. The trial will also cover other parts of NSW including Scone, Homebush, Ku-ring-gai and the Sydney CBD.

The consortium includes IBM Australia, AGL, GE Energy, TransGrid, Newcastle City Council and the NSW government.

Click [HERE](#) for a news release.

EnergyAustralia is already working on making the system smarter: see the following examples:

"Building a new communications platform - EnergyAustralia has rolled out 800 kilometres of new fibre optic cables, installed hundreds of communications switches and deployed carriergrade **Internet Protocol (IP) technology to connect more than 200 key substations and depots**.

This **telecommunications backbone is the foundation for a smart grid**. It will provide many benefits including greater **equipment monitoring and control**, allowing better decision-making and earlier fault detection and repair.

Installing smart monitoring devices to collect data -

EnergyAustralia is rolling **out 12,000 monitoring devices throughout its electricity distribution network**. This data will allow

EnergyAustralia to reduce outages through faster fault location and preventive maintenance and to work towards managing distributed energy sources such as solar and storage devices. The smart sensors will give EnergyAustralia an instant picture of the electricity network and how it is performing.

Rolling out smart sensors and analytical tools on the high voltage electricity network – This includes new smart equipment at zone

substations and major transmission cables to allow better, more efficient management of power equipment and greater automation of the network."

Click [HERE](#) for more details what they do.

EnergyAustralia and IEC 61850 - check the following documents:

NS 178 - Secondary System Requirements for Major Substations

Click [HERE](#) for the document

More to come ...

Posted by [Karlheinz Schwarz](#) at [8:59 AM](#) [0 comments](#) 

Labels: [communication](#), [EnergyAustralia](#), [GOOSE](#), [IEC 61850](#), [Smart Grid](#), [Substation](#), [Substation Automation](#)

Native Ethernet, IEC 61850 and Emerson Process Management

One of the real benefits of IEC 61850 is that it uses **native Ethernet** - not one of the many specialized "Ethernet Solutions". IEC 61850 compliant IEDs can easily communicate with any system that provides native Ethernet and TCP/IP connectivity. Ethernet for GOOSE and Sampled Values and Ethernet/TCP/IP for Client-Server communication (Get, Set, Control, Reporting events, browse the IEDs, logging events, ...).

Emerson Process Management announced on June 09, 2010, that its

[Native Ethernet, IEC 61850 and Emerson Process Man...](#)

[Siemens to erect 160 wind turbines in a single off...](#)

[UML model of IEC 61850](#)

[Do Wind Turbines change our Climate?](#)

[Deutsche Industrie empfiehlt China einheitliche St...](#)

- May (7)
- April (8)
- March (9)
- February (10)
- January (12)

► 2009 (162)

► 2008 (82)

Contributors

[Karlheinz Schwarz](#)

[Michael Schwarz](#)

new Ovation™ Ethernet Link Controller I/O Module supports IEC 61850 connectivity.

"Applications protocol packages can be loaded onto the Ethernet Link Controller I/O Module, enabling Emerson to extend its PlantWeb™ digital architecture and Ovation system beyond traditional plant boundaries. One such protocol package is IEC (International Electrotechnical Commission) 61850, which has emerged as a global standard for Substation Automation (SA). Integrating data from electrical devices used in generators, switchgear, transmission lines, transformers and substations drives more-informed decision making throughout the organization."

Click [HERE](#) for the press release.

Posted by [Karlheinz Schwarz](#) at [8:19 AM](#) [0 comments](#) 

Labels: [Automation](#), [Emerson](#), [Ethernet](#), [IEC 61850](#), [Power Automation](#), [standards](#)

Saturday, June 5, 2010

Siemens to erect 160 wind turbines in a single off-shore park


Siemens reported the other day that they will supply and erect 160 wind turbines each with a capacity of 3.6 megawatts for the Gwynt y Môr project (North Wales coast). Siemens will also provide the connection of the wind turbines to the power grid including substations (offshore transformer platforms).

Click [HERE](#) to read the full press release.

The first German off-shore park ([Alpha-Ventus](#)) is in operation since Spring 2010. This is just the first step - huge projects are planned. More to come.

Click [HERE](#) for a (HUGE) list of planned wind power projects (these are challenges for engineers!).

Click [HERE](#) for general information on off-shore wind parks.

Posted by [Karlheinz Schwarz](#) at [10:00 PM](#) [0 comments](#) 

Labels: [off-shore](#), [RWE](#), [Siemens](#), [wind power](#), [wind turbine controller](#)

Thursday, June 3, 2010

UML model of IEC 61850

As you know, IEC 61850-7-x uses mainly a table notation for the many models. Using UML as an optional notation for the content of IEC 61850 and the harmonization of IEC 61850 and CIM has been discussed since the late nineties. ABB has recently provided a UML based model notation for IEC 61850.

The initial version of this model has been developed by ABB, Switzerland, Corporate Research for further discussion and maintenance in IEC TC 57 WG 10.

Click [HERE](#) to access the UML model.

Posted by [Karlheinz Schwarz](#) at [9:51 AM](#) [0 comments](#) 

Labels: [IEC 61850](#), [models](#), [UML](#)

Wednesday, June 2, 2010

Do Wind Turbines change our Climate?

Some 10 years ago when there was not so much to discuss in the electric power industry (the Smart grid was not yet invented) I attended a conference on Electric Power Systems. One of the crucial questions was: Do Wind Power Turbines change our Climate? These questions are still asked - all over and by many experts.

The other day I read in the IEEE Power & Energy Magazine some interesting answers on this question. In the May/June 2010 issue you can read on page 6 (share your thoughts) an answer from NREL: "... it should be kept in mind that our energy mix will never be comprised solely of wind energy, so at even at large but reasonable levels of wind penetration the **global impact would not be measurable**. These results should not be surprising because fundamentally wind turbines just increase the friction or drag at the bottom of the atmospheric boundary layer **much like trees** or any other obstruction to the flow. My conclusion is that levels of wind energy amounting to 20–50% of our electricity should not cause any measurable change in global climate."

There is another question: Can you proof that the leaves of a tree are moved by the wind? Or are they generating the wind? Wind turbines may be used to generate wind - once we have too much electric power ... ok, I am kidding.

Click [HERE](#) to read the full text in May/June 2010 issue.

Posted by [Karlheinz Schwarz](#) at [11:04 PM](#) [0 comments](#) 

Labels: [electric power system](#), [en](#), [wind power](#), [wind turbine controller](#)


Deutsche Industrie empfiehlt China einheitliche Standards für Smart Grid

Namhafte deutsche Verbände und Firmen haben während des ersten "Sino-EU Smart Grid Technology and Standardization Forums" Ende Mai 2010 in Peking die Bedeutung von Normen für Smart Grids diskutiert.

Der chinesische Energiemarkt ist für deutsche Firmen sehr wichtig - ""Allerdings nur, wenn wir uns **frühzeitig** mit China bezüglich der Architektur und Standardisierung von Smart Grid **abstimmen** können", betont Dipl.-Ing. Roland Bent, Geschäftsführer Marketing und Entwicklung bei PHOENIX CONTACT. Eine frühzeitige Berücksichtigung von Normungsaspekten im Forschungsprozess und bei der Umsetzung schafft Wettbewerbsvorteile für Deutschland. "Was wir brauchen sind **einheitliche internationale Standards, die den Informationsaustausch für Grid Automation, Industry Automation und Home Automation** beschreiben", fordert auch Dr.-Ing. Bernhard Thies, Sprecher der Geschäftsführung von VDE|DKE."

Diese Forderungen nach einheitlichen internationalen Standards können nur unterstrichen werden - einheitlich für China, für Europa und für Deutschland! Wenn es "**einheitliche**" internationale Standards gibt, dann gibt es auch mindestens einen "**un-einheitlichen**" internationalen Standard! Oder? In der Tat den gibt es tatsächlich: [IEC 61158](#). Mit IEC 61850 gibt es glücklicherweise **EINE wirklich einheitliche Norm** für Smart Grids, Industrie-Automation und Gebäudeautomation.

Click [HIER](#) für die Pressemitteilung des VDE.

Posted by [Karlheinz Schwarz](#) at [10:36 PM](#) [0 comments](#) 

Labels: [Automation](#), [de](#), [IEC 61158](#), [IEC 61850](#), [NIST](#), [Smart Grid](#), [standards](#)

Wednesday, May 26, 2010

The next wave of Ethernet Switches and Routers for Smart(er) Grids

Have you heard of SISCO in conjunction with IEC 61850? Which S/C-isco? I mean the "C"-Cisco. May be you did not expect Cisco getting involved in the Power market!

But "In electric substations there are so many sensors, meters and other control elements," said Inbar Lasser-Raab, a senior director of network systems at Cisco. "Tens of millions of elements will be connected to the network through these routers and switches," she said.

If each element provides some 100 signals, we will have to manage billions of signals! What is the right approach to manage these signals? Signal lists? Signal lists provided by field busses? **There is only one international standard that has the answer to that challenge: IEC 61850 - The standard for (process) information management! Or?**

Click [HERE](#) for more information.

Posted by [Karlheinz Schwarz](#) at [8:00 AM](#) [0 comments](#) 

Labels: [Cisco](#), [GOOSE](#), [IEC 61850](#), [IEC61850](#)

Tuesday, May 25, 2010

Seminar and Training Opportunities - Update

STRI (Ludvika/Sweden and NettedAutomnation (Karlsruhe/Germany) offer two comprehensive SAS Seminars and Training opportunities in **Paris/France** the week before the Cigré Conference (18-20 August 2010) and in **Stockholm/Sweden** (02-05 November 2010).

General seminars will be conducted by NettedAutomation in **Frankfurt/Germany** (22-24 September 2010) and in **Dallas/Texas** (19-20 October 2010)

Click [HERE](#) for the updated schedule.

Posted by [Karlheinz Schwarz](#) at [3:23 PM](#) [0 comments](#) 

Labels: [Automation](#), [hands-on Training](#), [IEC 61400-25](#), [IEC 61850](#), [Power Automation](#), [seminar](#), [Smart Grid](#), [standards](#), [Substation Automation](#), [wind power](#)

Mitsubishi Electric will Invest 7 Billion JPY in Smart Grid Technology - New Approach

New approach in Japan with regard to Smart(er) Grids:

Don't discuss what could be done - just do it!

Mitsubishi Electric Corporation announced the other day that it will invest a total of 7 billion yen by March 2012 in a project to build facilities

within the company's production sites in Japan for experiments designed to establish advanced smart grid technologies. The project will contribute to the company's efforts to support the adoption of sustainable power supplies worldwide.

Mitsubishi Electric's smart grid business will be carried out as a company-wide project spanning the company's five business segments. In April 2010, Mitsubishi Electric established two project teams to promote development in smart grid technology. The Power Grid Project in the Transmission & Distribution Systems Center will be responsible for smart grid electric systems and equipment. **The Next Generation Energy Communication Project in the Communication Networks Center will be responsible for the smart grid communication network.**

Click [HERE](#) for the full press release.

Posted by [Karlheinz Schwarz](#) at [3:15 PM](#) [0 comments](#) 

Labels: [communication](#), [electric power system](#), [Japan](#), [Power Automation](#), [Substation](#), [Substation Automation](#)

Thursday, May 20, 2010

Copy machines and security

You may think: A copy machine has nothing to do with security - you may be right with the old machines manufactured some 10 years ago. But what's about the digital copiers?

What happens with the copy of your passport the hotel staff makes? It may be communicated all over ... thanks to the digital images taken and stored.

What has all this to do with IEC 61850? May be a lot: Think of someone that wants to check his SCL file against the standard. There was (may be still is) a syntax checker available on the Internet. You just need to upload your complete SCL file to the tool and let it check your file. Somebody may have taken a copy of that file ... and now knows a lot of access information of that substation or other plant.

Click [HERE](#) for a nice report on the issue - quite interesting, isn't it?

Posted by [Karlheinz Schwarz](#) at [10:20 PM](#) [0 comments](#) 

Labels: [communication](#), [IEC 61850](#), [SCL](#), [security](#)

Tuesday, May 18, 2010

Wireless Communication and IEC 61850 meet for Distribution Automation

It was just a question of time to see IEC 61850 running on Wireless communication systems. Here it is: Siemens and RuggedCom announced the other day that SIPROTEC will use WiMAX 802.16e to communicate IEC 61850 GOOSE messages for various (distributed!) functions in Distribution Automation Systems.


We have always said that one of the crucial benefits of IEC 61850 is that it can use advances in the domain of high speed communication solutions developed for the IEEE 802 suit.

It may take a few more years to see the distributed functions specified

by the standard IEC 61499 (Function Blocks). The benefits of distributed functions (versus centralized control systems) is that "the faulted segment is quickly isolated by the relay(s) and where possible, segments at the end of a feeder have service restored through the tie-point switch. The relays are **"self-aware" and operate based on real-time information they have about the network, so no master is required.**"

Click [HERE](#) for the press release.

Click [HERE](#) for some discussion on IEC 61499 and IEC 61850 based distribution automation.

Posted by [Karlheinz Schwarz](#) at [10:34 PM](#) [1 comments](#) 

Labels: [Automation](#), [distribution automation](#), [electric power system](#), [GOOSE](#), [IEC 61499](#), [IEC 61850](#)

Saturday, May 1, 2010

IEC 61850-7-2 Ed.2 published for final approval

IEC has published the IEC 61850-7-2 Edition 2 of "Communication networks and systems for power utility automation – Part 7-2: Basic information and communication structure – **Abstract communication service interface (ACSI)**" for final approval.


Ballot on the FDIS (IEC TC57 document 1065) **closes on July 02, 2010.**

The second edition improves as follows:

- class diagrams of edition have been updated,
- data types not required have been removed,
- errors and typos in the first edition haven been corrected,
- substitution model has been moved to IEC 61850-7-3,
- service tracking for control blocks have been added,
- the view concept (conceptually described in edition 1) will be implemented according to the new work on role bases access (RBA),
- security issues are solved by the IEC 62351 series, and
- several terms have been harmonized with those in the other parts.

For a copy of the FDIS contact your national IEC TC 57 committee.

The Model of IEC 61850-7-2 and its relation to other parts is shown in the following figure (modified slightly: added additional 7-x):

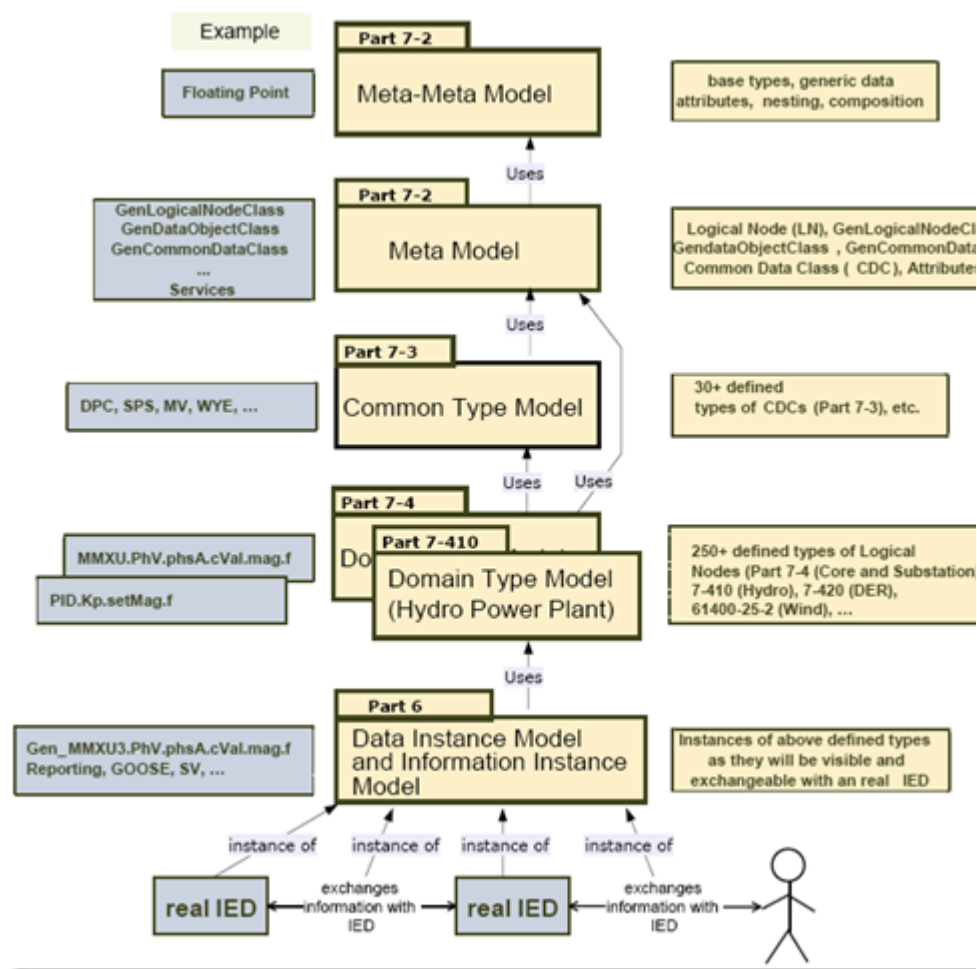

Posted by [Karlheinz Schwarz](#) at 9:19 PM 0 comments 

Labels: [ACSI](#), [IEC 61850](#), [IEC 61850 edition 2](#), [standards](#)

Two-day special Course on Crucial Standards for Smart Grids in Dallas (TX), October 19-20, 2010

A two-day special seminar and training on key standards for Smart Grids (IEC 61850, IEC 61400-25 and DNP3) will be conducted by Karlheinz Schwarz during the


Remote 2010 Conference & Expo
October 19-20, 2010
Dallas, Texas

Useful information and interoperable information exchange are among the most crucial needs for Smart(er) Grids. The "NIST Smart Grid Interoperability Standards Roadmap" recommends several standards for the interoperable exchange of information at the process level. Crucial standards like IEC 61850 and DNP3 are marked as high priority solutions. These standards are used in various application domains in medium and high voltage power systems. While most transmission systems are well monitored and automated there is almost no monitoring and automation in distribution networks. One of the crucial application domains for IEC 61850 is power (gas, oil and water) distribution.

This course is designed for utility IT and engineering staff who are tasked with specifying, organizing, managing and verifying open standards-based projects

aimed at **sustainable interoperability**. The application of the standards is not restricted to power system automation - its use is underway in many automation application domains like factory or process control automation. The roots of the standard IEC 61850 are - among others - the factory [and process automation domains in the eighties](#).

Click [HERE](#) for more information on the event.

Posted by [Karlheinz Schwarz](#) at [12:46 AM](#) [0 comments](#) 

Labels: [61850](#), [communication](#), [electric power system](#), [engineering](#), [IEC 61400-25](#), [IEC 61850](#), [interoperability](#), [NIST Roadmap](#), [Power Automation](#), [Training](#)

Thursday, April 29, 2010

German E-Energy Roadmap for Smart Grid published

The 70+ page Roadmap of the German E-Energy Projects and German Standardization organizations has been published the other day.

The Roadmap contains many recommendations on how to use existing standards and how to improve or extend those standards. According to the German Federal Minister of Economics and Technology "it is the task now to ascertain the extend to which these approaches can be implemented". He wishes the Roadmap many readers and users.

The Roadmap refers some 50 times to IEC 61850 - IEC 61850 is one of the very crucial standards for Smart Grids. IEC 61850 is likely THE standard that will be used in many domains outside the electrical world. The new edition of the information models (IEC 61850-7-4) contain many new Logical Nodes like STMP (Supervisory of temperatures) that can be used wherever a temperature is to be monitored for limit violation (alarm and trip): in a factory, building, power plant, ship, ...

IEC 61850 is a single standard for many application domains. More to come. Stay tuned.

Click [HERE](#) to download the German Smart Grid Roadmap in English [pdf, 2,9 MB]

Click [HERE](#) to download the German Version [pdf, 1.3 MB]

Posted by [Karlheinz Schwarz](#) at [2:09 AM](#) [0 comments](#) 

Labels: [communication](#), [E-Energy](#), [electric power system](#), [IEC 61499](#), [IEC 61850](#), [IEC 61850-7-410](#), [IEC 61850-7-420](#), [Power Automation](#), [standards](#)

Wednesday, April 28, 2010

IEC 61850 @ CHIP Development Kit (Starter Kit) available

The Beck IPC IEC 61850 @ CHIP Development Kit (Starter Kit) is now available for order: **Special price until 2010-05-21!**

This is one of the easiest and most cost effective ways to get started with IEC 61850!

The IPC@CHIP DK61 Development Kit is the complete development system for the IPC@CHIP SC123/SC143 Embedded Controller. It contains all the hardware and software components required for the fast development of customer applications.

The fair package also includes:

- DK60 Development Board including the SC143-IEC
- Paradigm C/C compiler on CD®
- CoDeSys CD (IEC 61131-3 PLC programming language)
- IEC 61850Li C
- 100 – 240V/24V plug-in power supply unit
- Programming and Ethernet cable
- SD card

ORDER FORM and other information:

- [Orderform Special-Price DK61-IEC61850](#)
- [IEC 61850 Protocol API User Manual](#)
- [PIS10 PICS](#)
- [Getting Started DK61 IEC61850](#)
- [General info on IPC@CHIP](#)

Posted by [Karlheinz Schwarz](#) at [6:07 PM](#) [0 comments](#) 

Labels: [education](#), [IEC 61131-3](#), [IEC 61400-25](#), [IEC 61850](#), [implementation](#), [starter kit](#)

Monday, April 19, 2010

First day at Hanover Fair was a big success for IEC 61850 @ Chip

The first day of the Hanover Fair (Hannover Messe 2010) - Monday April 19, 2010 - was a big success for IEC 61850 on the Beck IPC@Chip.

Many experts came by and stopped at the Beck booth E51 in hall 27 to see the IEC 61850 @ Chip in action. Even the German Chancellor, Mrs. Angela Merkel (in the center of the photo), came by and enjoyed seeing the many new products. The Beck booth has one of the crucial products of interest for Smart Grids: IEC 61850 @ Chip!



The booth has been "tagged" with an additional banner at the end of the first day ... as an eye catcher for people coming by on Tuesday and the other days:



We hope that You will stop for a demonstration and some discussion on the benefit of the standard @ Chip:



See you at booth E51 in hall 27 !! Once you are in hall 27 you will not miss the booth!

Posted by [Karlheinz Schwarz](#) at 1:29 PM 0 comments 

Labels: [E-Energy](#), [electric power system](#), [IEC 61850](#), [implementation](#), [Smart Grid](#)

Wednesday, April 14, 2010

Manitoba Hydro (Canada) Goes IEC 61850 for 100+ Substations

Cooper Power Systems announced on April 12, 2010, that it is working with Manitoba Hydro and its system integrator, Virelec, to develop fully IEC 61850 compliant substations. The project is intended to modernize, automate and integrate over 100 substations, following the IEC 61850 standard.

Click [HERE](#) for the Cooper press release.

Manitoba Hydro, a utility headquartered in Winnipeg, Manitoba (Canada), was looking to replace their current Substation Automation System (SAS) which is a discrete RTU and PLC-based control and metering architecture with an integrated IEC 61850-based architecture. This initiative follows a trend that is observed throughout the world, as the benefits of technologically advanced IEDs and IEC 61850 get more interest from utilities.

A comprehensive 4-day training in 2008 for some 25 of their best engineers helped the Manitoba Hydro "IEC 61850 Team" to write the system specification in a way so that the potential vendors and system integrators got a very detailed and comprehensive specification taking

IEC 61850 into account. The responsible engineers wanted to write a document that covers all crucial requirements with regard to the standard. This is contrary to many specifications today that spend one sentence: "Communication: according to IEC 61850."

Click [HERE](#) for the White paper from Manitoba Hydro and Cooper.

Posted by [Karlheinz Schwarz](#) at [2:56 AM](#) [0 comments](#) 

Labels: [electric power system](#), [IEC 61850](#), [Interlocking](#), [RTU](#), [Smart Grid](#), [standards](#), [Substation Automation](#)

[Newer Posts](#)

[Home](#)

[Older Posts](#)

Subscribe to: [Posts \(Atom\)](#)

News on IEC 61850 and related Standards

Daily news concerning the standards IEC 61850, IEC 61400-25, IEC 61970 (CIM), IEC 60870-5, ...

Friday, April 9, 2010

IEC 61850 Goes University in Sydney - And You?

IEC 61850 is one of the crucial standards that needs to be understood by young aspiring automation and electrical engineers. ABB has opened a hands-on training lab including their substation automation system at the University of Sydney. This will allow young people to get first experience with the power of the standard.

The Beck IPC Development Kit (DK61) for IEC 61850 / IEC 61400-25 to be presented at the Hannover Messe 2010 (Hanover Fair) at booth E51 in hall 27 from 19-23 April 2010 is an excellent **opportunity to get started with IEC 61850** - in real projects, in pilot projects, in university labs, ... any kind of lab or just at your office desk. The DK61 is a 16 Bit programmable micro controller (C/C++, IEC 61131-3 CoDeSys) that has the IEC 61850 stack integrated on the IPC@CHIP.

To my knowledge: This Kit provides the **fastest and easiest way to get started with the use of IEC 61850 implementations** - and very likely the **most cost effective way!**

Come and visit Beck IPC at the Hannover Messe Hall 27 Booth E51 -

See you there ([Plan of hall 27](#))

Click [HERE](#) if you want to get a free entry ticket for the fair.

Click [HERE](#) to for more information on the IPC@CHIP with IEC 61850 integrated.

Click [HERE](#) to contact BECK IPC for an Request for Quotation (RFQ) for the IEC 61850 Chip, Ready-to-Go modules, and Development Kit DK61.

Posted by [Karlheinz Schwarz](#) at [1:34 AM](#) [0 comments](#) 

Labels: [61850-7-420](#), [IEC 61131-3](#), [IEC 61850](#), [implementation](#), [MMS](#), [Power Automation](#), [Smart Grid](#), [wind power](#)

Thursday, April 1, 2010

What are the benefits of IEC 61850?

If you ask different people you get various answers. Guess most experts agree that crucial benefits are: use of TCP/IP, Ethernet, Client/Server, and Layer 2 Publisher/Subscriber (GOOSE and Sampled Values), get rid of copper wires. What else? Information Models, System Configuration Language (SCL), retrieving the self-description of Information Models from IEDs, and ...

Another crucial benefit of IEC 61850 and IEC 61400-25 (IEC 61850 extensions for Wind Power Plants - defined in IEC TC 88) is that it is a **GLOBALLY accepted STANDARD**. Hmm, a standard is a standard! - So, what is special here?

If you implement client/server, GOOSE, and SV it is defined **WHICH** protocol you have to choose for each of the three: MMS, TCP/IP, ... for

Subscribe To IEC 61850 News

 Posts 

 All Comments 

Blog Archive

- [2012](#) (11)
- [2011](#) (159)
- ▼ [2010](#) (153)
 - [December](#) (8)
 - [November](#) (9)
 - [October](#) (19)
 - [September](#) (18)
 - [August](#) (24)
 - [July](#) (17)
 - [June](#) (12)
 - [May](#) (7)
 - ▼ [April](#) (8)

[German E-Energy Roadmap for Smart Grid published](#)

[IEC 61850 @ CHIP Development Kit \(Starter Kit\) ava...](#)

[First day at Hanover Fair was a big success for IE...](#)

[Manitoba Hydro \(Canada\) Goes IEC 61850 for 100+ Su...](#)

[IEC 61850 Goes University in Sydney - And You?](#)

[What are the benefits of IEC 61850?](#)

[Edition 2 of IEC 61850-7-](#)

client/server, "GOOSE" for GOOSE, and "SV" for SV ... You don't have to choose between 40 or 50 solutions! See the international field bus standard IEC 61158: click [HERE](#) for a list of the 50+ field-bus-standards in a single standard.

You should ask (from time to time) this question: **What would the situation in the domain of power utility protection, control and automation be WITHOUT IEC 61850?** We would have a lot of very different vendor specific solutions, regional standards, utility standards, ... and may be a situation like in the field-bus domain!

"A technical standard is an established norm or requirement. It is usually a formal document that establishes UNIFORM engineering or technical criteria, methods, processes and practices." (according to Wikipedia). This is what IEC 61850 provides: **UNIFORM** definitions to a high degree. The field-bus standard has **TOO MANY NON-UNIFORM** definitions.

It's a big benefit that we have **prevented really an intoxicating proliferation of protocols and other definitions**. We have even prevented two standards for utility communication: In 1998 IEC TC 57 and IEEE agreed to merge UCA 2.0 and IEC 61850 into ONE standard - a great decision! From a global viewpoint we have one situation where we have two standards: IEC 610870-5-101/104 and DNP3 ... this is definitely better than having 10 or more under one number ;-)

Posted by [Karlheinz Schwarz](#) at [8:49 PM](#) [0 comments](#) 

Labels: [Ethernet](#), [fieldbus](#), [GOOSE](#), [IEC 61850](#), [SMV](#), [standards](#)

Edition 2 of IEC 61850-7-4 has been published

The second edition of IEC 61850-7-4 has been published as international standard:

Communication networks and systems for power utility automation – Part 7-4: Basic communication structure – Compatible logical node classes and data object classes

Click [HERE](#) to download the preview of part 7-4.

A list of all currently published Logical Nodes and Data Objects can be found [HERE](#).

Posted by [Karlheinz Schwarz](#) at [4:04 AM](#) [0 comments](#) 

Labels: [Edition 2](#), [IEC 61850](#), [IEC 61850-7-4 Ed2](#), [IEC 61850-7-410](#), [IEC 61850-7-420](#), [logical node](#), [models](#)

IEC 61850 on IPC@CHIP® at Hannover Messe, April 19-23, 2010

[Beck IPC](#) (Pohlheim, Germany), [SystemCorp](#) (Perth, Australia), and [NettedAutomation](#) (Karlsruhe, Germany) will present at the Hannover Messe 2010 (Hannover, Germany) in **Hall 27 Booth E51** on 19.-23. April 2010 the IEC 61850 integrated on the IPC@CHIP®, compact modules and ruggedized IEDs for harsh environments

[4 has been published](#)

[IEC 61850 on IPC@CHIP® at Hannover Messe, April 19...](#)

- ▶ [March](#) (9)
- ▶ [February](#) (10)
- ▶ [January](#) (12)

- ▶ [2009](#) (162)
- ▶ [2008](#) (82)

Contributors

[Michael Schwarz](#)

[Karlheinz Schwarz](#)

based on IPC@CHIP®.

The IEC 61850 conformant products shown in Hannover are applicable for many domains of utility automation - to make the power delivery system smarter:

- **Smart Automation of Power Generation**
Monitoring, protection and control of process and equipment (reactive power control, condition monitoring of turbines, ...)
- **Smart Automation of Power Transmission**
Monitoring, protection and control of process and equipment (interlocking, condition monitoring of transformer and switch gears, ...)
- **Smart Automation of Power Distribution**
Monitoring, protection and control of process and equipment (fault location, power restoration, condition monitoring of transformer, ...)
- **Smart Automation of Vehicle to Grid**
Monitoring and control of process and equipment (charger station, condition monitoring of charging station, ...)
- **Smart Automation of Loads and Generation**
Monitoring and control of process and equipment (load control, active and reactive power control, ...)

Due to the fact that IEC 61850 / IEC 61400-25 define many common aspects of standardized information and information exchange services it is obvious that standard conformant products can be applied in many domains outside the power industry: in gas and oil transmission and distribution networks, and in any other industrial automation domain.

Posted by [Karlheinz Schwarz](#) at [1:14 AM](#) [1 comments](#) 

Labels: [asset management](#), [communication](#), [condition monitoring](#), [distribution](#), [distribution automation](#), [electric power system](#), [electric vehicles](#), [IEC 61131-3](#), [IEC 61850](#), [integration](#), [interoperability](#), [monitoring](#), [Power Automation](#), [process control](#), [Smart Grid](#), [Substation](#), [wind turbine controller](#)

Tuesday, March 30, 2010

IEC 61850 Chip Revealed at DistribuTech 2010 in Tampa

The Beck IP@CHIP integrating IEC61850Li (IEC 61400-25) was revealed during the DistribuTech Exhibition in Tampa (Florida) from March 23-25, 2010.

The Tampa Convention Center hosted the 20th DistribuTech. The Conference and Exhibition was a big success - more exhibitors, more visitors, and more products, interest and discussions related to IEC 61850!



One of the crucial topics was the discussion of Smart Grids. The range of names for the same thing span a variation of terms: from Advanced Metering, Smart Metering, Smart Grid, to **Intelligent Smart Grid**. Experts that have a good understanding of the North American market told that this was the first time where almost all people talked about IEC 61850 - one way or the other.



In the light of the many requirements from Smarter Grids and Distribution Automation to define, use, exchange, store, and manage much more "signals" in future, the **IEC 61850 Chip** revealed at the UCA IUG Booth was really welcomed by many international experts: from Australia, Russia, Europe, North an South America.



The module shown above is a Gateway (Beck IPC - COM.TOM; with the Chip integrated) that could map CAN Bus signals into IEC 61850 models. The Module supports also a GSM/GPRS modem. The application could be programmed using C/C++ or IEC 61131-3 (PLC programming language - based on CoDeSys, the well known platform). Other modules with different I/O's are available. Support for IEC 60870-5-101/104 and DNP3 is under way.

The most crucial help for the application of IEC 61850/61400-25 is the Development Kit for IEC 61850: DK61. The Chip as well as the Development Kit are available for purchase. The prices for both components are amazingly low - you can afford to purchase the Development Kit without long discussions with your management and your accountants.

Get Smart Quick with the IEC61850Li (IEC 61850 Lite implementation). One interesting product with the IEC 61850 Lite implementation is the **IPC@Chip®** with IEC 61850 Client, Server, GOOSE publisher and subscriber **on the Chip** in addition to **IEC 61131-3** (PLC programming language, using the well known [CoDeSys platform](#)), **C/C++** programming, **FTP, TELNET, TCP/IP, web server, 2 Ethernet ports, GSM/GPRS, WiFi, CAN** bus, and many other possibilities.

The **Chip** and **Ready-To-Go Modules** (with the chip on board) are applied for IEDs, Gateways, RTUs, Data and Information Managers, Smart Grids, Distributed Energy Resources like PV, CHP, Wind, Hydro, Fuel Cells, ...

Click [HERE](#) to get general and background information.

Beck IPC (Germany) and SystemCorp (Perth, Australia) will present the Chip, compact modules, ruggedized IEDs for high voltage environments, and IEC 61850/61400-25 Stack Software at the Hannover Messe 2010 in Hannover (Germany) on 19-23 April 2010. Visit them in **Hall 27 Booth E51**.

I want to share a nice experience with you: Some 2 1/2 years ago I did a half day presentation on IEC 61850 to the experts and the management of a North American electric utility. At DistribuTech 2008 I asked the young engineer of that utility how IEC 61850 is doing in his company. He said: "Oh, we are still two retirements away from using the standard." During the Distributech 2010 I asked the young man again. This time he mentioned, that things are improving: They are now just one retirement away from using IEC 61850. This is an experience I have made quite often - utility management blocks new technologies, technologies that they may need to keep the lights on in the long run.

Posted by [Karlheinz Schwarz](#) at [1:08 AM](#) [0 comments](#) 

Labels: [61850](#), [communication](#), [condition monitoring](#), [DER](#), [distribution](#), [distribution automation](#), [E-Energy](#), [electric power system](#), [IEC 61850](#), [IEC61850Li](#), [implementation](#), [Power Automation](#), [Smart Grid](#), [wind power](#)

Monday, March 29, 2010

IEC 61400-25 AND IEC 61850 for Wind Turbines

The standard IEC 61400-25 (Wind turbines – IEC 61400-25: Communications for monitoring and control of wind power plants) must be seen in conjunction with IEC 61850. The wind turbine specific information models (Logical Nodes) can be used with IEC 61850 compliant tools and communication stacks. Services like GOOSE and Sampled Values Exchange are NOT referenced in IEC 61400-25 - because the SCADA experts that have defined the standard series some 10 years ago did not see any need to include these services in the list of services to be inherited from IEC 61850.

From a technical and implementation point of view there is no reason to not use these real-time services for wind power applications. **Any IEC 61850 compliant implementation of GOOSE and SV could be used to exchange any data object of IEC 61400-25-2 (Wind turbine LNs)**. The missing reference of GOOSE and SV in IEC 61400-25 has already been used to state that IEC 61400-25 would not support real-time services (**I guess this is an excuse in order to propose a non-IEC61850 solution for real-time applications, e.g., a fieldbus**). The statement is - from a document point of view - true, but the fact is, that GOOSE and SV as specified in IEC 61850 can be understood as an integral part of IEC 61400-25. That is the benefit of the fact that IEC 61400 builds on IEC 61850 - most of the IEC 61850 definitions,

implementations, and tools can be used also for wind power plants - without any change!

On the other side: The additional communication stacks (mappings) defined in IEC 61400-25-4 may be usually not implemented in substation IEDs. The stacks specified in this part of IEC 61400-25 comprise:

- SOAP-based web services,
- a mapping to OPC/XML-DA,
- a mapping to MMS (IEC 61850-8-1),
- a mapping to IEC 60870-5-104,
- a mapping to DNP3.

Click [HERE](#) for more details on mappings in IEC 61400-25-4.

Click [HERE](#) for a General Electric paper that discusses the application of SV realtime communication in wind power parks.

Posted by [Karlheinz Schwarz](#) at [5:18 AM](#) [0 comments](#) 

Labels: [Automation](#), [communication](#), [condition monitoring](#), [electric power system](#), [fieldbus](#), [GOOSE](#), [IEC 61400-25](#), [IEC 61850](#), [real-time](#), [wind power](#), [wind turbine controller](#)

DistribuTech 2010: Paper and Presentation on IEC 61850/61400-25 for Monitoring

A very important topic at the recent DistribuTech Conference (23-25 March 2010) was the paper presentation on "**Monitoring and Control of Power Systems and Communication Infrastructures**" based on IEC 61850 and IEC 61400-25" presented by Karlheinz Schwarz, SCC. The Session was about "Enterprise Information and Asset Management". The first presentations were the right basis for the presentation of IEC 61850: the smart grid and the transformer monitoring will create much more information to be exchanged than in today's systems. Transformer monitoring in the Distribution Network is one of the crucial solutions to keep the power flowing. IEC 61850 and IEC 61400-25 have a lot of logical nodes and data objects.

The presentation was attended by some 40 experts. Good questions were discussed at the end of the presentation.

The paper has an attachment with the names of all 283 published Logical Nodes of all standards of the series IEC 61850 and IEC 61400-25.

Click [HERE](#) for the paper [PDF, 670 KB]

Click [HERE](#) for the presentation slides [PDF, 300 KB]

Posted by [Karlheinz Schwarz](#) at [3:52 AM](#) [0 comments](#) 

Labels: [communication](#), [condition monitoring](#), [DER](#), [Distributech](#), [distribution automation](#), [electric power system](#), [IEC 61850](#), [IEC61850](#), [IEC61850Li](#), [interoperability](#), [Smart Grid](#), [Substation](#)

Sunday, March 21, 2010

Get Smart Quick with IEC 61850 on a Chip

The long wait for a lite implementation of IEC 61850 is over:

IEC61850Li® is available now

Get Smart Quick with the IEC61850Li (IEC 61850 Lite implementation). One interesting product with the IEC 61850 Lite implementation is the **IPC@Chip®** with IEC 61850 Client, Server, GOOSE publisher and subscriber **on the Chip** in addition to **IEC 61131-3** (PLC programming language), **C/C++** programming, **FTP**, **TELNET**, **TCP/IP**, **web server**, **2 Ethernet ports**, **GSM/GPRS**, **WiFi**, **CAN** bus, and many other possibilities.

The **Chip** and **Ready-To-Go Modules** (with the chip on board) are applied for IEDs, Gateways, RTUs, Data and Information Managers, Smart Grids, Distributed Energy Resources like PV, CHP, Wind, Hydro, Fuel Cells, ...

Click [HERE](#) to get more details and contact information.

A demonstration will be provided during the DistribuTech 2010, Tampa (Florida), 23-25 March 2010: See you at the UCA IUG **Booth 1932**

Posted by [Karlheinz Schwarz](#) at 3:40 AM 0 comments 

Labels: [Chip](#), [DER](#), [Ethernet](#), [IEC 61131-3](#), [IEC 61400-25](#), [IEC 61850](#), [IEC61850Li](#), [IED](#), [lite](#), [RTU](#), [SCADA](#), [Smart Grid](#)

Wednesday, March 10, 2010

See you in two weeks: IEC 61850 - Enterprise Information and Asset Management at DistribuTech 2010

Three case studies explore experiences in planning, architecting and implementing innovative applications that leverage power system automation and control infrastructure and **data to extend benefits beyond the control room**.

DistribuTech 2010, Wednesday, March 24, 9:30 a.m.

[Enterprise Information and Asset Management](#) (Room 19)

Conquering Organizational, Business Process and IT Challenges

Author(s):

- Al Mithani, DMS Project Manager, BC Hydro
- Bob Uluski, Executive Advisor, Quanta Technology

Distribution Substation Transformer Monitoring and Diagnostics at AEP

Author(s):

- Paul Thomas, AEP Ohio gridSMARTSM Deployment Project Manager, American Electric Power
- Byron Flynn, Technical Director, GE Energy
- Leon White, Monitoring & Diagnostics Sales Manager, GE Energy

Monitoring of Power System and Communication Infrastructures Based on IEC 61850 and IEC 61400-25

Author(s):

- Karlheinz Schwarz, Owner, SCC (Schwarz Consulting Company)

Click [HERE](#) for the paper abstract.

See you in Room 19 on Wednesday, March 24, 9:30 a.m.

Posted by [Karlheinz Schwarz](#) at [9:53 AM](#) [0 comments](#) 

Labels: [asset management](#), [communication](#), [Distributech](#), [IEC 61400-25](#), [IEC 61850](#), [interoperability](#), [Power Automation](#), [wind power](#), [wind turbine controller](#)

Friday, March 5, 2010

Deutsche Normungstrategie - Aktualisierte Ausgabe


Deutschland hat eine Normungsstrategie! Normungsarbeit rückt zunehmend ins Bewußtsein der Verantwortlichen aus Wirtschaft, Verbänden und Regierung! Seit 2005 werden strategische Konzepte zur Normung definiert und permanent an die Gegebenheiten angepasst.

Die große Bedeutung der Normung - auch und gerade im Bereich der Energieversorgung mit IEC 61850, IEC 61400-25, IEC 61968/70 CIM, ... - wird von maßgeblichen Verantwortlichen immer häufiger gesehen!

"Durch eine effiziente, von der Politik unterstützte, engere Verknüpfung von Forschung und Entwicklung mit Normung und Standardisierung ist dafür Sorge zu tragen, dass die innovationsfördernde Wirkung der Normung und Standardisierung in noch stärkerem Maß zum Tragen kommt. ... Für Deutschland als Exportland ist die Wettbewerbsfähigkeit deutscher Produkte und Technologien auf dem Weltmarkt zu sichern und weiter auszubauen. Weltweit akzeptierte, einheitliche Normen und Standards sind hierzu der Schlüssel."

Der hohe Nutzen von Norm wird sicher auch am Beispiel der Meterkonvention deutlich, in der am 20. Mai 1875 17 Staaten einen internationalen Vertrag unterzeichnen mit der Aufgabe, Maß und Gewicht international zu vereinheitlichen und dafür nötige Organisationsformen zu schaffen sowie diese zu finanzieren. Ganz nach dem Motto "Einer braucht eine Idee, einer muss es haben wollen und einer muss es bezahlen".

Click [HIER](#) zum Laden der neuen Ausgabe der Deutschen Normungsstrategie.

Posted by [Karlheinz Schwarz](#) at [12:25 AM](#) [0 comments](#) 

Labels: [de](#), [IEC 61850](#), [Normung](#), [standards](#)


Thursday, March 4, 2010

Die IEC 61850 – ein Kernstandard des zukünftigen Smart Grids

Am 15. und 16. April 2010 findet im [Kloster Eberbach bei Wiesbaden](#) ein **Expertenforum zum Thema "Die IEC 61850 – ein Kernstandard des zukünftigen Smart Grids"** statt. Namhafte Experten werden sowohl wesentliche Aspekte der Normenreihe vorstellen als auch in einem Dialog führen mit betroffenen verantwortlichen Vorstände und Geschäftsführer sowie leitenden Mitarbeiter und Entscheidungsträger der technischen und IT-Abteilungen von Energieversorgungsunternehmen, Netzbetreibern in öffentlichen und innerbetrieblichen Verteilnetzen und Betreibergesellschaften von erneuerbaren Energieerzeugungsanlagen. Angesprochen sind ebenfalls verantwortliche Mitarbeiter von Systemlieferanten, aus den Hersteller- und Zulieferunternehmen.

Teilnehmer können bereits im Vorfeld Fragen an die Experten stellen!

Click [HIER](#) für weitere Informationen.

Posted by [Karlheinz Schwarz](#) at [11:25 AM](#) [0 comments](#) 

Labels: [de](#), [fieldbus](#), [IEC](#), [IEC 61850](#), [Power Automation](#), [Stationslettechnik](#), [wind power](#)

3 day IEC 61850 Seminar and Hands-on Training Moved from Rio de Janeiro to São Paulo

The 3 day Seminar/Hands-on Training on IEC 61850 with real protection and control IEDs and test sets scheduled for **Rio de Janeiro (Brazil), 28.-30. April 2010**, has ben moved to **São Paulo**. Program and dates are the same:

Buenos Aires (Argentina), 26.-28. April 2010

Support for the organization and local contact: [Artec](#)

São Paulo (Brazil), 28.-30. April 2010

Support for the organization and local contact: [Instronic](#)

Click [HERE](#) for the program and registration information [pdf] ... see you there.

Posted by [Karlheinz Schwarz](#) at [4:38 AM](#) [0 comments](#) 

Labels: [communication](#), [electric power system](#), [engineering](#), [Ethernet](#), [GOOSE](#), [hands-on Training](#), [IEC 61850](#), [interoperability](#), [Power Automation](#), [protection](#), [Relays](#), [Training](#)

Wednesday, March 3, 2010

What is Edition 1 and Edition 2 of IEC 61850?

The first 14 parts of the standard SERIES IEC 61850 have been published between 2001 and 2004. These standards are often understood as IEC **61850 EDITION 1**. Each of these parts and also the two parts IEC 61850-7-410 (Hydro Power) and IEC 61850-7-420 (DER) have been published tagged as EDITION 1. Example:

Click [HERE](#) for preview of Part 7-420 EDITION 1: Basic communication structure – Distributed energy resources logical nodes

Several of these 16 published standards are now under revision (IEC calls this process maintenance). The revised document - once published - will be tagged EDITION 2, e.g., the EDITION 2 of part IEC 61850-6 has been published recently:

Click [HERE](#) for the Preview of the standard IEC 61850-6 **EDITION 2**.

Additional parts, e.g., IEC 61850-7-4 or -7-3 are in the maintenance process and will be published in their EDITION 2 very soon.

BUT there will be not an EDITION 2 of the standard SERIES IEC 61850 per se!! Various parts (of the **first 16** parts) will be revised and extended and then published tagged as EDITION 2.

New parts will be published with the tag **EDITION 1**, e.g., IEC 61850-80-1 (Guideline to exchanging information from a CDC-based data model using IEC 60870-5-101 or IEC 60870-5-104) - **IEC/TS 61850-80-1, Edition 1.0, 2008-12**.

Click [HERE](#) for a preview of IEC 61850-80-1 **EDITION 1**.

All parts published after the first 14 parts that had been published by

2004 have either the tag Edition 2 or Edition 1 !!

If you are waiting for "Edition 2" what do you mean? I guess you mean the following:

- **EDITION 2** of parts IEC 61850-6, -7-4, -7-3, -7-2, -7-1, -8-1, 9-2, 7-410, 7-420, etc. and
- **EDITION 1** of the parts IEC 61850-80-1, 61850-90-1, -90-2, -90-3, -90-4, etc.

Click [HERE](#) to download a table of all parts of Edition 1 and Edition 2 (updated 2010-02-01).

It is highly recommended to **name the specific part** when we talk about EDITION 2! Example: **IEC 61850-6 EDITION 2**.

Hope that helps!

Posted by [Karlheinz Schwarz](#) at [6:10 AM](#) [1 comments](#) 

Labels: [Edition 2](#), [Edition1](#), [IEC 61850](#), [IEC 61850 edition 2](#), [IEc 61850-7-4 Ed2](#), [SCL](#)

Wednesday, February 17, 2010

UCA International Users Group at DistribuTECH 2010

The UCA International Users Group (UCAiug) will be present at the DistribuTECH 2010: **Booth 1932**; March 23-25, 2010 - Tampa Convention Center - Tampa Florida


Celebrating 20 years as the leading annual T&D event. DistribuTECH covers automation and control systems, energy efficiency, engineering, demand response, renewables integration, power delivery equipment and water utility technology. No show provides more educational and networking opportunities than DistribuTECH.

Plan for a stop at **Booth 1932** for a chat with Karlheinz Schwarz (NettedAutomation) about the latest developments on "**IEC61850-Li**" (Lite implementation) and to see how it looks like. You will be surprised!

Click [HERE](#) to visit the DistribuTCH website.

Click [HERE](#) for an abstract of a paper on IEC 61850 at the DistribuTECH

Click [HERE](#) to visit the UCAiug

Posted by [Karlheinz Schwarz](#) at [10:17 AM](#) [1 comments](#) 

Labels: [Distributech](#), [IEC 61850](#), [interoperability](#), [real IEDs](#), [RTU](#), [Smart Grid](#)


Monday, February 15, 2010

3 day IEC 61850 Seminar and Hands-on Training in Buenos Aires and Rio de Janeiro

STRI and Nettedautomation GmbH have posted the **program and registration information** for the 3 day Seminar/Hands-on Training with real protection and control IEDs and test sets:

Buenos Aires (Argentina), 26.-28. April 2010
Rio de Janeiro (Brazil), 28.-30. April 2010

Click [HERE](#) for the program and registration information [pdf] ... see you there.

Posted by [Karlheinz Schwarz](#) at [9:42 AM](#) [0 comments](#) 

Labels: [communication](#), [electric power system](#), [hands-on Training](#), [IEC 61400-25](#), [IEC 61499](#), [IEC 61850](#), [interoperability](#), [MMS](#), [Power Automation](#), [process bus](#), [Smart Grid](#), [Training](#), [wind turbine controller](#)


Sunday, February 14, 2010

IEC 61850 for Smart Grid in High Voltage Valley

STRI (Ludvika/Sweden) will build a Smart Grid using IEC 61850 interoperable solutions for Substation Automation, Wind Power, Hydro Power and Process bus.

The project totals 3 million EUR including 4 PhD students at 3 Swedish Universities and is funded by The Swedish Governmental Agency for Innovation Systems together with ABB, High Voltage Valley association consortium and STRI.

Click [HERE](#) for more details.

Posted by [Karlheinz Schwarz](#) at [11:49 PM](#) [0 comments](#) 

Labels: [hydro power](#), [IEC 61850](#), [interoperability](#), [NIST](#), [NIST Roadmap](#), [process bus](#), [Smart Grid](#), [wind power](#)

Monday, February 8, 2010

IEC 61850-3 compliant Gigabit Ethernet Switch from Hirschmann

Hirschmann goes Gigabit for substation and other applications. The new Ethernet Switch offers 16 Gigabit Ethernet combination ports (1000 BASE-TX) that will also connect SFP fiber optical transceivers (100/1000 BASE-FX/SX/LX/LH). All ports support version 2 of the Precision Time Protocol (IEEE 1588 V2) as well as optionally Power over Ethernet (IEEE 802.3af).

Further characteristics include an operating temperature range of -40 to +70 °C, high resistance to jarring, and extensive insusceptibility to electrical discharge and magnetic fields. Passive cooling (no fans) and a redundant power supply add to ensure high operational safety. Furthermore, the new Hirschmann™ Gigabit Ethernet switch meets the standards and approval requirement of IEC 61850, IEEE 1613, EN 50121-4, EN 50155, cUL 508, cUL 1604 C1 Div2 and GL.

EPRI (Electric Power Research Institute) tested 10 Megabit Shared Ethernet for UCA 2.0 (Utility Communication Architecture) in the mid nineties. I remember when we had some 25 PCs connected to test UCA communication services. EPRI called me during these days to come to Los Angeles to give a presentation on the performance of Ethernet compared to Profibus DP. At that time many experts already believed that Ethernet is a serious option for Substation automation. Nowadays almost all experts are supporting Ethernet - some people that just know the old Shared Ethernet of the eighties don't believe that this is the right solution. After some explanation they change their mind - usually.

Click [HERE](#) for product information.

Click [HERE](#) for a paper **published in 1991-11 on the use of Ethernet instead of Token passing** [PDF, 720 KB] - at that time the author did not know about Gigabit Ethernet.

Click [HERE](#) for a paper **published in 1991-03 on the use of Ethernet as a fieldbus** [PDF, 720 KB].

Posted by [Karlheinz Schwarz](#) at [9:27 PM](#) [1 comments](#) 

Labels: [Ethernet](#), [fieldbus](#), [IEC 61850](#), [IEC 61850-3](#), [IEEE 1588](#), [MAP](#), [MMS](#), [Power Automation](#), [redundancy](#)

Saturday, February 6, 2010

10th Anniversary of NettedAutomation GmbH


NettedAutomation GmbH was established on 2000-01-01. All in a sudden we celebrate the 10th Anniversary. Stay tuned with this blog and the NettedAutomation Website - a source of free information.

After 25 years active participation in the international Standardization of Karlheinz Schwarz, the vision of NettedAutomation GmbH (as posted on our website in 2000) becomes really true - step by step:

The [Vision of NettedAutomation GmbH](#):

The Net is the Automation

Current trend: Very soon we will see Ethernet Switches that can provide some kind of a remote I/O functionality and (distributed) automation functions ... and more to come!

Posted by [Karlheinz Schwarz](#) at [1:54 AM](#) [1 comments](#) 

Labels: [Automation](#), [NettedAutomation](#), [standards](#)

[Newer Posts](#)

[Home](#)

[Older Posts](#)

Subscribe to: [Posts \(Atom\)](#)

News on IEC 61850 and related Standards

Daily news concerning the standards IEC 61850, IEC 61400-25, IEC 61970 (CIM), IEC 60870-5, ...

Saturday, February 6, 2010

IEC 61850-7-4 approved as International Standard

The FDIS on IEC 61850-7-4 Edition 2 has been approved as International Standard (100 % approval)!

Click [HERE](#) for the voting result.

Posted by [Karlheinz Schwarz](#) at [1:37 AM](#) [0 comments](#) 

Labels: [IEC 61850](#), [IEC 61850-7-4 Ed2](#)

283 Logical Nodes defined in IEC 61850 and IEC 61400-25

Click [HERE](#) to get a list of all 283 Logical Nodes [PDF, 75 KB] defined in:

- IEC 61850-7-4 Ed2 FDIS
- IEC 61850-7-410 Ed1 IS
- IEC 61850-7-420 Ed1 IS
- IEC 61400-25-2 Ed1 IS

The list contains all LN Class names for your convenience.

Posted by [Karlheinz Schwarz](#) at [1:36 AM](#) [0 comments](#) 

Labels: [IEC 61400-25](#), [IEC 61850](#), [IEC 61850-7-410](#), [IEC 61850-7-420](#), [logical node](#)

Friday, February 5, 2010

New PAP16 to deal with Wind Plant Communications according to IEC 61400-25

The NIST **Smart Grid** Priority Action Plan (PAP) has been extended by the PAP 16 "**Wind Plant Communications**".

Motivation for the new PAP:

"While an **international standard for wind power plant communications interoperability exists**, few if any developers or utilities have implemented it in the US. **Given that 1.5 billion dollars in ARRA funds have been awarded to wind plant projects**, it is critical to accelerate the adoption of this standard to ensure those funds do not end up going to systems that are not interoperable which eventually results in stranded assets and less market competition. Most of the existing command and control infrastructure for wind power plants and site monitoring is based on **proprietary technologies and products or at best old protocols that are not capable of being managed or secured**. The Director of the Utility Wind Integration

Subscribe To IEC 61850 News

 Posts 

 All Comments 

Blog Archive

- 2012 (11)
- 2011 (159)
- ▼ 2010 (153)
 - December (8)
 - November (9)
 - October (19)
 - September (18)
 - August (24)
 - July (17)
 - June (12)
 - May (7)
 - April (8)
 - March (9)
 - ▼ February (10)

[UCA International Users Group at DistribuTECH 2010...](#)

[3 day IEC 61850 Seminar and Hands-on Training in B...](#)

[IEC 61850 for Smart Grid in High Voltage Valley](#)

[IEC 61850-3 compliant Gigabit Ethernet Switch from...](#)

[10th Anniversary of NettedAutomation GmbH](#)

[IEC 61850-7-4 approved](#)

Group (UWIG) – one of the two major wind industry associations – has brought this situation to the attention of the [SGIP](#) Administrator and has requested that a new PAP be formed to address this immediate need. "

Schedule:

- February 11: Presentation to UWIG membership in Albuquerque – solicit participation
- March 1: Begin weekly teleconferences
- May: Completed set of use cases and requirements
- July: Completed analysis of gaps in 61400-25 standard
- September: Completed best practices
- October: Completed recommendations to IEC TC 88

Objectives:

- Gather and develop use cases and requirements related to wind power plant communications
- Map these requirements to the existing 61400-25 standard and **identify gaps and issues** that are hindering its use in the US
- Develop best practices on the application of 61400-25
- **Provide specific recommendations to the IEC TC 88 working group** responsible for maintaining the 61400-25 standard to address the gaps identified.

Click [HERE](#) for the PAP16

Click [HERE](#) for the list of all PAPs

Click [HERE](#) to visit the Users Group for IEC 61400-25 USE61400-25

Posted by [Karlheinz Schwarz](#) at [9:41 PM](#) [0 comments](#) 

Labels: [control center](#), [electric power system](#), [IEC 61400-25](#), [IEC 61850](#), [interoperability](#), [NIST](#), [wind power](#)

Wednesday, February 3, 2010

Deutsche Normungsroadmap Smart Grid

Am 02. Februar 2010 wurde beim BMWi in Berlin der erste Entwurf der **deutschen Roadmap für Smart Grids** (E-Energy) vorgestellt und diskutiert.

"Dieses Dokuments ist der Entwurf für eine strategische und dennoch technisch orientierte Roadmap, welche die Anforderungen an Normen und Standards für die deutsche Vision des 94 Smart Grids unter besonderer Berücksichtigung der BMWi- und BMU-Fördermaßnahme E-Energy [BMWi] darstellt. Zudem bietet sie eine Übersicht über Normen und Standards in diesem Umfeld, aktuelle Aktivitäten, notwendige Handlungsfelder, internationale Kooperationen und strategische Empfehlungen."

Der Entwurf steht jetzt zur öffentlichen Kommentierung bis zum 05.März 2010 zur Verfügung!

Klicken Sie [HIER](#), um den Entwurf herunterzuladen [pdf].

Klicken Sie [HIER](#) für weitere Informationen bezüglich der Kommentierung.

Machen Sie unbedingt Gebrauch von der Kommentierung!

Die DKE hat das Kompetenzzentrum E-Energy als Ansprechpartner zu allen Normungs- und Standardisierungsfragen mit Bezug zur Optimierung, Vernetzung und Steuerung von intelligenten Erzeugern, Speichern, Verbrauchern und Netzbetriebsmitteln in der

[as International Standard](#)

[283 Logical Nodes defined in IEC 61850 and IEC 614...](#)

[New PAP16 to deal with Wind Plant Communications a...](#)

[Deutsche Normungsroadmap Smart Grid](#)

[Comprehensive IEC 61850 Training - New Opportuniti...](#)

► [January](#) (12)

► [2009](#) (162)

► [2008](#) (82)

Contributors

[Karlheinz Schwarz](#)

[Michael Schwarz](#)

Energieversorgung mit der Hilfe von Informations- und Kommunikationstechnologien (E-Energy/Smart Grid) gegründet. Damit wird die Bedeutung der Normen für die Energieversorgung nicht nur anerkannt, sondern auch mit Rat und Tat unterstützt!!

Klicken Sie [HIER](#), um auf die Webseite des Kompetenzzentrums zu gelangen!

Posted by [Karlheinz Schwarz](#) at [10:48 AM](#) [0 comments](#) 

Labels: [DKE](#), [E-Energy](#), [IEC 60870-5-101](#), [IEC 60870-5-104](#), [IEC 61850](#), [IEC 61968](#), [IEC 61970](#), [NIST Roadmap](#), [Roadmap](#), [Smart Grid](#)

Monday, February 1, 2010

Comprehensive IEC 61850 Training - New Opportunities

NettedAutomation GmbH offers new hands-on training and seminar opportunities in 2010:

Public Courses:

02.-05. March 2010	Moscow (Russia)
26.-28. April 2010	Buenos Aires (Argentina)
28.-30. April 2010	Rio de Janeiro (Brazil)
05.-07. May 2010	Frankfurt (Germany)
18.-20. August 2010	Paris (France)
22.-24. September 2010	Frankfurt (Germany)
19.-20. October 2010	Dallas (TX, USA)
November 2010	Stockholm (Sweden)

Training Modules: Click [HERE](#) for a list of seminar/training modules.

In-House Courses: Click [HERE](#) for an example program for a 5 day training conducted in January 2010.

Posted by [Karlheinz Schwarz](#) at [3:03 AM](#) [0 comments](#) 

Labels: [61850](#), [applications](#), [Automation](#), [DER](#), [DNP3](#), [electric power system](#), [IEC 60870-5-101](#), [IEC 61400-25](#), [IEC 61850](#), [interoperability](#), [maintenance](#), [MMS](#), [process bus](#), [RTU](#), [SCL](#), [seminar](#), [Smart Grid](#), [Substation](#), [Training](#), [workforce](#)

Sunday, January 31, 2010

Status of all parts of IEC 61850

The first part of IEC 61850 Edition 2 has been published as standard: part 6. Several other parts are in the final preparation for publication. Other new parts are under preparation.

Click [HERE](#) to download a table of the latest update of the parts (2010-02-01).

Posted by [Karlheinz Schwarz](#) at [5:56 AM](#) [0 comments](#) 

Labels: [IEC 61850](#), [standards](#)

Friday, January 29, 2010

Smart Grid Devices with IEC 61850 and IEC 61499 at

IEEE T&D Conference in New Orleans - 21 April 2010

The [2010 IEEE Transmission and Distribution Conference and Exposition](#) (New Orleans, 19-22 April 2010) has the title: **Smart Solutions for a Changing World**.

What makes the Grid smart? Smart people that develop smart solutions! One of these smart solutions will be presented (by smart people) on

Wednesday, 21 April, 2010 8:00 AM-10:00 AM

IG01Wd1

Intelligent Grid Coordinating Committee Poster Session

2010TD0592: Towards Intelligent Smart Grid Devices with IEC 61850 Interoperability and IEC 61499 Open Control Architecture

The Smart Grid vision, outlined in EPRI's "Report to NIST on the Smart Grid Interoperability Standards Roadmap", incorporates into the grid "the benefits of distributed computing and communications to deliver real-time information and enable the near-instantaneous balance of supply and demand at the device level". This vision implies a multilayer information and control system architecture, with power transmission and distribution layer playing a crucial role in achieving the "smartness" of the grid.

The complexity of this task requires reconsidering grid control architectures, possibly changing them from the traditional hierarchical topology with distributed data acquisitions but central decision making, to decentralized decision making. **For that, basic automation devices would need to become "intelligent"**. Most advanced version of such devices are currently based on microcomputers with communication capabilities, but the data flow is purely bottom up, from devices to the control center, and control flow is opposite: from the control centre to instruments. **In Smart Grids this may need to change to horizontal communication, negotiation and collaborative decision making by the instruments.**

There has been considerable amount of research on the corresponding computing architectures capable of implementing such distributed intelligence. For example, multi-agent system architectures for grid automation have been proposed. Unfortunately these ideas cannot be implemented on current grid devices based on proprietary and closed hardware/software platforms. Besides, multi-agent implementations require high computation performance and still cannot deliver sufficient real-time performance and determinism. While multi-agent systems need powerful workstations to run, practitioners in the field are very conservative and insist on high reliability, determinism and performance of the microprocessor-based instruments. Reliable communication is crucial, and interoperability amongst IEDs (Intelligent Electronic Devices) is of paramount importance.

Thus, practical deployment of intelligent multi-agent solution at the transmission and distribution layer of Smart Grid can happen if a new generation of IEDs appears that have open architecture based on industrially accepted standards in the areas of information, configuration, communication and distributed automation.

The paper presented proposes an approach to pave the way to multi-agent intelligent control of grid is using two standards: IEC 61850 and IEC 61499.

IEC 61499 (Function Blocks) promises a framework for gluing those functions together in patterns of increasing capability and complexity.

Abstract-- The paper reports on developments and experiments

conducted to prove the feasibility of using decentralized multi-agent control logic in the automation of power distribution networks. The utility network is modelled as communicating logical nodes following IEC 61850 standard's architecture, implemented by means of IEC 61499 distributed automation architecture. The system is simulated in an IEC 61499 execution environment combined with Matlab and proven to achieve simple fault location and power restoration goals through collaborative behaviour and interoperable devices.

Index Terms-- Smart Grid, IEC 61850, interoperability, distributed intelligent automation, IEC 61499

Posted by [Karlheinz Schwarz](#) at 8:53 PM 0 comments 

Labels: [Automation](#), [communication](#), [Functionblock](#), [IEC 61499](#), [IEC 61850](#), [IEEE](#), [NIST Roadmap](#), [Power Automation](#), [Smart Grid](#)

Monday, January 25, 2010

Automation Standard (IEC 61499) meets Power Standard (IEC 61850)

"The first Conference on Innovative Smart Grid Technologies", sponsored by the IEEE Power & Energy Society (PES) and hosted by the National Institute of Standards and Technology (NIST), was held January 19-21, 2010 in Gaithersburg, Maryland, USA. The Conference was a forum to discuss the state-of-the-art innovations in smart grid technologies.

The paper "Towards the Energy Web via Standards-enabled Smart Grid" presented by Prof. Mihaela Ulieru was a big Blast.

Authors of the paper:

Valeriy Vyatkin, Senior Member, IEEE,
Gulnara Zhabelova, non-member,
Neil Higgins, Member, IEEE,
Mihaela Ulieru, Senior Member, IEEE
Karlheinz Schwarz, Member, IEEE and
Nirmal-Kumar C Nair, Member, IEEE

Abstract -- "In this paper we propose an information and control architecture for Smart Grid based on the combination of upcoming industrial standards and intelligent control methods. We make the case that an incremental approach is required for the transition to the Smart Grid and propose a way of doing that through bringing intelligence down to the level of substation automation devices. The architecture employs two strong international standards, IEC 61850 and IEC 61499, to enrich the applications that can be created using interoperable Smart Grid devices. Interoperability and open configurability - key enablers for efficient application of the revolutionary EnergyWeb ideas – are evident in this architecture.

The utility network is modeled as IEC 61850-compliant logical nodes, embedded in an IEC 61499 distributed automation framework. The system is simulated in an IEC 61499 execution environment combined with Matlab, and is proven to achieve simple fault location and power restoration goals through collaborative behavior."

Some 200 engineers - a forward looking crowd, extremely supportive and especially extremely receptive - were in fact quite enthusiastic of the ideas. The presentation was 'Stellar!' **"What a genial idea to merge an automation standard with a power standard"** has been the Motto everywhere after the talk.

Click [HERE](#) for the presentation.

The topic will also be presented and discussed during the IEEE PES T&D Conference in New Orleans, April 19-22, 2010.

Posted by [Karlheinz Schwarz](#) at [12:27 PM](#) [0 comments](#) 

Labels: [Automation](#), [communication](#), [engineering](#), [Functionblock](#), [IEC 61499](#), [IEC 61850](#), [integration](#), [interoperability](#), [Power Automation](#)

Saturday, January 23, 2010

Gigabit Ethernet and IEEE 1588 for Substations

[IEC 61850-3](#) compliant **Gigabit** Ethernet with **IEEE 1588** time synchronization available for substation automation and protection. Korenix offers an IEC61850-3 Modular Managed Ethernet Switch, equipped with 4 on-board Gigabit RJ45 / MINI GBIC combo ports plus 3 modular slots for maximum 24 10/100 Base-TX Ports or 18 100Base-FX Fiber interfaces ports.

Click [HERE](#) for more details.

Posted by [Karlheinz Schwarz](#) at [6:07 AM](#) [0 comments](#) 

Labels: [communication](#), [Ethernet](#), [IEC 61850-3](#), [IEEE 1588](#), [real-time](#), [Substation](#), [synchronization](#)

Saturday, January 16, 2010

The Wind of Change is blowing in Wind Power Protection using IEC 61850-9-2

When the IEC Technical Committee 88 (Wind Turbines) started the IEC 61850-based project IEC 61400-25 "Communications for monitoring and control of wind power plants" in 2001 only a few experts expected that IEC 61850 would have a crucial impact on the way how wind parks will be equipped with intelligent devices. Most experts believed that the main use of **standard information models** and **information exchange** is for **control and monitoring** purposes only.

A very interesting paper has been written recently that discusses the use of IEC 61850-9-2 "Sampled values over ISO/IEC 8802-3" for protection functions in a whole park. Each Turbine/Tower provides current and voltage samples and other information in a continuous stream of sampled value messages. The IEC 61850-9-2 sampled values are distributed as Ethertype multicast messages (from a publishing device, often called **Merging Unit**) - and received by many subscribing devices. This allows to distribute and collect the measurements for protection and other use cases (e.g., 80 samples per nominal period - 20 ms in a 50 Hz system). Protection could now be implemented in a **centralized location**, and a few central protection devices could **protect many distributed equipments** (generator, transformer, circuit breakers, ...).

Implementation of Merging Units may also be used in the near future to distribute non-electric measurements like vibration measurements from gear boxes and blades.

Click [HERE](#) for the very interesting paper.

Posted by [Karlheinz Schwarz](#) at [3:01 AM](#) [0 comments](#) 

Labels: [communication](#), [distribution](#), [IEC 61400-25](#), [IEC 61850](#), [interoperability](#), [merging unit](#), [protection](#), [wind power](#)

Thursday, January 14, 2010

Why IEC 61850 will succeed

The **industrial automation** in manufacturing and petrochemical plants has fallen well short of the expectations of the 1980s and 1990s. The MAP project (1983-1990) for example has not been accepted and the many international field-busses have not helped to provide a few real internationally standardized solutions. The [many field-busses](#) are now the headaches of many engineers. Why could we expect that IEC 61850 will be a real international standard **accepted and applied all over and for many decades?**

The key is that the **physical power system** is easier to model than the **collective industrial processes of the world**. The basic topology of the current electrical power system is the same since the very first steps. It is likely that the **electrical power system** will be the same in many years down the street. Since its inception, the power industry has operated with clear demarcations between its generation, transmission, and distribution subsystems. All over we have physical measurements and processed information than can be used in all domains of the electrical system today and in the future, e.g., the [electrical measurements like voltage or currents](#).

The basics of the physical part of the power system will stay the same. The **number** of energy resources will explode and the **locations** of the grid connections will be quite distributed. The **number of loads** in existing grids will more or less be the same. **What will change is how to monitor and control the many new and existing connection points of power resources and loads.** It is likely that for every connection point there will be a need for a smarter device that communicates with its environment.

IEC 61850 implementations have proven that all basic requirements for the information and communication system are met by the various information models, communication services, networks, and configuration language. Missing elements can and will be added while we go. There is - to my knowledge - no competing standard on the horizon.

The challenges in the future power system are the **stability of the electrical system** with the many connection points (power engineers) and the management of the **sheer unlimited number of smart devices** (ITC engineers). There is a crucial need: These people have to team-up with each other - led by power engineers. Power engineers know the difference between a power network and the communication network: in the communication network **messages can be stored** in queues for seconds or hours - in the power network the **power is consumed at the very same moment when it is produced**.

Keep the grass green, the sky blue, and the power flowing.

Posted by [Karlheinz Schwarz](#) at [5:43 AM](#) [0 comments](#) 

Labels: [communication](#), [condition monitoring](#), [distribution](#), [distribution automation](#), [IEC 61850](#), [Smart Grid](#), [standards](#)

Wednesday, January 13, 2010


IEC 61850 on a Chip? - Yes!

Beck-IPC GmbH (Pohlheim/Germany) offers IEC 61850 on a Chip.

The Fully Integrated Single Chip Solution IPC-10 enables a cost effective integration of IEC 61850 in IED designs. The IEC 61850 software is also available as portable client/server software, or already integrated in the RTU MRU-10 and WEBCAN RTU and Gateway. The configuration is using/generating IEC 61850-6 conformant Configuration files (SCL).

Click [HERE](#) for information in English.

Click [HERE](#) for information in German.

Posted by [Karlheinz Schwarz](#) at [10:03 PM](#) [0 comments](#) 

Labels: [IEC 61850](#), [implementation](#), [MMS](#), [Power Automation](#), [RTU](#), [Substation](#), [Substation Automation](#)

IEC 61850-7-4 Edition 2 FDIS open for Ballot

The second edition of IEC 61850-7-4 has been published for final ballot until February 05, 2010:

IEC 61850-7-4 Ed.2:

Communication networks and systems for power utility automation –
Part 7-4: Basic communication structure – Compatible logical node
classes and data object classes

The second edition specifies more than 150 Logical Nodes.

The major technical changes with regard to the first edition are as follows:

- corrections and clarifications according to information letter;
- extensions for new logical nodes for the power quality domain;
- extensions for the model for statistical and historical statistical data;
- extensions regarding IEC 61850-90-1 (substation-substation communication);
- extensions for new logical nodes for monitoring functions according to IEC 62271;
- new logical nodes from IEC 61850-7-410 and IEC 61850-7-420 of general interest.

Example of new Logical Nodes in IEC 61850-7-4 Edition 2:

New Logical nodes for functional blocks:

Counter - FCNT

Curve shape - FCSD

Generic filter - FFIL

Control function output limitation - FLIM

PID regulator - FPID


Ramp function - FRMP

Set-point control function - FSPT

Action at over threshold - FXOT

Action at under threshold - FXUT

An example of a PID loop control with an Logical Node FPID representing the attributes (or input and output signals):

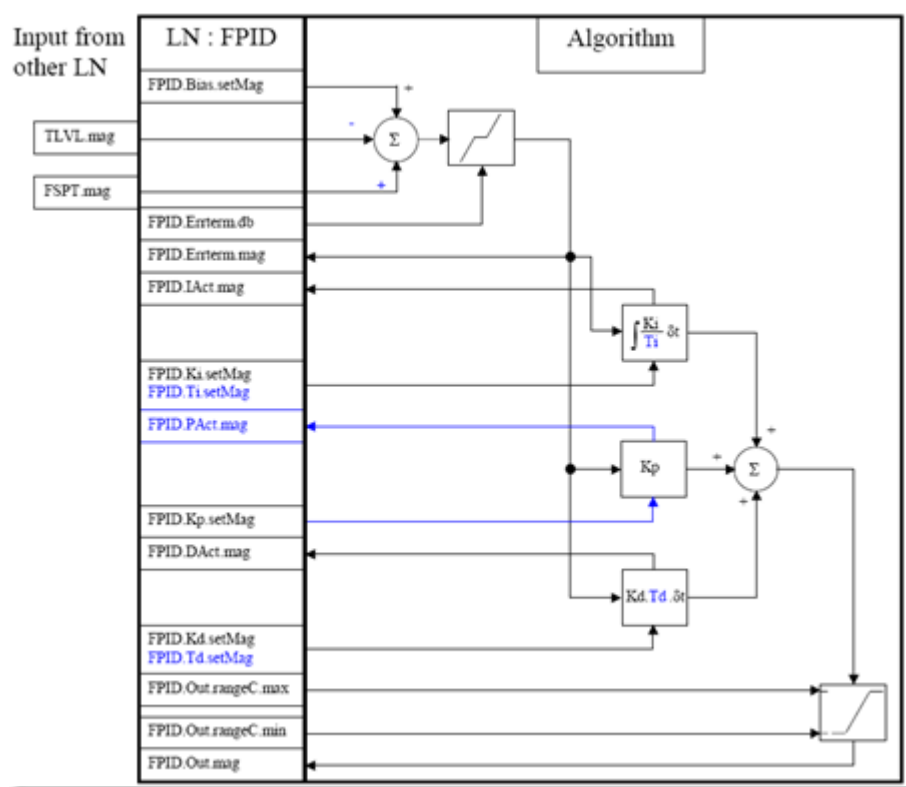

Note that IEC 61850 DOES NOT specify the PID loop control algorithm or function. IEC 61850-7-4 Logical Nodes provide the "interface" or the presentation of the signals, the configuration of the object models and the exchange of the values. The Data Object "KP" (Proportional gain) can be set by an ACSI service. Or the Data Object "DAct" (Derivative action) can be read, reported, logged, or GOOSEd.

If you are interested to comment on the document, please contact your [national committee of the IEC TC 57](#).

Posted by [Karlheinz Schwarz](#) at 3:31 AM 0 comments 

Labels: [Automation](#), [engineering](#), [Functionblock](#), [GOOSE](#), [hydro power](#), [IEC 61850](#), [IEC 61850-7-410](#), [Power Automation](#)

IEC 61850-6 (Configuration Language) Edition 2 has been published


The first part of Edition 2 of IEC 61850 has been published as International Standard:

IEC 61850-6 Edition 2 (2009-12)

Communication networks and systems for power utility automation – Part 6: Configuration description language for communication in electrical substations related to IEDs

Click [HERE](#) for the Preview of the standard IEC 61850-6 Edition 2.

The second edition provides several crucial extensions. One extension is the way how to specify the source of a signal needed by an IED in more detail. The following slide from the NettedAutomation training shows that in the SCL file for IED B the source can be specified:

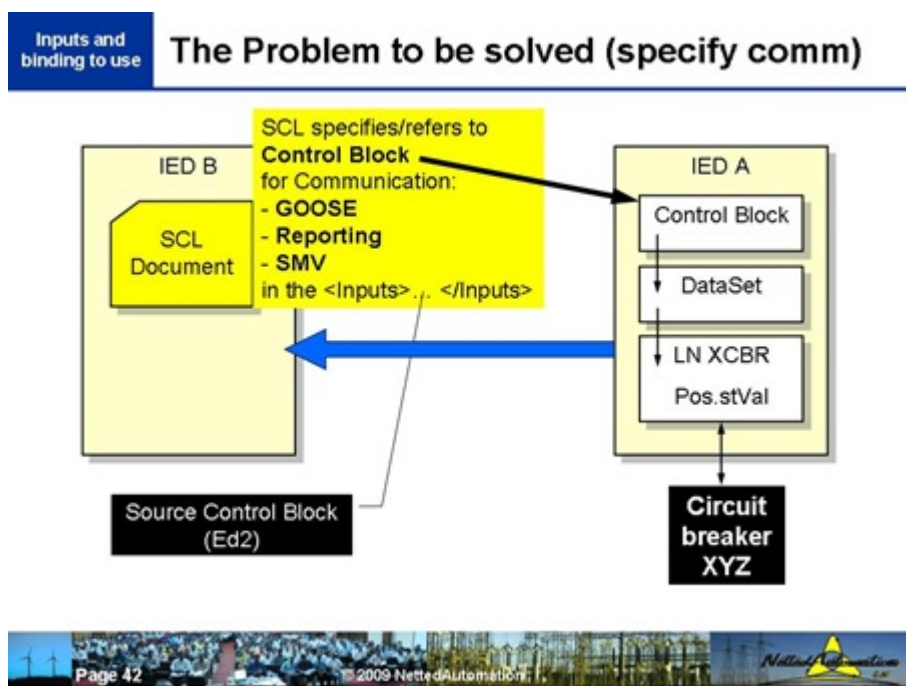

The list of extended details for the specification of the signal source is shown in the next slide:

Inputs and binding to use

Inputs in SCL (Edition 2)

Table 33 – Attributes of the Input/ExtRef element

All Attributes of Edition 1 plus the following	
desc	A free description / text. Can e.g. be used at system engineering time to tell the IED engineer the purpose of this incoming data
serviceType	Optional, values: Polt, Report, GOOSE, SMV. Typically used at system design time to specify the service type to be used for sending the needed input data
srcLDInst	The LD inst of the source control block – if missing, same as IdInst above
srcPrefix	The prefix of the LN instance, where the source control block resides; if missing, no prefix
srcLNClass	The LN class of the LN, where the source control block resides; if missing, LLNO
srcLNInst	The LN instance number of the LN where the source control block resides – if missing, no instance number exists (LLNO)
srcCBName	The source CB name; if missing, then all other srcXX attributes should also be missing, i.e. no source control block is given.

Page 44

© 2009 Netted Automation

Netted Automation

This allows to have a complete specification of the signal and how it is communicated. The specification uses a reference from the destination IED back to the source IED. The <Inputs>...</Inputs> represent a crucial part of the "wiring plan" of a substation automation system or any other automation system.

Posted by [Karlheinz Schwarz](#) at 2:30 AM 1 comments

Labels: [Automation](#), [configuration](#), [electric power system](#), [IEC 61850](#), [IED](#), [Power Automation](#), [Training](#)

Tuesday, January 12, 2010

IEC 61850 and IEC 61499 build a "Team"

The paper "**Distributed Power System Automation with IEC 61850, IEC 61499 and Intelligent Control**" presents a new approach to power system automation, based on distributed intelligence rather than traditional centralised control. The paper investigates the interplay between two international standards, IEC 61850 and IEC 61499, and proposes a way of combining of the application functions of IEC 61850-compliant devices with IEC 61499-compliant "glue logic," using the communication services of IEC 61850-7-2. The resulting ability to customise control and automation logic will greatly enhance the flexibility and adaptability of automation systems, speeding progress toward the realisation of the Smart Grid concept.

Click [HERE](#) to download the paper.

A second paper "**Towards Intelligent Smart Grid Devices with IEC 61850 Interoperability and IEC 61499 Open Control Architecture**" presents and discusses new developments and experiments conducted to prove the feasibility of using decentralized multi-agent control logic in the automation of power distribution networks. The utility network is modeled as communicating logical nodes following IEC 61850 standard's architecture, implemented by means of IEC 61499 distributed automation architecture. The system is simulated in an IEC 61499 execution environment combined with Matlab and proven to achieve simple fault location and power restoration goals through collaborative behavior and interoperable devices.

Click [HERE](#) to download the paper.

Posted by [Karlheinz Schwarz](#) at [7:45 AM](#) [0 comments](#) 

Labels: [Automation](#), [communication](#), [IEC 61499](#), [IEC 61850](#), [interoperability](#), [Smart Grid](#)

DNP3 to become an IEEE Standard

IEEE has announced yesterday (2010-01-11) that a new project (P1815 - Standard for Electric Power Systems Communications - Distributed Network Protocol (DNP3)) has been set up to publish the DNP3 specification as an IEEE Standard in mid 2010.

The "purpose of this standard is to document and make available the specifications for the DNP3 protocol. ... The intent of this DNP3 standard is to meet the goal established by NIST for a Smart Grid protocol:

- Provides a **protocol standard** from a recognized standard institution
- Provides interoperability with 100s of operational systems and 1000s of devices
- Provides cyber security based on **IEC 62351-5** ([Preview](#))
- Provides Devise data profiles in a format that can be mapped to **IEC 61850 Object Models**"

Click [HERE](#) to access the official IEEE press release.

This is what I have expected for some time. The mapping of IEC 61850 and IEC 61400-25-2 Object Models and (some) Services to DNP3 and IEC 60870-5-101/104 has already been standardized in IEC 61400-25-4 (some 2 years ago). DNP3 and IEC 60870-5-101/104 are used as SCADA protocols between substations and control centers all over.

Click [HERE](#) for some additional information on the mapping of IEC 61850/61400-25-2 objects and services to DNP3 and other protocols.

The following comparison shows that the objective of IEC 61850 goes far beyond the use as a SCADA protocol:

IEC 61850
in brief

What is the difference compared to DNP3?

IEC 61850	DNP3/101/104
<ul style="list-style-type: none">■ Communication protocols<ul style="list-style-type: none">– SCADA– Real-time– Selfdescription■ Information models■ Configuration language	<ul style="list-style-type: none">■ Communication protocol<ul style="list-style-type: none">– SCADA

Page 29 © 2009 NettedAutomation GmbH

The **Configuration Language** (IEC 61850-6 - [Preview of Edition2](#)) is the most crucial part of the standard series IEC 61850 and IEC 61400-25!!

Posted by [Karlheinz Schwarz](#) at 4:08 AM 0 comments

Labels: [Automation](#), [communication](#), [control center](#), [DNP3](#), [IEC 61400-25](#), [IEC 61850](#), [interoperability](#), [NIST](#), [Smart Grid](#), [standards](#), [Substation](#), [wind power](#)

Saturday, January 2, 2010

Successful IEC 61850 Hands-On Training Courses in Australia

NettedAutomation GmbH and STRI conducted two 3 day IEC 61850 Hands-On Training courses in Australia: in Brisbane on November 30 - December 02 and Sydney on December 02-04, 2009.



Brisbane course (attendees from 7 organizations)



Sydney course (attendees from 10 organizations)



Andrea Bonetti (STRI) in action
... actions speak louder than words!

The attendees reported that there are many concrete plans to apply IEC 61850 in Substations of Australian transmission and distribution utilities in 2010 and 2011. Also substations outside of utilities (e.g., in the mining industry) are being build with IEC 61850 compliant automation and protection systems.

The plans to implement a huge Smart Grid project in Australia are an additional opportunity for IEC 61850 being applied for distribution networks - to make the Grids smarter.

Feedback from an attendee of the Sydney course:

"Well organized and very well run. The presenters were well on top of the subject and could explain the subject matter. There was a huge amount of material to cover and they did it well. Being independent, the subject was presented objectively. Karlheinz was very strong on the background and the detail of the specification, including the interaction with related specifications. Andrea was excellent on the implementation and configuration. Had a very practical approach and committed to making it work in the real world. **I certainly gained much more than I expected from the seminar. Excellent value.**"

Posted by [Karlheinz Schwarz](#) at [4:12 AM](#) [0 comments](#) 

Labels: [Australia](#), [Automation](#), [hands-on Training](#), [IEC 61850](#), [interoperability](#), [protection](#), [Smart Grid](#), [Substation](#), [Training](#)


Thursday, December 31, 2009

ABB uses IEC 61850 for integrated power and process control in Greece

ABB has won in December 2009 an order worth \$26 million from Hellenic Petroleum SA to provide an integrated power and automation system for the upgrade of Hellenic Petroleum's Elefsina refinery, west of Athens. The environmentally friendly refinery will manufacture products in accordance with best in class technology and **global standards** to minimize environmental impact.

ABB will install a **fully automated power management and load shedding system** based on the 800xA automation platform and **IEC 61850 compatible communication networks**. **Integrating the electrical and automation system** on the common 800xA platform provides additional benefits including reduced maintenance, engineering and overall lifecycle costs.

Click [HERE](#) for the full press release.

Posted by [Karlheinz Schwarz](#) at [11:02 PM](#) [0 comments](#) 

Labels: [800xA](#), [ABB](#), [communication](#), [IEC 61850](#), [medium voltage](#), [process control](#)

[Newer Posts](#)

[Home](#)

[Older Posts](#)

Subscribe to: [Posts \(Atom\)](#)

News on IEC 61850 and related Standards

Daily news concerning the standards IEC 61850, IEC 61400-25, IEC 61970 (CIM), IEC 60870-5, ...

Wednesday, December 30, 2009

2009 comes to a close - 2010 is about to come

As the year 2009 comes to a close, I want to say "Thank You!" for supporting the standardization of solutions for a smarter grid in 2009 and for using my knowledge and experience in the field of information technology for power systems.

I wish you and your family a happy, healthy and prosperous New Year 2010 - and successful applications of standards like IEC 61850, IEC 61400-25, IEC 61968/70 (CIM), TASE.2, DNP3, ...


The year 2009 was quite busy with many public and in-house courses and consultancy services on IEC 61850 and related standards. The interest in IEC 61850 has picked up in 2009 all over. What we see now is that we could expect even more interest in 2010. Many utilities are in the process of planning to equip first substation with IEC 61850 conformant substation IEDs (protection, control, monitoring, ...).

During 2009 we have seen the US NIST activities on Smart Grids popping up. In this context we see a lot of challenges to get "sustainable interoperable" solutions for power systems.

What concerns me is that the pace of events with regard to the use of IT is accelerating very very steep! The use of standards progresses faster than usual expected. All experts I know are quite busy. What we need is: more well educated people in the power business.

I look forward to helping you to get all information and experience you need in the application of advanced standards as listed above.

Click [HERE](#) for a discussion on education of engineers in the power industry and [HERE](#) for a list of of our 70+ up-to-date seminar modules.

Posted by [Karlheinz Schwarz](#) at [11:06 PM](#) [0 comments](#) 

Labels: [CIM](#), [DNP3](#), [education](#), [hands-on Training](#), [IEC 61400-25](#), [IEC 61850](#), [IEC 61968](#), [IEC 61970](#), [Power Automation](#), [Smart Grid](#), [TASE.2 ICCP](#), [Training](#), [wind power](#)

IEEE Smart Grid Web Portal

IEEE has launched a new web portal on Smart Grid activities to support the many activities in the domain of making the grids smarter. The portal is intended to provide the "latest information on IEEE's involvement in the area of Smart Grid including conferences, publications, standards, educational programs and public policy."

Click [HERE](#) to visit the portal.

The focus seems to be on North American solutions. The list of "[IEEE Approved Standards Related to Smart Grid](#)" ignores many other

Subscribe To IEC 61850 News

 Posts 

 All Comments 

Blog Archive

- [2012](#) (11)
- [2011](#) (159)
- [2010](#) (153)
- ▼ [2009](#) (162)
 - ▼ [December](#) (4)
 - [ABB uses IEC 61850 for integrated power and proces...](#)
 - [2009 comes to a close - 2010 is about to come](#)
 - [IEEE Smart Grid Web Portal](#)
 - [Interoperability for Intelligent Devices for Trans...](#)
- [November](#) (11)
- [October](#) (17)
- [September](#) (16)
- [August](#) (18)
- [July](#) (11)
- [June](#) (9)
- [May](#) (25)
- [April](#) (11)
- [March](#) (16)
- [February](#) (11)
- [January](#) (13)
- [2008](#) (82)

International Standards (e.g., published by IEC). The page "[IEEE Smart Grid Standards in Development](#)" lists more than 30 (!) standard projects related to smarter grids.

Which international organization is about to coordinate the development of standards for the many different aspects of smarter grids? There seems to be some competition. It would be advantage for the global community to have - more ore less - a single set of standards for smarter grids. IEC should play a crucial role in getting a consistent set of standards (including IEC/IEEE double logo standards) ... in order to prevent the situation we have in the international fieldbus standardization with tooooo many standard solutions in one (!) standard: IEC 61158. Click [HERE](#) to see the list of filedbus standards.

Posted by [Karlheinz Schwarz](#) at 10:33 PM 0 comments 

Labels: [communication](#), [electric power system](#), [IEC 61850](#), [IEC61850](#), [IEEE](#), [Power Automation](#), [Smart Grid](#), [standards](#)

Sunday, December 20, 2009

Interoperability for Intelligent Devices for Transportation

A very comprehensive set of standards for information models and information exchange has been published for ITS (Intelligent Transportation Systems; defined and used in the U.S.). One crucial objective is to reach Interoperability: "A standards-based approach to integration helps to **facilitate the exchange of transportation data as well as more easily accommodate future equipment replacements, systems upgrades, and system expansions.**"

The standard NTCIP 1213, for example, defines a couple of information models that are also defined in IEC 61850.

NTCIP 1213 v02.19 (National Transportation Communications for ITS Protocol -- Object Definitions for Electrical and Lighting Management Systems (ELMS))

Examples of three phase voltages for Delta and Y, current and power:

```
BranchcircuitEntry ::= SEQUENCE {  
    ...  
    branchcircuitVoltageAB INTEGER,  
    branchcircuitVoltageBC INTEGER,  
    branchcircuitVoltageCA INTEGER,  
    branchcircuitVoltageAN INTEGER,  
    branchcircuitVoltageBN INTEGER,  
    branchcircuitVoltageCN INTEGER,  
    branchcircuitCurrent    INTEGER,  
    branchcircuitPower      INTEGER  
    ...  
}
```

These models are mapped to MIB (SNMP) and communicated, e.g., in ASN.1 BER - as is the case for IEC 61850-8-1. It would be nice to use the IEC 61850-7-4 [MMXU](#) (three phase electrical measurements for all applications - independent of transportation, distribution, generation, ...).

Smart Power Distribution Grids will have a lot of relations to Transportation Systems and vice versa.

No Power System - NO Transportation!

Contributors

[Michael Schwarz](#)

[Karlheinz Schwarz](#)

The NIST Smart Grid activities list the NTCIP part 1213 in the [SGIP Identified Standards](#) (number 31).

Click [HERE](#) for the ITS website ... provides [free access](#) to model and protocol standards, e.g. part 1213 can be accessed for free (registration required).

Click [HERE](#) for more information on the ITS Standards Background.

Posted by [Karlheinz Schwarz](#) at 8:50 PM 0 comments 

Labels: [Automation](#), [communication](#), [IEC 61850](#), [Intelligent Transportation System](#), [interchangeability](#), [interoperability](#), [ITS](#), [message encoding](#), [NIST Roadmap](#), [NTCIP](#), [SNMP](#), [Transmission Grid](#)

Wednesday, November 25, 2009

IEC 61131-3 and IEC 61499 in action

The standard IEC 61499 (Functionblocks) is implemented on several platforms. NXTControl demonstrates a couple of PLCs (from Beckhoff, Siemens, ...) with IEC 61499 at the SPS/IPC/DRIVES Fair in Nuremberg (Germany) this week.

After discussions with several experts I expect a big move towards more standards in the Automation arena. The financial crisis lets more people think about using well accepted international standards - to get rid of too many vendor specific or even standardized solutions.

IEC 61499 focuses on:

Portability: the ability of software tools to accept and correctly interpret library elements produced by other software tools.

Configurability: the ability of devices and their software components to be configured (selected, assigned locations, interconnected and parameterized) by multiple software tools.

Interoperability: the ability of devices from different vendors operating together to perform the functions specified by one or more distributed applications.

The interoperability is mainly provided by a standardized international information and information exchange standard like IEC 61850. Several people I met at the fair yesterday are looking for the combination of the two standards: IEC 61499 and IEC 61850. More to come soon.

Click [HERE](#) for the comparison of IEC 61131-3 and IEC 61499.

Click [HERE](#) for other posts on this blog that discuss IEC 61499 and IEC 61850 to get to really sustainable interoperability.

Posted by [Karlheinz Schwarz](#) at 1:36 AM 0 comments 

Labels: [Automation](#), [communication](#), [IEC 61131-3](#), [IEC 61499](#), [IEC 61850](#), [interoperability](#), [sustainable interoperability](#)

Tuesday, November 24, 2009

AEP Ohio gridSMART Demonstration Project funded with US\$ 150.000.000

US DoE Secretary Chu announced on Nov. 24, 2009, a total of \$620 Million for 32 Smart Grid Demonstration and Energy Storage Projects.

"The projects include streamlined communication technologies that will allow different parts of the grid to **"talk" to each other in real time; sensing and control devices** that help grid operators monitor and control the flow of electricity to **avoid disruptions and outages**; smart meters and in-home systems that empower consumers to reduce their energy use and save money; energy storage options; and on-site and renewable energy sources that can be integrated onto the electrical grid."

"The project will include 13 different **technologies from the substation to the customer**, including **distribution automation and control**, smart meters and appliances, home area networks, plug-in hybrid electric vehicles, energy and battery storage, and renewable generation sources."

This is the time for Standards like IEC 61850, DNP3, IEC 61400-25, IEC 61968/70 CIM, ... to make the Grid smarter. After many years in operation these standards are mature for large scale implementations.

Recovery Act funding granted: \$435,200,987

Total Project Value Including Cost Share: \$877,241,878

Click [HERE](#) for the full press release.

Click [HERE](#) for the list of funded projects.

Posted by [Karlheinz Schwarz](#) at [9:44 PM](#) [0 comments](#) 

Labels: [communication](#), [IEC 61400-25](#), [IEC 61850](#), [IEC 61968](#), [IEC 61970](#), [interoperability](#), [Power Automation](#), [Smart Grid](#)

Friday, November 20, 2009

Information Models and Protocols for Smart Grids

"The **Smart Grid Interoperability Panel (SGIP)**, a new stakeholder forum to provide technical support to the Commerce Department's National Institute of Standards and Technology (NIST) as it **coordinates standards for a modernized electric power system**, concluded today (19. Nov. 2009) with election of 20 members to its governing board."

Key for the SGIP is to "coordinate the development of a **framework** that includes **protocols** and **model standards** for information management to achieve interoperability of smart grid devices and systems."

Click [HERE](#) for the press release.

Posted by [Karlheinz Schwarz](#) at [9:38 PM](#) [0 comments](#) 

Labels: [communication](#), [interoperability](#), [interoperability tests](#), [Smart Grid](#), [standards](#)

IEC 61850 at the Conference on Innovative Smart Grid Technologies

"The first Conference on Innovative Smart Grid Technologies, sponsored by the IEEE Power & Energy Society (PES) and hosted by the National Institute of Standards and Technology (NIST), will be held January 19 - 21, 2010 in Gaithersburg, Maryland, USA. The Conference will be a forum for the participants to discuss the state of the art innovations in smart grid technologies. The Conference will feature special sessions and tutorials by international experts on smart grid applications."

Paper presentation at the conference:

"Towards the Energy Web via Standards-enabled Smart Grid"

Authors:

Valeriy Vyatkin, Senior Member, IEEE,
Gulnara Zhabelova, non-member,
Neil Higgins, Member, IEEE,
Mihaela Ulieru, Senior Member, IEEE
Karlheinz Schwarz, Member, IEEE and
Nirmal-Kumar C Nair, Member, IEEE

Abstract -- In this paper we propose an information and control architecture for Smart Grid based on the combination of upcoming industrial standards and intelligent control methods. We make the case that an incremental approach is required for the transition to the Smart Grid and propose a way of doing that through **bringing intelligence down to the level of substation automation devices**. The architecture employs two strong international standards, **IEC 61850 and IEC 61499**, to enrich the applications that can be created using interoperable Smart Grid devices. Interoperability and open configurability - key enablers for efficient application of the revolutionary EnergyWeb ideas – are evident in this architecture. The utility network is **modelled as IEC 61850-compliant logical nodes, embedded in an IEC 61499 distributed automation framework**. The system is simulated in an IEC 61499 execution environment combined with Matlab, and is proven to achieve **simple fault location and power restoration goals through collaborative behaviour**.

Click [HERE](#) for the conference website.

Posted by [Karlheinz Schwarz](#) at 9:08 PM 1 comments 

Labels: [Automation](#), [communication](#), [conference](#), [electric power system](#), [IEC 61499](#), [IEC 61850](#), [interoperability](#), [interoperability tests](#), [NIST](#), [Smart Grid](#), [standards](#)

Tuesday, November 17, 2009

Active and Reactive Power Control with IEC 61400-25-2

The focus of the IEC 61400-25 series is on the communications between wind power plant components such as wind turbines and actors such as SCADA systems. IEC 61400-25-2 specifies the information model of devices and functions related to wind power plant applications. These models extend IEC 61850-7-x models. Almost all definitions, hardware and software solutions available for IEC 61850 can be used for IEC 61400-25-2. In particular, IEC 61400-25-2 specifies the compatible logical node names, and data names for communication between wind power plant components.

The standard IEC 61400-25-2 defines a comprehensive list of information models (Logical Nodes) for wind turbines, e.g.:

- WTUR - Wind turbine general information
- WROT - Wind turbine rotor information
- WTRM - Wind turbine transmission information
- WGEN - Wind turbine generator information
- WCNV - Wind turbine converter information
- WTRF - Wind turbine transformer information
- WNAC - Wind turbine nacelle information
- WYAW - Wind turbine yawing information
- WTOW - Wind turbine tower information

The most crucial Logical Nodes are likely the

- WAPC - Wind power plant **active power control** information
- WRPC - Wind power plant **reactive power control** information

These models describe the "interface" between a complete **park and the grid operator for control purposes**. These Logical Nodes can be used for other power resources like CHP, PV, ... The German EEG (Erneuerbare-Energien-Gesetz) accelerates the application of IEC 61400-25 tremendously, because the Grid Operator needs more information about the park and he needs to control the whole power system in cases of faults and critical conditions - wind power plants and other resources are an integrated part of the whole system. These resources cannot be treated just as negative loads.

The WAPC (active power control) comprises the following Data Objects:

Status information

- Actual number of wind turbines in operation
- Active Power Limitation Mode Enabled
- Active Power Control Mode Enabled controlling apparent power
- Gradient Function Enabled
- Delta Function Enabled

Measurements

- Wind Power Plant active power output capability
 - Wind Power Plant active power output
 - Wind Power Plant apparent power
 - Wind Power Plant Gradient
 - Wind Power Plant active power reserve utilizing the Delta function
- the difference between active power generation capability and active power generated

Control information

- Activate active power control function
 - Activate apparent power control function
 - Activate gradient control function
 - Activate delta control function
 - Set reference value for the wind power plant active power output
 - Set reference value for the wind power plant apparent power output
 - Set reference value for gradient ramping up the wind power plant active power output
 - Set reference value for gradient ramping down the wind power plant active power output
 - Set reference value for the wind power plant active power reserve
- also named as "spinning reserve"

The information provided by these models is crucial for a future stable power delivery system.

Posted by [Karlheinz Schwarz](#) at [8:11 AM](#) [0 comments](#) 

Labels: [active power control](#), [control center](#), [electric power system](#), [IEC 61400-25](#), [IEC 61850](#), [reactive power control](#), [wind power](#), [wind turbine controller](#)

Seats for IEC 61850 Tutorial at the SPS/IPC/DRIVES available

The Tutorial "**IEC 61850 - Die universale Norm für die Informations-Integration**" during the SPS/IPC/DRIVES on Tuesday, 24.11.2009, 14:00 - 17:00 is approaching quite fast ... **just 7 days left to register!** The presentation is in German - presentation material is in English.

Please note that a real live demo will show crucial benefits of the new standard - for power automation and industrial automation. What is industrial automation without POWER (automation)?

Several manufacturers will show IEC 61850 connectivity ... one is Beckhoff.

Click [HERE](#) for the program and other details.

Click [HERE](#) for information on Beckhoff's support of IEC 61850/61400-25.

Posted by [Karlheinz Schwarz](#) at [3:48 AM](#) [0 comments](#) 

Labels: [beckhoff](#), [control center](#), [IEC 61400-25](#), [IEC 61850](#), [PLC](#), [Power Automation](#), [wind power](#)

Access to key O&M data by use of IEC 61400-25


Availability of online and historical data is a prerequisite for effective operation and maintenance (O&M) of wind power plants. This is where the standard series IEC 61400-25 "Wind turbines – Communications for monitoring and control of wind power plants" comes in. IEC 61400-25 is mainly an extension of the definitions of IEC 61850. A substation does not have a rotor - obviously. So we had to add a model for the rotor with **WROT** as the standard Logical Node and **WROT.RotSpd** as the data object for the rotor speed. Where ever a rotor of a wind mill turns it could be modeled as WROT.RotSpd. Since the publication of the standard series there is no need for vendor specific communication solutions and no need for myriads of Excel or Word tables of signal lists that specify the rotor speed with some kind of an index. What does "A2839" mean? May be it is the rotor speed of a turbine running in Buxtehude" - who knows. Of course it takes some time to have the standard implemented ... a couple of IEC 61400-25 conformant products are already available.

According to a presentation at the the European Offshore Wind 2009 Conference & Exhibition, 14 – 16 September, Stockholm (Sweden): "Vattenfall, Statkraft and DONG Energy have all **included the IEC 61400-25 series in their requirements specifications. Support for the standard is one of the evaluation criteria for the delivery of new wind power plants.**"

Click [HERE](#) for the poster presented in Stockholm.

Click [HERE](#) for a paper on the subject.

Click [HERE](#) for a presentation.

Posted by [Karlheinz Schwarz](#) at [12:43 AM](#) [0 comments](#) 

Labels: [communication](#), [condition monitoring](#), [IEC 61400-25](#), [IEC 61850](#), [SCADA](#), [Vattenfall](#), [wind power](#), [wind turbine controller](#)


Monday, November 16, 2009

OpenGrid uses IEC 61850 and IEC 60870-6-TASE.2

The Current Group developed a so-called "*OpenGrid*" *specification as a* "software foundation to enable Smart Grid applications deployed today and in the future. The *OpenGrid* platform provides the network and data management system to integrate any grid device, including intelligent sensors, capacitor banks, tap changers, reclosers, switches, substation devices and meters with a variety of low-latency IP based communications systems."

Key components are (many based on IEC standards developed by IEC TC 57) a "Smart Grid communication network using industry standard protocols such as **IEC 61850**, DNP3, IP and SNMP" and "SCADA integration adapters utilizing **ICCP TASE.2**, while GIS and OMS integration adapters are built using **IEC 61968-11 CIM**".

Click [HERE](#) to learn more about the OpenGrid.

Posted by [Karlheinz Schwarz](#) at [11:49 PM](#) [0 comments](#) 

Labels: [CIM](#), [communication](#), [DNP3](#), [IEC 61850](#), [IEC 61968](#), [IEC61850](#), [implementation](#), [TASE.2 ICCP](#)

Friday, November 13, 2009

RWE awarded Development of IEC 61400-25 for Wind Power Control System

RWE (second biggest German Utility) awarded Mr. Pascal Dresselhaus for the development of an **IEC 61400-25** compliant software for a Beckhoff PLC (Programmable Logic Controller). He implemented the mapping to MMS according to IEC 61850-8-1. Mr. Dresselhaus' Diploma-Thesis "Entwicklung einer Bibliothek für die Kommunikation von Windkraftanlagen nach IEC 61400-25" **won the highest award!** Congratulation!

The development is now available as a Product of Beckhoff.

Click [HERE](#) for some information related to the Development (English).

Click [HERE](#) for the press release of RWE (German only).

Click [HERE](#) for the press release of the Fachhochschule Südwestfalen (German only)

Posted by [Karlheinz Schwarz](#) at [10:44 PM](#) [0 comments](#) 

Labels: [communication](#), [IEC 61400-25](#), [IEC 61850](#), [PLC](#), [Power Automation](#), [wind power](#), [wind turbine controller](#)

Thursday, November 12, 2009

First Part of IEC 61850 Edition 2 Approved

The first part of Edition 2 of IEC 61850 has been approved for publication:

Communication networks and systems for power utility automation - Part 6: Configuration description language for communication in electrical substations related to IEDs (SCL).

Note that the application domain of the configuration language is much broader than for substations. Part 6 can easily applied to any IED that uses Logical Devices, Logical Nodes, Data Objects and common data classes. Only the Substation Section (describing the single line diagram)

is specific to electrical substations. The rest is quite common. Experts of IEC 61400-25 have recently discussed with IEC 61850-6 experts on how to add a corresponding wind power turbine model - as an extension - to IEC 61850-6. The work on such an extension is likely to start in 2010. The same is true for hydro power plants and DER.

Further parts of Edition 2 of IEC 61850 will follow in 2010.

Click [HERE](#) for the official webpage for IEC 61850-6.

Posted by [Karlheinz Schwarz](#) at [5:02 AM](#) [0 comments](#) 

Labels: [configuration](#), [engineering](#), [IEC 61850](#), [IEC61850](#)


Friday, November 6, 2009

General Electric to support University education

General Electric will donate an Innovation Lab for power systems and communications to The University of Western Ontario in London, Ontario.

The Lab will help in training on power system protection and automation of electrical substations, including the use of IEC 61850 and Ethernet communication. This is a major step in educating more young people in advanced information and communication technologies for the future power system.

Click [HERE](#) for the full press release.

Posted by [Karlheinz Schwarz](#) at [12:27 AM](#) [0 comments](#) 

Labels: [communication](#), [education](#), [electric power system](#), [IEC 61850](#), [IEC61850](#), [peopleware](#), [workforce](#)

Saturday, October 31, 2009

MMS and ASN.1 Tutorial

The basics of MMS (Manufacturing Message Specification, ISO 9506) and ASN.1 (Abstract Syntax Notation 1) are available at the NettedAutomation Website.

MMS is a messaging system for modeling real devices and functions and for exchanging information about the real device, and exchanging process data - under real-time conditions - and supervisory control information between networked devices and/or computer applications. MMS is an international standard (ISO 9506) that has been developed and maintained by the ISO Technical Committee 184 (TC184) - Industrial Automation - of the International Organization for Standardization (ISO).

The object models and messaging services provided by MMS are generic enough to be appropriate for a wide variety of devices, applications, and industries. Whether the device is a Programmable Logic Controller (PLC) or a robot, the MMS object models, services and messages are identical. Similarly, applications as diverse as material handling, fault annunciation, energy management, electrical power distribution control, inventory control, and deep space antenna positioning in industries as varied as automotive, aerospace, petro-chemical, electric utility, office machinery and space exploration have put MMS to useful work.

MMS is the base standard to communicate all client/server information

exchange for **IEC 61850, IEC 61400-25** (in addition to other protocols) and **IEC 60870-6 TASE.2 (ICCP)**. ASN.1 is used in MMS to specify the syntax of messages, ASN.1 BER defines the concrete encoding of the messages. Please note that **only a small subset of MMS and ASN.1** is needed by IEC 61850, IEC 61400-25 and TASE.2.

Click [HERE](#) to begin the Tutorial ... enjoy.

Posted by [Karlheinz Schwarz](#) at 5:44 AM 1 comments 

Labels: [ASN.1](#), [communication](#), [IEC](#), [IEC 61850](#), [IEC61850](#), [message encoding](#), [MMS](#), [TASE.2](#), [TASE.2 ICCP](#)

Freely Available ISO and IEC Standards

A list of more than 300 ISO and IEC standards are made **available by ISO/IEC for free download**.

The list comprises many standards for information and communication technologies like:

ISO/IEC 7498-1:1994
Information technology -- Open Systems Interconnection -- Basic Reference Model: The Basic Model

ISO/IEC 7498-3:1997
Information technology -- Open Systems Interconnection -- Basic Reference Model: Naming and addressing

ISO/IEC 16448:2002
Information technology -- 120 mm DVD -- Read-only disk

ISO/IEC 23360-1..8:2006
Linux Standard Base (LSB) core specification 3.1-- Part 1 to 8

Click [HERE](#) for the full list of freely available standards.

Posted by [Karlheinz Schwarz](#) at 5:31 AM 0 comments 

Labels: [ICT](#), [IEC](#), [interoperability](#), [ISO](#), [standards](#)

Thursday, October 29, 2009

US Smart Grid - \$8 Billion investment including \$4.3 from Government

The US Government and the power industry will invest more than US\$ 8,000,000,000 in improving the electric delivery system in the US. 100 private companies, utilities, manufacturers, cities and other partners received the Smart Grid Investment Grant awards on October 27, 2009.

The Government has awarded many groups with a total of \$3.4 Billion! These groups will invest an additional \$4.7 Billion.

Millions of Smart Meters, 850 Phase Measurement Units, more than 200,000 Smart Transformers, almost 700 automated substations, ... will be installed by these projects. There seems to be a high potential and need for the application of standardized information and information exchange.

Click [HERE](#) for the DoE press release October 27, 2009.

Click [HERE](#) for the list of grants awarded by category.

Click [HERE](#) for the list of grants awarded by state.

Click [HERE](#) for a map of the awards.

More to come in other countries.

Posted by [Karlheinz Schwarz](#) at [4:20 AM](#) [0 comments](#) 

Labels: [NIST Roadmap](#), [Obama](#), [Power Automation](#), [Power Plants](#), [Smart Grid](#), [Substation](#), [US president](#)

Wednesday, October 28, 2009

The "Semantic Web" in Power System Automation

Traditionally almost all communication solutions for automation and especially for power system automation is build on hundred and thousands of "Points" (Signals) organized in huge lists. Each "Point" has a type and a kind of a simple index (or identifier). Different vendors (or even different people) use different list. In one case the "Phase A Voltage to ground" may have the index "26717" in another case it may be "363.26". Do you know what these numbers mean?

This is comparable to the web of today: search engines are searching mainly for ASCII strings. If I search for "Guenther" "Wilhelm", I could not specify that "Guenther" is the first name and "Wilhelm" is the family name. Google returns 18,700,000 hits. Searching for "Guenther Wilhelm" returns just 30,000 hits. The second is closer to what I am looking for. I would like to search linke this: "firstname = Guenther" and "familyname = Wilhelm". In this example we have added some semantic (meaning) to the names.

It would be nice to have **reasonable names for the "signals"** instead of **just numbers** and to have **semantic** added to the "signals". This would allow to interpret the list of signals - IF THE NAMES ARE CHOOSSEN TO MEAN SOMETHING USEFUL. IEC 61850 and IEC 61400-25 are standards that define semantic and names for each signal - like the Semantic Web does.


According to Wikipedia is "**The Semantic Web** an evolving development of the World Wide Web in which the **meaning (semantics) of information and services on the web is defined**, making it possible for the web to understand and satisfy the requests of people and machines to use the web content."

In IEC 61850 we have decided many years ago that the name for the three-phase electrical system should be the same all over (in principle) and the same for all voltage levels - because the electrical system is the smae all over (with different voltages and frequencies). The following picture shows two voltage levels and a single model for the three-phase system. The name "**MMXU**" stands for a logical node defining all crucial information that describes a three-phase electrical system. The "**PhV**" (phase voltage) has a "**PhsA**" value etc. Each of the values has SI-Units, scaling factors etc. These names expose the same information allover, in all applications (in substations and in factories, on ships, on railways, ...). Why do we need myriads of different indices in current solutions for the same information?

Standard Logical Node
Class MMXU

A	Phase currents
PhV	Phase to ground voltage
PhV.PhsA	
PhV.PhsB	
...	
PPV	Phase to phase voltage
W	Phase active power
VA	Phase reactive power
VA	Phase apparent power
TotW	Total active power
TotVA	Total reactive power
TotVA	Total apparent power
Hz	Frequency

400.000 Volt



What's the difference?
... don't touch the line to figure it out!!

Page 32 2009 Netted Automation

The communication based on simple lists seems to be simple. But if your company has **Millions of points to test and to manage** ... what then? Guess there is no need to discuss the **problems handling huge lists** - lists that are differently formatted and contained in Wordfiles, Spreadsheets, pdf files, just on paper, data bases, ... How could one make these lists machine readable? One of my customers told me that the have to maintain 1,300 documents containing signal lists - wow.

IEC 61850 is - to my knowledge - the only comprehensive standard that defines common and specific information models for the electric power industry and beyond. We had a proposal to add a "FishCounter" for hydro power plants ... why not? The standard also defines services to exchange the values and concrete protocols to serialize the services.

IEC 61850 could be understood as the "Semantic Web" of the power automation and protection world. Now you can read the Phase voltage of **MMXU1** of the logical device **SpyDER** under the address: **192.168.1.77**. In order to know where this device is located you just can talk to the device to retrieve some description or you can use the system configuration description file (according to IEC 61850-6). This file has all semantic information including the binding of the model to the real world.

Click [HERE](#) for an example of a device that implements the MMXU logical node and exposes the voltage of the power outlet it is connected to.

In this regard IEC 61850 is **MAYA** (Most Advanced Yet Accepted) -- [accepted all over](#).

Posted by [Karlheinz Schwarz](#) at 5:06 PM 0 comments 

Labels: [Automation](#), [communication](#), [engineering](#), [IED](#), [interoperability tests](#), [message encoding](#), [process control](#), [protection](#), [Smart Grid](#), [standards](#), [Substation Automation](#)

[Newer Posts](#)

[Home](#)

[Older Posts](#)

Subscribe to: [Posts \(Atom\)](#)

News on IEC 61850 and related Standards

Daily news concerning the standards IEC 61850, IEC 61400-25, IEC 61970 (CIM), IEC 60870-5, ...

Wednesday, October 28, 2009

NIST Smart Grid Roadmap open for Comments

The **Draft NIST Framework and Roadmap for Smart Grid Interoperability Standards, Release 1.0** is open for Comments. The US National Institute of Standards and Technology (NIST) of the Department of Commerce invites you to comment on the crucial roadmap towards a smarter Grid.

The commenting period **ends on November 09, 2009**.

Click [HERE](#) for a description of the procedure and any other information needed to comment on this crucial document.

Please take a moment (or two) to review and comment the draft roadmap. This is your chance to contribute in this open process. Your opinion is crucial. If you have and comment you want to share with me please feel free to contact me.

Posted by [Karlheinz Schwarz](#) at [12:03 PM](#) [0 comments](#) 

Labels: [communication](#), [electric power system](#), [NIST](#), [NIST Roadmap](#), [Smart Grid](#)

Smart(er) Grids: US DoE spends \$ 100,000,000 on training - and you?

Smart Grids require smart engineers. Are there enough power engineers available to design, plan, build, operate, maintain, ... the Smart(er) Grids yet to be build? NO! So, what to do? The solution is as simple as this: **Educate more people interested** to keep the gras green, the sky blue and the **power flowing**.

The Billions of US\$ to be spent for the Smart(er) Grids during the next years require **skilled people that have already experience in power systems and power system automation** - but may not have been educated to use advanced information and communication technologies for:

- Self-healing mechanisms conducted by smart devices
- Demand response
- Handling physical and cyber attacks
- Providing high power quality
- Accommodating a mix of multiple generation and storage options
- Enabling new opportunities in the power delivery
- Optimizing asset usage and lifetime, and operation efficiency

The US Department of Energy (DoE) has realized that EDUCATION is key for the success in implementing a Smart(er) Grid. It spends \$ 100,000,000 for various measures to improve the **Knowledge, Understanding, and Application** of advanced information and

Subscribe To IEC 61850 News

 Posts 

 All Comments 

Blog Archive

► [2012](#) (11)

► [2011](#) (159)

► [2010](#) (153)

▼ [2009](#) (162)

► [December](#) (4)

► [November](#) (11)

▼ [October](#) (17)

[MMS and ASN.1 Tutorial](#)

[Freely Available ISO and IEC Standards](#)

[US Smart Grid - \\$8 Billion investment including \\$4...](#)

[The "Semantic Web" in Power System Automation](#)

[NIST Smart Grid Roadmap open for Comments](#)

[Smart\(er\) Grids: US DoE spends \\$ 100,000,000 on tr...](#)

[Microsoft's Smart Energy Reference Architecture](#)

[Experts from 11 countries attended IEC 61850 train...](#)

[New Tool for IEC 61850 and IEC 61400-25](#)

[NIST Smart Grid Collaboration Site -](#)

communication technologies!! The earlier you start with the training - the better.

I have already started to train my grandson:

Long term education starts here

My grandson
Joern (5)
may become
an engineer
like his
grandfathers
and father ...



... he did not
inherit our
experience ...
so I started to
educate him

One crucial element in building the Smart(er) Grid is the use of various international standards: IEC 61850, IEC 61400-25, IEC 61968/70 CIM, DNP3, IEC 61131-3 (PLC programming), IEC 61499 (Functionblocks), IEC 61158 (Field busses) etc.

After training of more than 2,000 experts from more than 400 companies and more than 50 countries NettedAutomation is ready to educate you and your people soon - in order to get the most comprehensive **Knowledge, Understanding, and Application** of the above mentioned standards. You'd get first-hand, very comprehensive, vendor neutral and up-to-date knowledge, experience, and guidance; learn how to reach interoperability of devices; You'd get best advice.

Often I have found this situation:

Bright future of utility engineers



That's good for vendors BUT not for Utilities and system integrators.

Click [HERE](#) for a brief statement of IEEE on the DoE plans.

Click [HERE](#) for a brand-new paper on "**Professional Resources to Implement the "Smart Grid"**" written by nine university and education experts.

Click [HERE](#) for a report on the latest training last week in Frankfurt/Germany where experts from 11 countries attended our IEC 61850 training.

News

[IEC61850-Tutorial
während der
SPS/IPC/Drives in Nü...](#)

[Interoperability, secure
Investments and IEC](#)

[First PLC supporting IEC
61850 in comprehensive
Ha...](#)

[Australia to invest AUD 43
Billion in
communicatio...](#)

[IEC 61850 IED Scout
version 2.10 available](#)

[German E-Energy Projects
presented at IEEE PES
mee...](#)

[smart grid - Smart IEDs -
SMART PEOPLE](#)

- ▶ [September \(16\)](#)
- ▶ [August \(18\)](#)
- ▶ [July \(11\)](#)
- ▶ [June \(9\)](#)
- ▶ [May \(25\)](#)
- ▶ [April \(11\)](#)
- ▶ [March \(16\)](#)
- ▶ [February \(11\)](#)
- ▶ [January \(13\)](#)
- ▶ [2008 \(82\)](#)

Contributors

[Michael Schwarz](#)

[Karlheinz Schwarz](#)

[CONTACT us by email](#) in case you have any question with regard to your education needs on advanced standard information and communication technologies for the Smart(er) Grids.

Posted by [Karlheinz Schwarz](#) at [5:51 AM](#) [0 comments](#) 

Labels: [communication](#), [education](#), [electric power system](#), [engineering](#), [hands-on Training](#), [IEC 61131-3](#), [IEC 61499](#), [IEC 61850](#), [IEC 61968](#), [IEC 61970](#), [IEC61850](#), [peopleware](#), [Smart Grid](#), [standards](#), [sustainable interoperability](#), [workforce](#)

Friday, October 23, 2009

Microsoft's Smart Energy Reference Architecture

Microsoft has published the other day a comprehensive "**Power and Utilities - Smart Energy Reference Architecture**". "Microsoft believes it's more accurate to refer to the new utility landscape as a "smart energy ecosystem" that's collaborative and integrated."

The Smartness comprises - of course - more than the Grid. The "**smart energy ecosystem**" describes the challenge very well.

Microsoft says that it "is committed to supporting these global efforts by taking a leadership role in the development of the smart energy ecosystem" as discussed in China, Europe, North America, ... by **IEC**, **IEEE**, ... IEC Standards (IEC 61968/70, IEC 61850, IEC 610870-6, ...) are referenced some 80 times in Microsoft's architecture!!

Click [HERE](#) for the full Microsoft Architecture [pdf, 6 MB].

The Smart Energy Ecosystem requires many **Smart People** defining, implementing and using the needed Standards to realize the vision.
Smart People are those that are well educated.

Click [HERE](#) for an opportunity (in San Antonio, 29-30 October 2009) to get **comprehensive education in the application of Standards like IEC 61850, IEC 61400-25, DNP3, ...** Click [HERE](#) for the program.

Posted by [Karlheinz Schwarz](#) at [11:02 PM](#) [0 comments](#) 

Labels: [CIM](#), [communication](#), [DNP3](#), [electric power system](#), [IEC 61850](#), [IEC 61968](#), [IEC 61970](#), [IEC61850](#), [implementation](#), [Microsoft](#), [NIST](#), [Power Automation](#), [security](#), [workforce](#)

Experts from 11 countries attended IEC 61850 training in Frankfurt

More than 20 experts from 11 countries attended the Comprehensive & Independent Hands-on Training on IEC 61850 in Frankfurt (Germany), 20.-23. October 2009 organized by NettedAutomation GmbH and [STRI](#):



Experts from: Belgium, Cyprus, Denmark, Germany, Hungary, Iceland, Ireland, Lithuania, Norway, Sweden, and USA

In order for users and system integrators to utilize the benefits of IEC 61850 it is **necessary for power utilities, integrators and vendors to education their most crucial asset – people.**

The attendees have been educated in most crucial aspects of IEC 61850. The **interoperability training (Client/Server and GOOSE)** was run using IEDs from ABB (Relay), AREVA (Relay), Beckhoff (PLC), Ingeteam (Bay Controller), QNE (Measuring Unit), SEL (Relay), Siemens (Relay), Hirschmann (Ethernet Switch) and RuggedCom (Ethernet Switch and Router):



The SCL Engineering training was conducted by Joerg Reuter (Helinks):



Click [HERE](#) to find the scheduled seminars and training opportunities.
Click [HERE](#) to see the list of the ratings by course participants (very high level of satisfaction).

Posted by [Karlheinz Schwarz](#) at [10:19 PM](#) [0 comments](#) 

Labels: [ABB](#), [electric power system](#), [hands-on Training](#), [hirschmann](#), [IEC 61850](#), [IEC61850](#), [interoperability tests](#), [peopleware](#), [seminar](#), [Siemens](#), [workforce](#)

New Tool for IEC 61850 and IEC 61400-25

Ingeteam Technology (Spain) released the INGESYS®energyFactorySuite 2.0: a comprehensive suite of tools for modeling, configuring and commissioning IEC 61850 and IEC 61400-25 systems.

Click [HERE](#) for a description of Ingeteam's IEDs for power system automation [pdf, 1.5 MB].

Click [HERE](#) for a description of Ingeteam's NEW Tool for IEC 61850 and IEC 61400-25 [pdf, 0.85 MB].

Click [HERE](#) to read more details on the tool and find link to download a demo version.

Posted by [Karlheinz Schwarz](#) at [9:26 PM](#) [0 comments](#) 

Labels: [engineering](#), [IEC 61400-25](#), [IEC 61850](#), [IEC61850](#), [IED](#), [Power Automation](#), [process control](#), [tools](#)

Wednesday, October 14, 2009

NIST Smart Grid Collaboration Site - News

The **Smart Grid Interoperability Panel** (SGIP) will be launched in Denver (Colorado) on 16 November 2009. This panel is being created to provide a more permanent structure and process—with stakeholder representation—to support the **Framework and Roadmap for Smart Grid Interoperability Standards**.

The standards development process is likely to be monitored and supported by the panel. It is crucial that the standardization groups closely cooperate together and with the members of the SGIP - in order to reach a high level of interoperability for the many devices and systems to be installed in the future Smart(er) Grid.

TEAMWORK is very crucial to reach sustainable interoperability: **Smart People for Smart Grids**.

Note that several standards developed and published by IEC TC 57, e.g., IEC 61850, CIM, ... and DNP3 are crucial for the Roadmap - in the

US and in many other regions and countries.

Click [HERE](#) for the website of the SGIP.

Click [HERE](#) for a **ONE page introduction** to IEC 61850 and IEC 61400-25.

Posted by [Karlheinz Schwarz](#) at [1:33 PM](#) [0 comments](#) 

Labels: [61850](#), [DER](#), [DNP3](#), [IEC 61850](#), [interoperability](#), [interoperability tests](#), [Smart Grid](#)

Tuesday, October 13, 2009

IEC61850-Tutorial während der SPS/IPC/Drives in Nürnberg

Was: Dreistündiges Tutorial "IEC 61850 - Die universale Norm für die Informations-Integration"

Die Norm IEC 61850 „Communication networks and systems for power utility automation“ ist die global anerkannte Integrationslösung für die Automatisierung in der elektrischen Energieversorgung und zunehmend in anderen Bereichen. Mittlerweile ist diese Norm ein wichtiger Baustein der weltweiten Aktivitäten zur Erneuerung der Energieversorgung hin zu einem Smart Grid. In dem Tutorial wird der Stand der Normung und der Anwendungen im In- und Ausland vorgestellt - möglicherweise sind Sie viel unmittelbarer von dieser Norm betroffen, als Sie glauben!

Wann: Tuesday, 24.11.2009, 14:00 - 17:00 hrs

Wo: Nürnberg (Germany)

Click [HIER](#) für weitere Informationen und das Anmeldeformular.

Posted by [Karlheinz Schwarz](#) at [1:39 PM](#) [0 comments](#) 

Labels: [61850](#), [Automation](#), [electric power system](#), [IEC 61850](#), [IEC61850](#), [Power Automation](#), [Smart Grid](#)

Friday, October 9, 2009

Interoperability, secure Investments and IEC

While some **50 IEC TC 57 experts** from all over were meeting in Los Angeles this week to work on **Interoperability Standards**, the US Government announced a Comprehensive Energy Plan. One objective of the plan is to "support **\$ 32 Billion** in loan guarantees and create **\$40-50 Billion** in project investments" another is to "providing \$750 million to accelerate conventional renewable energy projects" ... many dollars will be used to develop and use interoperable information and communication standards.

The information and communication technology for the Smart(er) Grids requires a high level of syntactic and semantic interoperability of the various products, solutions and systems that build up the future power system. Furthermore the specific requirements like **long term investment security** in existing interoperability standards (like IEC 61850, IEC 60870-5, IEC 61968/70, DNP3, ...) and **legacy systems** must be considered. These two rationales - **interoperability** and **investment security** - make it absolutely necessary to base all developments and investment of Billions of Dollar or Euros on a **sound framework of sustainable interoperability standards**. IEC and especially IEC TC 57 are developing crucial elements of this framework.

Click [HERE](#) for the US Government press release (2009-10-07)
Click [HERE](#) for the US Government presentation (2009-10-07)
Click [HERE](#) for IEC TC 57 Scope (Power systems management and associated information exchange)
Click [HERE](#) for the list of experts of WG 19 "Interoperability within TC 57 in the long term"
Click [HERE](#) for information on the IEC Special Group on Smart Grids (SG 3).

Posted by [Karlheinz Schwarz](#) at 6:44 AM 0 comments 

Labels: [communication](#), [DNP3](#), [electric power system](#), [IEC 61850](#), [IEC61850](#), [interoperability tests](#), [Smart Grid](#), [Transmission Grid](#)

Thursday, October 8, 2009

First PLC supporting IEC 61850 in comprehensive Hands-On Training

Beckhoff (Verl, Germany) provides an IEC 61850 compliant Standard PLC with a Server according to IEC 61850 for the comprehensive Hands-On Training in Frankfurt (Germany) on October 20-23, 2009:



The Seminar and Hands-on Training will cover all crucial aspects of the standards and common IEDs from ABB, Areva, Siemens, Omicron, Megger, ... and Beckhoff.

Click [HERE](#) for details of the program.
Click [HERE](#) for other training opportunities all over.
Click [HERE](#) for more details on the Beckhoff PLC with IEC 61850 support.

Posted by [Karlheinz Schwarz](#) at 7:02 AM 0 comments 

Labels: [61850](#), [communication](#), [electric power system](#), [IEC 61400-25](#), [IEC 61850](#), [IEC61850](#), [IED](#), [PLC](#), [process control](#), [wind turbine controller](#)

Wednesday, October 7, 2009

Australia to invest AUD 43 Billion in communication

The Australian Government and other stakeholders will invest up to **AUD 43 billion** over eight years to build and operate a National Broadband Network to bring broadband communication to Australian homes and workplaces. This infrastructure is likely being used for Smart Grid applications.

Click [HERE](#) for more details.

The Government also announced the other day investment of up to **AUD 100 million** to develop the Smart Grid, Smart City demonstration project in partnership with the energy sector in 2010.

Click [HERE](#) for more details.

Smart Grids are the future Backbones of societies ... all over. No power - no communication; no communication - no power.

Posted by [Karlheinz Schwarz](#) at [6:41 AM](#) [0 comments](#) 

Labels: [Critical Infrastructure Protection](#), [Power Automation](#), [Smart Grid](#)

Monday, October 5, 2009

IEC 61850 IED Scout version 2.10 available

Omicron has posted a new version (2.10) of the IEC 61850 IED Scout on their website for download. There is also some information available on the use cases for the tool.

Be aware that the software runs in demo mode only. If you want to see the full functionality you need a dongle from Omicron.

In case you want to see this and many other tools fully functional in action, you may attend the upcoming IEC 61850 training opportunities in Frankfurt, San Antonio, Brisbane or Sydney.

Click [HERE](#) for information on IEC 61850 training opportunities.

Click [HERE](#) to visit the Omicron web page for more details on the IED Scout.

Posted by [Karlheinz Schwarz](#) at [4:48 AM](#) [0 comments](#) 

Labels: [COMTRADE](#), [electric power system](#), [hands-on Training](#), [IEC 61850](#), [IEC61850](#), [tools](#)

Friday, October 2, 2009

German E-Energy Projects presented at IEEE PES meeting in Calgary

Standards are crucial for the success of the future electric power delivery system - in Germany, Europe, and globally. A presentation of "The German program to manage future power supply" (E-Energy program) during the IEEE PES general meeting in Calgary in July 2009 provides some details of the base architecture and technologies of the German E-Energy Projects (see last but one page for the protocol architecture).

Click [HERE](#) to download the presentation.

Posted by [Karlheinz Schwarz](#) at [11:15 PM](#) [0 comments](#) 

Labels: [61850](#), [DER](#), [IEC 61850](#), [IEC61850](#), [Smart Grid](#)

Thursday, October 1, 2009

smart grid - Smart IEDs - SMART PEOPLE

Dalibor Kladar talks on his blog about substation integration benefits and starts with the statement: "The **intelligence of power system** (PS) is concentrated in **HW/SW products for substation automation and integration**. Those products common name is - Intelligent Electronic Devices (IED). The IED is the 'building block' of SG".

A statement: "This is an IED" does not mean that the HW and SW is really intelligent. In many cases the "I" in "IED" stands for "**Ignorant**" - **Ignorant Electronic Device**.

How does the intelligence come into devices to make them intelligent? By magic? No - there are hundreds of engineers, programmers, architects, accountants, managers, ... involved one way or the other. Many smart people help to make devices and systems really intelligent - others block even interested people to get involved, to get the needed knowledge, education and skills to build and use intelligent devices and systems!

A **lack of education or knowledge** in the area of information, information exchange and configuration of systems in the domain of Smart Grid will endanger our daily need for secure electric power.

During the last 5 years I have trained some 2.000 people from more than 350 companies and from some 50 countries in the area of advanced international smart grid standards for IEDs. It is quite obvious: **smart grids** are build by **smart IEDs** - that are developed by **SMART PEOPLE** - that are trained by **other SMART PEOPLE**.

We can help smart people to learn **the benefits of standards** like DNP2, IEC 60870-6-TASE.2 (ICCP), IEC 60870-5-101/104, IEC 61850, IEC 61968/70 CIM, ... and how to build smart(er) grids.

Click [HERE](#) to get more information on **education opportunities** in Frankfurt (Oct. 20-23), San Antonio (Oct. 29-30), Brisbane (Nov. 30), Sydney (Dec. 02).

Click [HERE](#) to read the Blog of Dalibor Klador.

Posted by [Karlheinz Schwarz](#) at 7:50 AM 0 comments 

Labels: [CIM](#), [DNP3](#), [education](#), [electric power system](#), [engineering](#), [hands-on Training](#), [IEC 61850](#), [IEC 61968](#), [IEC 61970](#), [IEC61850](#), [peopleware](#), [Smart Grid](#), [Training](#)

Tuesday, September 29, 2009


100 million US Dollar for single Smart Grid Project!?

Yes! The U.S. government is spending some 4.5 billion US Dollar to smart grid development as part of the economic stimulus package. In San Diego (CA) a coalition of some 25 organizations is applying for **100 million US Dollar** of the stimulus funds! The coalition will increase renewable generation, ... store electricity and **use more sensors, communication technologies and automation** to interconnect the resources.

Click [HERE](#) to read the UCSD news release.

A portion of this money may be spend to develop several new communication solutions or it can be invested to apply available standards like DNP3, IEC 61850, ... TASE.2, BacNet.

Click [HERE](#) to get a copy of the 3rd edition of the "Comparison of IEC 60870-5-101/-103/-104, DNP3, and IEC 60870-6-TASE.2 with IEC 61850"

Posted by [Karlheinz Schwarz](#) at [11:50 PM](#) [0 comments](#) 

Labels: [DNP3](#), [IEC 61850](#), [Power Automation](#), [Smart Grid](#), [TASE.2 ICCP](#)

U.S. Smart Grid development gets support from Europe

AREVA's Transmission and Distribution division (T&D, based in France) announced the other day that it will deliver crucial components (IEDs - Intelligent Electronic Devices) to support Smart Grid research by the Electric Power Research Institute (EPRI).

AREVA provides 13 different IEDs, to be used in the Institute's labs. The devices will help EPRI to implementing the 'Smart Grid': distance protection, transformer protection, line current differential management, feeder management, phasor measurement and GPS time synchronization.

The devices provided by **AREVA and other companies**, will be used to build a small Smart Grid so that various scenarios and tests can be performed. **One of the building blocks will be the IEC 61850 process bus and station bus for system wide interoperability.**

"The goal of this project is to provide a test bed for new ideas to address the challenges facing the Smart Grid," noted Paul Myrda, Technical Executive at EPRI. *"Ultimately, we expect to couple this facility with our existing 'living lab' that primarily deals with end-user devices and with our 'Sensor' lab that is focused on **asset health assessment**."*


Smart Grids will be composed of devices, systems and tools from multiple vendors. The key issue in multi-vendor projects is the **Interoperability of all components** that provide or consume information for the many tasks.

An interoperability test lab based on the IEC 61850 station bus has been build up by STRI (Ludvika, Sweden):

Click [HERE](#) for an overview about the IEC 61850 Interoperability lab.

Click [HERE](#) for a story on "The true meaning of IEC 61850 - Interoperability!"

Click [HERE](#) to see what's next on the agenda of training for multi-vendor systems.

Posted by [Karlheinz Schwarz](#) at [10:15 PM](#) [0 comments](#) 

Labels: [Areva](#), [Automation](#), [communication](#), [condition monitoring](#), [education](#), [electric power system](#), [IEC 61850](#), [IED](#), [interoperability](#), [interoperability tests](#), [process bus](#), [protection](#), [Smart Grid](#)

Monday, September 28, 2009

E-Energy Jahreskongress 26.-27.11.2009 in Berlin

Das Bundesministerium für Wirtschaft und Technologie veranstaltet den **ersten E-Energy Jahreskongress** am Donnerstag 26.11. und Freitag 27.11. im Konferenzzentrum des BMWi in Berlin.

Mit den [E-Energy-Projekten](#) soll in Deutschland der "Durchbruch zum

intelligenten Elektrizitätssystem" (oder - wie die Angelsachsen sagen: **Smart Grid**) erreicht werden!

Laut Veranstalter "bietet der E-Energy Jahreskongress Gelegenheit, Ergebnisse, Akteure und das große Potenzial von E-Energy konkret kennenzulernen. Dem interessierten Fachpublikum bietet der Kongress die Möglichkeit, mit allen E-Energy Projektbeteiligten sowie prominenten Vertretern aus Politik, Wirtschaft und Wissenschaft zu diskutieren. Seien Sie dabei, wenn die Weichen für das Energieversorgungssystem der Zukunft gestellt werden."

Sie sollten sich unbedingt kurzfristig um eine Vorregistrierung bemühen!

Klicken Sie [HIER](#), um zum Programm und zur Anmeldeseite zu gelangen.

Posted by [Karlheinz Schwarz](#) at [11:44 AM](#) [0 comments](#) 

Labels: [E-Energy](#), [electric power system](#), [Smart Grid](#)

Friday, September 25, 2009

Security measures for IEC 60870-5-101 and -104

The standards IEC 60870-5-101 and -104 are in use for many years and will be applied during the next years. The security measures of these protocols need to be improved to meet the market requirements. These standards are used for the communication between control centers and underlying systems like substations or power plants.

A New Work Item (**Security Extensions to IEC 60870-5-101 and IEC 60870-5-104 protocols**; IEC document 57/1029/NP) has been proposed to apply the just published Technical Specification IEC 62351-5 for 101 and 104: The ballot for the NWP closes 2009-12-11. If you are interested to join that work, please contact your [national committee of the IEC TC 57](#).

IEC/TS 62351-5 Ed. 1.0 - Power systems management and associated information exchange - Data and communications security - Part 5: Security for IEC 60870-5 and derivatives

Click [HERE](#) for a preview of IEC/TS 62351-5.

Telecontrol equipment and systems – **Part 5-101**: Transmission protocols - Companion standard for basic telecontrol tasks

Click [HERE](#) for a preview of -101.

Telecontrol equipment and systems – **Part 5-104**: Transmission protocols – Network access for IEC 60870-5-101 using standard transport profiles

Click [HERE](#) for a preview of -104.

Posted by [Karlheinz Schwarz](#) at [11:48 PM](#) [0 comments](#) 

Labels: [control center](#), [IEC 60870-5-101](#), [IEC 60870-5-104](#), [security](#)

Thursday, September 24, 2009

First Release of the NIST Framework and Roadmap for Smart Grid Interoperability Standards

Commerce Secretary Gary Locke today (2009-09-24) unveiled an accelerated plan for developing standards to transform the U.S. power distribution system into a secure, more efficient and environmentally friendly Smart Grid and create clean-energy jobs.

The NIST Draft Publication **"NIST Framework and Roadmap for Smart Grid Interoperability Standards Release 1.0 (Draft)"** published by the Office of the U.S. National Coordinator for Smart Grid Interoperability" is the result of **thousands of working-hours** of **hundreds of smart people** from many states and countries.

Smart Grids will be build on standards. The most crucial standards are required for the following areas:

- Demand Response and Consumer Energy Efficiency
- Wide Area Situational Awareness
- Electric Storage
- Electric Transportation
- Advanced Metering Infrastructure
- Distribution Grid Management
- Cyber Security
- Network Communications

NIST found that the market has reached already consensus on 16 standards. After review of this list, there are now 31 standards understood as crucial for the smart grid. Many crucial IEC standards like standards from IEC TC 57: IEC 60870-6 (TASE.2), IEC 61850, IEC 61969/61970 (CIM), IEC 62351; IEC TC 65: IEC 62541; other committees: ISO/IEC 15045, ISO/IEC 15067, ISO/IEC 18012, ... are members of the list of the 31 standards!

The experts identified some 70 gaps in the list of standards. 14 gaps have been identified as MOST CRUCIAL to be solved:

"For each, an action plan has been developed, specific organizations tasked, and aggressive milestones in 2009 or early 2010 established. One action plan has already been completed. The Priority Action Plans and targets for completion are (**in bold** = impact from/on standards of IEC TC 57):

1. Smart meter upgradeability standard (completed)
2. Common specification for price and product definition (early 2010)
3. Common scheduling mechanism for energy transactions (year-end 2009)
4. **Common information model for distribution grid management (year-end 2010)**
5. **Standard demand response signals (January 2010)**
6. **Standard for energy use information (January 2010)**
7. **IEC 61850 Objects / DNP3 Mapping (2010)**
8. **Time synchronization (mid-2010)**
9. **Transmission and distribution power systems models mapping (year-end 2010)**
10. **Guidelines for use of IP protocol suite in the Smart Grid(mid-year2010)**
11. **Guidelines for use of wireless communications in the Smart Grid (mid-year 2010)**
12. **Electric storage interconnection guidelines (mid-2010)**
13. **Interoperability standards to support plug-in electric vehicles (December 2010)**
14. **Standard meter data profiles (year-end 2010)**

Click [HERE](#) to read the press release of today (2009-09-24).

Click [HERE](#) to download the 90 page Draft Release 1.0 of the NIST Framework and Roadmap for Smart Grid Interoperability Standards

With that official Draft it is confirmed that crucial international Standards published by IEC TC 57, TC 65, and TC 88 are key for the sustainable interoperability of smart devices and smart systems in smart grids - developed by smart people.

Click [HERE](#) for a discussion on the availability of smart people.

Posted by [Karlheinz Schwarz](#) at [12:26 PM](#) [0 comments](#) 

Labels: [61850-7-420](#), [Automation](#), [CIP](#), [communication](#), [Critical Infrastructure Protection](#), [DER](#), [distribution automation](#), [electric power system](#), [electric vehicles](#), [IEC 61400-25](#), [IEC 61850](#), [IEC 61850-7-420](#), [IEC 61968](#), [IEC 61970](#), [IEEE 1588](#), [interchangeability](#), [interoperability](#), [interoperability tests](#), [Multispeak](#), [NIST](#), [OPC](#), [peopleware](#), [Power Automation](#), [standards](#), [sustainable interoperability](#)

[Newer Posts](#)

[Home](#)

[Older Posts](#)

Subscribe to: [Posts \(Atom\)](#)

News on IEC 61850 and related Standards

Daily news concerning the standards IEC 61850, IEC 61400-25, IEC 61970 (CIM), IEC 60870-5, ...

Saturday, September 19, 2009

What do you expect from Smart(er) Grids?

Saifur Rahman has summarized in the September 2009 issue of the IEEE "power & energy" magazine what experts believe could be expected from Smart(er) Grids.

In the first paragraph he states: "The term "smart grid" is almost becoming a household name. From the U.S. president talking about the smart grid to television commercials on this topic, we have a plethora of activities around the world where engineers, policy makers, entrepreneurs, and businesses have shown a keen interest in various aspects of this technology. There are smart-grid-related funding opportunities, projects, seminars, conferences, and training programs going on in Europe, the United States, Japan, and China to name a few." There are millions of Dollars, Euro, ... waiting for "smart" managers to be spend by "smart" engineers.

Mr. Rahman's view on what is required for a Smart(er) distribution Grid is the implementation of:

- Automated Meter Reading
- Security and Privacy Issues
- Advanced Communication Infrastructure and Cybersecurity
- Ineroperability standards
- Greening of the Grid
- Business Model for Customer Level Integration

He asks, what is next? The answer is: "

I can see many nonutility players entering this smart-grid market and attempt to provide solutions. For example, many **computer networking companies** have plans to deliver an end-to-end, highly secure network infrastructure that helps utility customers take the most advantage of energy efficiency, demand reduction, and the integration of renewable energy sources in their homes and businesses. The end result may not be cost reduction but more value for the money spent and an environmentally friendly power grid."

Click [HERE](#) to read the view of Saifur Rahman as published in the IEEE "power & energy" magazine.

I took a photo of an interesting ad by IBM at the Berlin Tegel Airport (Germany) on 2009-09-15:


Subscribe To IEC 61850 News

 Posts 

 All Comments 

Blog Archive

- [2012](#) (11)
- [2011](#) (159)
- [2010](#) (153)
- ▼ [2009](#) (162)
 - [December](#) (4)
 - [November](#) (11)
 - [October](#) (17)
 - ▼ [September](#) (16)
 - [100 million US Dollar for single Smart Grid Projec...](#)
 - [U.S. Smart Grid development gets support from Euro...](#)
 - [E-Energy Jahreskongress 26.-27.11.2009 in Berlin](#)
 - [Security measures for IEC 60870-5-101 and -104](#)
 - [First Release of the NIST Framework and Roadmap fo...](#)
 - [What do you expect from Smart\(er\) Grids?](#)
 - [IEC 61850 and IEC 61400-25: How to report errors, ...](#)
 - [PSI supports TASE.2 and CIM](#)
 - [Embedded controller exposes electric](#)

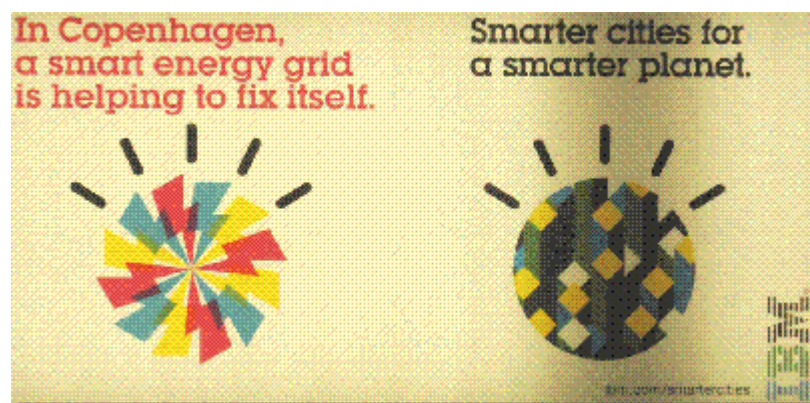

What I see allover is that ICT (information and communication technology) is meeting the power distribution world. BUT: Where are the utility (automation and protection) experts that can understand the impact of ICT on the availability and stability of the grid? There is not much automation implemented in distribution networks today. So, the ICT companies will provide smart solutions for a market that uses very little automation. Usually ICT experts know the "I" and "C" in ICT very well - but the distribution grid is mainly a huge electrical system between the already smart transmission grid and many users.

I hope that the people in charge for the distribution grids have a good understanding of the real-time electrical network! The electrical grid is quite different compared to a business dealing with bananas, orange juice or books.

Smart(er) Distribution Grids require first smart (electrical) engineers! There are smart engineers for the transmission grid ...

Click [HERE](#) for some information regarding the **Lack of Power Engineers - A Risk for Smart Grids**.

Posted by [Karlheinz Schwarz](#) at 2:37 AM 0 comments 

Labels: [Automation](#), [Critical Infrastructure Protection](#), [distribution](#), [electric power system](#), [engineering](#), [Power Automation](#), [Power Plants](#), [process control](#), [Smart Grid](#), [US president](#)

Friday, September 18, 2009

IEC 61850 and IEC 61400-25: How to report errors, missing definitions or ambiguities

Standards like IEC 61850 and IEC 61400-25 are no exception when it comes to errors, missing definitions or ambiguities in the published documents. Most issues (called TISSUES - Technical issues) with regard to the first 14 parts have been solved during the last years. The edition 2 of the standard will be a "clean" version.

Recently new parts like IEC 61850-7-410 (Hydro Power extensions), IEC 61850-7-420 (DER extensions) and the standard series IEC 61400-25 (Wind Power extensions) have been published.

Click [HERE](#) if you have a TISSUE to report on IEC 61850-7-410 (Hydro)

Click [HERE](#) if you have a TISSUE to report on IEC 61850-7-420 (DER)

Click [HERE](#) if you have a TISSUE to report on IEC 61400-25 (Wind)

Before you post a new tissue you may first check if it has already been posted.

[measurements ...](#)

[Paper on IEC 61850 and IEC 61400-25 accepted for D...](#)

[Beckhoff's TwinCAT supports IEC 61850](#)

[SystemCorp \(Perth, Australia\) offers new IEC 61850...](#)

[etz-Report 34 \(IEC 61850\) als E-Book erhältlich](#)

[IEC 61850-6 \(SCL\) - Final ballot on Configuration ...](#)

[Interoperable Standards for Smart Grid: US\\$ 8.5 mi...](#)

[IEC 61850 Hands-on Training in Brisbane and Sydney...](#)

- ▶ August (18)
- ▶ July (11)
- ▶ June (9)
- ▶ May (25)
- ▶ April (11)
- ▶ March (16)
- ▶ February (11)
- ▶ January (13)

▶ 2008 (82)

Contributors

[Karlheinz Schwarz](#)

[Michael Schwarz](#)

Posted by [Karlheinz Schwarz](#) at 1:26 AM 0 comments 

Labels: [IEC 61400-25](#), [IEC 61850](#), [IEC 61850 edition 2](#), [IEC 61850-7-410](#), [IEC 61850-7-420](#), [tissues](#)

Thursday, September 17, 2009

PSI supports TASE.2 and CIM

PSI reports in the latest Magazine "energie manager" (1/2009) that they deliver a SCADA and DMS system for Enexis (Netherlands) supporting TASE.2 for inter-control center communication (IEC 60870-6) and CIM (Common Information Model, IEC 61968/70) for information exchange in the control center.

TASE.2, CIM along with IEC 61850 are crucial international standards published by [IEC TC 57](#) "Power systems management and associated information exchange" and used in utilities (Electric, Gas, Oil, ...). The scope of the IEC TC 57 is "To prepare international standards for power systems control equipment and systems ...". Power systems means **electric power** systems. So, how can you use these standards, e.g., for the Gas applications? IEC stands for "International Electrotechnical Commission". So the scope is to prepare and publish International Standards for all **electrical, electronic and related technologies**.

It is somehow "forbidden" to claim that IEC standards like IEC 61850 are applicable for **any other control equipment and systems outside the electrical world**. BUT - from a technical point of view -: IEC 61850 could be understood as a framework of (extensible) information models, information exchange methods, and configuration language for devices and systems in many application domains. The first edition of the standard models did not provide a model for a rotor - because substations do not have rotors. We extended the information models for wind turbines (published under IEC 61400-25). So, you can define (or standardize in another organization) an object for "**Gas pressure**" ... and use the whole communication and configuration infrastructure available for substation automation - and vice versa.

Some people (that do not like these standards) argue against their applications outside the electric world by saying: "You can not use these IEC standards, because their scope is restricted to the electric world." Fortunately, technical solutions based on these standards do not care about what some people say!

Click [HERE](#) to search for CIM related blog entries of this blog.

Click [HERE](#) to read a brochure on IEC 61400-25 [pdf]

Click [HERE](#) to read a paper on IEC 61850, IEC 61400-25 and CIM [pdf]

Posted by [Karlheinz Schwarz](#) at 10:45 PM 0 comments 

Labels: [applications](#), [Automation](#), [communication](#), [control center](#), [electric power system](#), [IEC 61400-25](#), [IEC 61850](#), [Power Automation](#), [SCADA](#), [Substation Automation](#), [wind power](#)

Embedded controller exposes electric measurements through IEC 61850


A new, easy to install embedded device for electrical measurements provides crucial information on the status of the power system through the following information in (or near) real-time by an IEC 61850


Server:

- Voltage L1 true RMS
- Voltage L2 true RMS
- Voltage L3 true RMS
- Current L1 true RMS
- Current L2 true RMS
- Current L3 true RMS
- Instantaneous Real Power
- Instantaneous Reactive Power
- Grid Frequency Power Angle (Cos Phi)



The IEC 61850 Server (build into the box shown above) provides the crucial MMXU Logical Node (3 phase Measurements) and COMTRADE formatted files of the values. The Server's Information model is shown below:

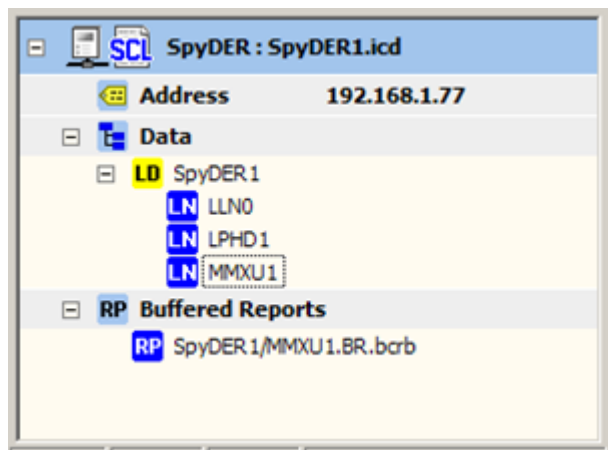

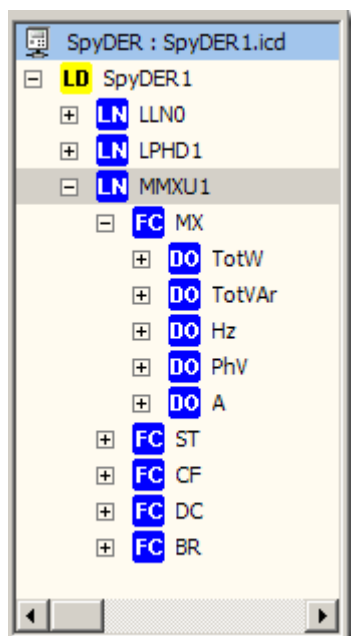

This Information model is derived from the real device (the server implemented at the device) via IEC 61850 self-description services. The model could be converted to an SCL file (according to IEC 61850-6):

```
<?xml version="1.0" encoding="UTF-8" ?>
- <SCL xmlns="http://www.iec.ch/61850/2003/SCL"
  xmlns:xsi="http://www.w3.org/2001/XMLSchema-instance"
  xsi:schemaLocation="http://www.iec.ch/61850/2003/SCL SCL.xsd">
  <Header id="E-Energy" nameStructure="IEDName" />
  + <Communication>
  - <IED name="SpyDER" type="" manufacturer="" configVersion="">
  + <Services>
  - <AccessPoint name="P1">
  - <Server>
    <Authentication none="true" />
  - <LDevice inst="1">
    + <LN0 InType="LLN0_0" InClass="LLN0" inst="">
    + <LN InType="LPHD_0" InClass="LPHD" prefix="" inst="1">
    - <LN InType="MMXU_0" InClass="MMXU" prefix="" inst="1">
      + <ReportControl name="bcrb" datSet="" intgPd="5000"
        rptID="SpyDER1/MMXU1$bcrb" confRev="1" buffered="true"
        bufTime="1000">
      + <DOI name="Mod">
      - <DOI name="NamPlt">
        - <DAI name="vendor">
          <Val>Quare Novum Enterprises</Val>
        </DAI>
        - <DAI name="swRev">
          <Val>1.06</Val>
        </DAI>
        - <DAI name="d">
          <Val>High accuracy measurement and power flow supervision
            of 3 phase system with a frequency of 6 values per
            second</Val>
        </DAI>
      </DOI>
    </LN>
  </LDevice>
  </Server>
  </AccessPoint>
  </IED>
  - <DataTypeTemplates>
    + <LNNodeType id="LLN0_0" InClass="LLN0">
    + <LNNodeType id="LPHD_0" InClass="LPHD">
    - <LNNodeType id="MMXU_0" InClass="MMXU">
      <DO name="Mod" type="INC_1" />
      <DO name="Beh" type="INS_0" />
      <DO name="Health" type="INS_1" />
      <DO name="NamPlt" type="LPL_0" />
      <DO name="TotW" type="MV_0" />
      <DO name="TotVAr" type="MV_0" />
      <DO name="Hz" type="MV_0" />
      <DO name="PhV" type="WYE_0" />
      <DO name="A" type="WYE_0" />
    </LNNodeType>
```

A complete Substation Specification (.ssd and .scd file) according to IEC 61850-6 would provide also how the Information model is bound to the real electrical installation, e.g., where is the measurement taken etc.

The complete description contained in the SCL file could be used by any system (Gateway, SCADA database, ...).

Further information models (calculated in an application or from the physical input/output terminals) can be implemented. The platform could be used for many applications in power systems and other domains.

[ONE \(Oldenburg/Germany\)](#) is active in the domain of Smart Metering, Embedded Real-Time HW/SW Systems, SCADA, Analog and Digital Transducers, Technology Consulting, Research & Development

Click [HERE](#) to read a two page flyer [pdf].

Posted by [Karlheinz Schwarz](#) at [12:48 AM](#) [0 comments](#) 

Labels: [communication](#), [COMTRADE](#), [configuration](#), [electric power system](#), [engineering](#), [IEC 61400-25](#), [IEC 61850](#), [monitoring](#), [SCL](#), [Smart Grid](#)

Friday, September 11, 2009


Paper on IEC 61850 and IEC 61400-25 accepted for DistribuTech 2010

The abstract "MONITORING OF POWER SYSTEM AND COMMUNICATION INFRASTRUCTURES BASED ON IEC 61850 AND IEC 61400-25" (by Karlheinz Schwarz) has been accepted for presentation at the DistribuTech 2010 (Tampa, FL, USA).

The focus of the first edition of IEC 61850 was on substation operational aspects (mainly protection and control). Various groups have identified that IEC 61850 is the basis of further applications, e.g., monitoring of functions, processes, primary equipment, and the communication infrastructure in substations and other power system application domains. The second edition and other extensions provide new definitions to keep the high quality and availability of power systems, to reduce commissioning time and life cycle costs.

Track Assignment: Enterprise Information and Asset Management
Session Assignment: Case Studies of Advanced Applications Extending Benefits of Automation & Control Data
Date: 2010-03-24 (Wednesday)
Time of session: 9:30 AM
Type of Session: paper

Click [HERE](#) for the abstract.

Posted by [Karlheinz Schwarz](#) at [10:57 PM](#) [0 comments](#) 

Labels: [condition monitoring](#), [Critical Infrastructure Protection](#), [IEC 61400-25](#), [IEC 61850](#), [maintenance](#), [wind turbine controller](#)

Monday, September 7, 2009

Beckhoff's TwinCAT supports IEC 61850

Beckhoff opens up new opportunities by implementing this communication protocol in a software PLC: The user can use a cost-effective standard PLC for controlling his electrical installation, which not only offers the benefits of PC-based control technology but can also communicate externally via the IEC 61850 compliant communication. The basic standard defines a general transmission protocol for protective and control equipment in medium and high voltage electrical

substations. This means that time-consuming and costly special developments for the implementation of manufacturer-specific protocols are no longer required, and the associated engineering is simplified significantly.

Customers can utilize the complete communication stack developed by Beckhoff in the form of a PLC library.

As extension to the basic IEC 61850 standard, IEC 61400-25 defines the communication requirements for monitoring and controlling wind turbines. The integration of this standard into the TwinCAT library will simplify the control of heterogeneous wind farms significantly. The wind farm standard is characterized by a single wind power-specific dataset, so that TwinCAT users can use TcIEC61850Server.lib for communication purposes and TcIEC61400_25.lib for specific logical nodes and common data classes.

Click [HERE](#) for a two page brochure in English.

Click [HERE](#) for a two page brochure in German.

The TwinCat solution will be used during the next **Hands-on Training** in Frankfurt (Germany) on October 23, 2009.

Click [HERE](#) for the program of the training in Frankfurt.

Posted by [Karlheinz Schwarz](#) at [6:30 AM](#) [0 comments](#) 

Labels: [communication](#), [IEC 61400-25](#), [IEC 61850](#), [interoperability](#), [PLC](#), [Power Plants](#), [wind power](#)

SystemCorp (Perth, Australia) offers new IEC 61850 IEDs

The IEC 61850 software stack PIS-10 accommodates client and server functionality. It is portable across various software platforms. Data throughput and other Ethernet related performance criteria are inherited from the operating system.

The stack supports MMS, GOOSE, Sampled Value functionality as well as buffered and unbuffered reporting. Data sets are defined using the WebCAN Designer Studio configuration software.

Protocol conversation from other SCADA protocols such as IEC 8750-5-10 or DNP3.0 require only the additional executable files to be downloaded and configured through WebCAN Designer Studio.

Products:

- Portable IEC 61850 Client and Server Software Stack PIS-10
- Fully Integrated Single Chip Solution IPC-10
- Compact Protocol Converter CFE-40
- Distribution Remote Terminal Unit MRU-10
- WebCAN Substation RTU and Data Gateway
- WebCAN Designer Studio Configuration Tool

Platforms:

- Microsoft Windows XP, 2003/2008 and Vista
- Ubuntu Linux (x86,x86-64)
- Embedded Linux (ARM, Coldfire)
- **Beck @Chip SC1x3 RTOS**
- Other platforms available on request

Click [HERE](#) for a two page description [pdf].

Posted by [Karlheinz Schwarz](#) at [6:23 AM](#) [0 comments](#)



Labels: [Australia](#), [communication](#), [configuration](#), [electric power system](#), [en](#), [IEC 61850](#), [IED](#), [RTU](#)

etz-Report 34 (IEC 61850) als E-Book erhältlich

Der etz Report 34 "Offene Kommunikation nach IEC 61850 für die Schutz- und Stationsleittechnik", 2004, 159 Seiten, DIN A4 ist jetzt auch als E-Book erhältlich:



Click [HIER](#), um das Vorwort zu lesen.

Click [HIER](#) für weitere Informationen zum E-Book (Inhalt, Bestellung, ...).

Posted by [Karlheinz Schwarz](#) at [2:28 AM](#) [0 comments](#)

Labels: [de](#), [IEC 61850](#), [schutztechnik](#), [Stationsleittechnik](#)

Saturday, September 5, 2009

IEC 61850-6 (SCL) - Final ballot on Configuration Language Edition 2

The most crucial part of the **second edition** of IEC 61850 "Communication networks and systems for power utility automation" - Part 6 "Configuration description language for communication in electrical substations related to IEDs" is available for **final (FDIS) Ballot until November 06, 2009**. This is the first part of Edition 2 that is out for Ballot.

The new edition fixes some technical issues of the first edition. Extensions are based on changes in other parts, e.g., Part 7-2 and 7-3; the engineering process, especially for configuration data exchange between system configuration tools, has been added.

Contact your [national TC 57 committee](#) for a copy if you want to do a final check of the document. The files distributed by IEC contain all xml schema files etc. needed to create and interpret SCL files.

Example [SCL file from AREVA](#) (.icd file), Edition 1 compliant.

Note that the **SCL (Substation Configuration Language)** would be better named: **System Configuration Language**. Main parts of the standard can be used for many other application domains. Any information that can be modeled with Logical Nodes and Data Objects according to IEC 61850 rules, can be used as domain specific "words".

The communication of these "words" from a "sender" (Server and Publisher) to a "receiver" (Client and Subscriber) can be described in SCL. The communication may be realized with MMS (Client/Server), or GOOSE and SMV (Publisher/Subscriber).

The new "words" may be a **"Fish Counter"** in a hydro power plant or a **"Bird Counter"** in a wind turbine. SCL can describe (without any modification) that a device (Server) provides this information and that it can automatically be communicated by IEC 61850 reporting to another computer (Client) every day or be stored locally in an IEC 61850 log. The CSL file can be used to automatically configure the server and/or the client!

Posted by [Karlheinz Schwarz](#) at 8:54 AM [2 comments](#) 

Labels: [communication](#), [configuration](#), [electric power system](#), [engineering](#), [icd file](#), [Areva](#), [IEC 61850](#), [IEC61850](#), [MMS](#), [Power Automation](#), [SCL](#), [wind turbine controller](#)

Thursday, September 3, 2009

Interoperable Standards for Smart Grid: US\$ 8.5 million for two year support to get there

The Smart Grid in the U.S. (and all over!) relies on **information and networking technologies** to allow **advanced control** and **communication** capabilities. "It is a key component of President Obama's plans to achieve energy independence and to address climate change.", according to [NIST](#).

NIST has awarded EnerNex (based in Knoxville, TN, USA) to help in developing "Smart Grid interoperability standards" and helping in standards "harmonization effort". Under the **US\$ 8.5 million contract**, [EnerNex will help NIST](#) during the next two years to reach a higher level of [interoperability of systems and devices](#) needed for a smart(er) electric power delivery system.

Many people in charge of the U.S. power delivery system - obviously - have understood the importance of a sustainable Interoperability in the utility domain.

Two crucial "interoperability projects" have been run by EPRI many years ago: UCA 1.0 and UCA 2.0. The UCA 2.0 was taken over by IEC TC 57 as the foundation of IEC 61850 and IEC 61400-25. The GREAT cooperation between the North American experts and experts from all over has let to the BIG success of UCA 2.0 - which is (of course) now IEC 61850.

Click [HERE](#) for a comparison of UCA 2.0 and IEC 61850.


I would appreciate if the history would repeat: The development of the many standards for a SMART(er) GRID will be done **by international cooperation for a global market!!** The need for smarter systems is an **international requirement** - to the good of human beings and the nature - in Russia, Germany, USA, Australia, ... Smart experts at TERNA (the Italian TSO) have already started to make the Italian Transmission Grid smarter with IEC 61850:



... and some 350 Indian experts have been trained on IEC 61850 in a [three day event in Bangalore](#):



And how are you getting involved? With the help of real experts you can speed up your knowledge in international smart grid standards very fast - ask the right experts during the upcoming IEC 61850 events in [Frankfurt](#), [San Antonio](#), [Nürnberg](#), [Brisbane and Sydney](#), ...

Posted by [Karlheinz Schwarz](#) at [12:07 PM](#) [0 comments](#) 

Labels: [education](#), [IEC 61850](#), [interoperability](#), [interoperability tests](#), [Obama](#), [seminar](#), [Smart Grid](#), [standards](#), [Transmission Grid](#), [UCA](#)

Wednesday, September 2, 2009

IEC 61850 Hands-on Training in Brisbane and Sydney (Australia) confirmed

The final program, locations, and dates for **two 3 day events in Australia** are now confirmed:

Brisbane (Australia): 30 November - 02 December 2009

Sydney (Australia): 02-04 December 2009

According to feedback from interested experts we have modified the program to have more practical exercises (1 1/2 days theory and 1 1/2 hands-on training with real IEDs).

Click [HERE](#) for the **final program, registration form and other details** [pdf].


Please note that the event in Brisbane is almost sold out. Several seats are available for the Sydney event.

We are confident, that our experience and service will meet all your

expectations! You'd get first-hand, very comprehensive, vendor neutral and up-to-date knowledge, experience, and guidance; learn how to reach interoperability of devices; You'd get best advice - for the best price.

I look forward to seeing you down under later this year.

Please feel free to forward this email to any colleagues who you think might be interested in the event.

Posted by [Karlheinz Schwarz](#) at [12:27 PM](#) [0 comments](#) 

Labels: [Australia](#), [communication](#), [condition monitoring](#), [DNP3](#), [education](#), [electric power system](#), [engineering](#), [Ethernet](#), [hands-on Training](#), [IEC 61400-25](#), [IEC 61499](#), [IEC 61850](#), [interoperability](#), [Power Automation](#), [seminar](#)

Saturday, August 29, 2009

Technical Report IEC 61850-90-1 accepted

The Draft Technical Report "Communication networks and systems for power utility automation - Part IEC 61850-90-1: Use of IEC 61850 for the **communication between substations**" has been positively balloted.

The Technical report will be [published on Sept 15, 2009](#).

Click [HERE](#) for a list of applications contained in part IEC 61850-90-1.

Posted by [Karlheinz Schwarz](#) at [3:29 AM](#) [0 comments](#) 

Labels: [IEC 61850](#), [Substation](#), [Substation Automation](#), [telecommunication](#)


Sunday, August 23, 2009

Vendor-independent IEC 61850 Hands-on Training at Itaipu (Brazil)

To gain vendor-independent knowledge and experience is one of the crucial steps towards the implementation of IEC 61850 based multi-vendor projects. Itaipu (Brazil) has trained their substation experts in two courses. A comprehensive seminar at Itaipu was conducted in 2007 (Christoph Brunner and Karlheinz Schwarz). The hands-on training by STRI (Ludvika, Sweden) was run onsite in Itaipu last week ([brief report in Portuguese](#)).

The interoperability of IEDs (intelligent electronic devices) from different manufacturers needs to be tested. Experts have to understand the **standardized functions AND restrictions** build into the IEDs. How do IEDs use the standard? What are the constraints of limited resources in an IED? What are the functions (Reverse blocking, Auto reclosing, Switching with synchrocheck, Earthfault detection, ...) that use IEC 61850 and how are they using the standard?

STRI and NettedAutomation provide [comprehensive education](#) from understanding the Standards and Training with real IEDs - You'll get first-hand, very comprehensive, **vendor neutral** and up-to-date knowledge, experience, and guidance. You'll learn how to reach interoperability of devices.

Posted by [Karlheinz Schwarz](#) at [10:08 PM](#) [0 comments](#) 

Labels: [hands-on Training](#), [IEC 61850](#), [interoperability](#), [interoperability tests](#), [Power Automation](#), [Substation Automation](#)

Saturday, August 22, 2009

Interoperability in the context of IEC 61850

There are many efforts underway to define or extend standards that allow or support Interoperability between devices in the electric power delivery system. IEC 61850 is one of the crucial standards that is understood as to meet basic requirements.


According to the "EICTA [White Paper](#) on Standardization and Interoperability, Brussels, November, 2006 (page 4)" Interoperability is defined as follows:

"The **capability** of two or more networks, systems, **devices**, applications, or components to **exchange information between them** and to **use the information so exchanged**."

What does this all mean for the application of IEC 61850? Currently there are some problems with the interoperability of real devices implementing one or the other option of IEC 61850. That is the challenge: Which option do the devices use that are intended to be interoperable?

We have to differentiate interoperability on different levels: physical, syntactical, services, devices, ... functions. In the following we will briefly focus on services and devices [Note: This discussion just points to the general issue of options; details on interoperability issues are presented and discussed during the seminars of [NettedAutomation GmbH \(Karlsruhe/Germany\)](#)].

The following slide summarizes some option of what Interoperability could mean for a simple use case. The **Purpose** of the use case is: *Monitor the Temperature (Tmp) and figure out when the Tmp exceeds the Limit (Lim)*. There are two devices involved (Client and Server). Depending on the functional distribution of the monitoring function (located in the client or in the server) we can use one or the other Service of IEC 61850. In the case of Services A and B we assume that the purpose is to implement the monitoring function in the client. In the other two cases (C and D) we assume that the monitoring function is provided by the device that acts as server.

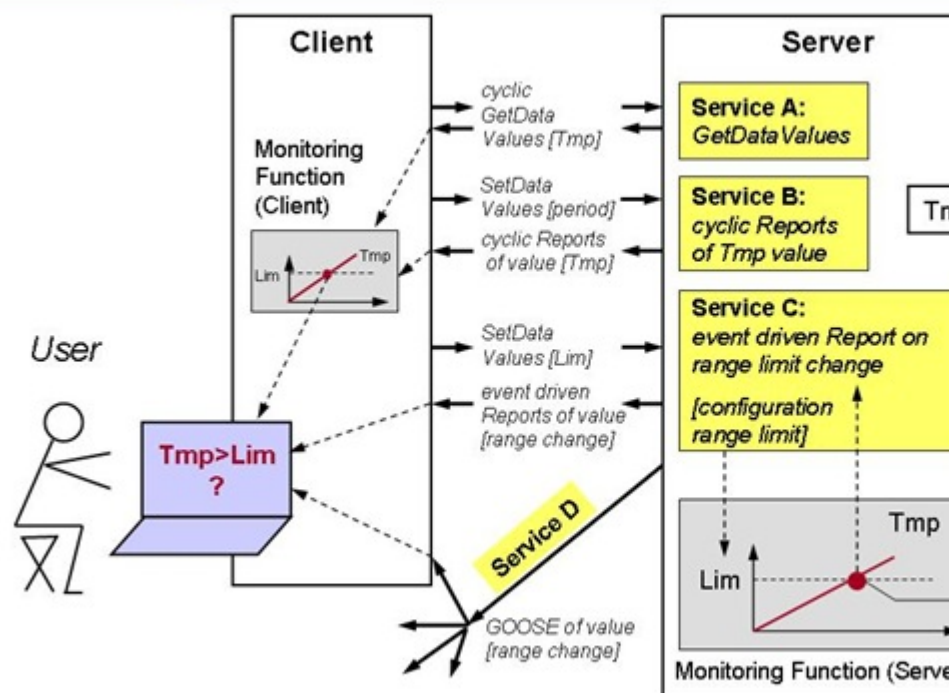

The four services (associated with the functional distribution) are quite different. Once the "user" (usually the system integrator) of the client and the "user" of the server HAVE DECIDED WHICH APPROACH (A, B, C, or D) to use then we could talk about interoperability. **IEC 61850 DOES NOT constrain which approach to use.** IEC 61850 is scalable - that means YOU HAVE TO make decisions how to scale! Which option to use!

The **IEC 61850 services** do not constrain the behavior of an IEC 61850 client **application process**, except with respect to **valid sequences of service primitives**. Therefore a model of the IEC 61850 client application process is not (!) provided in the current standard.

If the two "users" decide to use the option with Service A then we could define, what is required to make the client and server interoperable. This is defined in IEC 61850 for all approaches shown in the figure.

Challenges with regard to interoperability are here: The "users" of both devices DO NOT define the exact approach (to use an approach with Service A or B, C, or D). **Just to expect that the vendors have implemented ALL approaches is dangerous: Usually the vendors implement the mandatory (M) requirements - which could also be translated to M=Minimum! Two devices conformant with IEC 61850(with a Certificate) may or may not interoperate! Depending on the functional distribution and the services provided and used.**

Non-Interoperability could have many reasons:

1. Client and server might implement only a subset of the full specification. In some cases, there may be a mismatch in what features are supported, where one system sends a message that the other cannot process.
2. The IEC 61850 specification makes certain things optional. If one implementation assumes that specific information will exist on messages

it receives, it may not interoperate with another implementation that chooses not to send that information.

3. Two implementers may interpret parts of the standard, where the language of the specification is ambiguous.


4. Finally, implementers may simply have bugs in their implementation that do not show up during standalone testing. Such bugs may also contribute to interoperability problems when two different implementations attempt to hook together.

To make devices interoperable requires (among other requirements) that the "users" of two devices specify exactly the distribution of the (application) functionality and which service to use for that functionality!

This specification (and the discussion of the involved people) is mainly outside of the standardization work. Some hints on the modeling approach (not that much on the use of services) will be given in new documents to be published by IEC, e.g., IEC 61850-7-510:

Hydroelectric power plants – Modeling concepts and guidelines. This Technical Report is intended to provide explanations on how to use the Logical Nodes defined in IEC 61850-7-410 as well as other documents in the IEC 61850 series to model complex control functions in power plants.

Example of working draft of IEC 61850-7-510 (2009-08) - Excitation function:

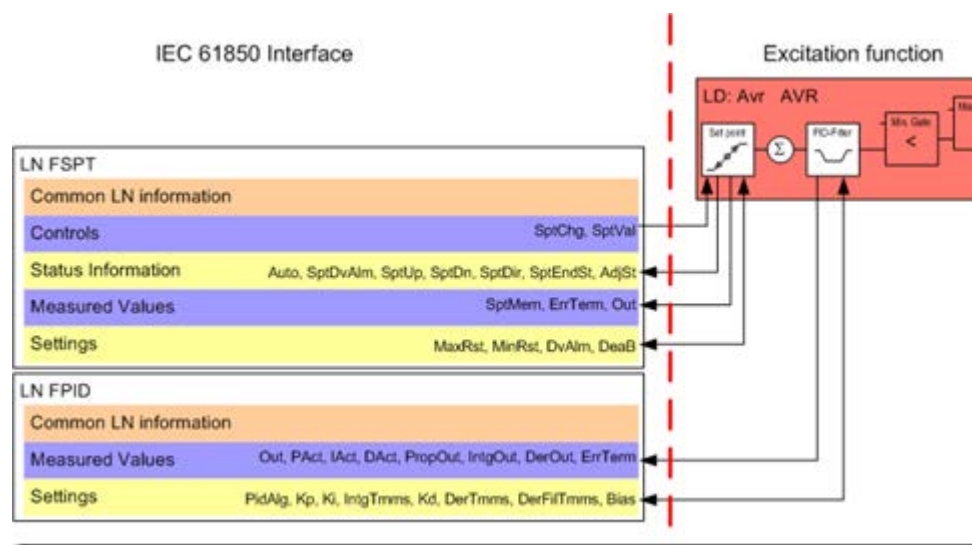

The document will provide general use cases of the models defined in IEC 61850-7-410.

Sustainable Interoperability of devices is a crucial challenge in the domain of Power Automation systems.

Posted by [Karlheinz Schwarz](#) at 1:30 AM 2 comments

Labels: [Automation](#), [communication](#), [condition monitoring](#), [distribution automation](#), [education](#), [electric power system](#), [GOOSE](#), [IEC 61400-25](#), [IEC 61850](#), [IEC 61850-7-410](#), [implementation](#), [interoperability](#), [interoperability tests](#), [models](#), [monitoring](#), [Power Automation](#), [Smart Grid](#)

Tuesday, August 18, 2009

Revised Input to NIST Interoperability Roadmap available

The input from EPRI to NIST was out for public review until end of July 2009. The team has received 83 comments that have been used to revise the EPRI input to NIST.


Many IEC Standards are referenced in the document: IEC 61968/70 (CIM), IEC 61850, IEC 61400-25, IEC 61499, ...

Click [HERE](#) to download the Report to NIST on the Smart Grid Interoperability Standards Roadmap **After Comments were addressed** [pdf].

Click [HERE](#) to download the **Consolidated Comments** August 10, 2009 [pdf].

Click [HERE](#) to check **results of the Workshop**, August 3-4, 2009.

Click [HERE](#) to check the **latest Priority Action Plans** (PAPs) that has been updated on August 10; after the August 3-4, 2009, Workshop.

Posted by [Karlheinz Schwarz](#) at [10:37 PM](#) [1 comments](#) 

Labels: [CIM](#), [CIP](#), [electric power system](#), [IEC 61400-25](#), [IEC 61850](#), [IEC 61968](#), [IEC 61970](#), [interoperability](#), [standards](#)

Friday, August 14, 2009

IEC 61131-3 SPS-Programmierung und IEC 61850

Zunehmend findet IEC 61850 Eingang in die Welt der Steuerungen. Neben anderen namhaften deutschen Herstellern hat jetzt auch WAGO (Minden) einen IEC-61850-Server in die Steuerungssoftware integriert.

Aufbauend auf der Codesys Version 3 bietet WAGO eine IEC-61850-Bibliothek an, mit der die Vorteile der Objektorientierung unter Verwendung der Objektmodelle der Normenreihe IEC 61850 und IEC 61400-25 genutzt werden können.

Click [HIER](#) für eine einseitige Einführung in IEC 61850 und IEC 61400-25 [pdf]

Click [HIER](#) für einen weiterführenden Artikel zur WAGO-Lösung im Heft 8-2009 der Zeitschrift *Computer & Automation*.


Im Artikel wird noch davon ausgegangen, dass IEC 61850 **nur eine Abbildung** der Objekte und Kommunikation unterstützt: [MMS \(Manufacturing Message Specification, ISO 9506\)](#). Seit einem Jahr gibt es eine internationale Norm mit weiteren Abbildungen: IEC 61400-25-4:

IEC 61400-25 umfasst die folgenden fünf Abbildungen:

- SOAP-based web services,
- a mapping to OPC/XML-DA,
- a mapping to MMS (IEC 61850-8-1),
- a mapping to IEC 60870-5-104,
- a mapping to DNP3.

Click [HIER](#) für weitere Details zu den Mappings (Abbildungen).

Unter dem Titel "IEC 61850 - Die universale Norm für die Informations-Integration" wird am Dienstag, 24.11.2009, 14:00 - 17:00 Uhr, [während der SPS/IPC/Drives in Nürnberg ein Tutorial durchgeführt](#); Vortragssprache ist Deutsch.

Posted by [Karlheinz Schwarz](#) at [11:54 PM](#) [0 comments](#) 

Labels: [de](#), [DNP3](#), [electric power system](#), [IEC 61131-3](#), [IEC 61400-25](#), [IEC 61499](#),

[IEC 61850](#), [implementation](#), [OPC](#), [wind turbine controller](#)

IEC 61850 Hands-on Training in Australia (December 2009)

IEC 61850 is the global standard for Power System Automation (generation, transport, distribution ... high, medium and low voltage levels). It allows for an open and "future proof" design, different architectures and possibilities to combine products from multiple vendors. In order for users and system integrators to utilize the benefits of IEC 61850 it is necessary for power utilities, integrators and vendors **to educate their most crucial asset – People**; and to start the migration to IEC 61850.

The popular STRI and NettedAutomation hands-on training provides both theory and practice on the application of IEC 61850 in a substation. During the training we follow the planning, design and engineering process for real applications all the way to configuration and testing on a real multivendor test installation. We believe real understanding is the result of both knowledge and hands-on experience. Therefore the training offers a unique combination of presentations, demonstrations and practical workshops in smaller groups.

Many utility experts have been trained, as TERNA (Italy):



The interest in performing such an event in Australia is high. We are right now negotiating with some utilities to fix the content, dates and locations.

Tentative locations and dates for 3 day events:

Brisbane (Australia): 30 November - 02 December 2009

Sydney (Australia): 02-04 December 2009

Click [HERE](#) for the tentative program and other details [pdf].

By end of August 2009 it is expected to announce the final contents, locations and dates.

Posted by [Karlheinz Schwarz](#) at [5:50 AM](#) [0 comments](#) 

Labels: [applications](#), [communication](#), [electric power system](#), [hands-on Training](#), [IEC 61400-25](#), [IEC 61499](#), [IEC 61850](#), [IEC61850](#), [interoperability](#), [low voltage](#), [medium voltage](#), [peopleware](#), [Power Automation](#), [seminar](#), [Substation](#), [Substation Automation](#)

Updated FERC Smart Grid Policy and Interoperability

The US Federal Energy Regulators Commission (FERC) has published recently an updated Smart Grid Policy (Docket No. PL09-4-000, Issued July 16, 2009).

Excerpt from the summary of the report: "This Policy Statement provides guidance regarding the development of a smart grid for the nation's electric transmission system, focusing on the **development of key standards to achieve interoperability and functionality of smart grid systems and devices**. In response to the need for urgent action on potential challenges to the bulk-power system, in this Policy Statement the Commission provides additional guidance on standards to help to realize a smart grid. ...".

The essential term used is "Interoperability" (Interoperability is described as exchanging meaningful information between two or more systems and achieving an agreed expectation for the response to the information exchange while maintaining reliability, accuracy, and security; according to GridWise). The term "Interoperability" is used 89 times throughout the policy statement.

One of the crucial standards that supports interoperability in power system automation, protection and control is the standard IEC 61850 ... also referred to in the policy statement: "The Commission stated that IEC Standards 61970 and 61968 (together, Common Information Model), along with IEC 61850 (Communications Networks and Systems in Substations), could provide a basis for addressing this issue."

Interoperability is impacted by many aspects (standard definition, implementation, subsetting, resources available in a device, ...). Two IEDs that are fully compliant may not be able to talk together, because of resource restrictions. A Server IED may support 3 TCP connections. A fourth client that wants to retrieve some information from that server cannot even open a TCP connection - due to the resource restriction. From an application point of view the two devices cannot interoperate.


There is a crucial difference in the use of TCP for general web applications and IEC 61850 (and other close to real-time applications). Usually a client opens a TCP connection posts a request, gets some responses, and closes the TCP connection. Web browsers, in their simplest mode of operation, would just connect to download a page and then disconnect. This simple transactions use very little resources. The resources are free after each transaction. But connecting and disconnecting repeatedly to the same server does carry an overhead and slows the communication down.

To allow close to real-time information exchange over TCP requires to keep the connection open all time. This has the drawback that the server needs to reserve resources for each client - independent if there is little or high traffic. For that reason IEDs in power systems (often with very limited resources) have a limited number of clients that can communicate with them at the same time. Once resources are consumed, there is no interoperation with one additional client possible at all.

This kind of limited resources in automation devices makes interoperability a challenge. If two devices do not operate: please do not start to blame it to the standard or to the implementation ... A system integrator needs to know many details on limitations. Be aware: Everything is limited!

The discussed challenge is independent of the upper layer protocols like DNP3, IEC 60870-5, IEC 60870-6, IEC 61850, ... it is typical for all protocols in the automation domain that use TCP.

Click [HERE](#) for the complete FERC Smart Grid Policy.

Posted by [Karlheinz Schwarz](#) at [3:52 AM](#) [0 comments](#) 

Labels: [Automation](#), [communication](#), [electric power system](#), [IEC 61850](#), [interoperability](#), [interoperability tests](#), [real-time](#), [TCP](#)

[Newer Posts](#)

[Home](#)

[Older Posts](#)

Subscribe to: [Posts \(Atom\)](#)

News on IEC 61850 and related Standards

Daily news concerning the standards IEC 61850, IEC 61400-25, IEC 61970 (CIM), IEC 60870-5, ...

Wednesday, August 12, 2009

Webservices for IEC 61850 or IEC 61850 LE (Lite Edition) are here

From time to time there is a discussion on the protocol stack for IEC 61850 - which is based on TCP/IP, upper OSI layers and MMS (ISO 9506). Some people today are looking for a lite edition that may use DNP3, IEC 60870-5-10x, or even Webservices.

Is there a need to define these protocol stacks during the years to come? NO!! The Standard IEC 61400-25-4 defines these stacks (published 12 months ago, 2008-08). No, I am not kidding. The Standard has been published by IEC TC 88 (Wind Turbines):

Wind turbines – IEC 61400-25-4: Communications for monitoring and control of wind power plants – Mapping to communication profile

Click [HERE](#) for the preview of the standard.

The stacks specified in this part of IEC 61400-25 comprise:

- SOAP-based web services,
- a mapping to OPC/XML-DA,
- a mapping to MMS (IEC 61850-8-1),
- a mapping to IEC 60870-5-104,
- a mapping to DNP3.

All mappings are optional, but at least one optional mapping shall be selected in order to be compliant with this part of IEC 61400-25.

The stacks in IEC 61400-25-4 are covering **all** or **parts** of the abstract services in IEC 61400-25-3 (IEC 61850-7-2, ACSI) - excerpt of the list of mappings and services supported:

Subscribe To IEC 61850 News

 Posts 

 All Comments 

Blog Archive

- 2012 (11)
- 2011 (159)
- 2010 (153)
- ▼ 2009 (162)
 - December (4)
 - November (11)
 - October (17)
 - September (16)
 - ▼ August (18)

[Technical Report IEC 61850-90-1 accepted](#)

[Vendor-independent IEC 61850 Hands-on Training at ...](#)

[Interoperability in the context of IEC 61850](#)

[Revised Input to NIST Interoperability Roadmap ava...](#)

[IEC 61131-3 SPS-Programmierung und IEC 61850](#)

[IEC 61850 Hands-on Training in Australia \(December...](#)

[Updated FERC Smart Grid Policy and Interoperabilit...](#)

[Webservices for IEC 61850 or IEC 61850 LE](#)

Table 1 – Mapping overview of IEC 61400-25-3 services

Mapping capability overview						
IEC 61400-25-3 Services	M/O	Web-services	OPC XML-DA	IEC 61850-8-1 (MMS)	IEC 60870-5-104	DNP3
Associate	M	Y	Y	Y	Y	Y
Release	O	Y	Y	Y	Y	N
Abort	O	Y	Y	Y	N	N
GetServerDirectory	O	Y	Y	Y	N	Y
GetLogicalDeviceDirectory	O	Y	Y	Y	N	Y
GetLogicalNodeDirectory	O	Y	Y	Y	N	N
GetDataValues	M	Y	Y	Y	Y	Y
SetDataValues	M	Y	Y	Y	Y	Y
GetDataDirectory	O	Y	Y	Y	N	N
GetDataDefinition	O	Y	Y	Y	N	N
GetDataSetValues	M	Y	P ^a	Y	N	Y
SetDataSetValues	O	Y	N	Y	N	Y
CreateDataSet	O	Y	N	Y	N	N
DeleteDataSet	O	Y	N	Y	N	N
GetDataSetDirectory	O	Y	N	Y	N	N
Report	O	Y	Y	Y	Y	N

Example of a service for the Webservice stack (excerpt):

A.5.5.2 GetDataValues

A.5.5.2.1 GetDataValuesRequest

The GetDataValuesRequest service shall be defined as follows:

```
<s:element name="GetDataValuesRequest">
  <s:complexType>
    <s:sequence>
      <s:element name="Ref" type="ews:tFcdFcdaType" />
    </s:sequence>
    <s:attribute name="UUID" type="ews:tstring36" use="optional"/>
    <s:attribute name="AssocID" type="ews:tAssocID" use="required"/>
  </s:complexType>
</s:element>
```

The Tag Names shall be defined according to Table A.21.

Table A.21 – GetDataValuesRequest

Tag Name	Description
GetDataValuesRequest	Retrieve values of DataAttributes of the referenced DATA made visible and thus accessible to a client by the referenced Logical-Node.
Ref	The parameter Reference shall define the functional constrained data (FCD) or functional constrained data attributes (FCDA) of the DATA whose DataAttribute value is to be written. The Reference shall be FCD or FCDA.
UUID	Universal Unique ID is used as a unique service identification for a request/response relationship. The UUID details shall be as specified in RFC 4122.
AssocID	AssocID is used to identify the association originator – the specific client. The AssocID shall be used to identify e.g. established subscriptions and loggings on the server.

The mapping of services to DNP3 is depicted for one example (excerpt):

LOGICAL-DEVICE			Data link address
	GetLogicalDeviceDirectory	O	Read Object Group 0 ^b
LOGICAL-NODE			
	GetLogicalNodeDirectory	O	n.a. ^a
DATA			
	GetDataValues	M	Read (Function Code 1)
	SetDataValues	M	Write (Function Code 2)
	GetDataDirectory	O	n.a. ^a
	GetDataDefinition	O	n.a. ^a

[\(Lite Ed...](#)

[You are experienced with IEC 61850? - Looking for ...](#)

[COPALP supports IEC 61850](#)

[NIST reports progress in transforming the power gr...](#)

[New version of the CIMTool for IEC 61968/70 CIM av...](#)

[IEC opened a website for Smart Grid Standards](#)

[2nd IEC 61850 Training Session in Moscow NOW WITH ...](#)

[Tutorial IEC 61850 während der SPS/IPC/Drives in N...](#)

[Batteries and Electric Vehicles - U.S. Government ...](#)

[Priority Action Plans for NIST Smart Grid Interope...](#)

[German E-Energy Projects go International](#)

► July (11)

► June (9)

► May (25)

The mapping of Common Data Classes to DNP3 is depicted for one example (excerpt):

E.4.3 CDC Measured Value (MV)

Table E.3 defines the mapping for data attributes in the IEC 61850-7-3 common data class MV. The data attributes [mag + t + q] shall map to a DNP3 data set prototype.

Table E.3 – CDC: Measured Value (MV) mapping

Attribute Name	Attribute Type	DNP3 Data Specification	DNP3 Data Element Mapping
-	-	UUID:OSTR	{29787E10-484F-4B22-A7BF-1C669D3748E8}
-	-	NSPC:VSTR	"IEC 61400-25-2"
-	-	NAME:VSTR	"MV"
mag	AnalogueValue	DAEL:FLT32	32-bit floating point value
q	Quality	DAEL:BSTR	SQ2 – Object coding (refer Table E 2)
t	TimeStamp	DAEL:TIME	Six octet binary time – Time of occurrence

The ancillary value associated with each DNP3 data element shall be the IEC 61850-7-Attribute Name e.g. "mag".

- April (11)
- March (16)
- February (11)
- January (13)

- 2008 (82)

Contributors

[Karlheinz Schwarz](#)
[Michael Schwarz](#)

So: Why waiting for an IEC 61850 LE or for IEC 61850 Webservices - Here they are: IEC 61400-25-4.

If there is a need to revise or improve the stacks, visit the [Tissue Data Base for IEC 61400-25](#).

Posted by [Karlheinz Schwarz](#) at [12:30 PM](#) [0 comments](#) 


Labels: [communication](#), [DNP3](#), [electric power system](#), [en](#), [IEC](#), [IEC 60870-5-101](#), [IEC 60870-5-104](#), [IEC 61400-25](#), [IEC 61850](#), [mapping](#), [standards](#), [Substation](#), [wind power](#), [wind turbine controller](#)

You are experienced with IEC 61850? - Looking for a new job in the U.S.?

The Public Service Company of New Mexico (USA) is looking for an engineer with experiences in IEC 61850.

The job description asks for: "... Provide direction to improve the reliability of subtransmission and transmission electrical facilities, and **design of electrical substation automation under IEC 61850**. ... and experience working with large consulting firms in the power industry and large industrial users, and must also have **experience with or have researched IEC 61850 substation automation**.

Click [HERE](#) for the full text of the job description.

Posted by [Karlheinz Schwarz](#) at [3:43 AM](#) [0 comments](#) 

Labels: [electric power system](#), [en](#), [engineering](#), [IEC 61850](#), [Substation Automation](#)

Tuesday, August 11, 2009

COPALP supports IEC 61850

The French company COPALP (focused on IEC 61131-3 based provide software tools and components for embedded systems) has integrated the Standard IEC 61850 into their architecture.

According to COPALP: "The Energy and Water industries require more and more complex protocols and control applications to meet the

growing demands for more information, more often. ... The IEC 61850 is one new component to the COPALP offer that comes in addition to the existing one like IEC60870-101 slave, IEC60870-104 server and DNP3 slave protocols."

Click [HERE](#) for their full news release.

The next step after IEC 61131-3 will be [IEC 61499 \(Function Blocks\) with IEC 61850 information exchange](#).

Posted by [Karlheinz Schwarz](#) at [12:48 PM](#) [1 comments](#) 

Labels: [Automation](#), [communication](#), [electric power system](#), [IEC](#), [IEC 61131-3](#), [IEC 61499](#), [IEC 61850](#)

NIST reports progress in transforming the power grid into a Smart Grid

The other day George W. Arnold (National Coordinator For Smart Grid Interoperability) reported to the House Committee on Science and Technology Subcommittee on Energy and Environment United States House of Representatives on the progress in transforming the U.S. power grid into a Smart Grid.

Mr. Arnold reported that "Modernizing and digitizing the nation's electrical power grid—the largest interconnected machine on Earth—is an enormous challenge and a tremendous opportunity. Success requires a combination of quick action and sustained progress in implementing and **integrating the components, systems, and networks that will make up the Smart Grid**. ... it is important that we base our standards, wherever possible, on **international standards** or work to get our approaches adopted as international standards. This will maximize the opportunities for U.S. suppliers to address a large, global market opportunity. **Fortunately, we are well-connected to International Electrotechnical Commission (IEC), IEEE and other international organizations** and are pursuing those connections vigorously in our effort. ... it is essential that we base the **Smart Grid on open standards**."

Click [HERE](#) for the full (10 page) Testimony.

NettedAutomation GmbH (Karlsruhe/Germany) believes that the Net(works) will automate the future power generation, transmission, distribution and power consumption: **The Net is the Automation**.

The driving force behind the standardization is to effectively and efficiently perform **seamless device data integration** and **sharing information** based on a rich, fine-grained data-stream about the state of the "power world" in any given instant. **Every node in the network would have to be awake, responsive, flexible, and – most important – interconnected with everything else: A distributed energy web**.

(from "Seamless Communication with IEC 61850 for Distributed Power Generation" by Karlheinz Schwarz, SCC, Karlsruhe, Germany)

Click [HERE](#) for a copy of the full paper on Seamless Communication with IEC 61850 for Distributed Power Generation presented at the 2002 DistribuTech in Miami (FL).

Posted by [Karlheinz Schwarz](#) at [12:13 PM](#) [0 comments](#) 

Labels: [communication](#), [Critical Infrastructure Protection](#), [distribution automation](#), [electric power system](#), [en](#), [IEC](#), [interoperability](#), [interoperability tests](#), [NIST](#), [Power Automation](#), [Smart Grid](#), [standards](#)

Monday, August 10, 2009

New version of the CIMTool for IEC 61968/70 CIM available

The CIMTool is an open source tool supporting the IEC TC 57 Common Information Model (CIM) standards (IEC 61968 and IEC 61970) used in the electric power industry.

The latest CIMTool release 1.6.1. is available for download. CIMTool is a plugin for the [eclipse](#) platform.

Click [HERE](#) for more information on the new release of the CIMTool.

Click [HERE](#) if you need help with the CIM.

Posted by [Karlheinz Schwarz](#) at [2:06 AM](#) [0 comments](#) 

Labels: [CIM](#), [electric power system](#), [IEC 61968](#), [IEC 61970](#), [tools](#), [Training](#)

IEC opened a website for Smart Grid Standards


IEC (International Electro-technical Commission) has launched a new website supporting "Global Standards for Smart Grids".

The areas of interest are:

- About Smart Grid
- Regional Concerns
- Need for Smart Grid Standards
- Interoperability and Standards
- Framework for Standardization
- IEC Leadership and Expertise
- Relevant IEC Standards

Click [HERE](#) to visit the new site.

The site is intended to provide (step by step) support in building the future smart power delivery infrastructure. Some key standards like IEC 61968, IEC 61970, IEC 61850, ... are already listed. More to come.

Posted by [Karlheinz Schwarz](#) at [12:45 AM](#) [0 comments](#) 

Labels: [CIM](#), [DER](#), [distribution automation](#), [IEC 61850](#), [IEC 61968](#), [IEC 61970](#), [interoperability](#), [Smart Grid](#), [Substation](#), [Substation Automation](#), [wind power](#)

Friday, August 7, 2009

2nd IEC 61850 Training Session in Moscow NOW WITH Hands-on Training, 01.-04. September 2009

The second comprehensive training on IEC 61850 in Moscow (Russia) has been **extended from three to four days** - adding a **hands-on training** with real IEDs from Areva, Siemens, SEL, GE, ... the event will be held in Moscow (Russia) from 01.-04. September 2009. The the first three days will be conducted by NettedAutomation (Karlsruhe, Germany), the hands-on training will be performed by [STRI](#) (Ludvika, Sweden).

Click [HERE](#) [pdf in Russian] for program details and registration form.

Click [HERE](#) for a brief report on the the first event in March 2009.

I look forward to meeting you soon in Moscow.

Posted by [Karlheinz Schwarz](#) at [7:19 AM](#) [0 comments](#) 

Labels: [Automation](#), [education](#), [IEC 61850](#), [IEC 61850-7-420](#), [IEC 61968](#), [IEC 61970](#), [Power Automation](#), [process control](#), [Substation](#), [Transmission Grid](#), [wind power](#)

Tutorial IEC 61850 während der SPS/IPC/Drives in Nürnberg, 24.11.2009

Unter dem Titel "IEC 61850 - Die universale Norm für die Informations-Integration" wird von Karlheinz Schwarz (SCC) am Dienstag, 24.11.2009, 14:00 - 17:00 Uhr, ein Tutorial durchgeführt; Vortragssprache ist Deutsch.

Die Norm IEC 61850 „Communication networks and systems for power utility automation“ ist die global anerkannte Integrationslösung für die Automatisierung in der elektrischen Energieversorgung und zunehmend in anderen Bereichen. Sie definiert im Wesentlichen:

- **Informationsmodelle** (dreiphasiges Stromnetz, Leistungsschalter, Temperaturwerte, ...)
- **Services für den Informations-Austausch** (Client-Server, Echtzeitkommunikation, ...)
- **System-Konfigurationssprache** (Anlage, Informationsmodelle, Datenfluss, Geräte, ...)

Mittlerweile wird die Normenreihe in Transport- und Verteilnetzen (von der Hochspannung bis zur Niederspannung), in der konventionellen und dezentralen Energieerzeugung sowie für Condition-Monitoring-Systeme eingesetzt. Die bedarfsgerechte und zuverlässige Bereitstellung elektrischer Energie für fertigungs- und verfahrenstechnische Prozesse hat einen zunehmenden Einfluss auf die gesamte Automatisierung. Die durchgängige Informations-Integration von Produktions- und Energieversorgungsprozessen mit IEC 61850 senkt die Kosten der Automatisierung und hilft, Energie effizient zu nutzen!

In dem Beitrag werden die Normenreihen IEC 61850 und IEC 61400-25 (Erweiterung für Windenergieanlagen), ihre globale Akzeptanz und Einsatzbeispiele vorgestellt.

In acht von 14 Anwendungsbereichen der amerikanischen [Smart-Grid-Aktivitäten wird IEC 61850](#) als Lösung gesehen ... more to come.

Click [HIER](#) für weitere Details zum Tutorial in Nürnberg.

Posted by [Karlheinz Schwarz](#) at [1:02 AM](#) [0 comments](#) 

Labels: [condition monitoring](#), [de](#), [DER](#), [education](#), [electric power system](#), [engineering](#), [IEC 61850](#), [monitoring](#), [standards](#), [Substation](#), [Training](#), [wind power](#)

Wednesday, August 5, 2009

Batteries and Electric Vehicles - U.S. Government spends \$2.4 Billion in Grants

According to the White House press release (2009-08-05) President Obama "announced 48 **new advanced battery and electric drive projects** that will receive **\$2.4 billion in funding** under the American Recovery and Reinvestment Act. These projects, selected through a

highly competitive process by the Department of Energy, will accelerate the development of U.S. manufacturing capacity for batteries and electric drive components as well as the deployment of electric drive vehicles, helping to establish American leadership in creating the next generation of advanced vehicles."

The award winners will invest **another \$2.4 Billion**.

One of the biggest deployment projects will be implemented by ETEC in cooperation with Nissan. According to ETEC: "The Project will install **electric vehicle charging infrastructure** and **deploy up to 1,000 Nissan battery electric vehicles** in strategic markets in five states: Arizona, California, Oregon, Tennessee, and Washington. ... To support the Nissan EV, the Project will install approximately **12,500 Level 2** (220V) charging systems and **250 Level 3** (fast-charge) systems."

Click [HERE](#) for the full White House press release.

Click [HERE](#) for the ETEC press release.

Posted by [Karlheinz Schwarz](#) at [11:27 PM](#) [1 comments](#) 

Labels: [batteries](#), [education](#), [electric power system](#), [electric vehicles](#), [Smart Grid](#)

Priority Action Plans for NIST Smart Grid Interoperability Standards Roadmap

EPRI has provided a list of prioritized actions on the "Smart Grid Interoperability Standards Roadmap" to NIST on July 30, 2009.

The plans cover 14 areas of interest. Excerpt from the Overview:

"On the basis of stakeholder input received at two public workshops as well as its reviews of research reports and other relevant literature, the National Institute of Standards and Technology (NIST) is proposing a **set of priorities for developing standards necessary to build an interoperable Smart Grid**. Among the criteria for inclusion on this initial list were immediacy of need, relevance to high-priority Smart Grid functionalities, availability of existing standards to respond to the need, state of the deployment of affected technologies, and estimated time frame to achieve an effective solution.

To facilitate timely and effective responses to these needs, NIST has drafted a preliminary Priority Action Plan (PAP) for each need. The PAPs are intended to scope out problem areas and to begin clarifying the steps required for achieving solutions."

The 14 prioritized areas (text in bold indicates involvement of IEC 61850 for that area):

1. IP for the Smart Grid
2. Wireless Communications for the Smart Grid
3. Common Pricing Model
4. Common Scheduling Mechanism
5. Standard Meter Data Profiles
6. **Common Semantic Model for Meter Data Tables**
7. **Electric Storage Interconnection Guidelines**
8. **CIM for Distribution Grid Management**
9. Standard DR Signals
10. **Standard Energy Usage Information**
11. **Common Object Models for Electric Transportation**
12. **IEC 61850 Objects/DNP3 Mapping**
13. **Time Synchronization, IEC 61850 Objects/IEEE C37.118 Harmonization**
14. **Transmission and Distribution Power Systems Model**

Mapping

Click [HERE](#) for the complete action plans.

Posted by [Karlheinz Schwarz](#) at [1:28 AM](#) [1 comments](#) 

Labels: [CIM](#), [communication](#), [condition monitoring](#), [Critical Infrastructure Protection](#), [DNP3](#), [electric power system](#), [en](#), [IEC 61400-25](#), [IEC 61850](#), [IEC61850](#), [interoperability](#), [interoperability tests](#), [Power Automation](#), [Smart Grid](#)

Monday, August 3, 2009

German E-Energy Projects go International

The seven German E-Energy Projects opened an International website with many useful information in English. "The primary goal of E-Energy is to create E-Energy model regions that demonstrate how the immense potential for optimization presented by information and communication technologies (ICT) can best be harnessed to enhance the efficiency and environmental compatibility of the power supply and to ensure supply security."

Click [HERE](#) for the content in English.

Posted by [Karlheinz Schwarz](#) at [11:35 PM](#) [0 comments](#) 

Labels: [E-Energy](#), [electric power system](#), [IEC 61850](#), [IEC 61968](#), [IEC 61970](#), [Smart Grid](#)


Wednesday, July 29, 2009

Remote 2009 Conference & Expo, October 29-30, 2009 - San Antonio (TX)

The Remote 2009 Conference and Expo will focus on the leading advancements for the monitoring and management of distributed equipment and facilities, remote assets, automated process & system controls and device networks. Large-scale users and industry experts will speak on SCADA, remote networking technology, security (cyber and physical), control, automation, onsite and back-up power, M2M, emerging wireless technology, telemetry and condition monitoring.

IEC 61850 will be discussed in a paper from Prosoft Technology, Inc. Click [HERE](#) for the conference program.

There will also be a **2 day workshop on IEC 61850, IEC 61400-25, DNP3** ... crucial building blocks also for smart grids. Click [HERE](#) for the program of the workshop.

Posted by [Karlheinz Schwarz](#) at [10:04 PM](#) [0 comments](#) 

Labels: [communication](#), [condition monitoring](#), [conference](#), [Critical Infrastructure Protection](#), [DNP3](#), [IEC 61400-25](#), [IEC 61850](#), [monitoring](#), [Smart Grid](#)

Tuesday, July 28, 2009

IEEE 1588 - Precision Clock Synchronization realized in Hirschmann Ethernet Switches

Hirschmann (Neckartenzlingen, Germany - a leader in Industrial Ethernet) claims to be one of first vendors that has implemented IEEE 1588 Precision Clock Synchronization.

Accurate time information is crucial for distributed automation systems in factories and power systems. The Precision Time Protocol (PTP) defined in IEEE 1588, supports synchronization of distributed clocks with an **accuracy of less than 1 microsecond** in an Ethernet networks.

Click [HERE](#) [pdf, 800KB, 20 pages] for a very helpful White Paper from Hirschmann that explains the synchronization basics ... in case you want to understand how IEEE 1588 functions.

The definition of a specific profile for power system (IEC 61850, especially IEC 61850-9-2) is currently under discussion and is expected to be available by end of 2009.

Click [HERE](#) [pdf] for a nice presentation by SEL (January 2008)

Click [HERE](#) [pdf] for a further reading on Why do we need time in Power Systems?

Posted by [Karlheinz Schwarz](#) at [10:34 PM](#) [0 comments](#) 

Labels: [Ethernet](#), [hirschmann](#), [IEC 61850](#), [IEC 61850-9-2](#), [IEEE 1588](#), [real-time](#), [synchronization](#)

Tuesday, July 21, 2009

U.S. 2010 Energy and Water Appropriations: some \$27 billion

According to a recent press release of the U.S. Committee on Appropriations the U.S. **Department of Energy will have some \$27 billion funding for 2010**: "The Energy and Water Appropriations Bill is a key part of ongoing efforts to meet the infrastructure needs of the country and, after years of neglect, addressing the inadequacies of our national energy policies. This bill **invests in new technologies**, scientific research, and conservation efforts that will provide **long term solutions to our energy needs and create jobs**. ... And it continues to invest **in the development of a new "smart grid" to ensure electricity delivery and energy reliability**."

Excerpt of the Summary:

Total funding: DEPARTMENT OF ENERGY = \$26.9 billion !!

- Energy Efficiency and Renewable Energy: \$2.25 billion

- Electricity Delivery and Energy Reliability : \$208 million:

- **Smart Grid Technologies: \$62.9 million**, \$30 million above 2009, for smart grid research and development.
- **Energy Storage: \$15 million**, more than triple 2009, for research and development of grid-connected energy storage technologies.
- **Cyber Security: \$46.5 million for energy delivery cyber security**, an increase of \$34.5 million from 2009, to develop secure grid technologies as cyber attacks increase worldwide and the grid becomes increasingly network-connected.
- **Clean Energy Transmission and Reliability: \$42 million** to increase the efficiency of the grid and enable the widespread deployment of clean, domestic renewable energy.

- ...

Click [HERE](#) for the complete official Summary.

What is your Government providing? The German Government funds many projects. E.g., the E-Energy projects ... project budgets of some € 140 million for a 4-year term ... some € 35 million per year.

Click [HERE](#) for executive information on the E-Energy projects.

Posted by [Karlheinz Schwarz](#) at [1:35 PM](#) [0 comments](#) 

Labels: [Critical Infrastructure Protection](#), [education](#), [electric power system](#), [security](#), [Smart Grid](#), [Transmission Grid](#)

Thursday, July 16, 2009

First German Offshore Wind Turbine - with IEC 61400-25

EWE, E.ON and Vattenfall have successfully completed the construction of the **first wind turbine for the alpha ventus offshore wind farm in the North Sea ... using IEC 61400-25**. The 5-megawatt turbine is located 45 kilometres north of the island of Borkum. A total of 12 turbines are scheduled to be in running by year's end.

Click [HERE](#) for more details on the offshore park (press release).

The communication with the turbines uses the new standard IEC 61400-25.

Click [HERE](#) for some details on the communication with IEC 61400-25 from a SCADA viewpoint.

Click [HERE](#) for a description of Beckhoff PLC supporting IEC 61400-25 for Wind Turbines in alpha ventus (GERMAN only).

Posted by [Karlheinz Schwarz](#) at [2:35 AM](#) [0 comments](#) 

Labels: [condition monitoring](#), [control center](#), [IEC 61400-25](#), [IEC 61850](#), [interoperability](#), [Vattenfall](#), [wind power](#), [wind turbine controller](#)

Saturday, July 11, 2009

German contribution to Smart Grids: E-Energy Flyer in German, English and Japanese

Several German E-Energy projects focus on ICT-based energy system of the future Smart Grid ... by spending an overall budget of some € 140 million for a 4-year term.

Initiated by the German Federal Ministry of Economics and Technology (BMWi) and implemented in collaboration with the German Federal Environment Ministry (BMU) the projects will deal with problems of the current German power delivery system. "New integral system solutions are called for, in which information and communication technologies (ICTs) will play a key role.", according to a new 2 page flyer that is available in three languages:

Click [HERE](#) for the German version.

Click [HERE](#) for the English version.

Click [HERE](#) for the Japanese version.

A Chinese version will be available soon.

Click [HERE](#) for an example of the use of IEC 61850 and IEC 61400-25 in an E-Energy projects.

Click [HERE](#) for further presentations discussing Smart Grid issues and some IEC Standards supporting Interoperability of devices and systems ... the slides were provided and discussed during the IEC TC 57 WG 17 DER Workshop in Fredericia (Denmark, 2008-02) and [HERE](#) for presentations of the Workshop in Oldenburg (Germany, 2007-06).

Posted by [Karlheinz Schwarz](#) at [8:43 AM](#) [0 comments](#) 

Labels: [distribution automation](#), [E-Energy](#), [electric power system](#), [en](#), [IEC 61400-25](#), [IEC 61850](#), [interoperability](#), [Power Automation](#), [Smart Grid](#)

EPRI Input to U.S. Smart Grid Roadmap open for Comments

The next crucial step towards the U.S. Smart grid Roadmap is the **public review and commenting** of the EPRI "*Report to NIST on the Smart Grid Interoperability Standards Roadmap*".

The commenting phase is open **until July 30, 2009**.

Click [HERE](#) for more details on how to comment.

The federal Register Notice announced the availability of the report on June 30.

Click [HERE](#) for the federal announcement.

The "Report to NIST on the Smart Grid Interoperability Standards Roadmap (Contract No. SB1341-09-CN-0031—Deliverable 7) prepared by the Electric Power Research Institute (EPRI), June 17, 2009, is available at: www.nist.gov/smartgrid/

I hope that many experts reading this news blog will provide comments on the Report to NIST.

I will provide comments taking my experience in interoperability issues into account.

Click [HERE](#) to see my experience profile. If you have any comments you want to share with me, please send a copy of your comments to schwarz@scc-online.de

Posted by [Karlheinz Schwarz](#) at [4:59 AM](#) [0 comments](#) 

Labels: [communication](#), [electric power system](#), [en](#), [IEC 61850](#), [interoperability](#), [interoperability tests](#), [Power Automation](#), [Power Plants](#), [Smart Grid](#)

Thursday, July 9, 2009

IEC 61850 - Hands-On Training in Sao Paulo (Brazil) on 19-21 August 2009

The details of the program for the planned NettedAutomation/STRI - vendor independent!! - **Hands-On Training on IEC 61850** to be held in Sao Paulo (Brazil) on 19-21 August 2009 are available.

Click [HERE](#) to download the program and registration information for the Sao Paulo event [pdf, 650 KB].

Click [HERE](#) to see the list of upcoming Training opportunities.

Posted by [Karlheinz Schwarz](#) at [12:35 AM](#) [0 comments](#) 

Labels: [ABB](#), [communication](#), [education](#), [electric power system](#), [Ethernet](#), [GOOSE](#), [hands-on Training](#), [IEC 61400-25](#), [IEC 61850](#), [interoperability](#), [peopleware](#), [Power Automation](#), [Power Plants](#), [Relays](#), [RTU](#), [SCADA](#), [seminar](#), [Siemens](#), [wind turbine controller](#)

[Newer Posts](#)

[Home](#)

[Older Posts](#)

Subscribe to: [Posts \(Atom\)](#)

News on IEC 61850 and related Standards

Daily news concerning the standards IEC 61850, IEC 61400-25, IEC 61970 (CIM), IEC 60870-5, ...

Wednesday, July 8, 2009

ENTSO-E: European Network of Transmission System Operators for Electricity

The organizations ATSOI, BALTSO, ETSO, NORDEL, UCTE and UKTSOA have been fully integrated into ENTSO-E since July 2009. The [ENTSO-E](#) is now fully operational.

The objectives of the new organization is: "Promote the reliable operation, optimal management and sound technical evolution of the **European electricity transmission system** in order to ensure security of supply and to meet the needs of the Internal Energy Market."

42 TSOs from 34 countries are members in the ENTSO-E.

Posted by [Karlheinz Schwarz](#) at [11:55 PM](#) [0 comments](#) 

Labels: [RWE](#), [Transmission Grid](#), [TSO](#)

ENTSO-E – EC Workshop on “Critical Infrastructure Protection” for Transmission Grid

The workshop on Critical Infrastructure Protection (CIP) for electricity transmission networks was held on 15/16 June 2009 in Cologne, Germany. ENTSO-E and the European Commission jointly organized the workshop. This workshop was an important platform for experts of European TSOs and other organizations involved in security issues.

Click [HERE \[pdf\] to download the agenda](#) and [HERE to download the presentations \[zip\]](#).

Posted by [Karlheinz Schwarz](#) at [11:41 PM](#) [0 comments](#) 

Labels: [CIP](#), [Critical Infrastructure Protection](#), [security](#), [Transmission Grid](#), [TSO](#)

CIM Users Group met at UCTE (ENTSO-E)

The CIM Users Group presented and discussed recently in Brussels (Belgium) the current status of IEC 61968 (CIM - Common Information Model) and the application in Europe.

The ENTSO-E reported: "About 70 experts from more than 40 companies worldwide attended the meeting, partly focused on the UCTE CIM profile. UCTE's migration policy towards CIM standards for exchange of operational and planning data is expected to lead to wide-spread adoption of the CIM standard for many additional applications in Europe."

Subscribe To IEC 61850 News

 Posts 

 All Comments 

Blog Archive

- [2012](#) (11)
- [2011](#) (159)
- [2010](#) (153)
- ▼ [2009](#) (162)
 - [December](#) (4)
 - [November](#) (11)
 - [October](#) (17)
 - [September](#) (16)
 - [August](#) (18)
 - ▼ [July](#) (11)

[Remote 2009 Conference & Expo, October 29-30, 2009...](#)

[IEEE 1588 - Precision Clock Synchronization realiz...](#)

[U.S. 2010 Energy and Water Appropriations: some \\$2...](#)

[First German Offshore Wind Turbine - with IEC 6140...](#)

[German contribution to Smart Grids: E-Energy Flyer...](#)

[EPRI Input to U.S. Smart Grid Roadmap open for Com...](#)

[IEC 61850 - Hands-On Training in Sao Paulo](#)

Click [HERE](#) to access the presentations of the event.

Posted by [Karlheinz Schwarz](#) at 10:36 PM 0 comments 

Labels: [CIM](#), [communication](#), [control center](#), [IEC 61850](#), [IEC 61968](#), [IEC 61970](#), [Smart Grid](#), [standards](#), [Substation](#)

Wednesday, July 1, 2009

IEC 61850 - Hands-On Trainings in Buenos Aires and Sao Paulo

Dear expert interested in the standard IEC 61850 for Substations and other Power Automation Systems,

NettedAutomation GmbH (Germany) and STRI (Sweden) are proud to announce possibility for **two 3-day Hands-On Training sessions in Buenos Aires (12-14 August 2009) and Sao Paulo (19-21 August 2009)**.

This training has the objective to provide both theory and practice on the application of IEC 61850 in a substation or a smart grid. We cover the planning, design and engineering process for real applications all the way to configuration and testing based on a real multivendor test installation. The 3 day course consists of:

Module 1 gives a level 1 introduction to the IEC 61850 standard together with a summary with real applications and the demonstration of STRI facilities for multivendor interoperability testing.

Module 2 gives an independent and more detailed update on the IEC 61850 standard for substation and device modelling as well as communication principles with real examples.

Module 3 provides a IEC 61850 hands-on workshop demonstrating interoperability of protection and control devices from ABB and Siemens as well as testing techniques communicating over a substation Ethernet network.

The program will be similar to the Training session scheduled for Frankfurt (Germany) on October 20-23, 2009 - mainly the Modules 1, 2, and 4a (of the Frankfurt event) will be used for the events in Buenos Aires and Sao Paulo:

[Program and registration for the Frankfurt event](#) [pdf]

The training is subject to minimum number of some 10 attendees. As we are traveling to South America for other events, we can offer these training sessions for a high discounted price of EURO 930 per person plus tax.

Please let us know by July 13, 2009 if you are interested to attend. Your feedback is essential in order to run the events.

We are confident, that our experience and service would meet all your expectations! You'd get first-hand, very comprehensive, vendor neutral and up-to-date knowledge, experience, and guidance.

Our experience profile can be found here:

http://nettedautomation.com/download/Netted-Schwarz-Profile-en_2009-01-21.pdf

<http://www.stri.se/iec61850>

[\(Brazil...](#)

[ENTSO-E: European Network of Transmission System O...](#)

[ENTSO-E – EC Workshop on “Critical Infrastructure ...](#)

[CIM Users Group met at UCTE \(ENTSO-E\)](#)

[IEC 61850 - Hands-On Trainings in Buenos Aires and...](#)

- ▶ June (9)
- ▶ May (25)
- ▶ April (11)
- ▶ March (16)
- ▶ February (11)
- ▶ January (13)

▶ 2008 (82)

Contributors

[Michael Schwarz](#)

[Karlheinz Schwarz](#)

We look forward to greeting you at one of our next training events.

If you are interested in a special in-house training for you and your people, please contact us.

Please feel free to forward this email to any colleagues who you think might be interested in one of the events.

Best Regards,

Karlheinz Schwarz
NettedAutomation GmbH
Im Eichbaeumle 108
76139 Karlsruhe
Germany

Phone +49-721-684844
Fax +49-721-679387
karlheinz.schwarz@nettedautomation.com
<http://www.nettedautomation.com>

Nicholas Etherden
STRI AB
Box 707
SE-771 80 Ludvika, Sweden

Phone +46 (0)240 795 02
Mobile +46 (0)70-6179562
Fax +46 (0)240 807 66
nicholas.etherden@stri.se
<http://stri.se>

Posted by [Karlheinz Schwarz](#) at [1:31 PM](#) [0 comments](#) 

Labels: [ABB](#), [communication](#), [education](#), [en](#), [engineering](#), [Ethernet](#), [hands-on Training](#), [hydro power](#), [IEC 61400-25](#), [IEC 61850](#), [interoperability](#), [interoperability tests](#), [Power Automation](#), [real IEDs](#), [Relays](#), [Siemens](#)

Wednesday, June 24, 2009

First Substation with IEC 61850 compliant Devices in Australia

According to ABB, the first substation with IEC 61850 conformant Devices (Protection and Control) has been commissioned in Australia in August 2008. "The system formed part of the \$10-million turnkey construction of the Juna Downs 220kV substation, and is part of Rio Tinto Pilbara Iron's extensive power upgrade in the Pilbara region of WA."

[Click HERE](#) to read the news report from ABB.

Posted by [Karlheinz Schwarz](#) at [10:32 PM](#) [0 comments](#) 

Labels: [ABB](#), [communication](#), [electric power system](#), [en](#), [IEC 61850](#), [Power Automation](#)

PAC World Magazine digs into Smart Grid

PACWorld magazine discusses some crucial aspects of the Smart Grid in the Spring 2009 issue. SmartGrids are discussed all over and on all levels: from Presidents to kids in the Kindergarten. Kindergarten in Germany are quite advanced in education of Physics and Technology:

[Click HERE](#) for a presentation which shows some kids in the Kindergarten trained ... even on Substation Automation in my office (on page 21).

Different people have different opinions what Smartgrids mean - it is not just to save money. SmartGrids require smart Hardware, smart Software and (in the first place) SMART Peopleware! No smart people - no smart grids.

The latest issue of the PAC World magazine discusses several crucial aspects of the protection of smart grids:

[Click HERE](#) to get to the list of contents ... that let you access and download the well written papers and other useful information. Enjoy.

Posted by [Karlheinz Schwarz](#) at [5:41 AM](#) [0 comments](#) 

Labels: [Automation](#), [education](#), [electric power system](#), [en](#), [IEC 61850](#), [peopleware](#), [Power Automation](#), [Smart Grid](#)

IEC 61850-3 compliant Computer for Substations and Power Plants

Moxa has announced the Moxa's DA-681 x86-based embedded computer line, that has just passed IEC 61850-3 power certification. This specially designed IED (embedded system) is intended for any power automation and substation application that require to be compliant with the IEC 61850-3 standard.

The general purpose IED has six Ethernet Ports and many other serial ports! It runs Embedded Linux, WinCE 6.0, or WinXPe.

[Click HERE](#) for more details.

Posted by [Karlheinz Schwarz](#) at [2:05 AM](#) [0 comments](#) 

Labels: [Automation](#), [electric power system](#), [en](#), [Ethernet](#), [IEC 61850](#), [IEC 61850-3](#), [IED](#), [Power Automation](#)

Standard IEC 61850-7-420 (DER) now available

A further part of IEC 61850 "Communication networks and systems for power utility automation" has been published:

Part 7-420: Basic communication structure – **Distributed energy resources logical nodes**

This standard in conjunction with other standards of the series IEC 61850 and IEC 61400-25 provide a comprehensive set of standardized means to engineer, monitor, operate and maintain distributed energy systems.

One of the key issues to understand is the fact that many tools, software and IEDs (like programmable controller, HMI clients, etc.) developed for IEC 61850 can be used for distributed energy applications.

[Click HERE](#) for a 12 page preview of the standard including the introduction and table of contents.

You may also **re-use** the knowledge and experience you obtained by one of our IEC 61850 Training sessions.

[Click HERE](#) [pdf] for a list of training modules on IEC 61850 and other Standards.

Posted by [Karlheinz Schwarz](#) at 1:53 AM 1 comments 

Labels: [DER](#), [electric power system](#), [IEC 61400-25](#), [IEC 61850](#), [IEC 61850-7-420](#), [interoperability](#), [Smart Grid](#), [standards](#), [wind power](#)

Friday, June 19, 2009

EPRI Provided Crucial Input to the U.S. Smart Grid Interoperability Roadmap

NIST (U.S. National Institute of Standards and Technology) released on June 18, 2009, a report that identifies issues and proposes priorities for developing technical standards and an architecture for a U.S. Smart Grid. The report is out for public review.

The nearly 300-page report, developed and delivered to NIST by the Electric Power Research Institute (EPRI), is now publicly available:

[Click HERE](#) to download the Report [pdf, 5,7 MB].

[Click HERE](#) for the NIST press release.

A similar report has been written for the German projects "E-Energy" (the report is available in German only!):

[Click HERE](#) for more information on the German report.

The report refers to many Standards published by IEC TC 57 (Power System Management) and IEC TC 88 (Wind Power). Even this report is focusing on the U.S. power system, it is applicable for other regions as well. Contributions have come from non-U.S. experts. The IEC standards referenced in the report are TRUE International Standards.

The open **review process is quite crucial** because the final Roadmap will become a more or less official guideline for the whole power delivery system!

Standards like IEC 61968/70 (CIM), IEC 61850, IEC 62351, IEC 60870-6-TASE2, DNP3, IEC 61588, ... are important parts of the power system and recommended in the report to be included in the Final Roadmap. It could be expected that these standards will need extensions, and new standards may be needed as well.

The standardization work in the years to come requires that all the IEC Standardization groups closely cooperate together and with U.S. and other related standardization groups like IEEE, ISO and others. It could be expected that the resources needed for the global standardization work is at least as high as during the last 10 years.

In addition, there are several crucial regional and national R&D and other Smart Grid related projects going on, just started or planned that have also an influence on the International Standardization. It is highly recommended that the successful cooperation of U.S. activities (UCA 1.0, UCA 2.0) and e.g., the European initiated activities like IEC 61850 and IEC 61400-25 will be continued during the next decade in International Standardization!

The [press release](#) states that "NIST will use the EPRI report in drafting the **NIST Smart Grid Interoperability Standards Framework**. The NIST document will describe a high-level architecture, **identify an initial set of key standards**, and provide a roadmap for **developing new or revised standards** needed to realize the Smart Grid. Release

1.0 of the NIST Smart Grid Interoperability Standards Framework is planned to be available in September.

A third public EPRI-sponsored Smart Grid interoperability-standards workshop will be held in early August to engage standards-development organizations in responding to unaddressed, high-priority needs identified in the draft standards roadmap.

Ultimately, the Federal Energy Regulatory Commission (FERC) determines whether sufficient consensus has been reached to implement final standards and protocols necessary for Smart Grid functionality and interoperability. NIST's role is to identify and submit to FERC recommendations for the final product."

Posted by [Karlheinz Schwarz](#) at [2:31 AM](#) [0 comments](#) 

Labels: [61850-7-420](#), [communication](#), [control center](#), [DER](#), [distribution automation](#), [electric power system](#), [en](#), [IEC 61400-25](#), [IEC 61850](#), [IEC 61850-7-420](#), [IEC 61968](#), [IEC 61970](#), [Smart Grid](#)

Monday, June 8, 2009

2nd IEC 61850 Training Session in Moscow (01.-03. September 2009)

The second comprehensive training on IEC 61850 in Moscow (Russia) will be held from 01.-03. September 2009.

Click [HERE](#) [pdf in Russian] for the first announcement and contact details for the course on 01.-03. September .

Click [HERE](#) for a brief report on the the first event in March 2009 and [HERE](#) for the program of the first event (this is tentatively the program for the next event in September 2009).

Posted by [Karlheinz Schwarz](#) at [7:01 AM](#) [0 comments](#) 

Labels: [communication](#), [education](#), [electric power system](#), [en](#), [IEC 61850](#), [seminar](#), [Training](#)

Sunday, June 7, 2009


RWE and Siemens: IEC 61850 for Power Plant MV Power Supply

RWE Power and Siemens Implement IEC 61850 in a huge medium voltage substation in German Power Plant. IEC 61850 is used to integrate the information of the medium voltage substation (for the power supply of all power needs within the Power Plant) into the power plant control system.

"IEC 61850 is a comprehensive standard that defines the communication platform and the specific requirements for the network structure, network components, data models, interoperability criteria and the engineering process. Proprietary protocols, specialised bus systems and manufacturer specific solutions are a thing of the past. The new standard offers improved possibilities for the standardisation of E-Technology structures and their integration into the whole process, **without being tied to one single manufacturer.**"

Click [HERE](#) for a full paper on the project [the abstract is in English and German; the main body is in German].

Click [HERE](#) for a information on ABB's application of IEC 61850 in Power Plants.

Posted by [Karlheinz Schwarz](#) at [11:51 AM](#) [0 comments](#) 

Labels: [ABB](#), [communication](#), [DCS](#), [de](#), [electric power system](#), [Ethernet](#), [IEC 61850](#), [Power Plants](#), [Siemens](#)

Advanced Information Exchange for Ontario's Green Energy Act

Ontario's Green Energy Act asks for more clean, renewable sources of energy, like wind, solar, hydro, biomass and biogas. One of the "back bones" of the future power system is a "Smart Grid" to facilitate and maximize the development of new renewable energy projects.

Click [HERE](#) and [HERE](#) to read more about the Green Energy Act.

A **Smart Grid** means: The "advanced information exchange systems and equipment that when utilized together improve the flexibility, security, reliability, efficiency and safety of the integrated power system and distribution systems"

Click [HERE](#) for the Bill 150 [pdf, 3 MB].

A new amendment of the 1998 Electricity act requires standards:

§ 53.0.1 "The Lieutenant Governor in Council may make regulations governing the smart grid and its implementation, including regulations, (a) in respect of the timeframe for the development of the smart grid; (b) assigning roles and responsibilities for the development, **implementation and standardization** of the smart grid; (c) **prescribing the standards for communications and any other aspects in respect of the operation of the smart grid.**"

Posted by [Karlheinz Schwarz](#) at [7:55 AM](#) [0 comments](#) 

Labels: [DER](#), [electric power system](#), [en](#), [Smart Grid](#), [standards](#), [wind power](#)

Thursday, June 4, 2009

Distribution Automation or Remote Control?

Distribution Automation is one of the crucial technologies that build the backbone of the "SmartGrid" or "SmarterGrids". The future power delivery system will be based on more Automation at the lower voltage levels than before. Substation Automation is in place for High and Medium Voltage networks - usually **Low Voltage networks are not really automated**. They are protected by Protection Relays and controlled remotely by RTUs (Remote Terminal Units).

The automation functions for distribution networks is now being added to remote control either as local automation through auto-recloser and self-sectionalizing or via decision support tools. Distributed monitoring and control is the foundation to Distribution Automation - to improve the reliability of the network and to keep the aging infrastructure running. An aged transformer needs special attention to extend his life time, e.g., by preventing over loads and other stress situations.

The basis of automation are sensors that provide precise measurements - mainly of the ac current. There are first IEC 61850 compliant IEDs available that provide measurements and calculated values for LV and

MV automation applications.

Click [HERE](#) [pdf] for information of Powersense or [HERE](#) for measurement units from Camille Bauer. More to come ...

Posted by [Karlheinz Schwarz](#) at [1:26 AM](#) [0 comments](#) 

Labels: [communication](#), [condition monitoring](#), [control center](#), [distribution automation](#), [en](#), [IEC 61850](#), [low voltage](#), [medium voltage](#), [protection](#), [RTU](#), [Smart Grid](#), [Substation](#), [Substation Automation](#)

Tuesday, May 26, 2009

ABB and others push IEC 61850 all over

According to a news letter dated 2009-05-04 "ABB has introduced and exploited the benefits of IEC 61850 for customers in **55 countries** and supplied **hundreds of systems** and **thousands of products** for new substation installations, as well as retrofit and migration projects. ... ABB **played a key role** in developing and verifying this global standard, and actually commissioned the world's first IEC 61850 multi-vendor project in 2004 at the 380 kilovolt (kV) Laufenburg substation in Switzerland – one of the largest and most important substations in Europe."

[Click HERE](#) for the ABB news report.

All big vendors like ABB, AREVA, GE, SEL, Siemens, and several others, utilities and several independent consultants have heavily contributed to the standard - and are still contributing!

During today's one-day seminar on IEC 61850 organized by Asia iKnowledge Sdn. Bhd. here in Kuala Lumpur (Malaysia) it was interesting to see the huge interest of power, gas and oil utilities in the new standard! It was clearly reported and confirmed by key people that attended that the education of "smart" engineers in the new standards is one of the crucial pre-requisite for smarter grids!

[Click HERE \[pdf, 600 KB\]](#) for today's program and the program of the conference tomorrow and Thursday.

Posted by [Karlheinz Schwarz](#) at [8:05 AM](#) [0 comments](#) 

Labels: [ABB](#), [Areva](#), [conference](#), [education](#), [engineering](#), [IEC 61850](#), [implementation](#), [interoperability tests](#), [security](#), [Siemens](#), [Smart Grid](#), [Substation](#), [Substation Automation](#)

DDS NETCOM lädt zu IEC-61850- Informationsveranstaltung nach Volkstswil bei Zürich ein (4. Juni 2009)

Die Normenreihe IEC 61850 "Communication networks and systems for power utility Automation" ist die global anerkannte, einheitliche Integrationslösung für die Automatisierung in der elektrischen Energieversorgung. Sie definiert im Wesentlichen:

- Informationsmodelle (Ströme und Spannungen in Dreiphasen-Systemen, Leistungsschalter, ...)
- Services für den Informations-Austausch (Ereignisübertragung, Archive, Steuern, Echtzeit, ...)
- System-Konfigurationssprache (Konfiguration einer gesamten Anlage)


Mittlerweile wird die Norm in Transport- und Verteilnetzen, in Windenergieanlagen, in Wasserkraftwerken und dezentralen Energieversorgungssystemen eingesetzt.

Die durchgängige "Vernetzung" von Produktions- und Energieversorgungsprozessen mit IEC 61850 senkt die Kosten der Automatisierung und hilft, Energie effizient zu nutzen!

Um die wesentlichen Aspekte der Normenreihe und ihre Akzeptanz zu vermitteln, lädt DDS NETCOM für Donnerstag, 4. Juni 2009 um 12:30 Uhr nach [Fehraltorf/Volketswil \(Schweiz\)](#) zur folgenden Info-Veranstaltung ein:

„Norm IEC 61850 im industriellen Umfeld“

[Klicken Sie hier](#) für weitere Einzelheiten und das Programm.

Posted by [Karlheinz Schwarz](#) at [6:46 AM](#) [0 comments](#) 

Labels: [de](#), [electric power system](#), [hydro power](#), [IEC 61400-25](#), [IEC 61850](#), [interoperability tests](#), [Smart Grid](#), [wind power](#)

Sunday, May 24, 2009

MMS Reports with or without Segmentation?

A utility specified for IEC 61850 conformant IEDs, that all the data of FC=SG are referenced in a single dataset, to make the setting group value easily read in one GetDataSetValues service. But once the data objects are too many so that one MMS PDU can't carry the values of all members, is there any method to help transmit the values of all members of such a huge dataset? The MMS standard (ISO 9506) does not have a parameter like "more follows" or "continue after". Is there a possibility at the level IEC 61850-7-2?

One can use an IEC 61850 report control block, refer to the "big" data set and run the "general interrogation" issued by a client. The reporting model provides segmentation! It is - of course - optional. So the server and the client need to support segmentation.

The IEC 61850 report message has the following parameter:

MoreSegmentsFollow (More report segments with the same sequence number follow).

Posted by [Karlheinz Schwarz](#) at [4:22 PM](#) [0 comments](#) 

Labels: [en](#), [IEC 61850](#), [MMS](#), [SCADA](#)

Power Plant DCS - Incorporating IEC 61650

A nice summary of the development of open Distributed Control Systems (DCS) for Power Plants since the eighties was written by Ralph Porfilio (ABB Power Generation).

One of crucial solutions for Open Systems is IEC 61850:

"DCS controller connectivity is currently under development for integrated IEC-61850. IEC-61850 uses Ethernet as backbone communication and will enable DCS controller integration for medium and high voltage electrical equipment. Used with electrical power distribution and substation equipment, IEC-61850 is being deployed within medium and high voltage drives, switchgear, motor starters, relay protection, generator and transformer protection, excitation and

synchronization. **DCS integration with IEC-61850** will include control, monitoring, asset monitoring, time stamp and integrated configuration tools to program the Intelligent Electrical Devices. With Profinet and IEC-61850 and an industrial Ethernet, it is expected that the DCS will be able to tightly integrate electrical system packages along with instrumentation for process control into a common system."

Click [HERE](#) for the complete paper.

Click [HERE](#) for an excerpt.

Posted by [Karlheinz Schwarz](#) at [4:21 PM](#) [0 comments](#) 

Labels: [ABB](#), [communication](#), [DCS](#), [electric power system](#), [en](#), [engineering](#), [Ethernet](#), [fieldbus](#), [IEC 61850](#), [Power Plants](#), [SCADA](#), [standards](#), [Substation](#)

Thursday, May 21, 2009


Additional 50 Million Euro funding for Electro Mobility in Germany

The German Government (Bundesministerium für Wirtschaft und Technologie BMWI) has decided to fund further R&D activities (2009-2011) with some 50 Million Euro in the domain of Information and Communication Technology (ICT) for Electro Mobility.

Five projects out of 36 proposals have been awarded. These five projects are closely related to the funded E-Energy projects.

[Click HERE](#) for the official press release (in German).

[Click HERE](#) for the "Studie zum Normungsumfeld von E-Energy" (in German)

Posted by [Karlheinz Schwarz](#) at [10:36 PM](#) [0 comments](#) 

Labels: [communication](#), [control](#), [de](#), [E-Energy](#), [electric power system](#), [electro mobility](#), [ICT](#), [Smart Grid](#)

[Newer Posts](#)

[Home](#)

[Older Posts](#)

Subscribe to: [Posts \(Atom\)](#)

News on IEC 61850 and related Standards

Daily news concerning the standards IEC 61850, IEC 61400-25, IEC 61970 (CIM), IEC 60870-5, ...


Wednesday, May 20, 2009

Australian Government to support communication for Smart Grids

ZDNet Australia reported that "The Federal Government has announced an **up to \$100 million investment in the 2009 Budget to assist the development of smart grid technology** to create a "smarter and more efficient energy network". ... Smart grid technology monitors electricity supply across distribution networks **using communications technology**."

The Australian "Information and communication technology" research will get also more funding (AUD 185.5 million over four years).

[Click HERE](#) for the ZDNet Report.

Posted by [Karlheinz Schwarz](#) at [9:42 PM](#) [0 comments](#) 

Labels: [Australia](#), [communication](#), [electric power system](#), [en](#), [Smart Grid](#), [Substation](#), [Substation Automation](#)

US DOE supports IEC 61850 for Smart Grids

The US government directly supports the application of IEC 61850 for Smart Grids in the USA. According to a ABB we have a very famous supporter for the standard: DOE Secretary Chu and Commerce Secretary Locke:

"As announced by DOE Secretary Chu and Commerce Secretary Locke on Monday, IEC 61850 will serve as **the initial smart grid interoperability standard** for substation automation and protection."

[Click HERE](#) for the full ABB Press Release.

[Click HERE](#) for a Press release of U.S. Commerce Secretary Gary Locke and U.S. Energy Secretary Steven Chu (dated May 18, 2009)

[Click HERE](#) for the NIST - Recognized Standards for Inclusion In the Smart Grid Interoperability Standards Framework, Release 1.0

Excerpt of standards from the list:

DNP3
Substation and feeder device automation

IEC 60870-6 / TASE.2
Inter-control center communications

IEC 61850
Substation automation and protection

IEC 61968/61970

Subscribe To IEC 61850 News

Blog Archive

- [2012](#) (11)
- [2011](#) (159)
- [2010](#) (153)
- ▼ [2009](#) (162)
 - [December](#) (4)
 - [November](#) (11)
 - [October](#) (17)
 - [September](#) (16)
 - [August](#) (18)
 - [July](#) (11)
 - [June](#) (9)
 - ▼ [May](#) (25)

[ABB and others push IEC 61850 all over](#)

[DDS NETCOM lädt zu IEC-61850- Informationsveranstal...](#)

[MMS Reports with or without Segmentation?](#)

[Power Plant DCS - Incorporating IEC 61650](#)

[Additional 50 Million Euro funding for Electro Mob...](#)

[Australian Government to support communication for...](#)

[US DOE supports IEC 61850 for Smart Grids](#)

Application level energy management system interfaces

IEC 62351 Parts 1-8

Information security for power system control operations

Posted by [Karlheinz Schwarz](#) at 9:30 PM 0 comments 

Labels: [CIM](#), [DNP3](#), [electric power system](#), [en](#), [IEC 61850](#), [interoperability](#), [Smart Grid](#), [Substation](#), [Substation Automation](#), [TASE.2](#)

Sunday, May 17, 2009

IEC 61850 for condition monitoring diagnosis and analysis

The [IEC TC 57](#) (document: 57/1007/DC) has invited for a new project to extend IEC 61850 and use it for CMD (Condition Monitoring Diagnosis) to diagnose the power grid health status to improve the reliability of the power system by preventing a potential failure in advance. Too many different CMD solutions in various forms from many vendors are currently used - there is need to standardize the basic information models and information exchange within IEC TC57.

It is intended to first write a report that addresses communication aspects related to specific sensor networks that are widely used as well as information exchange towards asset management systems. It is proposed to publish that report as IEC 61850-90-3.

A task force within TC57 WG10 will prepare this report. The proposed project leader is: Mr Hyuk Soo Jang, Department of Computer Software, Myong Ji Univ. Yongin, 449-728 Korea.

The TC57 P-members are invited to submit comments to this proposal and nominate experts willing to participate in that work by **2009-07-03**.

Please contact your TC 57 National Committee to receive a copy of the Invitation (57/1007/DC).

The work will address condition monitoring of equipment handled by the following technical committees of IEC: TC11 (Overhead lines), TC14 (Power Transformers), TC17 (Switchgear), TC20 (Electrical cables) and TC38 (Instrument transformers).

In addition, coordination with the work done in TC88, IEC 61400-25-6 (Condition monitoring for wind power plants) is required.

Proposed Architecture:

[IEC 61850 for condition monitoring diagnosis and a...](#)

[What would Smart Grids be without Microsoft?](#)

[Brunei - First Substation with IEC 61850](#)

[IEEE Project 2030 for Smart Grids](#)

[IEC 61850 IEDScout Version 2.0 available](#)

[IEC 61850-9-2 LE - Process Bus Support by ABB and ...](#)

[Lack of Power Engineers - A Risk for Smart Grids](#)

[Draft IEC 62351-7 - Network and System Management ...](#)

[Training Opportunities 2009](#)

[IEC 61850: German-Korean Cooperation](#)

[Interoperability - Key for Smart Grid](#)

[Smart People - The most crucial asset for Smart Po...](#)

[Testing IEC 61850 Relays and Substations](#)


[Hands-on Training on IEC 61850 in Frankfurt](#)

[US President's commitment to energy research and e...](#)

[IEC 61968 \(CIM\) - Large scale interoperability tes...](#)

[Role-based access control for IEC 61850. ...](#)

[Two day seminar on IEC 61850, IEC 61400-25, DNP3; ...](#)

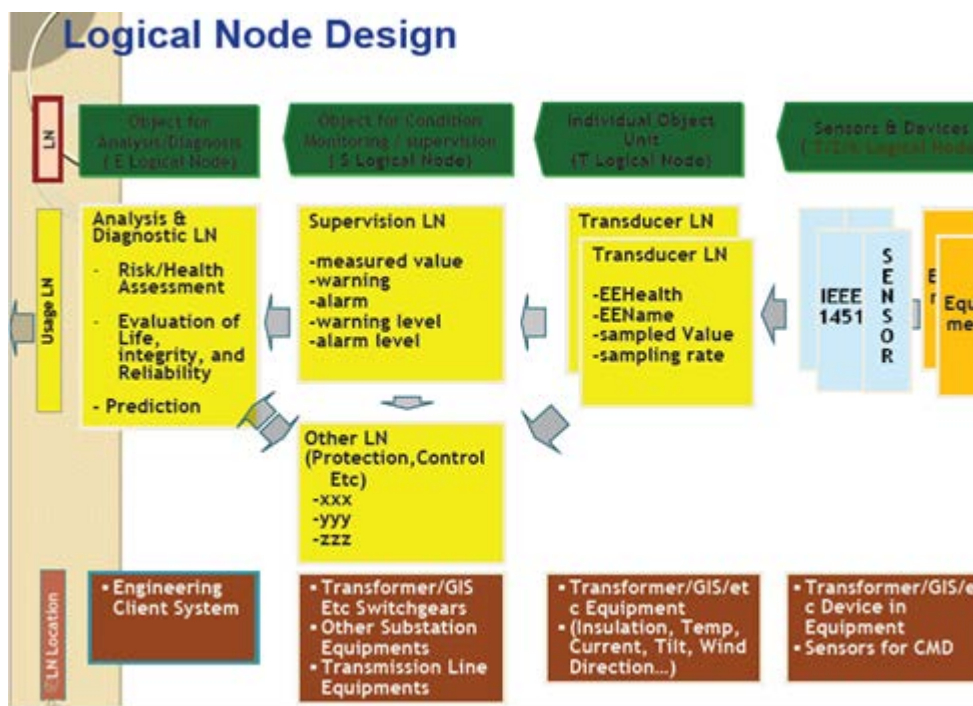

- March (16)
- February (11)
- January (13)
- 2008 (82)

Posted by [Karlheinz Schwarz](#) at 8:40 AM 0 comments

Labels: [condition monitoring](#), [electric power system](#), [en](#), [IEC 61400-25](#), [IEC 61400-25-6](#), [IEC 61850](#), [IEC 61850-7-420](#), [interoperability](#), [Power Plants](#)

Friday, May 15, 2009

What would Smart Grids be without Microsoft?

AREVA T&D (Transmission and Distribution division) announced on May 12, 2009, the extension of a 3-year long collaboration with Microsoft to develop Smarter Grid Management solutions to help the worldwide power industry to provide reliable power. AREVA T&D sees Microsoft as a strategic partner for smart grid solutions.

[Click HERE](#) for AREVA's press release.

I am not surprised that Microsoft tries to stick the nose into the tent of the electric power system's automation and control solutions. By the way, Microsoft has taken a very active role already: There are so many **Microsoft Office Power Point slides** discussing the Smart Grids and Smarter Grids available on the Web - paper doesn't blush.

In some years we will see how much smarter the grid will be as today. The smartness has to be found first at the side of human beings - then we may use tools (like ...) for devices and systems.

Do all these myriads of tools help us? Yes, if ... No, if ...

You may like the following sayings (I read some time ... I do not know who wrote it first) which I use very often:

**A fool with a tool is still a fool; and
A fool with a tool can foul up projects faster than a fool without a tool.**

One of the crucial challenges in the domain of power delivery systems is to get more "non-fool" experts for the development of tools and for the use of tools. That requires EDUCATION. Isn't it?

Power delivery systems have provided us with reliable power for


Contributors

[Michael Schwarz](#)

[Karlheinz Schwarz](#)

decades - without many "soft" tools ... talk to some well experienced senior engineers. The future of reliable and affordable power delivery systems will mainly depend on smart engineers that can judge to do the right things. Smart engineers are those that are well educated or got experience with bad judgements:

Tools are not a substitute for good judgment, and Good judgment comes from experience. Experience comes from bad judgment.

Posted by [Karlheinz Schwarz](#) at [12:14 PM](#) [0 comments](#) 

Labels: [Areva](#), [education](#), [en](#), [Microsoft](#), [Smart Grid](#), [tools](#), [Training](#)


Thursday, May 14, 2009

Brunei - First Substation with IEC 61850

A 66kV substation located near the Lumut Power Station (LPS) at Jalan Kecil Lumut with IEC 61850 compliant substation automation system (SAS) has been energized recently. This is claimed the first IEC 61850 based SAS in Brunei.

"This new system is flexible and 'open', enough for all power utility and industrial applications, and applicable at all voltage levels."

[Click HERE](#) for the news.

Posted by [Karlheinz Schwarz](#) at [11:25 PM](#) [0 comments](#) 

Labels: [electric power system](#), [en](#), [IEC 61850](#), [Power Plants](#), [protection](#), [Substation](#), [Substation Automation](#)

IEEE Project 2030 for Smart Grids

IEEE announced the other day an additional smart grid initiative for the **power engineering, communications and information technology industries**: IEEE 2030 "Guide for Smart Grid Interoperability of Energy Technology and Information Technology Operation with the Electric Power System (EPS) and End-Use Applications and Loads".

Intel will host the first P2030 meeting, open to individuals and organizations interested in smart grids, at its headquarters in Santa Clara, CA, June 3-5, 2009.

[Click HERE](#) for more information.

"Intel is honored to host the first meeting of the IEEE P2030 Committee, because the time to take action on smart grids is now," said Lorie Wigle, general manager of Intel's Eco-Technology Program Office. "To accelerate deployment of a smart energy infrastructure, the industry must work **toward interoperability and the creation of standards**. Intel's Open Energy Initiative is committed to supporting the development of **open standards** that will empower energy consumers and drive rapid integration of renewable energy sources, smart buildings, electric vehicles and other intelligent systems." Source: IEEE Website.

What does "smart" or "intelligent" mean in the context of the electric power delivery system?

I guess we can state that "smart" and "intelligent" are synonyms in this context. The [FreeDictionary](#) states the following:

"[smart](#): Characterized by sharp quick thought; bright. See **Synonyms at intelligent**: second definition below.

[intelligent](#) (*Adjectiv*):

1. having or showing intelligence: an intelligent child, an intelligent guess
2. (of a computerized device) able to initiate or modify action in the light of ongoing events"

The second definition can be applied to the power automation system IEDs (Intelligent Electronic Devices). These IEDs consume information received **from** other IEDs or the process input, **process** the information based on **algorithms and settings**, and generate information **for** other IEDs or the process output.

Information needs to be defined (information models, example: IEC 61850-7-4, IEC 61400-25-2, ...) and communicated (information flow, example: IEC 61850-7-2, 8-1, IEC 61400-25-4). The information flow needs to be configured (Example: IEC 61850-6).

IEC 61850 and IEC 61400-25 are standards that provide crucial features of **intelligent devices** used to build **smart grids** - developed by SMART people!! Data and information in the hands of smart human beings make a system smart! The algorithms and settings may be defined using the "Function Block" standard IEC 61499. [Click HERE](#) to learn more about IEC 61499.

Before we can develop Smart Grids, we need smart (or intelligent and well experienced) PEOPLE. [Click HERE](#) to learn more about Peopleware (i.e., about you and me).

Posted by [Karlheinz Schwarz](#) at 1:51 PM 1 comments 

Labels: [engineering](#), [IEC 61400-25](#), [IEC 61499](#), [IEC 61850](#), [IEC 61968](#), [IEC 61970](#), [interoperability](#), [peopleware](#), [Smart Grid](#), [workforce](#)

Wednesday, May 13, 2009

IEC 61850 IEDScout Version 2.0 available

The following updated/new features have been added:


- * New, improved Data View
Easier navigation between devices.
- * New Polling Window
Shows all polled data together, easy to use.
- * Recording of GOOSE traffic into COMTRADE files
Captures GOOSE traffic for in-depth offline analysis.

You can download IEDScout Version 2.00 from <http://www.omicron.at/iedscout>

The software you can download runs in demo mode. With an USB dongle the software runs in full mode. The demo version can be used to connect to any IEC 61850 compliant IED. The IEDScout is an IEC 61850 client, and GOOSE publisher and subscriber.

It can also be used to visualize an .icd or .scd file (IEDs in the .scd).

NettedAutomation uses the fully functional IED Scout in IEC [61850 hands-on training](#) - with dongles for the attendees.

Posted by [Karlheinz Schwarz](#) at [11:11 AM](#) [0 comments](#) 

Labels: [education](#), [en](#), [engineering](#), [GOOSE](#), [hands-on Training](#), [IEC 61850](#), [Substation](#), [Substation Automation](#)

IEC 61850-9-2 LE - Process Bus Support by ABB and others

The IEC 61850-9-2 LE (Lite Edition) is key for the first implementations of the IEC 61850 Process Bus. The 9-2 LE edition defines two specific profiles for the exchange of sampled values:

- 80 samples per nominal period for protection applications; one set of samples is sent immediately in one SMV message.
- 256 samples per nominal period for metering applications; eight sets of samples are sent in one SMV message.

[Click HERE](#) to download the IEC 61850-9-2 LE (Users Guide) from the UCA International Usersgroup.

ABB stated that "Based on the new technologies ..., the substation footprint can be reduced by more than 50 percent, while at the same time increasing its availability and reliability."

[Click HERE](#) for a report from ABB on first experiences with the IEC 61850 Process Bus.

It could be expected that sampled values and GOOSE messages on a process bus will be used in larger scales in about two to four years.

[Click HERE](#) for some information of the process bus pilot under way at RWE (Germany - the second biggest German utility).
SCC/NettedAutomation is involved with HesoTech (Germany) in the [transformer monitoring system based on IEC 61850](#).

[Click HERE](#) for a Paper on the pilot project (in German).

Posted by [Karlheinz Schwarz](#) at [5:57 AM](#) [0 comments](#) 

Labels: [ABB](#), [electric power system](#), [en](#), [GOOSE](#), [HesoTech](#), [IEC 61850](#), [IEC 61850-9-2](#), [process bus](#), [sampled value](#), [SMV](#)

Tuesday, May 12, 2009

Lack of Power Engineers - A Risk for Smart Grids

If you are working in the domain of Power Systems in utilities or industrial plants, look around your workplace. Almost half of the people may walk out of the door during the next five to ten years - may be even you!

There is a need to replace the "heads" - let's say for every one that leaves there is a replacement (we are far away from that - but let's assume it). Does this help? To some extend. The people that leave are often the most experienced people. New people help to keep the "Head Count" at a reasonable level - but what's about the "Head Content"? It seems to be required to do more than to keep the numbers of engineers and other experts at the same amount as today.

There is another issue to mention: All the new technologies walking into the power systems: Smart Grid, Smarter Grid, renewables, PHEV, information and communication technologies (ICT), monitoring the Grid and ICT infrastructure, ... Engineers have to manage the existing

system and get prepared for the many changes to come very soon.


Utilities and all other stake holders need to keep an eye on the planning of the recruitment of their future work force AND **training in these new technologies** of the people still there for the next 10 to 20 years! While universities partly start to get involved in the advanced ICT for power systems it seems to be crucial to also use other education possibilities: **The training offered by independent and well experienced experts.**

International standards like IEC 61968 (CIM), IEC 60870, IEC 61850, IEC 61400-25, ... are a pivotal point for the interoperability in the future electric power systems – they can make the system smarter than it was in the past, and keep the number of incompatible solution very low.

Massachusetts-based utility NSTAR is getting prepared they can replace the people about to walk out the door. [Click HERE for a podcast at Pennet.](#)

IEEE PES is also concerned about the situation. They have published recently a Report on the crucial issue:

"Preparing the U.S. Foundation for Future Electric Energy Systems: A Strong Power and Energy Engineering Workforce" [Click HERE](#) to download the IEEE report [PDF].

Posted by [Karlheinz Schwarz](#) at [11:43 PM](#) [0 comments](#) 

Labels: [education](#), [en](#), [engineering](#), [IEC 61850](#), [IEC 61968](#), [interoperability](#), [peopleware](#), [power systems](#), [Training](#), [workforce](#)

Monday, May 11, 2009

Draft IEC 62351-7 - Network and System Management objects

The IEC TC 57 Committee Draft for IEC 62351-7 TS Ed.1 has been published the other day (document 57/1003/DTS): Power systems management and associated information exchange – Data and communication security – **Part 7: Network and system management (NSM) data object models**

Closing date for comments: **2009-08-07**
(contact your [national TC 57 committee](#) for a copy).

These NSM data objects will be used to monitor the health of networks and systems, to detect possible security intrusions, and to manage the performance and reliability of the information infrastructure in power systems.

Scope and Objectives

Power systems operations are increasingly reliant on information infrastructures, including communication networks, intelligent electronic devices (IEDs), ... Therefore, management of the **information infrastructure** has become crucial to providing the necessary high levels of security and reliability in power system operations. Using the concepts developed in the IETF Simple Network Management Protocol (SNMP) standards for network management, IEC 62351-7 defines Network and System Management (NSM) data object models that are **specific to power system operations**. These NSM data objects will be used to monitor the health of networks and systems, to detect possible security intrusions, and to manage the performance and reliability of the information infrastructure. These data objects are defined as

abstract data objects. These abstract data objects will be mapped to specific standards, such as IEC 61850, IEC 60870-5, IEC 60870-6, IEC 61968/61970 (CIM), web services, SNMP. These mappings will be defined later.

The utility industry should take these activities very serious - the many objects that will be standardized have a crucial impact on the **power system monitoring!** It is likely that the infrastructure will provide much more status information (provided by many "software" sensors) than the power delivery process (breaker status, voltage, current, oil pressure of a transformer, ...). Be aware that the ICT (information and communication technology) infrastructure will become very comprehensive (!!); may no too complex - but providing hundreds or thousands of new "Signals" not needed today! **Get involved in the future of YOUR power system.**

Posted by [Karlheinz Schwarz](#) at [2:14 AM](#) [0 comments](#) 

Labels: [DNP3](#), [electric power system](#), [en](#), [IEC 61850](#), [interoperability](#), [mapping](#), [SNMP](#)

Saturday, May 9, 2009

Training Opportunities 2009

NettedAutomation GmbH holds three public seminars/trainings in 2009:

Kuala Lumpur (Malaysia): 26-27 May 2009
Frankfurt (Germany): 20-23 October 2009
San Antonio, TX (USA): 29-30 October 2009

1. Kuala Lumpur (Malaysia)

A two day International Conference (27-28 May 2009) and a one day Pre-Conference Seminar (26 May 2009) will be held at PWTC in Kuala Lumpur (Malaysia)

The program and registration form [pdf, 530 KB] can be downloaded [HERE](#)

2. Frankfurt (Germany)

The third four (three) day Comprehensive & Independent Hands-on Training by NettedAutomation and STRI will be held in Frankfurt (Germany) on 20-23 October 2009

The program and registration form [pdf, 500 KB] can be downloaded [HERE](#)

3. San Antonio, TX (USA)

Two-Day Special Course on IEC 61850, IEC 61400-25, and DNP3 will be held at the Remote 2009 Conference and Expo in San Antonio, TX (USA) on 29-30 October 2009

The program and registration form can be accessed [HERE](#)

This event will educate you in the latest development of the Backbone for the "Smart Grid": The advanced Automation of the power generation, transmission and distribution systems and process Automation systems with standard compliant devices and systems.

These events make you, the experts - the most crucial asset! - smarter.

Posted by [Karlheinz Schwarz](#) at [2:01 AM](#) [0 comments](#) 

Labels: [conference](#), [DER](#), [electric power system](#), [en](#), [hands-on Training](#), [IEC 61850](#), [peopleware](#), [Smart Grid](#), [Substation Automation](#), [Training](#), [wind power](#)

Friday, May 8, 2009

IEC 61850: German-Korean Cooperation

The Korean Electrical Manufacturers Association (KOEMA), and DKE (Deutsche Kommission Elektrotechnik Elektronik Informationstechnik im DIN und VDE) signed a MoU (Memorandum of Understanding) to cooperate in the domain of power system standardization: especially with regard to IEC 61850 and SmartGrid. DKE K 952 mirrors the IEC TC 57 activities on IEC 61850. DKE has published several documents on the use of IEC 61850 [[web page with use cases in English](#)].

[Click HERE](#) for press release on the MoU in German.

Posted by [Karlheinz Schwarz](#) at [10:36 PM](#) [0 comments](#) 

Labels: [electric power system](#), [IEC 61850](#), [Smart Grid](#)

Thursday, May 7, 2009

Interoperability - Key for Smart Grid


NIST to Receive \$610 Million Through Recovery Act

"The National Institute of Standards and Technology (NIST) will receive \$610 million in funds as part of the American Recovery and Reinvestment Act of 2009. The agency will use the funds for programs that support U.S. innovation and industrial competitiveness, key factors in spurring economic growth.

The Act provides \$220 million in direct appropriations for NIST laboratory research, competitive grants, research fellowships, and advanced research and measurement equipment and supplies. ... Additional funding transferred to NIST from other federal agencies includes ... **\$10 million for collaborative efforts to develop a comprehensive framework for a nationwide, fully interoperable smart grid for the U.S. electric power system.**"

[Click HERE](#) for more details from NIST.

What is Interoperability? According to [IEC 61850](#) it is the **ability of two or more IEDs** (Intelligent Electronic Devices) from the same or different vendors, to exchange information and use that information for correct execution of a specified function. Interoperability needs to be tested - just claiming that a device is conformant to a standard is not sufficient. [STRI](#) (Ludvika, Sweden) provides [interoperability tests](#) for IEC 61850 and IEC 61400-25 compliant devices.

Posted by [Karlheinz Schwarz](#) at [11:39 AM](#) [0 comments](#) 

Labels: [electric power system](#), [en](#), [IEC 61850](#), [interoperability](#), [interoperability tests](#), [standards](#)

Wednesday, May 6, 2009

Smart People - The most crucial asset for Smart Power Systems

As a consultant for Power Automation Systems I am traveling all over educating utility people to better understand the paradigm shift from today's - some times electromechanical - solutions to the use of ICT (Information and Communication Technologies) in the power world. I

am very concerned that the most crucial Asset - the PEOPLE - is often understood to save money: less people, less education, less ... leads to better profits - yes, in the Short Term!

This morning I read a very interesting (not surprising) viewpoint written by the Editor Emeritus of the [Hydro Power Magazine HRW](#) (May 2009 issue, Vol. 17, No 2) with the title:

Dams and Hydropower Endure ...
Yet, the Right **People** Are Needed!

"Dams and hydropower facilities are almost uniquely enduring ... in a world too often focused on the "next quarter" (or, perhaps, the next election). Many beneficial facilities exceed 50 -and some 100 -years of age.

While such facilities can seem ageless, the people who tend to them are not. In fact, multiple generations of **educated, trained, and experienced individuals** are required to care for these facilities. As things continually change, it's important that personnel needs not be minimized. It must remain a top priority to do what's necessary to ensure that people are available and **well-trained** to provide needed stewardship. ... Today there is a heightened concern over adequate staffing and technical support, as policy-and decision-makers often have quite limited knowledge of the needs, associated risks, and possible consequences of failing to appropriately address "people" needs."

Low and high level investments in the power industry are really challenging. In the recent years you could see many companies cutting personal - often the well educated and experienced experts left their firm in the age of 55 to 60. Many experts are still available. Some of them are really not looking for the paradigm shift because this would require to learn a lot of new stuff. I have heard that a manager said: "If you want to use this new technology, you have wait until I have retired!"

Some two years ago I did some education on IEC 61850 at a small utility. Some six months later I asked about the progress they made in the meantime. The answer was: "We are still two retirements away from IEC 61850!"

The years to come may provide huge investments (many billions of USD or EUR or ... for the Smart Grid). Check the announcements of the last days or weeks.

How could the relatively few engineers spent this huge amount of money? Often the utilities will just buy what's available - to keep the power flowing. There is usually not much time at all to get the key people trained in order to become able to use the new technology for the benefit of the utility. Investing huge amounts of money without a solid and well thought plan will lead to this: **Today's solution will become tomorrow's problems.**

The Power Delivery Systems Endures ...
Yet, the Right **People** Are Needed - people educated and experienced!

Education is when you study the new ICT solutions based on International Standards -- **Experience** is what you get if you don't. Human beings learn only by experience - but only by their own experience. Benefit from the experienced senior engineers that are open to the use of advanced ICT.

Read the following paper discussing the "Impact of IEC 61850 on System Engineering, Tools, Peopleware and the Role of the System Integrator" [[full paper](#)] and [[slides](#)]

Finally, let me briefly discuss "Smart Grids":

"Data" becomes "Smart Data"

"Smart Data" becomes "Smarter Data"


"Grid" becomes "Smart Grid"

"Smart Grid" becomes "Smarter Grid"

"People" need to become "Smart People"

"Smart People" need to become "Smarter People"

Smart (well educated) People are the prerequisite to use data, software, devices, tools, and the grid to **build Smart Power Systems!**

Posted by [Karlheinz Schwarz](#) at [12:39 AM](#) [0 comments](#) 

Labels: [education](#), [en](#), [IEC 61850](#), [peopleware](#), [Smart Grid](#), [Training](#)

Tuesday, May 5, 2009

Testing IEC 61850 Relays and Substations

Megger provides a test device to monitor GOOSE messages, e.g., messages to trip a circuit breaker etc.

The test device can be configured using a SCL file.

[Click HERE](#) for more information on the MPRT test tool.

Test sets from Omicron, Doble and Megger are in action during the Hands-on Training sessions of STRI & NettedAutomation. [Click HERE](#) for information on the Hands-on Training scheduled for Frankfurt, 20-23 October 2008.

Posted by [Karlheinz Schwarz](#) at [10:12 PM](#) [0 comments](#) 


Labels: [en](#), [GOOSE](#), [IEC 61850](#), [Relays](#), [SCL](#), [Substation Automation](#), [test set](#), [testing](#), [Training](#)

Hands-on Training on IEC 61850 in Frankfurt

NettedAutomation and STRI offer the next Comprehensive & Independent Hands-on Training to be held in Frankfurt (Germany) on 20-23 October 2009:

The Future of Power Systems Requires Comprehensive Know-how IEC 61850 is the global standard for Power System Automation (generation, transport, distribution ... high, medium and low voltage levels). It allows for an open and "future proof" design, different architectures and possibilities to combine products from multiple vendors. In order for users and system integrators to utilize the benefits of IEC 61850 it is necessary for power utilities, integrators and vendors to education their most crucial asset – people, and start the migration to IEC 61850.

[Click HERE](#) for the program and other details.

Posted by [Karlheinz Schwarz](#) at [11:44 AM](#) [0 comments](#) 

Labels: [en](#), [engineering](#), [Ethernet](#), [GOOSE](#), [hands-on Training](#), [IEC 61850](#), [IEC 61850 edition 2](#), [IEC 61850-7-420](#), [IEC 61850-9-2](#), [IEC61850](#), [interoperability](#), [interoperability tests](#), [process bus](#), [Substation](#), [Substation Automation](#), [wind power](#)

US President's commitment to energy research and education

US President Obama has committed to high increase in funding for the future of the US energy supply. In a speech to the National Academy of Sciences he made a very strong commitment to support R&D, education, ... to "enlist the **talents and skills of the very best American scientists and engineers** to address current fundamental scientific roadblocks to **clean energy** and **energy security**."

"In the 1950s and 1960s, Sputnik and the space race inspired young people to pursue careers in science and engineering. The average age of NASA's Mission Control during the Apollo 17 Mission, for example, was 26.

President Obama believes that we have a similar opportunity to inspire today's young people to tackle the single most important challenge of their generation – the need to develop cheap, abundant, clean energy and accelerate the transition to a low carbon economy." ...

"The President's initiative will empower young men and women to invent and commercialize advanced energy technologies such as efficient and cost effective methods for converting sunlight to electricity and fuel, carbon capture and sequestration, stationary and portable advanced batteries for plug-in electric cars, advanced energy storage concepts that will enable sustained energy supply from solar, wind, and other renewable energy sources, high-efficiency deployment of power across **"smart grids"** and carbon neutral commercial and residential buildings."

[Click HERE](#) for the complete ARPA-E news letter.

[Education on international standards](#) is one of the pillars of the future "smart grids" - education of people that **want to become engineers** and education of **engineers that are already working for years**. In some years down the road most young engineers are likely to have a solid knowledge of modern information and communication technologies. In the meantime many well experienced power engineers need to understand better the change in power system automation: the shift from wires to smart networks: to the **distributed energy web**. Every node in the network would have to be awake, responsive, flexible, and – most important – interconnected with everything else!

[Click HERE](#) for a comprehensive paper on "*Seamless Communication with IEC 61850 for Distributed Power Generation*" (presented in 2002 at the DistribuTech 2002, Miami)

Posted by [Karlheinz Schwarz](#) at [10:20 AM](#) [2 comments](#) 

Labels: [DER](#), [en](#), [engineering](#), [Obama](#), [Smart Grid](#), [standards](#), [US president](#)

Sunday, May 3, 2009


IEC 61968 (CIM) - Large scale interoperability test in Europe

UCTE (Union for the Co-ordination of Transmission of Electricity) and the Electric Power Research Institute (EPRI, Palo Alto, CA, USA), along with European and American vendors and Transmission System Operators (TSO) organized a large CIM (Common Information Model) interoperability test. The test, held on March 23rd – 27th in Paris, was organized by UCTE, directed by EPRI and hosted by RTE (TSO of France).

[CLICK here](#) for the UCTE press release.

[CLICK here](#) to learn about CIM.

UCTE is the association of transmission system operators in continental Europe, providing a reliable market base by efficient and secure electric "power highways". An "electronic highway" for ITC (information technology and communication) is under way.

Posted by [Karlheinz Schwarz](#) at [10:36 AM](#) [0 comments](#) 

Labels: [CIM](#), [en](#), [IEC 61968](#), [IEC 61970](#), [interoperability](#), [interoperability tests](#)

[Newer Posts](#)

[Home](#)

[Older Posts](#)

Subscribe to: [Posts \(Atom\)](#)

News on IEC 61850 and related Standards

Daily news concerning the standards IEC 61850, IEC 61400-25, IEC 61970 (CIM), IEC 60870-5, ...

Sunday, May 3, 2009

Role-based access control for IEC 61850, ...

The IEC TC 57 Committee Draft for **IEC/TS 62351-8** Ed. 1.0 has been published the other day (document 57/1001/CD):

Power systems management and associated information exchange -
Data and communications security - Part 8: Role-based access control.

Closing date for comments: **2009-08-07**
(contact your [national TC 57 committee](#) for a copy).

This document provides a technical specification for access control in power systems. The power system environment supported by this specification is enterprise-wide and extends beyond traditional borders to include external providers, suppliers, and other energy partners.

This specification defines role-based access control (RBAC) for enterprise-wide use in power systems. It supports a distributed or service-oriented architecture where security is distributed service and applications are consumers of distributed services.

The access control for IEC 61850 data objects is to implement by the virtual access view with the following roles:

- VIEW right: Allows the user/role to discover what objects are present within a Logical Device. If this right is not granted to a user/role, the Logical Device for which the View privilege has not been granted shall not appear.
- READ right: Allows the user/role to obtain the values of objects that are present within a logical device.
- DATASET right: Allows the user/role to have full management rights for both permanent and non-permanent DataSets.
- REPORTING right: Allows a user/role to use buffered reporting as well as un-buffered reporting.
- FILE right: Allows the user/role to have restricted rights for File Services.
- CONTROL right: Allows a user to perform control operations.
- CONFIG right: Allows a user to remotely configure certain aspects of the server.
- SETTINGGROUP right: Allows a user to remotely configure Settings Groups.
- MNGT right: Allows the role to transfer substation configuration language files and other files, as well as delete existing files.
- SECURITY: Allows a user/role to perform security functions at both a Server/Service Access Point and Logical Device basis.

Posted by [Karlheinz Schwarz](#) at [7:43 AM](#) [0 comments](#) 

Labels: [en](#), [IEC 61850](#), [IEC61850](#), [MMS](#), [RBA](#), [security](#)

Saturday, May 2, 2009

Subscribe To IEC 61850 News

 Posts 

 All Comments 

Blog Archive

- [2012](#) (11)
- [2011](#) (159)
- [2010](#) (153)
- ▼ [2009](#) (162)
 - [December](#) (4)
 - [November](#) (11)
 - [October](#) (17)
 - [September](#) (16)
 - [August](#) (18)
 - [July](#) (11)
 - [June](#) (9)
 - ▼ [May](#) (25)

[ABB and others push IEC 61850 all over](#)

[DDS NETCOM lädt zu IEC-61850- Informationsveranstal...](#)

[MMS Reports with or without Segmentation?](#)

[Power Plant DCS - Incorporating IEC 61650](#)

[Additional 50 Million Euro funding for Electro Mob...](#)

[Australian Government to support communication for...](#)

[US DOE supports IEC 61850 for Smart Grids](#)

Two day seminar on IEC 61850, IEC 61400-25, DNP3; October 29-30, San Antonio (TX)

A Two-Day Special Course on IEC 61850, IEC 61400-25, DNP3 will be held during the "Remote 2009 Conference and Expo", October 29th & 30th, 2009 in San Antonio, Texas (USA).

The reality of the world-wide retiring process of the most valuable assets (the senior engineers in the utilities) the aging systems, the companies tightening budgets and lowering sales expectations could bring some great opportunities for everyone involved in information management of local and remote devices and processes. Less people means less proprietary solutions could be supported. This is the time for a single, internationally standardized and accepted solution: IEC 61850.

In this comprehensive 2-day workshop students learn the fundamental concepts and vision of the IEC 61850 standard series. Students compare traditional solutions like DNP3 and the new OPC UA to IEC 61850 and discuss the strength each method offers. All the IEC 61850 standards, their extensions, and many application domains are briefly discussed and the class delves into IEC 61850 real-time and client/server solutions.

Click [HERE](#) for full details and registration information.

Posted by [Karlheinz Schwarz](#) at [12:32 AM](#) [0 comments](#) 

Labels: [conference](#), [DNP3](#), [en](#), [IEC 61400-25](#), [IEC 61850](#), [IEC 61850-7-420](#), [OPC](#), [questions](#), [RTU](#), [seminar](#), [Training](#), [wind power](#)

Wednesday, April 29, 2009

Industrial Plants - Easier Integration of Automation and Electrical Systems

Usually the **automation of production processes** (DCS - Distributed Control System) and the **electrical distribution system** in an industrial plant are two - more or less - independent systems. The electric energy is a very crucial raw material that needs be taken into account in the automation system of the production process.

ABB has focused on this integration during last week's Hanover Industrial Fair (HMI, Hanover Germany) pointing to **IEC 61850** as an **universal integration standard**:

Excerpt from the news letter: "... What has been standard in the sector of power generation and supply is now also coming to effect in the process automation sector. The **international standard IEC 61850** allows the integration of automation and electrification as well as energy distribution and management, thus providing operators and other users with essential information on the overall system. If, for example, the targeted productivity of a plant does not tolerate process interruptions, the integrated communication allows to implement optimized failure scenarios for load shedding. The operator can quickly respond and optimally use the energy available. Particularly for industries with high energy demand, the production capacities can be geared towards optimized consumption – costly peak loads can thus be avoided. ..."

ABB news letter [PDF: [English](#) - [German](#)]

Power plant projects that use IEC 61850 for system integration ... [PDF: [English](#)]

[IEC 61850 for condition monitoring diagnosis and a...](#)

[What would Smart Grids be without Microsoft?](#)

[Brunei - First Substation with IEC 61850](#)

[IEEE Project 2030 for Smart Grids](#)

[IEC 61850 IEDScout Version 2.0 available](#)

[IEC 61850-9-2 LE - Process Bus Support by ABB and ...](#)

[Lack of Power Engineers - A Risk for Smart Grids](#)

[Draft IEC 62351-7 - Network and System Management ...](#)

[Training Opportunities 2009](#)

[IEC 61850: German-Korean Cooperation](#)

[Interoperability - Key for Smart Grid](#)

[Smart People - The most crucial asset for Smart Po...](#)

[Testing IEC 61850 Relays and Substations](#)

[Hands-on Training on IEC 61850 in Frankfurt](#)

[US President's commitment to energy research and e...](#)

[IEC 61968 \(CIM\) - Large scale interoperability tes...](#)

[Role-based access control for IEC 61850, ...](#)

[Two day seminar on IEC 61850, IEC 61400-25, DNP3; ...](#)

► April (11)

► March (16)

Use of IEC 61850 in Power Plants (hydro, wind, ...) [PDF: [English](#)]

Posted by [Karlheinz Schwarz](#) at 9:48 PM 0 comments 


Labels: [ABB](#), [DCS](#), [de](#), [en](#), [IEC 61850](#), [IEC61850](#), [integration](#), [power distribution](#), [Power Plants](#), [process control](#), [Substation Automation](#)

Tuesday, April 28, 2009

Why do we need Single Point and Double Point Status?

The Single Point signals and Double Point signals for Status monitoring of e.g. circuit breaker switch positions in substations are quite special in process control systems. The basic definitions have been made in fifties of the last century - when remote monitoring was realized with electro-mechanical relays, contacts, wires and relay inputs.

The most simplest approach was to use a single contact to signal a switch position: 110 V on the input contact = Switch closed; no voltage = Switch open. This single contact is called "a Single Point Signal":

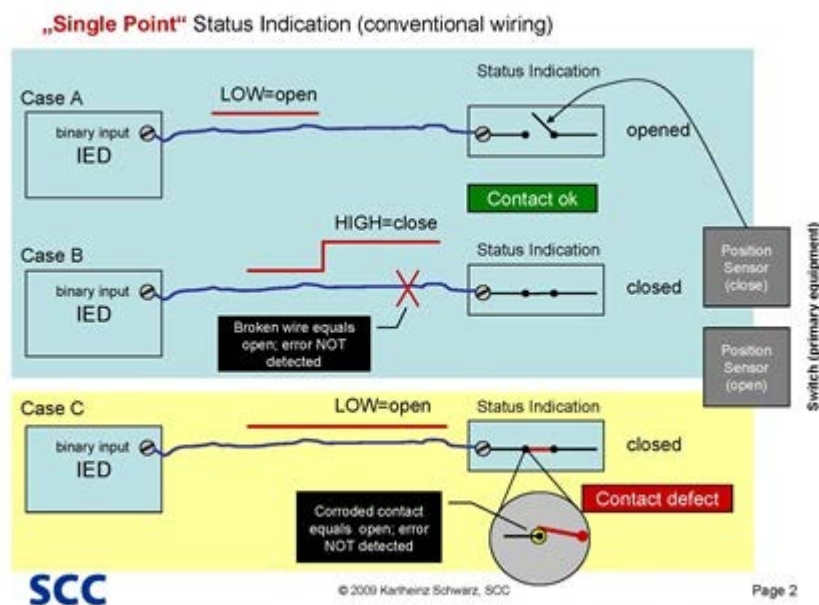

This solution was not very safe. Think of broken wire that was not detected. Or of a contact that was not closed for a long time. After that time the contact may have been corroded so that after closing the contact mechanically there is no electrical contact! The receiving device would not be informed that the switch has been closed!

Engineers found solutions to solve the problem: They invented the "Double Point Signal":

► February (11)


► January (13)

► 2008 (82)

Contributors

[Michael Schwarz](#)

[Karlheinz Schwarz](#)

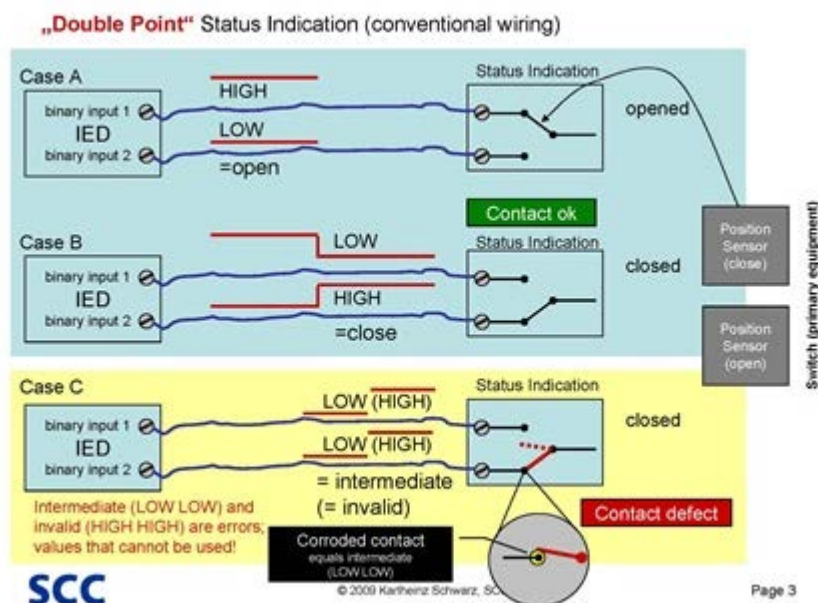

Page 3

Single Point and Double Point Data Types are still in use in serial communication systems like DNP3, IEC 60870-5-104 or IEC 61850. The IEC 61850-7-3 defines these types -- so-called Common Data Classes (CDC).

The reason for Double Point Status in serial communication systems (like the IEC 61850-7-3 CDC DPS) is quite different: the two bits for the representation of "open" and "close" make the status message secure. A single bit error does not cause a wrong interpretation of the value! The value will not be valid anymore.

More details on the basic modeling approach of process information and information exchange is provided in the comprehensive and neutral seminars and training classes of NettedAutomation GmbH ([details](#)). Now is the time to get more education.

Posted by [Karlheinz Schwarz](#) at 7:46 AM 0 comments

Labels: [control](#), [control center](#), [DNP3](#), [double point](#), [I/Os](#), [IEC 60870-5-104](#), [IEC 61850](#), [models](#), [single point](#), [status message](#)

Q&A on IEC 61850 from attendees of seminar in Moscow

The attendees of the IEC 61850 seminar held in Moscow (Russia) recently provided more than [10 questions on IEC 61850 that have been answered in written form](#) [pdf, 47 KB] ... the questions have been discussed during the class. Usually attendees provide questions prior to the classes.

Posted by [Karlheinz Schwarz](#) at 6:33 AM 0 comments

Labels: [en](#), [Ethernet](#), [IEC 61850](#), [interoperability](#), [questions](#), [redundancy](#), [RTU](#), [SCADA](#), [Substation](#), [Training](#)

Monday, April 27, 2009

Protocol Message Repository

If you are looking for traces of packets (e.g. [MMS](#) messages) you can find a huge and growing repository provided by [Mu Dynamics](#): [Pcap](#).

Have a look - it has many features. [MMS message traces ...](#)

Posted by [Karlheinz Schwarz](#) at [11:13 PM](#) [1 comments](#) 

Labels: [en](#), [message encoding](#), [MMS](#), [pcap](#)

Saturday, April 25, 2009

Green Power Superhighway

US FERC (Federal Energy Regulatory Commission) supports a proposed 3,000-mile regional "green power superhighway" designed to deliver wind-powered renewable energy from the upper Midwest to consumers in and around Chicago, Minneapolis and other load centers.

The cost for the new 765 kV transmission system is estimated at \$10 - 12 billion and deliver up to 12,000 megawatts. [News letter \[pdf\]](#)

Under the assumption of 3 MW wind turbines it would require some 4,000 wind turbines to be installed!

What do these systems need? Information and communication systems ... a bright future for today's communication standards.

Posted by [Karlheinz Schwarz](#) at [12:36 AM](#) [0 comments](#) 

Labels: [DER](#), [en](#), [IEC 61400-25](#), [monitoring](#), [wind power](#), [wind turbine controller](#)

Friday, April 24, 2009

Mit oder ohne Gateway - geschlossen oder offen?

Seit Mitte der achtziger Jahre des letzten Jahrhunderts wird immer wieder über offene und geschlossene Informations- und Kommunikationssysteme diskutiert. Während einer der ersten öffentlichen Konferenzen zu offenen Systemen (etwa 1983) habe ich gehört, wie Kritiker offener Systeme die Lokalen Netzwerke (LAN) und offene Systeme wie folgt kommentierten:

LAN = **L**eidvolle **A**nwender-**N**euorientierung

Offene Systeme - **"Wer offene Systeme will, der ist nicht ganz dicht!"**

Wie sieht nach 25 Jahren im industriellen Automatisierungsbereich die Situation aus?

Offene Systeme werden sich global - mal mehr und mal weniger - in vielen Anwendungsbereichen durchsetzen! Ohne Zweifel!

Damit offene Systeme **"dicht"** bleiben, müssen angemessene Sicherheitsmaßnahmen ergriffen werden! **Viele Systeme sind nicht "ganz dicht"** - sie laden regelrecht zu einem "Besuch" ein! Wenn der Zugriff auf viele Informationen möglich ist, dann ist es sehr wahrscheinlich, dass bald jemand davon Gebrauch macht! Aus Neugierde oder zum Schaden des Systembetreibers!

Ethernet-Lösungen, mit denen **"Das Ende der Gateways"** (die totale Offenheit) verkündet wird ([Artikel in der C&A 03/2009](#)), können sinnvoll


eingesetzt werden, wenn angemessene Security-Maßnahmen ergriffen werden, die das Gesamtsystem (traditionelle IT **und** Prozess-IT) **"dicht"**, das heißt, sicher machen".

*Auszug aus dem C&A-Artikel: "Ein Ethernet-Netzwerk für alle Applikationen eines Unternehmens – ohne Bruch zwischen Echtzeit- und Standard-Anwendung! Diese Vision beschäftigt seit Anfang des Jahrtausends intensiv die Automatisierungstechniker. Harting zeigt zur Hannover Messe erstmals Switches, die nun beide Welten zusammenführen – **ohne die bis dato notwendigen Gateways.**"*

Offenheit ist bei machen schon zur Religion geworden: "Echelon is agnostic about modems, Lund explained as he stood for a 30-minute interview. **"Our only religion is it must be IP."**" (Quelle: [SmartGridToday](#))

Die notwendigen IT-Security-Maßnahmen werden in vielen Prozess-Automatisierungssystemen sehr oft (zu oft!) als Aufgabe der IT-Abteilung gesehen! Mit der zunehmenden Ethernet- und IP-Vernetzung muss in Automatisierungssystemen eine vernünftige Balance zwischen einer **notwendigen funktionalen Offenheit** und einer **hinreichenden System-Sicherheit** gefunden werden.

Haben Sie Fragen zur IT-Sicherheit von Systemen, in den offene Kommunikationsnormen wie IEC 61850, IEC 61400-25, IEC 60870-5-10x angewendet werden? [Kontakt.](#)

Posted by [Karlheinz Schwarz](#) at 8:48 AM 0 comments 

Labels: [de](#), [Ethernet](#), [Gateway](#), [IEC 60870-5-101](#), [IEC 60870-5-104](#), [IEC 61400-25](#), [IEC 61850](#), [security](#)


Low voltage electrical measurements and general I/O's with IEC 61850

Camille Bauer (Switzerland) offers a **measurement** IED for electric distribution systems or industrial facilities compliant with IEC 61850. The IED can also be used as a **Gateway** for many other input and output signals. SINEAX CAM-POWER is designed for measurements in electric distribution systems or in industrial facilities.

The following Logical Nodes are supported:

- [SINEAX CAM Universal measuring unit for heavy current variables \[en\]](#)
- [SINEAX CAM Universelle Messeinheit für Starkstromgrößen \[de\]](#)
- [Installation \[en/de\]](#)
- [General information](#)

The IED is a good example that demonstrates that advanced IEDs can run several applications: measurements, general I/O's or logic functions. The classical PLC (programmable logic controller) with its special hardware has been converted to a software that can run on almost any hardware platform with Ethernet, TCP/IP and upper layer protocols.

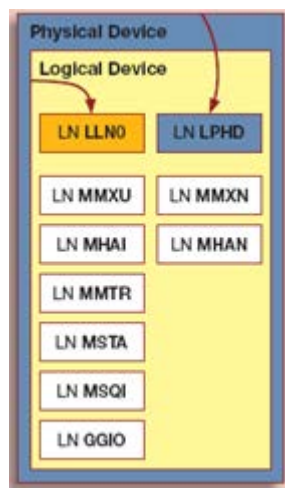

Protection IEDs have integrated Ethernet switches ... it is likely that classical Ethernet Switches will soon provide general I/O's and logic

function. IEDs will become more multifunctional!

Upper layer protocols and other definitions like information models and configuration language according to IEC 61850 will play a crucial role in future automation systems.

Posted by [Karlheinz Schwarz](#) at 7:21 AM 0 comments 

Labels: [control](#), [Data concentrator](#), [de](#), [en](#), [Gateway](#), [GGIO](#), [IEC 61850](#), [RTU](#), [Substation](#), [Substation Automation](#)

Friday, April 17, 2009

NERC refers to IEC 61400-25

The North American Electric Reliability Corporation (NERC) has published a special report "Accommodating High Levels of Variable Generation" on April 16, 2009 . The report discusses the planning and **operation** of the future power system with high volume of flexible grid resources like wind power or plug-in hybrid electric vehicles. A crucial element in the future power delivery system will be the **information and communication technology**.

IEC TC 57 and TC 88 have published International Standards for most crucial aspects of future power delivery systems: IEC 61850 and IEC 61400-25 (extending IEC 61850 for wind power). The NERC report refers to IEC 61400-25 in clause 2.4.3:

"2.4.3. Power Management

For variable generation to provide power plant control capabilities, it must be visible to the system operator and able to respond to dispatch instructions during normal and emergency conditions. Real-time wind turbine power output, availability, and curtailment information is critical to the accuracy of the variable generation plant output forecast, as well as to the reliable operation of the system. It is critical that the Balancing Area operator have **real-time knowledge of the state of the variable generation plant and be able to communicate timely instructions to the plants**. In turn, variable generation plant operators **need to respond** to directives provided by the Balancing Area in a timely manner. The need for this information was clearly illustrated during the restoration of the UCTE system following the disturbance of Nov. 9, 2006 **when there was a lack of communications between distribution system operators (DSOs) and transmission system operators (TSOs)** delayed the TSO's ability to restore the bulk power system.

Therefore, as small variable generation facilities grow into significant plants contributing significantly to capacity and energy, **balancing areas will require sufficient communications for monitoring and sending dispatch instructions to these facilities**. *(Foot note: An international standard communications protocol has been prepared, IEC 61400-25, Wind turbines – Communications for monitoring and control of wind power plants – Overall description of principles and models, International Electrotechnical Commission, December, 2006).*

Further, Balancing areas and generator owner/operators must ensure procedures, protocols, and **communication** facilities are in place so dispatch and control instructions can be **communicated** to the variable generation plant operators in a timely manner. **Adequate communication** of data from variable generation and **enhanced system monitoring** is not only a vital reliability requirement, but is also necessary to support the data analysis posed by other recommended NERC and Industry actions."

[\[Press Release\]](#)

[\[Executive Summary\]](#)

[\[Full Report\]](#)

Posted by [Karlheinz Schwarz](#) at [2:18 AM](#) [0 comments](#) 

Labels: [condition monitoring](#), [control](#), [control center](#), [DER](#), [en](#), [IEC 61400-25](#), [IEC 61850](#), [integration](#), [interoperability](#), [monitoring](#), [wind power](#)

Thursday, April 16, 2009

Process and Power Automation use ONE Integration Standard - IEC 61850

Comprehensive automation systems are in use in many application domains like:

- Factories (factory automation),
- Chemical and power plants (process automation),
- Electrical transmission and distribution substations (substation automation)
- ...

Usually these domains have their **own** solutions - there are many reasons (often historical reasons). They even have their own standardization bodies: Factory automation: ISO TC 184, process automation: IEC TC 65, and substation automation: IEC TC 57.

From a system integration point of view this is non-productive. Very often the electrical system was understood as somehow special - may be because of the danger of dealing with high voltage!!

The above mentioned automation domains need solutions to exchange the huge amount of information for control and monitoring. In the past very often these domains used their own communication solutions. There was no consensus between the different domains to define a seamless solution that makes integration easier - to save time and money, ...

The first approach to overcome the many proprietary solutions was the project MAP (manufacturing automation protocol) some 25 years ago. It failed - because it was simply too early. Just a few people understood the need of seamless integration. ISO TC 184 has published the system integration standard ISO 9506 (MMS) in 1990 - but it is used since the mid nineties all over in the electric power world: in IEC 60870-6-TASE.2, IEC 61850, and IEC 61400-25.

After the "fieldbus war" we still have the domain specific approaches, solutions and products. The fieldbus discussion has focused too long on the best approach of the field instrumentation - now we have tens of normative fieldbus standards! A seamless solution for system integration was developed by IEC TC 57: IEC 61850 "Communication networks and systems for power utility automation". The restricted scope on power utility automation has been chosen because IEC TC 57 has the scope electric power systems. Most experts outside the "dangerous" electrical world have not (yet) thought to use an "electrical" standard for non-electrical applications.

In fact the solution IEC 61850 can be used in almost all application domains of automation. At least for the three domains: factory automation, process automation, and substation automation. AND: All these application domains use a lot of electric power!! Electric power is one of the most crucial raw material for any application. Any plant manager has to pay more attention to the electric power system!

ABB has realized the crucial integration needs cross several application

domains: "We still have separate work spaces for **power people** and **process people**, but everyone does more of their work the same way, using the same paradigm. This means more and better optimization, lower total costs and more minimization of risk." according to Stefan Bollmeyer, ABB fieldbus product manager for its System 800xA. He says also: "Many users have their own department and kingdoms, and they want them to stay just as they are."

"To help process control and power staffs cooperate on achieving better electrical integration, ABB recommends they adopt a unified integration method based on a single system environment, use a **fieldbus** network to handle electrification control and management, and use the **IEC 61850 standard to tie together process instrumentation, process electrification and power distribution networks**." according to a report about ABB's March 23-25, 2009 event in Orlando, Florida (USA).
[Read Report.](#)

With the Ethernet, TCP/IP and XML based information exchange in most of the application domains it could be expected that IEC 61850 will be used as the standard for seamless information, information exchange and system configuration. The information model of IEC 61850 "MMXU" (electrical measurements) providing objects of three phase AC voltages (PhaseA, PhaseB, PhaseC or PhaseAB, PhaseBC, PhaseCA) or three AC currents (PhaseA, PhaseB, PhaseC) can be used where three phases are installed: in any application domain.

The same AC electrical system can be found in power plants, power transmission and distribution, and any other plant. Some companies have realized that IEC 61850 could be used as the single seamless solution in most application domains. Nobody would come up with a special 5 phase AC system for his application domain! IEC 61850 could play the same standard role as does the three phase seamless AC electrical system - even we have 50 Hz or 60 Hz systems!

IEC 61850 will be accepted some time down the road as the **seamless international integration standard** like the three phase AC electrical system is the **international standard for electric power**.

Posted by [Karlheinz Schwarz](#) at [10:34 PM](#) [0 comments](#) 

Labels: [ABB](#), [en](#), [engineering](#), [Ethernet](#), [fieldbus](#), [IEC 61850](#), [integration](#), [MMS](#), [Power Plants](#), [process control](#), [seamless](#), [Substation Automation](#), [TASE.2](#)

IEC 61850-9-2 Edition 2 out for CDV ballot

The Committee Draft for Vote for IEC 61850-9-2 Ed.2 has been published the other day (document 57/996/CDV):
Communication networks and systems for power utility automation -
Part 9-2 Specific Communication Service Mapping (SCSM) – Sampled values over ISO/IEC 8802-3

Closing date for commenting and voting: **2009-09-11**
(contact your [national TC 57 committee](#) for a copy).

The following are two extensions in the CDV of Edition 2:

- Link Redundancy: Parallel Redundancy Protocol and High Availability Seamless Ring (according to IEC 62439-3) - optional
- Sample Mode has been added to the control block and sample value message:
0 = samples per nominal period (DEFAULT)
1 = samples per second
2 = seconds per sample
If not available (backward compatibility) the

default value is 0.

Posted by [Karlheinz Schwarz](#) at [3:32 AM](#) [0 comments](#) 

Labels: [en](#), [Ethernet](#), [IEC 61850](#), [IEC 61850 edition 2](#), [IEC 61850-9-2](#)

Wednesday, April 15, 2009


Full day seminar and two day Conference on IEC 61850 in Kuala Lumpur, May 26-28, 2009

International experts will present and discuss the latest development in the domain of IEC 61850 for power systems ... especially for substation protection and automation.

A full day pre-conference workshop on IEC 61850, IEC 60870-5, DNP3, CIM, Security, Decentralized Energy, Smart Grids, ... will take place on May 26.

The event will take place in Kuala Lumpur (Malaysia) on May 26-28, 2009.

[Program and registration information \[pdf, 530 KB\]](#)

Posted by [Karlheinz Schwarz](#) at [10:21 PM](#) [0 comments](#) 

Labels: [CIM](#), [conference](#), [DNP3](#), [IEC 60870-5-101](#), [IEC 60870-5-104](#), [IEC 61850](#), [IEC 61968](#), [IEC 61970](#), [protection](#), [seminar](#), [Substation](#), [Substation Automation](#)

Tuesday, March 31, 2009

3 day IEC 61850 Substation Automation and Control Event in Kuala Lumpur on 26-28 May 2009

This technical event provides a national and regional platform for exposures and practical case studies on successful implementations of IEC 61850 around the globe. The event also shares world class substation automation, protection and control practices on IEC 61850. Delegates will gain in-depth insights and updates in the latest trends on IEC 61850. Attendees will be exposed to an innovative approach of IEC 61850 that will result in significant improvements in both costs and performance of electric power systems.

Dates:

26th May:
pre conference course on IEC 61850, IEC 61400-25, IEC 61968 CIM, IEC 60870-5-10x, DNP3, ... by Karlheinz Schwarz

27th and 28th May 2009: conference

Venue: PWTC, Kuala Lumpur, Malaysia

Delegates will gain in-depth insights and updates in the latest trends on IEC 61850. Attendees will be exposed to an innovative approach of IEC 61850 that will result in significant improvements in both costs and performance of electric power systems. "IEC 61850 - Substation Automation, Protection and Control" technical event aims to integrate the new international communication standard in substation automation and to expand your professional networks in the industry:


- Featuring presentations from IEC 61850 experts in the region:
- One day Pre-event Workshop on IEC 61850, IEC 6087-5, DNP3, CIM,

Security, Decentralized Energy, Smart Grids... @ 26 May 2009 by Karlheinz Schwarz

- IEC 61850 – The Information Exchange Standard for Energy Supply Systems
- IEC 61850 and IEC 61400-25 – General Monitoring and Condition Monitoring in Power Systems
- More, Faster, Less, Less – The Business Drivers for IEC 61850
- Engineering Process for IEC 61850
- Evaluation of Substation Automation with IEC 61850
- The Single, Global and Future Proof Automation Standard - IEC 61850
- Reliability and Availability Calculation for Substation Automation in IEC 61850
- IEC 61850, A New Engineering Perspective in Malaysia
- And More...

*Please contact for full event brochure (+603 78057905) or email

info@iknowledge.com.my

Posted by [Karlheinz Schwarz](#) at 9:05 PM 0 comments 

Labels: [CIM](#), [DER](#), [DNP3](#), [engineering](#), [Ethernet](#), [IEC 60870-5-101](#), [IEC 60870-5-104](#), [IEC 61499](#), [IEC 61850](#), [IEC 61850-7-420](#), [IEC 61968](#), [IEC 61970](#), [Relays](#), [RTU](#), [SCADA](#), [Smart Grid](#), [Substation](#), [Training](#)

Studie zum Normungsumfeld von E-Energy

Die Studie zur Untersuchung des Normungsumfeldes zum BMWi-Förderschwerpunkt "e-Energy - IKT-basiertes Energiesystem der Zukunft" wurde im Auftrag des Bundesministeriums für Wirtschaft und Technologie (BMWi) von OFFIS - Institut für Informatik, SCC Schwarz Communication Consult (Karlheinz Schwarz) und mpc management project coaching erstellt.

Ziel dieser Studie ist primär die konsistente Bereitstellung von Informationen über bestehende, in Arbeit befindliche und zusätzlich notwendige Normen für IKT-basierte Energiesysteme und deren Verwendung im Kontext der sechs geförderten Konsortialprojekte von E-Energy. Die einzelnen Projekte werden individuell über die Ergebnisse der Studie informiert. Im Rahmen der Begleitforschung zu E-Energy wird gemeinsam der Handlungsbedarf bei der Umsetzung vorhandener Normen (wie beispielsweise IEC 61850, IEC 61400-25, IEC 61499, IEC 61968, IEC 61970) und Standards und bei der Zuarbeit zu den Normungsgremien festgestellt.

Inhalte:

1. Zusammenfassende Empfehlungen der Studie für die Modellregionen
2. Aufbau der Studie
3. Einführung und Problemstellung
4. Methodisches Vorgehen
5. Standards zur Softwareerstellung
6. Softwarearchitekturkonzepte für e-Energy
7. TR IEC 62357: TC 57 Seamless Integration Architecture
8. Normenfamilie IEC 61968 und IEC 61970: CIM
9. Normenreihe IEC 61850: Schaltanlagenautomatisierung
10. Normenreihe IEC 60870-5 für die Fernwirktechnik
11. Normenreihe IEC 60870-6 TASE.2 für die Kommunikation zwischen Netzleitstellen
12. IEC 61131-3 und IEC 61499 für die funktionale Interoperabilität
13. Vernetzung in der elektrischen Energieversorgung

14. Norm IEC 62361: Harmonisierung von Qualitätscodes
15. Standards zur Marktkommunikation in der Energiewirtschaft
16. Standards im Bereich Sicherheit
17. Standards zur Home Automation
18. Kommunikationsstandards für Smart Metering
19. Mit e-Energy vergleichbare internationale Programme
20. Normungsorganisationen und Gremien

[Download der Zusammenfassung](#) [PDF, 0.8 MB]

[Download der Studie](#) [PDF, 5.4 MB]

Posted by [Karlheinz Schwarz](#) at [8:39 PM](#) [0 comments](#) 

Labels: [de](#), [DER](#), [E-Energy](#), [IEC 61400-25](#), [IEC 61499](#), [IEC 61850](#), [IEC 61850-7-420](#), [Smart Grid](#)

Sunday, March 29, 2009

Application of IEC 61850-9-2 for non-conventional sensors

Dear supporter of IEC 61850-9-2 for non-conventional sensors,

There is a growing interest in the application of IEC 61850-9-2 for non-conventional sensors. I have been asked several times, when mature products will be available etc.

Have you any information about (pilot) installations (planned, under commissioning or in operation)?

If you could share some information with me I would highly appreciate your response.

Thanks a lot!

Some industry statements: Areva [\[pdf, 200 KB\]](#) , [\[pdf, 250 KB\]](#)

Email feedback to: [Karlheinz Schwarz](#)

Posted by [Karlheinz Schwarz](#) at [9:20 AM](#) [0 comments](#) 

Labels: [en](#), [IEC 61850](#), [IEC 61850-9-2](#), [merging unit](#), [synchronization](#)

Saturday, March 28, 2009

Emerson Process Management applies IEC 61850 for power plants

Emerson Process Management announced on March 26, 2009, that it will use IEC 61850 in power plants to be build for EDF in France and UK.

"Emerson's PlantWeb architecture will make extensive use of HART Communications to connect the I/O. IEC 61850 modules will interface to Intelligent Electronic Devices (IED) used within the switchyard."

[Full press release.](#)

Posted by [Karlheinz Schwarz](#) at [9:56 PM](#) [0 comments](#) 

Labels: [EDF](#), [en](#), [IEC 61850](#), [Power Plants](#), [process control](#)

Wednesday, March 25, 2009

IEC 61850-90-1 Communication between substations

The Draft Technical Report for the communication between substations has been published by IEC TC 57 for the final vote. Original project number was IEC 62445.

Document: 57/992/DTR

Distributed: 2009-03-13

Voting terminates: 2009-05-15

Use Cases

1. Distance line protection with permissive tele-protection scheme
2. Distance line protection with blocking tele-protection scheme
3. Directional comparison protection
4. Transfer/Direct Tripping
5. Interlocking
6. Multi-phase auto-reclosing application for parallel line systems
7. Current differential line protection
8. Phase Comparison Protection
9. Fault locator system (2, 3 terminals)
10. System Integrity Protection Schemes (SIPS)
11. Real time predictive generator shedding
12. Out-of-step detection
13. Synchrophasors
14. Remedial Action Schemes (RAS)

If you want to comment on these document, please contact your national IEC committee. [Member bodies of IEC TC 57.](#)

Posted by [Karlheinz Schwarz](#) at [12:25 AM](#) [0 comments](#) 

Labels: [en](#), [IEC 61850](#), [protection](#), [Substation](#), [Substation Automation](#)

[Newer Posts](#)

[Home](#)

[Older Posts](#)

Subscribe to: [Posts \(Atom\)](#)

News on IEC 61850 and related Standards

Daily news concerning the standards IEC 61850, IEC 61400-25, IEC 61970 (CIM), IEC 60870-5, ...

Monday, March 23, 2009

Report on Distributech 2009, San Diego

The DistribuTECH covers automation and control systems, energy efficiency, engineering, demand response, renewables integration, power delivery equipment and water utility technology.

The 19th DistribuTECH and Transtech Conference & Exhibition was held from February 03 to 05, 2009 at the Sand Diego Convention Center in San Diego (California, USA). It is a key event in North America. The event offered many opportunities to electric power system professionals to learn about the latest offerings in technology, share experience with existing solutions and exchange ideas about the challenging future of the power industry. The event was well attended by vendors, utilities, system integrators and other experts. The number of exhibitors has grown since 2008.

The domains covered by the conference and exhibition comprise automation and control systems, information technology, transmission and distribution engineering, power delivery equipment and water utility technology. One crucial focus was on the many facets of the Smart Grids. Many of the three hundred exhibitors offered solutions for **smarter or intelligent Grids**. The new US government is expected to support alternative and renewable energy and to accelerate rebuilding the whole electric network and to make the power delivery system a Smart Grid. The event showed that many **companies and groups are prepared (or waiting) to receive the "Obama Dollars"** – to build the system of the future.

[Download full report](#) [pdf, 24KB]

Posted by [Karlheinz Schwarz](#) at [5:36 AM](#) [1 comments](#) 

Labels: [AMI](#), [en](#), [IEC 61850](#), [IEC61850](#), [SCADA](#), [Smart Grid](#)

Sunday, March 22, 2009

CDV of IEC 61850-8-1 Edition 2 published

The Committee Draft for Vote for IEC 61850-8-1 Ed.2 has been published the other day (document 57/994/CDV): Communication networks and systems for power utility automation - Part 8-1: Specific Communication Service Mapping (SCSM) - Mappings to [MMS \(ISO 9506-1 and ISO 9506-2\)](#) and to ISO/IEC 8802-3

Closing date for voting: **2009-09-04**
(contact your [national committee](#) for a copy).

This document is based on the experiences made after the publication of the first Edition of 8-1. The crucial changes made are according to the Tissues (Technical Issues) posted at the Tissue database (www.tissue.iec61850.com).

Subscribe To IEC 61850 News

Blog Archive

- ▶ [2012](#) (11)
- ▶ [2011](#) (159)
- ▶ [2010](#) (153)
- ▼ [2009](#) (162)
 - ▶ [December](#) (4)
 - ▶ [November](#) (11)
 - ▶ [October](#) (17)
 - ▶ [September](#) (16)
 - ▶ [August](#) (18)
 - ▶ [July](#) (11)
 - ▶ [June](#) (9)
 - ▶ [May](#) (25)
 - ▶ [April](#) (11)
 - ▼ [March](#) (16)

[3 day IEC 61850 Substation Automation and Control ...](#)

[Studie zum Normungsumfeld von E-Energy](#)

[Application of IEC 61850-9-2 for non-conventional ...](#)

[Emerson Process Management applies IEC 61850 for p...](#)

[IEC 61850-90-1 Communication between substations](#)

The following tissues have been solved in this CDV:

Tissues for clauses 1-6 – General, Communication stack:

[122](#) [235](#) [290](#) [292](#) [299](#) [430](#) [459](#)

issues for clause 7-8, 11-14:

[109](#) [110](#) [111](#) [112](#) [115](#) [116](#) [119](#) [120](#) [123](#) [128](#) [144](#) [165](#) [168](#) [183](#) [222](#) [314](#)
[368](#) [377](#) [422](#) [433](#)

Tissues for clause 16 (Setting Group):

[33](#) [34](#) [36](#) [37](#) [38](#) [39](#) [40](#) [41](#) [52](#) [53](#) [172](#) [333](#) [417](#)

Tissues for clause 17 (Reporting model):

[114](#) [177](#) [198](#) [344](#) [438](#)

Tissues for clause 18-Annex A (GOOSE):

[117](#) [121](#) [224](#) [227](#) [231](#) [237](#) [279](#) [323](#) [365](#) [419](#)

Tissues for clause 20 (Control model):

[143](#) [196](#) [246](#) [262](#) [528](#)

Tissues for clause 22 (File transfer):

[118](#) [260](#) [576](#)

Harmonization with 7-2 and 7-3:

[103](#) [141](#) [146](#) [149](#) [173](#) [246](#) [453](#) [456](#) [457](#)

Need help in MMS? [Contact us.](#)

Posted by [Karlheinz Schwarz](#) at [9:04 AM](#) [0 comments](#) 

Labels: [en](#), [GOOSE](#), [IEC 61850](#), [mapping](#), [MMS](#)

Tuesday, March 17, 2009

Electricity speaks one language: IEC 61850

Bachmann electronics provides an IEC 61850 solution for the Integration of wind parks or power stations seamlessly into a control station or into a network.

The IEC 61850 (MMS) server of Bachmann electronic runs as a software module on a M1 controller and communicates outwards the variables available in the application programs (e.g., programmed with IEC 61131-3).

Two page [description by A M Khadkikar \[pdf, 160 KB\]](#)

Posted by [Karlheinz Schwarz](#) at [6:17 AM](#) [0 comments](#) 

Labels: [applications](#), [en](#), [IEC 61400-25](#), [IEC 61850](#), [implementation](#), [Power Plants](#), [SCADA](#), [wind power](#), [wind turbine controller](#)

IEC 61850 Gateway for PLCs

A master thesis by Jonas Lidén (2006, Stockholm/Sweden) discusses the use of IEC 61850 for Vattenfall Vattenkraft AB's technical systems for turbine controllers. The work started with an investigation of today's automation products with focus on station bus communication. Today Vattenfall Vattenkraft AB are modernising their automation products in many of their hydro power plants, and the turbine controllers are developed by SwedPower AB on standard PLC's (Programmable Logic Controller).

[Report on Distributech 2009, San Diego](#)

[CDV of IEC 61850-8-1 Edition 2 published](#)

[Electricity speaks one language: IEC 61850](#)

[IEC 61850 Gateway for PLCs](#)

[Substation hardened Ethernet Switch and Fanless PC...](#)

[IEC 61850, IEC 60870-5 and IEC 61968 CIM Course in...](#)

[Multi-Vendor Test Case at Frankfurt IEC 61850 trai...](#)

[IEC 61850 Interoperability Research Project - Func...](#)

[Siemens PCS 7 driver for IEC 61850](#)

[Hands-on Training in Frankfurt on October 20-23, 2...](#)

[IEC 61850 in action - overview on 12 projects by S...](#)

► February (11)

► January (13)

► 2008 (82)

Contributors

[Karlheinz Schwarz](#)

[Michael Schwarz](#)

The report describes the implementation and the results of the testing.

[Download the report \[pdf, 2.3 MB\]](#)


Posted by [Karlheinz Schwarz](#) at [6:00 AM](#) [0 comments](#) 

Labels: [en](#), [hydro power](#), [IEC 61850](#), [implementation](#), [PLC](#), [SCADA](#), [Vattenfall](#)

Substation hardened Ethernet Switch and Fanless PCs

Advantech has developed a 19" rack mounted [Industrial Ethernet Switch](#) and a [Fanless Box PC](#) for grid and substation automation. The hardware is designed for IEC 61850-3 compliance (especially to meet the higher requirements on EMC, temperature range, supply voltage, ...) to be used in Substations and with data gateways and data concentrators.

It is very likely that more processor performance for substation automation will be available soon.

Posted by [Karlheinz Schwarz](#) at [5:51 AM](#) [0 comments](#) 

Labels: [Data concentrator](#), [en](#), [Ethernet](#), [Gateway](#), [IEC 61850](#), [RTU](#)

IEC 61850, IEC 60870-5 and IEC 61968 CIM Course in Moscow, March 10-12, 2009

Experts of Substation Automation Systems in the Russian Federation are quite interested in the new Standard IEC 61850 and other IEC Standards.



Several experts from vendors and from an important user attended the comprehensive course on the standards IEC 61850, IEC 60870-5 and IEC 61968 CIM at the Novotel Moscow Centre on March 10 to 12, 2009.

The Russian utility market asks for Russian products compatible with IEC 61850 (protection and control IEDs, SCADA systems, RTUs, ...).



The average age of the participants was surprisingly low! Power engineering is one of the favorite subjects at Moscow's universities and institutes.

We are planning to organize another public IEC 61850 event together with "**Vsya Electrotehnika**" publishing house, www.energyexpert.ru, in Moscow (October or November 2009).

Contact [NettedAutomation for details](#) or [EnergyExpert](#).

Posted by [Karlheinz Schwarz](#) at 3:37 AM 0 comments 

Labels: [CIM](#), [hands-on Training](#), [IEC 60870-5-104](#), [IEC 61850](#), [IEC 61968](#), [RTU](#), [SCADA](#), [Substation](#), [Substation Automation](#), [Training](#)


Multi-Vendor Test Case at Frankfurt IEC 61850 training

STRI and NettedAutomation GmbH arranged the second "Comprehensive & Independent Hands-on Training" for IEC 61850 in Frankfurt, March 3-6 2009 with participants from Europe, America and Africa. The multivendor test installation with IEDs from ABB, Areva and Siemens communicating over a RuggedCom network and equipped with an Omicron test set **was shipped in advance** from STRI to be the test environment for the hands-on course: **But it did not arrive on time.**
What to do now?

One crucial objective of IEC 61850 is **TEAMWORK**: To make different vendors to talk to each other and to work together. Omicron shipped a new test set overnight from Austria, the Doble participant to the course had brought a Doble test set and Megger/Programma surprised us with a new test set. And we got two new Ethernet switches from the Hirschmann attendee. What about the IEDs? The participant from SEL brought a Schweizer IED for IEC 61850, Siemens sent a new IED and Nicholas picked up a new Areva IED at their training center in Frankfurt. Programma offered us to borrow an ABB RET670 that Carl Öhlén from STRI picked up in Stockholm before flying down to Frankfurt.

One of the hotel rooms became the IEC 61850 instant system integration and engineering center ...

DHL did a good job

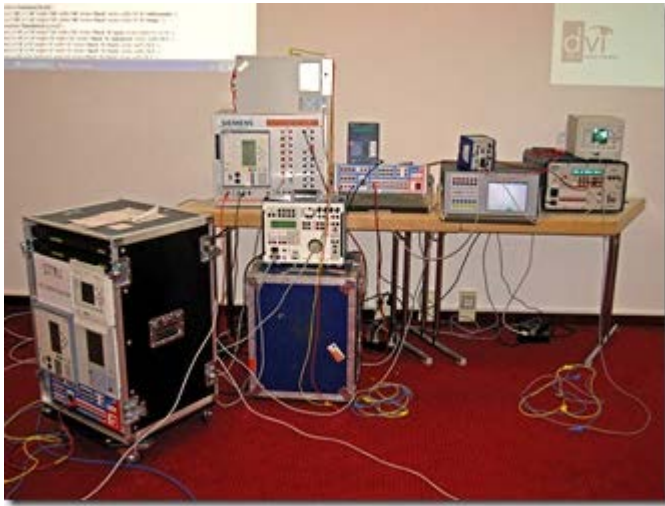

to force us the demonstration of REAL multivendor support and multivendor interoperability of new equipment that just arrived.

Read more details on the excellent [experience on multivendor support during the Frankfurt event](#).

The next **public IEC 61850 hands-on training** will be on October 20-23, 2009 in Frankfurt.

In-house hands-on training - a solution where your people do not need to travel - is also possible. Your equipment can also be used in the multivendor hands-on training.

A big European Transmission Grid company has contracted with NettedAutomation to intensively train their SAS staff including hands-on training together with STRI .

Contact [NettedAutomation for details](#).

Posted by [Karlheinz Schwarz](#) at [3:01 AM](#) [0 comments](#) 

Labels: [ABB](#), [Areva](#), [engineering](#), [Ethernet](#), [hands-on Training](#), [IEC 61850](#), [interoperability](#), [interoperability tests](#), [Substation Automation](#)

Monday, March 16, 2009

IEC 61850 Interoperability Research Project - Functional Specification available

A German InterOP research project (investigating interoperability of typical substation functions) has released its functional specification for interoperability testing on Monday, 16th March 2009.

More details on the project are available in the [official announcement](#).

Comments are welcome. Interested parties are invited to review the specification and send comments to the project leader FGH e.V., Germany no later than April 12, 2009.

Interested parties that want comment are kindly asked to register for free by simply sending an e-mail with contact details of a responsible person, in order to reply to potential comments and give feedback. The functional specification will be sent straight forward by the FGH to all registered parties.

For registration please send contact details to interop@fgh-ma.de

Posted by [Karlheinz Schwarz](#) at [2:16 AM](#) [0 comments](#) 

Labels: [engineering](#), [IEC 61850](#), [interoperability](#), [interoperability tests](#), [Substation](#), [Substation Automation](#)

Monday, March 9, 2009

Siemens PCS 7 driver for IEC 61850

The IEC 61850 communication library grants you full access to the data objects provided by protection and control devices. The library blocks automatically map the information to the PCS 7 Operator Station for the visualization of tag data as well as time stamped alarm data.

Areas of application PCS 7 driver blocks for IEC 61850

- Process plants with process connections between the process control system and the electrical power system
- Small to medium size substation systems automated with PCS 7 or S7
- Alarming of critical conditions in process control HMI when substation HMI is not permanently manned

[Details on PCS 7 ...](#)

ABB has already integrated the IEC 61850 into their controller: [see details on 800xA](#).

Posted by [Karlheinz Schwarz](#) at [4:57 AM](#) [0 comments](#) 

Labels: [ABB](#), [DCS](#), [en](#), [IEC 61850](#), [SCADA](#), [Substation](#)

Sunday, March 8, 2009

Hands-on Training in Frankfurt on October 20-23, 2009

After the successful training last week in Frankfurt/Germany, STRI and NettedAutomation have set the date for the fall Hands-on Training event to 20-23 October 2009. The event will also be held in Frankfurt/Germany.

The hands-on training will be extended to offer a SCADA session in parallel to the ID and SCL hands-on training on October 23. Details will be provided in due time.

[Contact us if you are interested.](#)

Posted by [Karlheinz Schwarz](#) at [2:18 PM](#) [0 comments](#) 

Labels: [61850](#), [condition monitoring](#), [engineering](#), [Ethernet](#), [GOOSE](#), [hands-on Training](#), [IEC 61850](#), [SCADA](#), [Training](#)

Monday, March 2, 2009

IEC 61850 in action - overview on 12 projects by Siemens

Siemens has published very interesting brief descriptions of successfully installed substation automation and protection systems with IEC 61850 conformant devices (IEDs):

- Aare-Tessin Ltd. for Electricity (Atel), Olten, Switzerland
- [East China Power Grid Company, Shanghai, China](#)
- RWE Power, Garzweiler, Germany
- RUSAL, Sayanogorsk, Russia

- CADAFE, Caracas, Venezuela
- Petróleos de Venezuela S.A. (PDVSA), Caracas, Venezuela
- Power Grid Corporation of India Ltd (POWERGRID), New Delhi, India
- NUON, Alkmaar, Netherlands
- Statnett SF, Oslo, Norway
- Electrificadora del Meta S.A. (EMSA), Meta/Bogotá, Colombia
- Réseau de Transport d'Electricité (RTE), La Défense Cedex, France
- Eólicas de Portugal / EDP RENOVÁVEIS, Lisbon, Portugal

All brief project descriptions [are contained in a 66 page document \[pdf, 3.3 MB\]](#)

Want to know what IEC 61850 is all about? [Brief introduction \[1 page\]](#).

Posted by [Karlheinz Schwarz](#) at [5:05 AM](#) [0 comments](#) 

Labels: [en](#), [GOOSE](#), [IEC 61850](#), [protection](#), [redundancy](#), [RTU](#), [Substation](#), [Training](#)

Friday, February 27, 2009


Information exchange and encoding messages

For the encoding of messages to be exchanged in automation systems the **red pencil tactics** are still too often used, in the opinion: The shorter the message, the better. Is that what we really are looking for? [Read the imposing joke on encoding.](#)

Saving a few octets was one of the objectives of the definition of hundreds of solutions for communication protocols for automation systems - focusing on getting rid of some octets. Now with the use of secure TCP/IP based communication tunneling the many "old" protocols adds many times more octets at several layers than those saved in the design of the "optimized" application protocols. Saving a few octets in the application protocols has a negligible effect! Some people that complained about the ASN.1 BER encoding years ago are now asking for Webservices with XML encoding - increasing the message lengths by orders of magnitude!

For every problem there is a solution which is simple, neat and wrong.

One lesson learned is: Focus on the applications, information to be exchanged, information exchange services, and the engineering process to get interoperable devices that can smoothly inter-operate - don't discuss saving a few bits in the application protocol encoding.

Posted by [Karlheinz Schwarz](#) at [10:12 PM](#) [0 comments](#) 

Labels: [en](#), [message encoding](#)

IEC 61850 and other Standards for metering

Triangle Microwork's long term experience with IEC Standards IEC 61850 and IEC 60870-5, as well as industry standards DNP3 and Modbus pays off:

Elster (offering smart metering and smart grid systems and solutions) announced that [Triangle MicroWorks](#) has joined [Elster's Advanced Grid Infrastructure \(AGI\) Initiative](#). The AGI Initiative is a collaborative effort between utilities, Elster, and key technology providers to realize innovative solutions for grid modernization.

Elster Senior Vice President David G. Hart said, "We are pleased to have a partnership with Triangle MicroWorks that provides our customers with the benefits of **greater interoperability**. Elster's solutions can better equip utilities by integrating Triangle MicroWorks' leadership in **standardized smart grid communication protocol technologies**."

[Complete news letter \[pdf, 37 KB\]](#)

Posted by [Karlheinz Schwarz](#) at 9:15 PM 0 comments 

Labels: [DNP3](#), [en](#), [IEC 60870-5-101](#), [IEC 60870-5-104](#), [IEC 61850](#), [smart metering](#)

Friday, February 20, 2009

Petrobras Goes IEC 61850 for Refineries in big scale

10 of Petrobras's 12 refineries in Brazil will be equipped with IEC 61850 conformant [DCS system 800xA](#) from ABB.

According to ABB "The scale of the modernization program is immense. In addition to building new units for distillation, hydrotreatment, cooking, desulfurization and other processes, Petrobras is constructing **50 new substations** and **modernizing about 40 others to the new IEC 61850 global standard** for interoperable substation automation devices ... enables refinery operators to monitor and control the systems from a single interface and run power management applications and intelligent IEC 61850 substations in the process automation system." [Read more on ABB's engagement at Petrobras ...](#)

The integration of IEC 61850 in process control automation systems is one of the expected new use cases for IEC 61850. The original scope of IEC 61850 was "substations", the new is "power utility automation" - still restricted to (electric) power, because IEC is in charge of the "electrical World". The standard series IEC 61850 can be used ALL OVER in the automation world: [IEC 61850 outside substations](#) is happening already. More to come.

Posted by [Karlheinz Schwarz](#) at 9:45 PM 0 comments 

Labels: [ABB](#), [DCS](#), [en](#), [IEC 61850](#), [IEC61850](#), [process control](#), [Substation](#), [Substation Automation](#)

Next IEC 61850 Hands-on Training 20-23 October 2009

STRI and NettedAutomation have set the date for the fall Hands-on Training event to 20-23 October 2009. The event is planned to be held in Ludvika (Sweden). Details will be posted in due time.

The next event is in Frankfurt (Germany) from 03 to 06 March 2009 [Details \[pdf\]](#)

Posted by [Karlheinz Schwarz](#) at 7:33 AM 0 comments 

Labels: [en](#), [hands-on Training](#), [IEC 61850](#), [interoperability](#), [interoperability tests](#), [Training](#)

Thursday, February 19, 2009

IEC 61850 OPC Device Driver

[ReLab Software LLC](#) (based in Concord, California) offers an [OPC Device Driver for IEC 61850](#) to enable communication with all devices supporting the international standard IEC-61850.

[Product information](#) [pdf, 190 KB]

[Experience of the ReLab programmers](#) with the IEC 61850 stack implementation:

"The difficulties of IEC-61850 stack implementation described in this article do not diminish the value of the protocol itself. The protocol is a significant step in communication unification and has a great future."

Posted by [Karlheinz Schwarz](#) at [9:43 PM](#) [0 comments](#) 

Labels: [en](#), [IEC 61850](#), [implementation](#), [OPC](#), [SCADA](#)

IEC 61850 modeled with UML

The standard IEC 61850 uses simple table notations and text description of the information models and information exchange services.

The working group 10 of IEC TC 57 discussed the use of higher level modeling languages many times, e.g., UML (Unified Modeling Language) or ASN.1. The discussion will continue in a new project group within IEC TC 57:


"Web-based and structured access to the IEC 61850 information models"

The web based access to the [IEC Component Data Dictionary](#) (IEC 61360) is a good example of the benefit of web technologies for IEC standards.

A public available model for IEC 61850 using UML 2.0 is provided and maintained by Electricité De France R&D (Clamart/France). The [current version accessible at the web](#) is dated December 2006, Release 1.1

The scope of this model is the IEC 61850 part 7-2, 7-3 and 7-4 (First Edition) and its HTML format. Enjoy.

Excerpt of model:

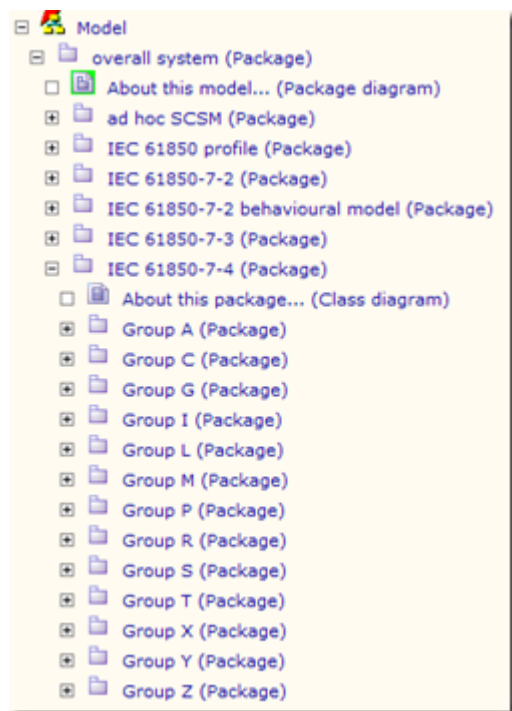

Posted by [Karlheinz Schwarz](#) at 9:00 PM 0 comments 

Labels: [en](#), [IEC 61850](#), [IEC61850](#), [UML](#)

RWE Innogy sucht Ingenieur mit Erfahrung in IEC 61850 und 61400-25

RWE Innogy sucht SCADA-Ingenieur mit Kenntnissen in IEC 61850, IEC 61400-25, DNP3, ... Einsatzort Hamburg. [Weitere Details...](#)

Posted by [Karlheinz Schwarz](#) at 6:31 AM 0 comments 

Labels: [de](#), [DNP3](#), [IEC 61400-25](#), [IEC 61850](#), [OPC](#), [SCADA](#), [wind power](#)

[Newer Posts](#)

[Home](#)

[Older Posts](#)

Subscribe to: [Posts \(Atom\)](#)

News on IEC 61850 and related Standards

Daily news concerning the standards IEC 61850, IEC 61400-25, IEC 61970 (CIM), IEC 60870-5, ...

Wednesday, February 18, 2009

New Tool for CIM (IEC 61970-301)

The internationally widely used standard for utility information modeling (IEC 61970-301) can be managed with the Sparx Systems [Enterprise Architect](#) as a UML tool to maintain and distribute the Common Information Model. IEC TC 57 WG 13 and 14 have decided recently to rely on the cost effective and powerful tool.

[Sparx news letter](#)

Use of the CIM Standard for Managing Assets at the Long Island Power Authority and the application of Enterprise Architect. [more...](#)

Posted by [Karlheinz Schwarz](#) at [9:31 PM](#) [0 comments](#) 

Labels: [CIM](#), [en](#), [IEC 61970](#)

CIM Users Group meets in Europe on 12-15 May 2009

The spring 2009 meeting of the CIM Users Group will be hosted by UCTE in Brussels on 12-15 May 2009.

Key issue is the adoption of the CIM standards by [UCTE](#) (Union for the Co-ordination of Transmission of Electricity) for information exchange. UCTE's decision is expected to lead to wide-spread adoption of the CIM standard for many additional applications in Europe.

Another issue is how CIM can support the Smart Grid vision.

[Further meeting information ...](#)

[Some background information on the use of CIM within UCTE.](#)

Posted by [Karlheinz Schwarz](#) at [7:48 PM](#) [0 comments](#) 

Labels: [CIM](#), [control center](#), [en](#), [IEC 61970](#)

Monday, February 16, 2009

E.ON - Erfahrungen mit IEC 61850

Die E.ON Thüringer Energie AG hat Ende 2008 erste Erfahrungen mit dem Einsatz der Normenreihe IEC 61850 vorgestellt:

"Vorgehensweisen und Erfahrungen mit der IEC 61850"

In einem Vortrag wurden Ideen und Ziele bezüglich des Einsatzes der IEC 61850 bei der E.ON Thüringer Energie AG im Rahmen eines Pilotprojektes vorgestellt und diskutiert.

Subscribe To IEC 61850 News

 [Posts](#) 

 [All Comments](#) 

Blog Archive

- [2012](#) (11)
- [2011](#) (159)
- [2010](#) (153)
- ▼ [2009](#) (162)
 - [December](#) (4)
 - [November](#) (11)
 - [October](#) (17)
 - [September](#) (16)
 - [August](#) (18)
 - [July](#) (11)
 - [June](#) (9)
 - [May](#) (25)
 - [April](#) (11)
 - [March](#) (16)
 - ▼ [February](#) (11)
 - [Information exchange and encoding messages](#)
 - [IEC 61850 and other Standards for metering](#)
 - [Petrobras Goes IEC 61850 for Refineries in big sca...](#)
 - [Next IEC 61850 Hands-on Training 20-23 October 200...](#)
 - [IEC 61850 OPC Device Driver](#)
 - [IEC 61850 modeled with](#)

[Download Foliensatz](#)

Die Ergebnisse liegen - vor dem Hintergrund der internationalen Erfahrungen - ganz auf Linie der Erfahrungen anderer großer Versorgungsunternehmen. Um die Anforderungen und Wünsche der Energieversorger (vor allem die nachhaltige Interoperabilität von Geräten und Werkzeugen!!) zukünftig umfassend und befriedigend zu erfüllen, sind weitergehende Abstimmungen der Hersteller untereinander, der Hersteller mit den Anwendern und aller Betroffenen mit den Normungsarbeiten notwendig. Bei der Normenreihe IEC 61850 verhält es sich so wie mit dem Baustoff Beton: Es kommt darauf an, was man daraus macht!

E.ON resümiert unter anderem, dass die betroffenen Experten die Normenreihe erst einmal verstehen müssen - und sicher auch, was die Hersteller bisher daraus gemacht haben. Einen Einblick in Produkte der ersten Generation großer Hersteller wie Siemens, Areva und ABB wird auf der neutralen Plattform eines Trainingskurses vom 3.-6. März 2009 in Frankfurt (Main) geboten.

[Details zum Training](#)

Posted by [Karlheinz Schwarz](#) at 8:50 PM 0 comments 

Labels: [ABB](#), [Areva](#), [de](#), [Ethernet](#), [hands-on Training](#), [IEC 61850](#), [interoperability](#), [Siemens](#)

Wednesday, February 4, 2009

IEC 61850 Seminar in Moscow (Russia), 10-12 March 2009

Как реализовывать
решения на базе
стандарта МЭК 61850

Семинар для главных инженеров
и руководителей департаментов РЗиА и АСУ ТП
Москва, 10-12 марта 2009 г.

«Ноу-хау» для создания систем нового поколения МЭК 61850 – международный стандарт для систем связи внутри подстанций. Использование данного стандарта позволяет осуществлять разработку и проектирование систем защиты и управления при применении аппаратуры различных компаний-производителей, и, как следствие, достичь более высокого уровня надежности и экономической эффективности предлагаемых решений. Помимо новых преимуществ, которые предоставляет стандарт, его реализация оказывается сопряжена с рядом трудностей и проблем, что усугубляется ситуацией, когда развитие ведущих производителей аппаратуры (ABB, Siemens, Areva, General Electric и др.) в части реализации стандарта МЭК 61850 становится все более стремительным.

По вопросам участия в семинаре
обращайтесь в редакцию ЗАО «ИД «Вся электротехника»
Куратор семинара: Головин Александр
Тел.: +7 499 157 56 75
Факс: +7 499 157 24 12
e-mail: gav@energyexpert.ru

Posted by [Karlheinz Schwarz](#) at 7:47 PM 0 comments 

Labels: [engineering](#), [IEC 61850](#), [protection](#), [SCADA](#), [Substation](#), [Training](#)

[UML](#)

[RWE Innogy sucht
Ingenieur mit Erfahrung
in IEC 61...](#)

[New Tool for CIM \(IEC
61970-301\)](#)

[CIM Users Group meets in
Europe on 12-15 May
2009](#)

[E.ON - Erfahrungen mit
IEC 61850](#)

[IEC 61850 Seminar in
Moscow \(Russia\), 10-12
March ...](#)

► January (13)

► 2008 (82)

Contributors

[Karlheinz Schwarz](#)

[Michael Schwarz](#)

Monday, January 19, 2009


IEC 61850 at DistribuTech 2009, San Diego

Several paper presentation are scheduled for the DistribuTech 09 conference in San Diego, 03.-05. February 2009

[List of IEC 61850 related papers](#)

Meet the IEC 61850 experts at the UCAIug booth #447

See you there.

Posted by [Karlheinz Schwarz](#) at [10:06 PM](#) [0 comments](#) 

Labels: [IEC 61850](#), [Users Group](#)

CIM Standard Edition 2 - FDIS ballot started

IEC 61970-301 Ed.2: Energy management system application program interface (EMS-API) - Part 301: Common information model (**CIM**) base

The FDIS ballot on the second edition just started.

Ballot closes on **2009-03-20**

The second edition contains several changes from the first edition:

- First edition Annex A which contained the description of the CIM UML model is now a part of the main body
- A new Annex A was added providing a model of a circuit breaker in the CIM as an example of how the CIM can be used to model network devices
- The naming hierarchy was changed.
- ModelingAuthority and ModelingAuthoritySet classes were added to represent ownership of models.
- A new schedules data model was added to replace the use of the curve model for time series data.
- The measurement value attributes were sub-typed into classes Analog, Discrete and Accumulator.
- The class naming was renamed to IdentifiedObject.
- Many editorial corrections, including several cardinality and attribute changes to resolve issues submitted on the first edition.

Posted by [Karlheinz Schwarz](#) at [12:07 PM](#) [0 comments](#) 

Labels: [CIM](#), [IEC 61970](#)

IEC 61850-7-420 (DER) passed the final Vote

The Standards series IEC 61850 has a new part:

IEC 61850-7-420 Ed.1: Communication networks and systems for power utility automation - Part 7-420: Basic communication structure - Distributed energy resources logical nodes

The FDIS vote for this part passed on 2009-01-09.

The International Standard IEC 61850-7-420 will be available very soon.


The standard covers the following energy resources:

- Reciprocating engine
- Fuel cell
- Photovoltaic system (PV)
- Combined heat and power (CHP)

Resources for hydro power and wind power are defined in

- IEC 61850-7-410 and
- IEC 61400-25

An overview of the parts can be found here [\[PDF, 450 KB\]](#)

Posted by [Karlheinz Schwarz](#) at [11:57 AM](#) [0 comments](#) 

Labels: [DER](#), [IEC 61850](#), [IEC 61850-7-420](#)

Saturday, January 17, 2009

CEPSI 2009 Papers now online

The papers of the oral presentations given at the CEPSI 2008 conference are available on the web:

[Two papers on IEC 61850 from Karlheinz Schwarz](#)

[General entry](#)

Posted by [Karlheinz Schwarz](#) at [1:30 AM](#) [0 comments](#) 

Labels: [IEC 61400-25](#), [IEC 61850](#), [interoperability](#), [SCADA](#), [Smart Grid](#), [Substation](#), [wind power](#)

Saturday, January 10, 2009

One-day special course on IEC 61850, IEC 60870-5, DNP3, CIM, Security, ... in Mexico City

[NEW: Details in Spanish!!](#)

Please find the details and registration information for the One-day special event on IEC 61850, IEC 60870-5, DNP3, CIM, Security, in Mexico City **on 27. January 2009** below.

NettedAutomation GmbH and ASOCIACIÓN DE NORMALIZACIÓN Y CERTIFICACIÓN, A.C. (ANCE, A.C.), Mexico City, offer you the following service for a special introduction and update on the standards IEC 61850, IEC 6087-5, DNP3, CIM, Security, and other standards.

The objective of the one-day event is to give an Overview and Update on the current standardization efforts within IEC TC 57 and TC 88 and to present the experience of users, vendors, and system integrators made since 2005 - for applications inside and outside the utility industry.

Proposed Program

Standard series presented and discussed are:

- IEC 61850 Communication networks and systems for power automation
- IEC 61400-25 Communications for monitoring and control of wind power plants
- IEC 60870-5 Profiles 101/104 and DNP3

- IEC 62351 Data and Communication Security and NERC CIP
- IEEE 1686 Substation IEDs Cyber Security Capabilities
- IEC 61968 CIM - Energy management system application program interface

Questions like the following will be discussed:

- When will the 2nd Edition of IEC 61850 be available?
- Do utilities really get what they are looking for?
- Is the sustainable interoperability of substation IEDs already reached?
- Turn-key versus "home-made" automation systems!?
- What is the status of the harmonization of CIM & IEC 61850?
- Is the security standard available? and implemented?
- What is the relation between IEC 62351 and NERC's CIP?
- What is IEEE 1686?
- What about multivendor projects for IEC 61850?
- What tools for IEC 61850 are available?
- What's going on in North America?
- What is the future of IEC 60870-5-101/104 and DNP3?

[Complete offer](#) [pdf, 650 KB]

[Program only](#) [pdf]

[Registration only](#) [pdf]

Posted by [Karlheinz Schwarz](#) at [11:45 AM](#) [1 comments](#) 

Labels: [CIM](#), [DNP3](#), [IEC 61400-25](#), [IEC 61850](#), [IEC 61968](#), [IEC 61970](#), [interoperability](#), [SCADA](#), [security](#), [Substation](#), [Substation Automation](#), [Training](#), [wind power](#)


Updated "Single page introduction on IEC 61850 and IEC 61400-25"

The standard series IEC 61850 „Communication networks and systems in substations“ and IEC 61400-25 „Communications for monitoring and control of wind power plants“ provide perfect support for **sustainable interoperability** of intelligent devices of any kind for electric Power Systems (Generation, Transmission, and Distribution for HV, MV, and LV, ...):

- **Standard Information Models,**
- **Standard Information Exchange Methods,**
- **Standard Protocol Mappings, and**
- **Standard System Configuration Language (SCL)**

An [updated "Single page introduction"](#) provides you with some basics.

Enjoy.

Posted by [Karlheinz Schwarz](#) at [12:44 AM](#) [0 comments](#) 

Labels: [IEC 61400-25](#), [IEC 61850](#), [interoperability](#)

Wednesday, January 7, 2009

Substation Automation Handbook - a must to read

Substation Automation Systems (SAS) are key for future power systems performing all the tasks in substations like data acquisition from the power grid via the switchgear and the activation of changes by commands to switchgear like circuit breakers, isolators, transformers, ...

protection, condition monitoring etc. These many functions are realized by intelligent electronic devices (IED).

The **Substation Automation Handbook** (approx. 400 pages) written by well experienced experts provides comprehensive knowledge of all aspects of the application of modern IEDs for SAS.

This book is a MUST to read by engineers involved (one way or the other) in Substation Automation.

[Read more ...](#)

Posted by [Karlheinz Schwarz](#) at [1:52 AM](#) [2 comments](#) 

Labels: [handbook](#), [IEC61850](#), [protection](#), [Substation Automation](#)


Tuesday, January 6, 2009

Devices from multiple vendors for wind power plant substation

24 devices from 9 different product platforms provided by 6 individual vendors (SEL, GE, RuggedCom, Siemens, ZIV, and Team Artech) have been tested and approved for a crucial CFE substation connecting a wind farm to the grid. Comisión Federal de Electricidad (CFE) is Mexico's national utility and major provider of electric power

Considering the international scope of the La Venta II transmission, protection, and control system CFE decided to use the IEC 61850 standard. IEC 61850 provides methods of developing the best engineering practices for substation protection, integration, control, monitoring, metering, and testing.

Read complete report from SEL [\[pdf\]](#).

Posted by [Karlheinz Schwarz](#) at [5:56 AM](#) [0 comments](#) 

Labels: [GOOSE](#), [IEC 61850](#), [interoperability](#), [interoperability tests](#), [SEL](#), [wind power](#)

Monday, January 5, 2009

Implementations of IEC 61400-25-6

Questions: I work at xx unit of utility-industry in xxx and help some energy companies with their future IT support for the handling of wind power production.

This also leads to some help with the requirements of the position before the contracts. I have a long background from both SCADA and maintenance systems.

Saw on the Internet that you are the project manager for IEC 61400-25-6 for Condition Monitoring and want to ask a few questions I hope you will be friendly to answer.

Question 1: What is the status of the expanded standard for Condition Monitoring IEC 61400-25-6?

The project team TC 88 PT is preparing the so-called FDIS document (final draft international standard). We have our next meeting scheduled for next week at DS in Copenhagen.

I hope that we reach the standard in June or so.

Question 2: How far has the commercial deployment come?

The part 25-6 uses parts 25-2 (many information models for WPP - some can be used for condition monitoring) and 25-4 (service mappings) and IEC 61850. The core software to be implemented is according to IEC 61850 ... IEC 61850 is widely deployed for substation automation systems. Most of the software etc can be re-used for 25 and 25-6.

IEC 61400-25 support is offered by e.g. Beckhoff:

<http://iec61850-news.blogspot.com/search?q=beckhoff>

and by Bachmann:

<http://iec61850-news.blogspot.com/2008/07/bachmann-electronic-mms-server-for-wind.html>

Question 3: Which vendors have implemented server and client?

Servers: see above.

Clients are available from various vendors: ABB, Siemens, ...

<http://iec61850-news.blogspot.com/search?q=siemens>

Question 3: Are there any deployed system? Operating Experience?

A lot with IEC 61850!! Siemens reported that they have installed 50.000+ devices and 1.000+ systems.

Most of these experiences could be applied for wind power applications and especially for condition monitoring.

There is a lot of very good experience!

Posted by [Karlheinz Schwarz](#) at [7:06 AM](#) [0 comments](#) 


Labels: [condition monitoring](#), [IEC 61400-25](#), [IEC 61400-25-6](#), [IEC 61850](#), [maintenance](#), [SCADA](#), [wind power](#), [wind turbine controller](#)

Sunday, January 4, 2009

CIM and Multispeak announced collaboration

The MultiSpeak Initiative and International Electrotechnical Commission's TC 57 Working Group 14 (WG14) announced to collaborate on the development of two new international integration standards to improve data exchange among electric utilities. The two groups seem to have understood that seamless standards are crucial for the future.

Read the [press release](#) [[pdf](#)].

Posted by [Karlheinz Schwarz](#) at [8:45 PM](#) [0 comments](#) 

Labels: [CIM](#), [mapping](#), [Multispeak](#)

New website for UCA International Users Group

The **UCA International Users Group (UCAIug)** has a [new website](#).

The UCAIug is a not-for-profit corporation focused on assisting users and vendors in the deployment of standards for real-time applications for several industries with related requirements. The UCAIug as well as its member groups (CIMug, Open Smart Grid, and IEC 61850) draws its membership from utility user and supplier companies.

Posted by [Karlheinz Schwarz](#) at [8:32 PM](#) [0 comments](#) 

Labels: [CIM](#), [IEC 61850](#), [Users Group](#)

Friday, January 2, 2009

USE61400-25 User Group Website online

The USE61400-25 user group's website is online.

The users group has the main objective to simplify the application of the International Standard [IEC 61400-25](#) and to support users implementing the standard within the wind power industry.

The IEC standard series 61400-25 provides a solution for access to wind power plant information with standardized data names and semantic. It gives possibilities to procure monitoring and control solutions as separate parts, and to use a single system to store, analyze and present wind power information. In addition the standard opens up for control and monitoring of information from different wind turbine vendors in a homogeneous manner - to provide interoperable intelligent devices.

The use of a standard communication solution are beneficial for all parties - vendors, system integrators as well as the customer ...

Read more:

[Access the Users Group's website](#)

[One page introduction to IEC 61400-25 / IEC 61850](#)

Posted by [Karlheinz Schwarz](#) at [2:50 AM](#) [0 comments](#) 

Labels: [IEC 61400-25](#), [interoperability](#), [wind power](#), [wind turbine controller](#)


Happy New Year 2009

I wish you all the best for the New Year 2009 and renew my commitment to provide you with news and up-to-date information on IEC 61850, IEC 61400-25, IEC 60870-5, IEC 60870-6, IEC 61499, ...

May every day in the New Year bring peace, health, happiness and good cheer to You and Your family.

I look forward to another successful year of standardization and application of standards. Enjoy the nature in winter time:



Posted by [Karlheinz Schwarz](#) at [12:37 AM](#) [0 comments](#) 

Labels: [IEC 61850](#)


Tuesday, December 30, 2008

SEL has enhanced the support for IEC 61850 in 2008

SEL is now supporting IEC 61850 as Significant Substation and RTU Standard ... SEL as one of the world leading supplier of protection IEDs is providing a wide range of IEC 61850 compliant devices and tools.

[A new brochure](#) provides many links to a wide range of applications of IEC 61850 with various SEL products:

"Combine IEC 61850 technology, Ethernet networking, and SEL high reliability to perform station computing and protection, automation, and control for distance, current differential, distribution, transformer, bus, motor, and bay control applications."

Posted by [Karlheinz Schwarz](#) at [11:14 PM](#) [0 comments](#) 

Labels: [IEC 61850](#), [protection](#), [RTU](#), [SEL](#), [Substation](#)

[Newer Posts](#)

[Home](#)

[Older Posts](#)

Subscribe to: [Posts \(Atom\)](#)

News on IEC 61850 and related Standards

Daily news concerning the standards IEC 61850, IEC 61400-25, IEC 61970 (CIM), IEC 60870-5, ...

Tuesday, December 30, 2008

Job Opportunities - IEC 61850 knowledge required

Experience with the International Standard IEC 61850 and other advanced IEC standards is a prerequisite for many open Job Opportunities! The application of IEC 61850 compliant IEDs and Tools is growing very fast all over - also in North America. Join a booming technology.

Here are a few Job Opportunities that require IEC 61850 experience:

- [3G Malaysia](#) ("... Excellent experience in IEC 61850/60870 protocol")
- [Virelec](#) ("...Systems Integration (SI) Specialist **IEC 60870-5-101/103/104, IEC 61850, TCP/IP** ")
- [MR Control Systems](#) ("...**IEC 60870-5-101, IEC 60870-5-103, IEC 61850**, ...")
- [SEL](#) ("...Research Engineer – Communications Emphasis ... Experience with various SCADA protocols: **IEC 61850, DNP, Modbus, IEC60870**")
- [Think Energy Group](#) ("...and substation automation protocols **such as IEC 61850** and DNP 3.0.")
- [The Select Group](#) ("...Understanding of the advantages of modern Substation Automation communication standards and protocols (e.g. **IEC 61850, DNP 3.0**)")
- [ABB](#) ("... Comprehends the benefits of modern Substation Automation communication standards and protocols (e.g. **IEC 61850, DNP 3.0**)")
- [GE](#) ("... Experience in substation automation and **IEC 61850**")
- [Siemens India](#) ("... **Experience on IEC 61850** protocol devices")
- [SCADA](#) ("... Familiar with typical utility protocols such as **IEC 61850, DNP, and Modbus**")
- [Sinclair Knight Merz \(SKM\)](#) ("... Knowledge in the related area of substation automation and in **particular, the application of IEC 61850**, would be highly regarded. ")
- [3G Labs India](#) ("... Looking for IEC professionals (61850/60870) ...Looking for IEC professionals (61850/60870)")
- ...

If you need help from the real experts on IEC 61850 ... to become an expert in the advanced Standards and to get a better job ... check the following training opportunities on IEC 61850 and other Standards. We help you to get the skills required - You'll get first-hand, comprehensive, up-to-date, vendor neutral knowledge, experience, and guidance:

[Training Overview](#)
[Training opportunities on IEC 61850](#)
[Training Modules on IEC 60870-5, DNP3, IEC 61970, TASE-2, CIM, ...](#)

Posted by [Karlheinz Schwarz](#) at [7:23 AM](#) [0 comments](#) 

Labels: [3G](#), [IEC 61850](#), [SCADA](#), [SEL](#), [Training](#), [Virelec](#)

Subscribe To IEC 61850 News

 Posts 

 All Comments 

Blog Archive

- [2012](#) (11)
- [2011](#) (159)
- [2010](#) (153)
- [2009](#) (162)
- ▼ [2008](#) (82)
 - ▼ [December](#) (12)
 - [SEL has enhanced the support for IEC 61850 in 2008...](#)
 - [Job Opportunities - IEC 61850 knowledge required](#)
 - [IEC 61850 Hands-on Training at STRI was a success](#)
 - [Various applications of IEC 61850 explained](#)
 - [IEC 61850 and IEC 61499 for Distributed Power Syst...](#)
 - [Stellenausschreibung-RWE-Innogy-IEC61850](#)
 - [IEEE 1588 for process bus time synchronization](#)
 - [Siemens says - Goodbye GGIO!](#)
 - [IEC 61850 UTC time stamp next leap second this mon...](#)
 - [IEC 61850 and SCADA systems](#)


Friday, December 26, 2008

IEC 61850 Hands-on Training at STRI was a success

35 power engineers from Sweden, Finland, Denmark, Norway, UK, Holland and New Zealand have been trained on how to use real multivendor IEDs for protection and control of substations. IEDs from ABB, Areva and Siemens as well as test sets from Omicron and Doble have been used to run the training. A second group has run hands-on training in the use of configuration tools.

The next public hands-on training by NettedAutomation and STRI will be held in Frankfurt (Germany) on March 03-06, 2009. [Details on next course in Frankfurt](#)

The [first Interoperability test](#) at the STRI Independent Interoperability Laboratory for IEC 61850 was performed in the end of November. Customer was Helinks LLC of Switzerland. The test verified the ability of the manufacturer independent Helinks STS configuration tool to act as an independent system configurator tool according to IEC 61850-6.

Posted by [Karlheinz Schwarz](#) at [12:22 AM](#) [0 comments](#) 


Labels: [IEC 61850](#), [interoperability](#), [interoperability tests](#), [SCL](#)

Tuesday, December 23, 2008

Various applications of IEC 61850 explained

An explanation of several applications of IEC 61850 can be found in a nice 48 page brochure published by Siemens (in [English](#) and [Deutsch](#)):

- Switchgear Interlocking with IEC 61850-GOOSE
- Reverse Interlocking Using the GOOSE of IEC 61850
- Beneficial Engineering of IEC 61850 Substation Automation Systems
- Innovative Solutions for Substation Control with IEC 61850
- Seamless Migration
- Ethernet Topologies with IEC 61850
- IEC Interoperability, Conformance and Engineering Experiences
- IEC Browser - A Powerful Test Tool for IEC 61850

Posted by [Karlheinz Schwarz](#) at [10:10 PM](#) [0 comments](#) 

Labels: [GOOSE](#), [IEC 61850](#), [Interlocking](#), [Migration](#), [Siemens](#)

IEC 61850 and IEC 61499 for Distributed Power System Automation

Distributed Power Systems need **Distributed Power System Automation** to reach a high level of an intelligent or smart grid. The standard series IEC 61850 and IEC 61499 (Function Blocks) could benefit from each other and provide the smart framework for distributed automation systems.

Neil Higgins, Valeriy Vyatkin, Nirmal-Kumar C Nair, and Karlheinz Schwarz have written one of the first papers presenting and discussing the use of IEC 61850 AND IEC 61499:

Concept for Intelligent Distributed Power System Automation with IEC 61850 and IEC 61499

[Redundancy - IEC 61850 to refer to IEC 62439?](#)

[Schneider Electric offers IEC 61850 IEDs](#)

- ▶ [November](#) (4)
- ▶ [October](#) (15)
- ▶ [September](#) (18)
- ▶ [August](#) (13)
- ▶ [July](#) (20)

Contributors

[Michael Schwarz](#)

[Karlheinz Schwarz](#)

Abstract.

This paper presents new approach to power system automation, based on distributed intelligence rather than traditional centralised control. The paper investigates the interplay between two international standards, IEC 61850 and IEC 61499, and proposes away of combining of the application functions of IEC61850-compliant devices with IEC 61499-compliant "glue logic," using the communication services of IEC 61850-7-2. The resulting ability to customise control and automation logic will greatly enhance the flexibility and adaptability of automation systems, speeding progress toward the realisation of the Smart Grid concept.

Keywords: Power system automation, IEC 61850, IEC61499, Smart Grid.

[pdf of the paper](#)

[Website of Valeriy Vyatkin](#) with background information on IEC 61499 etc.

Posted by [Karlheinz Schwarz](#) at [12:52 AM](#) [0 comments](#) 

Labels: [IEC 61499](#), [IEC 61850](#), [interoperability](#), [Smart Grid](#), [Substation Automation](#), [telecommunication](#)

Monday, December 22, 2008

Stellenausschreibung-RWE-Innogy-IEC61850

Falls Sie Kenntnisse in **IEC 61850**, **IEC 61400-25** ... OPC und DNP haben ... und sich für SCADA-Anwendungen interessieren und ..., dann könnten Sie sich bei RWE-Innogy bewerben: [Details](#)

Posted by [Karlheinz Schwarz](#) at [1:12 AM](#) [0 comments](#) 

Labels: [IEC 61400-25](#), [IEC 61850](#), [RWE](#), [SCADA](#)

Tuesday, December 16, 2008

IEEE 1588 for process bus time synchronization

The IEEE 1588 Standard Precision Time Protocol (PTP) is a new solution for very precise time synchronization on Ethernet networks. The days of "non-deterministic" Ethernet seem to be over ...

IEEE 1588 is about to have a crucial impact on the process bus applications of IEC 61850. IEC 61850-9-2 requires highly synchronized sampling processes for current and voltage sensors (CTs and VTs) in a substation. Today the synchronization is implemented using a separate fibre link.

A good source of technical background can be found at the following site: <http://www.ieee1588.com>

First products are already announced, e.g., by [Tekron \(New Zealand\)](#).

More to come ...

Posted by [Karlheinz Schwarz](#) at [2:08 AM](#) [0 comments](#) 

Labels: [IEC 61850](#), [IEEE 1588](#), [process bus](#), [synchronization](#)

Thursday, December 11, 2008

Siemens says - Goodbye GGIO!


Siemens says Goodbye to GGIO - Generic I/O Logical Node (see Siprotec [newsletter 4/2008](#)):

"The scope of standardized data object classes is often limited forcing users to use GGIO generic logical nodes (Generic Input / Output Data) instead. This will be a thing of the past. In the future all mandatory and optional data object classes and all logical nodes of IEC 61850 will be supported. The interoperability is thus greatly enhanced. All data objects can thus be transmitted so that the information semantics can be concluded directly from the object name. We thus obtain comfortable and transparent engineering, commissioning, test, diagnosis and service."

Siemens is very supportive of IEC 61850!!

Good news!!

[Newsletter in Deutsch.](#)

Posted by [Karlheinz Schwarz](#) at [11:01 AM](#) [0 comments](#) 

Labels: [engineering](#), [GGIO](#), [IEC 61850](#), [interoperability](#), [SCL](#), [Siemens](#)

Tuesday, December 9, 2008

IEC 61850 UTC time stamp next leap second this month

Dear All,

The IEC 61850 time stamp uses the [UTC time](#). The [next leap second](#) will be added on December 31, 2008:

2008 December 31, 23h 59m 59s

2008 December 31, 23h 59m 60s

2009 January 1, 0h 0m 0s

That means Dec 31, 2008 is one second longer than any other day in 2008!

As a consequence my birthday is (one second) longer than yours!! Yes, my birthday is Dec. 31 ...

I hope your SCADA and EMS systems take care of my birthday and adjust their glocks by inserting one "Karlheinz" second on Dec 31, 2008.

TAI, Temps Atomique International, is the international atomic time scale based on a continuous counting of the SI second. TAI is currently ahead of UTC by 33 seconds ... soon 34 seconds.

Posted by [Karlheinz Schwarz](#) at [8:40 AM](#) [0 comments](#) 

Labels: [IEC 61850](#), [leap second](#), [time stamp](#), [utc](#)

Wednesday, December 3, 2008

IEC 61850 and SCADA systems

Many of today's substation devices like protection relays are IEC 61850 compatible - one way or the other. From a SCADA point-of-view these


and other devices can easily interface with such devices using the client/server communication services:

- Get a value of single data object (GetDataValues – Client driven)
- Get a list of values of data objects (GetDataValues with list sent in each request – Client driven)
- Get the complete list values of data objects using a dataset object (GetDataSetValues – Client driven)
- Get the complete list of values of data objects (of a dataset) using reporting (reporting, General Interrogation – Client driven)
- Get the complete list of values of data objects (of a dataset) using reporting (reporting, Integrity period – Server driven)
- Get one (BufTm=0) or more (BufTm>0) value(s) of data objects (of a dataset) using reporting on data and quality change and data update – Server driven)
- GOOSE and Sampled Values ... exchanges complete list of values of data objects of a dataset (events: application specific – Server driven)
- Get sequence of value(s) of data objects (of a dataset) using logging (on data and quality change and data update – Client driven)

These IEC 61850 services (except for GOOSE and SV) are mapped to the MMS protocol.

In IEC 61400-25-4 the IEC 61850 services are mapped to:

- IEC 61950-7-2 ACSI and Information Models (LD, LN, DATA, DA, ...) defined as webservices (almost all service in IEC 61850 become a corresponding WS in 61400-25-4)
- (full) Mapping according to IEC 61850-8-1 MMS
- (subset) Mapping to OPC XML DA
- (small subset) Mapping to IEC 60870-5-104
- (small subset) Mapping to DNP3

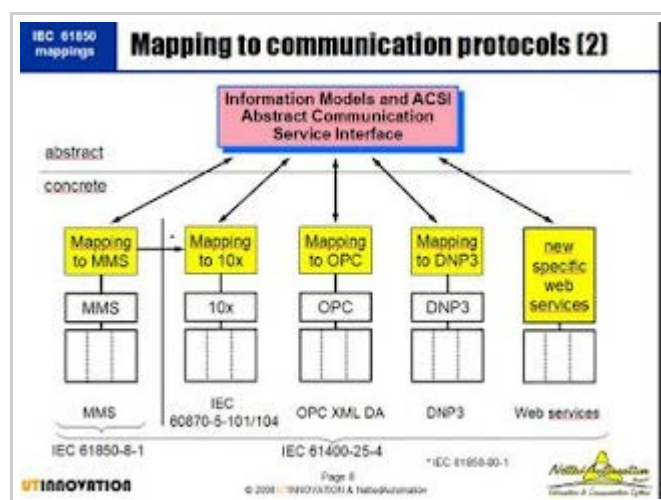


In the current scenario what should a SCADA vendor support in order to interface with 61850-compatible devices?

In existing installations with DNP3 or IEC 60870-5-101/104 it is recommended to keep these solutions. It is not recommended to just replace one protocol by another! IEC 61850 should be considered if SCADA systems want to benefit from the 3000+ standard information models and the substation configuration language (SCL, IEC 61850-6) to simplify the configuration of Gateways, RTUs, Data Management Systems, and SCADA systems and to simulate easily the Gateways, RTUs, and Data Management Systems!! Direct access from SCADA systems to IEDs may be required. Some utilities get rid of HMIs in Substations and provide IP access directly from the control center to

the IEDs (through routers).

EMS and SCADA systems of the big vendors have already or will have soon direct access to IEC 61850 compliant devices or systems. More to come soon.

Posted by [Karlheinz Schwarz](#) at [11:28 PM](#) [0 comments](#) 

Labels: [DNP3](#), [IEC 60870-5-101](#), [IEC 60870-5-104](#), [IEC 61850](#), [Relays](#), [RTU](#), [SCADA](#)

Redundancy - IEC 61850 to refer to IEC 62439?

IEC TC 57 WG 10 considers to use in IEC 61850 the results of the edition 2 of the following standard developed by IEC TC 65C:

IEC 62439: Industrial communication networks: high availability automation networks

The CDV has been published November 21, 2008 (Document 65C/519/CDV); the ballot closes 2009-04-24.


The redundancy is intended to be handled in the link layer ... so that the higher layers do not need to be doubled! Be aware, there are several redundancy concepts in IEC 62439 ... you need to know which concept you want to choose before implementing the redundancy software.

IEC 61850 is likely to reference to Part 3 (PRP).

The IEC 62439 (2nd edition CDV) comprises the following solutions:

- IEC 62439-1 Ed1.0, Industrial communication networks high availability automation networks -Part 1: general concepts and calculation methods (Including RSTP)
- IEC 62439-2 Ed1.0, Industrial communication networks high availability automation networks -Part 2: Media Redundancy Protocol (MRP)
- IEC 62439-3 Ed1.0, Industrial communication networks high availability automation networks -Part 3: Parallel Redundancy Protocol (PRP) and High availability Seamless Ring (HSR)
- IEC 62439-4 Ed1.0, Industrial communication networks high availability automation networks -Part 4: Cross-network Redundancy Protocol (CRP)
- IEC 62439-5 Ed1.0, Industrial communication networks high availability automation networks -Part 5: Beacon Redundancy Protocol (BRP)
- IEC 62439-6 Ed1.0, Industrial communication networks high availability automation networks -Part 6: Distributed Redundancy Protocol (DRP)

[Very good introduction to standard redundancy concepts, rationale, IEC 62439, etc. by Professor Hubert Kirrmann \(ABB Switzerland\) \[PPT, 2 MB\].](#)

Posted by [Karlheinz Schwarz](#) at [10:10 PM](#) [0 comments](#) 

Labels: [IEC 61850](#), [real-time](#), [redundancy](#)

Schneider Electric offers IEC 61850 IEDs

Schneider Electric provides IEC 61850 connectivity for their Sepam protection relays:

Sepam units can be connected to an IEC 61850 station bus by one of the following:

ECI850 Sepam server for:

- Sepam series 20
- Sepam series 40
- Sepam series 80

ACE850 communication interface for:

- Sepam series 40
- Sepam series 80 only (available soon).

Sepam units with ECI850 and ACE850 are compliant with:

- IEC 61850-6
- IEC 61850-7-1
- IEC 61850-7-2
- IEC 61850-7-3
- IEC 61850-7-4
- IEC 61850-8-1

[Products](#) [pdf, 680 KB]

[User's manual for Sepam 20/40/80 \(2008-06\)](#) [pdf, 3,8 MB]

Posted by [Karlheinz Schwarz](#) at [3:39 AM](#) [2 comments](#) 

Labels: [IEC 61850](#), [protection](#), [real IEDs](#), [Relays](#)

Friday, November 28, 2008

Hands-on Training at STRI big success

The first Hands-on Training at STRI in Ludvika, Sweden, from 25.-28. November 2008 was a great success.

Many experts have been trained on how to use real multivendor IEDs for protection and control of substations. IEDs from ABB, Areva and Siemens as well as test sets from Omicron and Dobel have been used to run the training. A second group has run hands-on training in the use of configuration tools.

The next public hands-on training by NettedAutomation and STRI will be held in Frankfurt (Germany) on March 03-06, 2009.

[Details on next course in Frankfurt](#)





Posted by [Karlheinz Schwarz](#) at 8:52 PM 0 comments 

Labels: [GOOSE](#), [hands-on Training](#), [interoperability tests](#), [real IEDs](#), [real-time](#), [Training](#)

Thursday, November 27, 2008

IEC 61850-6 SCL Files from Areva available

Areva provides a comprehensive list of SCL Files (.icd files - IED Capability Description) for their IEDs. You can download these files easily ...

[Overview of relays etc.](#)

[Example list for distance protection](#)

All files for [MiCOM P432 and P439](#)

Single icd file example: [P439-611-202.icd](#)

Posted by [Karlheinz Schwarz](#) at 12:57 AM 0 comments 

Labels: [icd file Areva](#), [IEC 61850](#), [SCL](#)

Wednesday, November 26, 2008

Phoenix Contact entwickelt IEC61850-Komponenten

Harald Grewe (Produktmanager IP67-I/O-Systeme bei der Phoenix Contact Electronics GmbH) berichtet am 11.09.2008:

"... Als langjähriger Partner vieler Energieversorgungs-Unternehmen setzt Phoenix Contact die Anforderungen der **IEC61850 in entsprechende Komponenten** um. Die Kombination aus umfassenden Branchenkenntnissen und einem tief greifenden Know-how in puncto

Kommunikationstechniken **wird zu ausgereiften Geräten führen, die zur Erhöhung der Produktivität der Schaltanlagen beitragen. ..."**

[Kompletter Beitrag im "Maschinenmarkt" ...](#)

Posted by [Karlheinz Schwarz](#) at 9:30 PM 0 comments 

Labels: [I/Os](#), [IEC 61850](#)

Thursday, November 20, 2008

IEC 61850 at DistribuTECH San Diego, February 3-5, 2009

The international standard IEC 61850 will be one of the crucial issues at the DistribuTECH, San Diego, February 3-5, 2009.

Monday, February 2, 2009 8:00 AM – FULL DAY COURSE

UU#305 – [Using the IEC 61850 Standard for Communication Networks and Systems in Substations](#)

Presented by: Members of the UCAIug

Course Description:

This seminar will provide an overview of how the IEC 61850 standard is being used in electric utilities today and an introduction to how to use the IEC 61850 standard for communications networks in substations from the perspective of industry leaders who are the editors for the standard and experts in the area of communications for utility automation. Topics will include an overview of system architecture, how data is modeled, mapping to communication protocols, configuring substations and testing, all using IEC 61850.


Who should attend this course? This is an intense comprehensive seminar on using the IEC 61850 Standard and is targeted at engineers interested in or considering applying the standard.

The course will be taught for the UCAIug by:

Christoph Brunner, UTInnovation
David Dolezilek, Schweitzer Engineering Laboratories
Herb Falk, SISCO
George Schimmel, Triangle Micro Works
Karlheinz Schwarz, NettedAutomation

All of the presenters have been and continue to be instrumental in the development of the IEC 61850 International Standard and its application to utility automation.

[Register now.](#)
[Utility university schedule](#)

Posted by [Karlheinz Schwarz](#) at 12:14 AM 0 comments 

Labels: [IEC 61850](#), [IEC61850](#), [interoperability](#), [Training](#)

Thursday, October 30, 2008

SystemCorp Perth/Australia provides IEC 61850 solutions

[SystemCorp](#) (Perth/Australia) announced the other day: "Substation control and other plant process automation tasks can be programmed easily using standardized IEC-61131 software tools. The preferred data

exchange protocol for power control applications is IEC-61850."

The solution is demonstrated at the CEPSE 2008 exhibition in Macau (27-31 October 2008).

[More details](#)

Posted by [Karlheinz Schwarz](#) at [8:01 AM](#) [0 comments](#) 

Labels: [IEC 61131-3](#), [IEC 61850](#)

Smart RTU running IEC 61850 on Linux

The Danish DISCOS® SmartCom RTU module is part of the DISCOS® System. The DISCOS® SmartCom RTU module is designed to link and integrate the DISCOS® System into high-level IT systems like SCADA solutions or other grid management IT platforms. The DISCOS® SmartCom RTU module is based on an ARM® processor running Linux, which offers connectivity according to IEC 61850.

[More details](#)

Posted by [Karlheinz Schwarz](#) at [7:41 AM](#) [0 comments](#) 

Labels: [IEC 61850](#), [RTU](#)

Monday, October 27, 2008

IEC 61850-7-420 - DER extensions out for final vote

The extension of IEC 61850 for DER has been published for final vote:

IEC 61850-7-420 Ed.1: Communication networks and systems for power utility automation – Part 7-420: Basic communication structure – Distributed energy resources logical nodes

The voting period ends on 2009-01-09.

The FDIS provides many new Logical nodes:

- 12 Logical nodes for DER management systems
- 10 Logical nodes for DER generation systems
- 10 Logical nodes for specific types of DER
- 13 Logical nodes for auxiliary systems

Need more information? [contact us please ...](#)

Posted by [Karlheinz Schwarz](#) at [7:58 AM](#) [0 comments](#) 

Labels: [61850-7-420](#), [DER](#), [IEC 61850](#)

[Newer Posts](#)

[Home](#)

[Older Posts](#)

Subscribe to: [Posts \(Atom\)](#)

News on IEC 61850 and related Standards

Daily news concerning the standards IEC 61850, IEC 61400-25, IEC 61970 (CIM), IEC 60870-5, ...

Monday, October 27, 2008

CEPSI 2008 Macau and IEC 61850

During the first day of the CEPSI 2008 Conference and Exhibition in Macau (27.-31.11.2008) there is a great interest in IEC 61850. Several exhibitors have indicated that IEC 61850 is a one of the crucial issues here in Asia. The enquiries for IEC 61850 compliant data management products is really growing very fast. One exhibitor told me at the end of the first day: "We have been contacted by so many people that we could leave the exhibition already after the first day ... we have been visited by sooo many people ... including people form the big vendors ...".

The presentation of some four papers on IEC 61850 in the session "T&D - Substation and Distribution Automation" was visited by some 40-50 experts.

More to come.

STRI announced the second hands-on training for IEC 61850 to be hold in Frankfurt/Germany on [03.-06. March 2009](#)... the first training in Ludvika/Sweden end of November 2008 is already sold out.

Posted by [Karlheinz Schwarz](#) at [7:35 AM](#) [0 comments](#) 

Labels: [hands-on Training](#), [IEC 61850](#), [Training](#)

Saturday, October 25, 2008

ABB's System 800xA supports IEC 61850

ABB USA reports on the use of IEC 61850 in ABB's System 800xA

"... System 800xA fully supports IEC 61850, the global communication standard for Power Distribution and Substation Automation. It includes a recently released IEC 61850 interface that fully integrates switchgear and protection Intelligent Electrical Devices (IED) for the power distribution side of an industrial plant. System 800xA has always supported regular electrical devices for the process side of the plant, such as variable-speed drives, motor controllers and low-voltage circuit breakers to enhance equipment effectiveness and improve access to vital equipment and system data without the need for gateways, serial interfaces or hardwiring. ..."

[Full text of the news ...](#)

[More about the use of IEC 61850 in Power Plants ...](#)

Posted by [Karlheinz Schwarz](#) at [12:01 AM](#) [0 comments](#) 

Labels: [IEC 61850](#), [Power Plants](#)

Subscribe To IEC 61850 News

Blog Archive

- [2012](#) (11)
- [2011](#) (159)
- [2010](#) (153)
- [2009](#) (162)
- ▼ [2008](#) (82)
 - [December](#) (12)
 - [November](#) (4)
 - ▼ [October](#) (15)
 - [SystemCorp
Perth/Australia provides
IEC 61850 solu...](#)
 - [Smart RTU running IEC
61850 on Linux](#)
 - [IEC 61850-7-420 - DER
extensions out for final
vot...](#)
 - [CEPSI 2008 Macau and
IEC 61850](#)
 - [ABB's System 800xA
supports IEC 61850](#)
 - [TVA orders IEC 61850
solutions from ABB and
GE](#)
 - [Security measures for
power industry \(BDEW\)](#)
 - [IEC 61850 is no longer a
novelty](#)
 - [IEC 61850, CIM, Security
one-day-event in Mexico
C...](#)

Friday, October 24, 2008

TVA orders IEC 61850 solutions from ABB and GE

ABB wins \$15 Million contract with TVA for IEC 61850 compliant relays

<http://uaelp.pennnet.com> reports: "... The IED 670 series supports the IEC 61850 standard for substation automation, providing extreme intelligence and flexibility that allows for interoperability in communication with other relays and substation automation components."

[more details ...](#)

TVA contract on GE Digital Energy's IEC 61850 compliant Universal Relays

<http://www.marketwatch.com/> reports: "...The Multilin UR products not only met all of TVA's criteria but also offered comprehensive support for IEC 61850, the international standard for substation communication that reduces construction and design costs and will allow TVA to upgrade to future technology without having to replace its existing infrastructure. ..."

[more details ...](#)

Posted by [Karlheinz Schwarz](#) at [11:48 PM](#) [0 comments](#) 

Labels: [IEC 61850](#)

Tuesday, October 21, 2008

Security measures for power industry (BDEW)

The German association BDEW has published earlier in 2008 "a white paper specifying essential security measures for control and telecommunication systems ... for **power industry organisations**. The purpose of this document is to sufficiently protect the operation of these systems against security threats."

DE: Whitepaper: Anforderungen an sichere Steuerungs- und Telekommunikationssysteme

EN: White Paper: Requirements for Secure Control and Telecommunication Systems

[Download dual language paper ... \[pdf\]](#)

Posted by [Karlheinz Schwarz](#) at [10:20 AM](#) [0 comments](#) 

Labels: [SCADA](#), [security](#), [telecommunication](#)

Saturday, October 18, 2008

IEC 61850 is no longer a novelty

ZIV USA states: "IEC 61850 is no longer a novelty. Its acceptance is growing and the number of practical applications in service that utilize it continues to increase. However, in the majority of applications all of the devices originate from the same manufacturer. Only a few projects have been converted into a **real example of interoperability between devices from different suppliers** to demonstrate in practice the viability and the success of the standardization process."

Currently there are many discussions about the "IEC 61850 interoperability".

[Myongji University \(Korea\) cooperates with NettedA...](#)

[IEC Fieldbus Edition 2008](#)

[IEC 61850 in conventional Power Plants](#)

[IEC 61850-7-4 Edition 2 CDV approved](#)

[IEC 61850 for DER systems at PGE \(Portland, OR\)](#)

[Approved: IEC 61400-25-6 CDV](#)

- [September](#) (18)
- [August](#) (13)
- [July](#) (20)

Contributors

[Karlheinz Schwarz](#)

[Michael Schwarz](#)

What does the standard IEC 61850-1 define?

interoperability

the ability of two or more IEDs from the same vendor, or different vendors, to exchange in-formation and use that information for correct execution of specified functions.

interchangeability

the ability to replace a device supplied by one manufacturer with a device supplied by another manufacturer, without making changes to the other elements in the system.


The interoperability ment in IEC 61850 is the **communication interoperability!** But, users usually want to have **function interoperability!** The function interoperability requires the FUNCTIONS to be defined - which is not (yet) the case in IEC 61850!

IEC 61850:

- DOES NOT standardize (application) functions like interlocking function NOR the distribution of a function (1 or n IEDs) !!
- Standardizes the information produced and consumed (3000+) by functions and how information is exchanged (get/set, control, report, log, GOOSE, SV ...)
- Standardizes a language to describe the substation topology, information models, communication, binding to process, the data flow, ... (SCL – Substation Configuration Language; IEC 61850-6)

Interchangeability is NOT AT ALL defined in IEC 61850!!

Download a comprehensive document on [IEC 61850 from ZIV](#) (link to pdf file 11 MB can be found there).

Posted by [Karlheinz Schwarz](#) at [10:41 PM](#) [0 comments](#) 

Labels: [IEC 61850](#), [interchangeability](#), [interoperability](#)

Wednesday, October 15, 2008

IEC 61850, CIM, Security one-day-event in Mexico City - January 27, 2009

Karlheinz Schwarz, NettedAutomation (Karlsruhe/Germany) offers a ONE-DAY event on IEC 61850, CIM, IEC 61400-25, IEEE 1686, ...

Where: Mexico City

When: January 27, 2009

Time: 09:00 a.m. to 06:00 p.m.

Language: English

The objective of the one-day event is to give an OVERVIEW and UPDATE on the current standardization efforts within IEC TC 57 and TC 88 and to present the USER, VENDOR and SYSTEM INTEGRATOR EXPERIENCE since 2005 - for applications inside and outside the utility industry:


- IEC 61850: Communication networks and systems for power automation
- IEC 62351: Data and Communication Security and NERC CIP
- IEC 61968: CIM - Energy management system application program interface
- IEC 61400-25: Communications for monitoring and control of

- wind power plants
- IEEE 1686: Substation IEDs Cyber Security Capabilities
- ...

Questions like the following will be discussed:

- When will the 2nd Edition of IEC 61850 be available?
- Do utilities really get what they are looking for?
- Is the interoperability of substation IEDs already reached?
- Turn-key versus "home-made" automation systems!?
- What is the status of the harmonization of CIM & IEC 61850?
- Is the security standard available? and implemented?
- What is the relation between IEC 62351 and NERC's CIP?
- What is IEEE 1686?
- What about multivendor projects for IEC 61850?
- What tools for IEC 61850 are available?
- What's going on in North America?
- ...

If you are interested to attend to get the latest information - neutral, up-to-date, experienced, and comprehensive - please [contact NettedAutomation by email](#) indicating how many experts from your organization may be interested.

Posted by [Karlheinz Schwarz](#) at [11:10 AM](#) [0 comments](#) 

Labels: [CIM](#), [IEC 61400-25](#), [IEC 61850](#), [IEC 61850 edition 2](#), [IEC 61968](#), [IEC 61970](#), [Training](#), [wind power](#)


Myongji University (Korea) cooperates with NettedAutomation

During the Seminar on IEC 61850 and IEC 61400-25 on October 02, 2008, at the Utility IT Laboratory of the Myongji University (Yongin, Kyunggi-Do/Republic of South Korea)

NettedAutomation GmbH (Karlsruhe / Germany) and

Utility IT Laboratory (Yongin, Kyunggi-Do / Republic of South Korea)

announced their cooperation in the area of the international standard series IEC 61400-25 and IEC 61850:

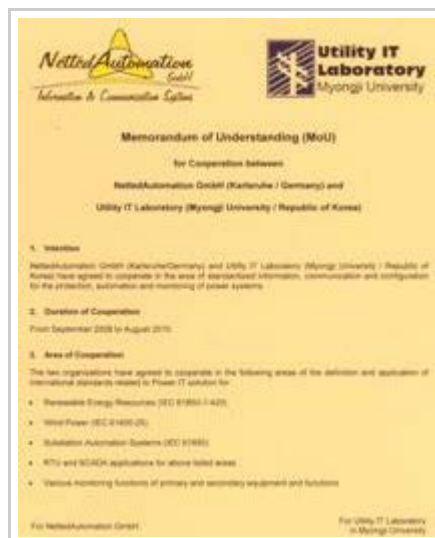

1. Intention

NettedAutomation GmbH (Karlsruhe/Germany) and Utility IT Laboratory (Yongin, Kyunggi-Do/Republic of South Korea) have agreed to cooperate in the area of standardized information, communication and configuration for the protection, automation and monitoring of power systems.

2. Duration of Cooperation


From September 2008 to August 2010.

3. Area of Cooperation

The two organizations have agreed to cooperate in the following areas of the definition and application of international standards related to Power IT solution for:

- Renewable Energy Resources (IEC 61850-7-420)
- Wind Power (IEC 61400-25)
- Substation Automation Systems (IEC 61850)
- RTU and SCADA applications for above listed areas
- Various monitoring functions of primary and secondary equipment and functions

[Seminar program \(2008-10-02\)](#)

Posted by [Karlheinz Schwarz](#) at 9:10 AM 0 comments 

Labels: [IEC 61400-25](#), [IEC 61850](#), [Training](#), [wind power](#)

Tuesday, October 14, 2008

IEC Fieldbus Edition 2008

The 2008 Edition of the IEC 61158 Fieldbus standard "Industrial communication networks –Fieldbus specifications" has been published recently.

The picture depicts the stack of fieldbus standards of the IEC 61158 Edition 2007 (more than 60 parts, each part is a CD ROM as sold by the German DIN).



A good overview of the parts and the many solutions could be found in a [table posted at the DKE website](#).

List of all [99 IEC 61158 standards and related standards](#)

Posted by [Karlheinz Schwarz](#) at 5:56 AM 0 comments 

Labels: [Ethernet](#), [fieldbus](#), [IEC 61158](#)

IEC 61850 in conventional Power Plants

ABB uses IEC 61850 in conventional Power Plants:

In Control, Issue May 2008, presents the new application domain for IEC 61850:

IEC 61850: New standard improves the automation of power plants

Today, power plants are highly automated. For large thermal power generators, all the sub-systems can be supervised from a central control room. The electrical systems are also one of these sub-systems. In the future, the new IEC 61850 standard will simplify the integration of electrical components from different manufacturers in power plant automation systems and at the same time reduce the costs for the operation and maintenance of these plants.

[Download magazine. EN \(pdf, 1MB\)](#)

IEC 61850: Neue Norm verbessert die Automatisierung von Kraftwerken

Kraftwerke sind heute hoch automatisiert. Bei großen thermischen Stromerzeugern können alle Teilsysteme von einer zentralen Leitwarte aus überwacht werden. Zu diesen Teilsystemen zählen auch die elektrischen Systeme. Die neue Norm IEC 61850 wird künftig herstellerübergreifend die Integration von elektrischen Komponenten in die Automatisierung von Kraftwerken vereinfachen und zugleich die Kosten für Betrieb und Instandhaltung dieser Anlagen senken.

[Download magazine, DE \(pdf, 1 MB\)](#)

[Additional Slides in German \(pdf, 750 KB\).](#)

Posted by [Karlheinz Schwarz](#) at 5:21 AM 0 comments 

Labels: [condition monitoring](#), [DCS](#), [IEC 61850](#), [Power Plants](#)

Sunday, October 12, 2008

IEC 61850-7-4 Edition 2 CDV approved

The IEC 61850-7-4 Edition 2 CDV approved by 100 per cent support.

IEC 61850-7-4 Ed.2:

Communication networks and systems for power utility automation -
Part 7-4: Basic communication structure -
Compatible logical node classes and data classes

[Voting report](#)

Posted by [Karlheinz Schwarz](#) at 9:54 PM 0 comments 

Labels: [IEC 61850 edition 2](#)

Tuesday, October 7, 2008

IEC 61850 for DER systems at PGE (Portland, OR)

One of the latest announcements to use and support IEC 61850 comes from the US - from Portland General Electric (PGE) ... according to ISA's InTech [news report 2008-10](#).

"... PGE received a grant from GridApp to take GenOnSys applications to the next version, GenOnSys 2.0. "In order to be able to go into that world, we wanted a standard [IEC 61850-7-420] we and other utilities could use to allow everyone to do things the same way,"

"GenOnSys is able to provide a distributed realtime monitoring, live video cameras, and alarming system based on the IEC 61850-7-420 object standard for all sites."

[More on IEC 61850-7-420 for DER ...](#)

Posted by [Karlheinz Schwarz](#) at 7:52 PM 0 comments 

Labels: [61850-7-420](#), [DER](#), [IEC 61850](#)

Saturday, October 4, 2008

Approved: IEC 61400-25-6 CDV

The Committee Draft IEC 61400-25-6 Ed.1:

Wind turbines -

Part 25-6: Communications for monitoring and control of wind power plants

- Logical node classes and data classes for condition monitoring

has been approved on Friday, October 03, 2008.

[Voting Report.](#)

The next step will be to prepare the FDIS. The Project Team PT 25-6 will meet in Copenhagen (Denmark) next week Oct 08-10) to prepare the next version.

Posted by [Karlheinz Schwarz](#) at [6:44 AM](#) [0 comments](#) 

Labels: [condition monitoring](#), [IEC 61400-25](#), [IEC 61400-25-6](#), [wind power](#)

Sunday, September 28, 2008

Huge off-shore substation with IEC 61850

The huge [off-shore substation for Alpha Ventus](#) supporting IEC 61850 has been installed in the North Sea (nice pictures ... text in German).

[Background information](#) from one of the partner companies: EWE (pdf, 950 KB)

Posted by [Karlheinz Schwarz](#) at [8:05 PM](#) [0 comments](#) 

Labels: [de](#), [IEC 61850](#), [wind power](#)

Alcatel Lucent IEC 61850 Gigabit Ethernet

Alcatel-Lucent OmniSwitch 6855 Hardened LAN **Gigabit** [Ethernet switch supports IEC 61850](#).

Posted by [Karlheinz Schwarz](#) at [5:28 PM](#) [0 comments](#) 

Labels: [Ethernet](#), [IEC 61850](#)

More than 250 visits per day

The IEC 61850 News Blog has been visited more than 250 times per day. There is always something to catch ...

I look forward to serving your needs in the future with up-to-date and crucial information on IEC 61850 and IEC 61400-25.

Keep tuned.

Posted by [Karlheinz Schwarz](#) at [7:20 AM](#) [0 comments](#) 

Labels: [IEC 61400-25](#), [IEC 61850](#)

IEC 61850 OPC Server

[ReLab](#) IEC-61850 OPC device driver extends ReLab OPC Server capabilities and allows it to communicate with any IED that support IEC-

61850 protocol.

ReLab's OPC server provides along awaited bridge between IEC-61850 devices and OPC world.

[More details ...](#)

Posted by [Karlheinz Schwarz](#) at [7:14 AM](#) [0 comments](#) 

Labels: [IEC 61850](#), [OPC](#)

Standard PLC with IEC 61850 and IEC 61400-25

[Beckhoff](#) (PLC manufacturer from Germany) supports the standards IEC 61400-25 and IEC 61850 in the TwinCAT PLCs for wind turbine communication. Release in mid 2009.

[Brief information in English ... in German ...](#)
[further information in German](#)
[further information in English](#)

After the many fieldbus wars we see more and more PLC manufacturers returning to the "old" concept of [MMS](#) (ISO 9506, Manufacturing Message Specification) ...

[IEC 61850 / IEC 61400-25 on a single page.](#)

Posted by [Karlheinz Schwarz](#) at [6:43 AM](#) [0 comments](#) 

Labels: [IEC 61400-25](#), [IEC 61850](#), [IEC61850](#), [MMS](#), [wind power](#), [wind turbine controller](#)

IEC 61850 and IEC 61400-25 at CEP SI 2008 (Macau)

IEC 61850 and IEC 61400-25 presented by Karlheinz Schwarz (SCC) at the [CEPSI 2008 conference in Macau](#) end of October 2008:

27 Oct 2008, Monday

4:15 pm – 6:00 pm Technical Session (IEC 61850 outside Substations, [paper abstract](#))

31 Oct 2008, Friday

2:00 pm – 6:00 pm Technical Session (IEC 61850/61400-25 and Condition Monitoring, [paper abstract](#))

I look forward to seeing you there.

Posted by [Karlheinz Schwarz](#) at [6:09 AM](#) [0 comments](#) 

Labels: [condition monitoring](#), [IEC 61400-25](#), [IEC 61850](#)

[Newer Posts](#)

[Home](#)

[Older Posts](#)

Subscribe to: [Posts \(Atom\)](#)

News on IEC 61850 and related Standards

Daily news concerning the standards IEC 61850, IEC 61400-25, IEC 61970 (CIM), IEC 60870-5, ...

Friday, September 26, 2008

Nari Relays successfully in operation

[Nari Relays](#) (Nanjing, China) provides a variety of products applying IEC 61850.

RCS-FAMILY Products Based on IEC 61850:

- RCS-900 Series Protection
- RCS-9700 Software Package
- RCS-9700 Series Bay Control Unit
- RCS-9600 Series Protection, Monitoring & Control Unit
- RCS-9698G/H Communication Control Unit
- RCS-9794A Protocol Converter (Gateway)

[Product prochure](#) (pdf, 1.4 MB)

Posted by [Karlheinz Schwarz](#) at [6:48 PM](#) [0 comments](#) 

Labels: [IEC 61850](#), [IEC61850](#)


Saturday, September 13, 2008

IEC 61850-80-1 to be published very soon

The final text for the Technical Specification (TS) IEC 61850-80-1 "Guideline to exchanging information from a CDC based data model using IEC 60870-5-101 or IEC 60870-5-104" has been sent by the project leader Wolfgang Brodt (Siemens Vienna) to IEC Central Office for preparation of the official TS publication. Wolfgang has done a great job to publish the TS!

"This Technical Specification gives a guideline on how to exchange information from a CDC based data model (e.g. IEC 61850) using IEC 60870-5-101 or IEC 60870-5-104 between substation(s) and control center(s). Mostly guidelines for functions needed in a substation gateway device are given.

The goal of this Technical specification is to describe standardized mapping of device oriented data models (e.g. IEC 61850) with already defined attributes of CDC's and services (e.g. IEC 61850-7) onto the already defined ASDU's and services of IEC 60870-5-104 or IEC 60870-5-101. It is not the goal of this Technical Specification to add any extensions to published standards (e.g. IEC 61850 or IEC 60870-5-104 or IEC 60870-5-101)."

Posted by [Karlheinz Schwarz](#) at [10:04 PM](#) [0 comments](#) 

Labels: [IEC 60870-5-101](#), [IEC 60870-5-104](#), [IEC 61400-25](#), [IEC 61850](#)

Center for IT Standards in the Energy Sector (CISE)

Subscribe To IEC 61850 News

Blog Archive

- [2012](#) (11)
- [2011](#) (159)
- [2010](#) (153)
- [2009](#) (162)
- ▼ [2008](#) (82)
 - [December](#) (12)
 - [November](#) (4)
 - [October](#) (15)
 - ▼ [September](#) (18)

[Huge off-shore substation with IEC 61850](#)

[Alcatel Lucent IEC 61850 Gigabit Ethernet](#)

[More than 250 visits per day](#)

[IEC 61850 OPC Server](#)

[Standard PLC with IEC 61850 and IEC 61400-25](#)

[IEC 61850 and IEC 61400-25 at CEPSI 2008 \(Macau\)](#)

[Nari Relays successfully in operation](#)

[IEC 61850-80-1 to be published very soon](#)

[Center for IT Standards in the Energy Sector \(CISE...\)](#)

Am [OFFIS in Oldenburg](#) wird im Oktober 2008 das "Center for IT Standards in the Energy Sector" ([CISE](#)) gegründet.

[Flyer mit Details](#)

Ziel: Bei zunehmender Anzahl und Heterogenität der Marktakteure, Geräte, Systeme und Anlagen in der zukünftigen (dezentralen) Energieversorgung ist die Automatisierung im Zusammenspiel mit dem Informationsaustausch eine sehr wichtige Komponente. Eine „semantisch saubere“, d.h. inhaltlich unmissverständliche Kommunikation der beteiligten Komponenten ist seit einiger Zeit Gegenstand der internationalen Normung bei IEC: IEC 61968, IEC 61970, IEC 61850, IEC 61400-25, ... ISO 9506. Mitarbeiter des CISE werden aktiv an der Gestaltung und Umsetzung der entsprechenden Normen mitwirken.

"Internationale Standards und Normen ermöglichen die Interoperabilität im Energiesektor und senken so die Integrationskosten. Der Umsetzung dieser Standards in Software ..."


Posted by [Karlheinz Schwarz](#) at [7:07 AM](#) [0 comments](#) 

Labels: [CIM](#), [IEC 61400-25](#), [IEC 61850](#), [IEC 61968](#), [IEC 61970](#)

Friday, September 12, 2008

One Page Introduction to IEC 61850 (IEC 61400-25)

One of the shortest introductions to the standard series IEC 61850 and IEC 61400-25 on a single page with the basics and an example ... [download](#) (pdf, 57 KB)

Posted by [Karlheinz Schwarz](#) at [6:18 AM](#) [0 comments](#) 

Labels: [en](#), [IEC 61400-25](#), [IEC 61850](#)

Wednesday, September 10, 2008

Solvay uses IEC 61850 for Energy Control Center

Solvay (world-leading producer of chemicals, plastics and pharmaceutical products) uses IEC 61850 to ensure the chemical company's power supply worldwide by utilizing an Energy Control Center based on IEC 61850. Solvay requires energy in large amounts on a consistent basis for its chemical processing, especially for soda production by electrolysis. Reliability and optimization of the supply are therefore vital to Solvay's success.

Solvay attached considerable importance to a solution with maximum standardization, not only for cost reasons but also because of its greater practicality. A standardized architecture for system features, archive and software module, as well as ease of operation and problem-free maintenance were therefore solidified in the invitation to bid.

Paper from Siemens in [English](#), [German](#)

Posted by [Karlheinz Schwarz](#) at [8:24 AM](#) [0 comments](#) 

Labels: [applications](#), [IEC 61850](#)

[One Page Introduction to IEC 61850 \(IEC 61400-25\)](#)

[Solvay uses IEC 61850 for Energy Control Center](#)

[Reinhausen reports about successful integration of...](#)

[One Day Introduction on IEC 61850/61400-25 for ren...](#)

[Cisco provides new release of AX-S4 MMS \(V5.1000\)](#)

[New IEC 61850-6 ICD Editor](#)

[Kick-off meeting for IEC 61400-25 Interest Group](#)

[Wind Power: IEC 61400-25 PLC library from Beckhoff...](#)

[IEC 61400-25-4 Mappings published as International...](#)

► [August](#) (13)

► [July](#) (20)

Contributors

[Karlheinz Schwarz](#)

[Michael Schwarz](#)

Reinhausen reports about successful integration of IEC 61850

Utilities in many different countries benefit from the Ethernet based networking offered by IEC 61850 for load tap change controllers. Reinhausen is one of the first manufacturer with integrated IEC 61850 capability in their devices. Reinhausen reports on several succesful projects in multiple languages:

News in [German](#), [English](#), [Spanish](#), [Italien](#), and [Russian](#)

Posted by [Karlheinz Schwarz](#) at [6:39 AM](#) [0 comments](#) 

Labels: [IEC 61850](#)

Sunday, September 7, 2008

One Day Introduction on IEC 61850/61400-25 for renewable energy in Seoul

The benefits of using approved International Standards IEC 61850 and IEC 61400-25 for Renewable Energy Resources will be presented and discussed during a one day seminar in Seoul (South Korea) on October 2008-10-02.

The Myongji University organizes the event during the 60th Anniverary.

[Flyer with details \(pdf\)](#)

Posted by [Karlheinz Schwarz](#) at [10:06 PM](#) [0 comments](#) 

Labels: [IEC 61400-25](#), [IEC 61850](#), [MMS](#), [tools](#)

Saturday, September 6, 2008

Sisco provides new release of AX-S4 MMS (V5.1000)

A [new release of Sisco's AX-S4 MMS \(V5.1000\)](#) is now available with improved IEC 61850 support including SCL configuration.

[AX-S4 MMS overview](#)

[AX-S4 MMS data sheet](#)

Posted by [Karlheinz Schwarz](#) at [11:02 AM](#) [0 comments](#) 

Labels: [en](#), [IEC 61850](#), [MMS](#)

New IEC 61850-6 ICD Editor

Triangle MicroWorks offers a new IEC 61850 ICD Editor (IED capability description) that supports the creation and editing of Substation Configuration Language (SCL) files defined by the IEC 61850-6 specification.

Downloads: [Evaluation version](#), [Brochure](#), [Manual](#), [Test Server Manual](#)

Posted by [Karlheinz Schwarz](#) at [10:50 AM](#) [0 comments](#) 


Labels: [IEC 61850](#), [SCL](#)

Friday, September 5, 2008

Kick-off meeting for IEC 61400-25 Interest Group

USE61400-25 – IEC 61400-25 user group in wind power kick-off meeting - the opening session for establishing an interest group focusing on the new IEC 61400-25 standard on communication aspects for wind power systems.

[Invitation](#) and [agenda](#) for first meeting in Copenhagen/Denmark, September 17, 2008

Posted by [Karlheinz Schwarz](#) at [12:59 AM](#) [0 comments](#) 

Labels: [IEC 61400-25](#), [IEC 61850](#), [wind power](#), [wind turbine controller](#)

Thursday, September 4, 2008

Wind Power: IEC 61400-25 PLC library from Beckhoff

The IEC 61400-25 standard defines information models and information exchange for monitoring and controlling wind turbines. Its integration in Beckhoff's TwinCAT PLC (programmable logic controller) software will simplify the control and monitoring of heterogeneous wind farms considerably.

[More details ...](#)

Posted by [Karlheinz Schwarz](#) at [11:00 PM](#) [0 comments](#) 

Labels: [IEC 61400-25](#), [IEC 61850](#), [wind power](#), [wind turbine controller](#)

Wednesday, September 3, 2008

IEC 61400-25-4 Mappings published as International Standard

The fifth part of the series IEC 61400-25 - part 25-4 for mappings - has been published recently.

The mappings specified in this part of IEC 61400-25 comprise:

- a mapping to SOAP-based web services,
- a mapping to OPC/XML-DA,
- a mapping to IEC 61850-8-1 MMS,
- a mapping to IEC 60870-5-104,
- a mapping to DNP3.

All mappings are optional, but at least one optional mapping shall be selected in order to be compliant with this part of IEC 61400-25.

A preview can be [downloaded from IEC](#).

Posted by [Karlheinz Schwarz](#) at [6:43 AM](#) [0 comments](#) 

Labels: [IEC 61400-25](#), [mapping](#), [wind power](#)

Thursday, August 28, 2008

How Vattenfall wants to benefit from IEC 61400-25

The IEC standard series [61400-25](#) (Communications for monitoring and

control of wind power plants) provides a solution for access to wind power information with standardized data names and semantic. It gives possibilities to procure monitoring and control solutions as separate parts, and to use a single system to store, analyze and present wind power information.

Paper from Vattenfall discusses the potential cost savings - quite interesting:

[Use of IEC 61400-25 to secure access to key O&M data](#)

Vattenfall has been involved in the development of the international standard from the very beginning. This paper gives an introduction to the IEC 61400-25 series of standards and presents an overview of the different parts. Furthermore it describes how Vattenfall and other wind power owners and operators can benefit from the standard.

Posted by [Karlheinz Schwarz](#) at 3:02 AM 0 comments 

Labels: [en](#), [IEC 61400-25](#), [IEC 61850](#), [maintenance](#), [wind power](#)

GE Multilin demo on IEC 61850 based HardFiber Process Bus at Cigré 2008 in Paris

GE Multilin has demonstrated their new IEC 61850 based HardFiber Process Bus System at Cigré 2008 in Paris. There were many experts that seem to be surprised seeing this quite simple approach used for HardFiber. HardFiber may be a first step in replacing copper wires between the switch yard and the control house.

The solution is - of course - quite restricted compared to what IEC 61850 could provide for a Process Bus.

One benefit - among others - is: the Bricks for HardFiber are available.

One drawback is: Bricks are (to my knowledge) interoperable with GE Relays ONLY. To be compatible with the Bricks it would require implementing GE-specific features ... these go beyond the standard IEC 61850!

Information on HardFiber can be found [here](#).

Download the comprehensive [Manual \[4.5 MB, PDF\]](#)


Posted by [Karlheinz Schwarz](#) at 2:32 AM 2 comments 

Labels: [en](#), [IEC 61850](#), [merging unit](#), [process bus](#)


Wednesday, August 27, 2008

Siemens sold more 1000 plants with IEC 61850

Siemens reported during the Cigré exhibition in Paris (25-29 August 2008) that they have sold more than 1000 plants with some 50 000 IEC 61850 compliant devices.

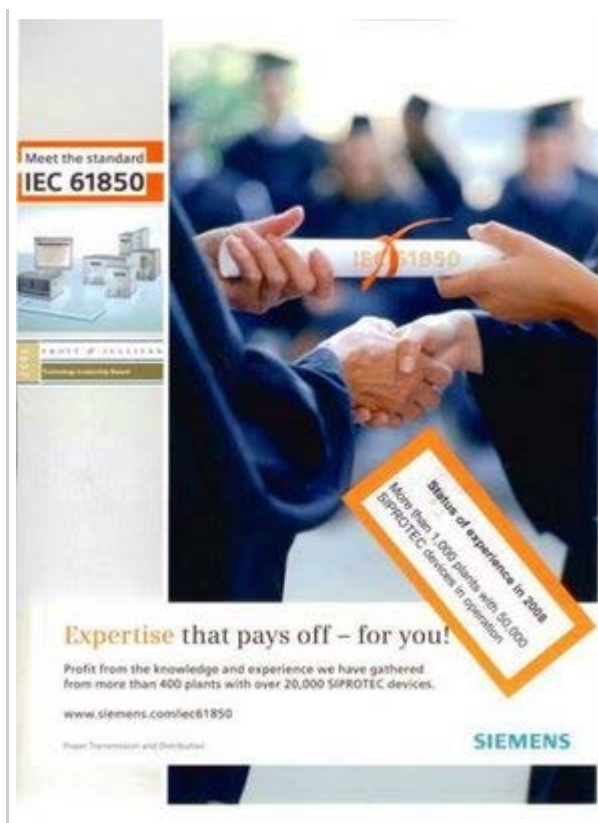

According to a statement made in January 2008 Siemens is selling more IEC 61850 compliant devices than expected earlier!

Posted by [Karlheinz Schwarz](#) at 3:19 AM 0 comments 


Labels: [en](#), [IEC 61850](#), [IEC61850](#)

Tuesday, August 26, 2008

IEC 61850 Usersgroup at Cigré 2008 in Paris

The UCA booth #95 at the Cigré 2008 in Paris (25-28 August 2008) is a big success! Many utility experts from utilities, vendors, consultants, system integrators, and universities stopped at the booth to listen to presentations,



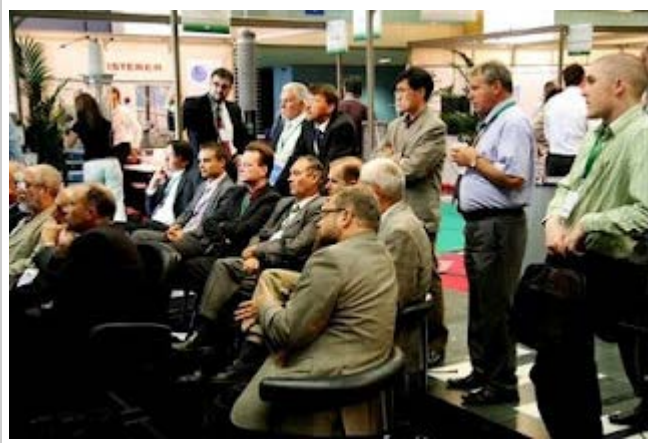

discuss the use of IEC 61850




and to make users and vendors happy



or just to collect some useful information.

More reports on the Cigré 2008 follow. Stay tuned.

Posted by [Karlheinz Schwarz](#) at [10:28 PM](#) [0 comments](#) 

Labels: [en](#), [IEC 61850](#), [IEC61850](#)

Schniewindt demo on CT and VT according to IEC 61850-9-2LE in Paris at Cigre 2008

Schniewindt (Neuenrade, Germany) offers one of the first Hybrid Electronic Combined Current and Voltage Transformers (VT and VT) with

optical-digital data transfer according to IEC 61850-9-2LE (light edition).

Information about the sensor could be found [here](#).

The merging unit for the CT/VT according to IEC 61850-9-2LE is available (IX 9010 Optically Powered Data Link Ethernet Output module) and in use at the RWE Process Bus R&D project in Nehden (Germany).

For information about the merging unit contact Schniewindt [directly](#).
Information about the IEC 61850-9-2LE could be [downloaded](#).

More details on the RWE project will be disclosed shortly. Stay tuned.

Posted by [Karlheinz Schwarz](#) at 9:40 PM 0 comments 

Labels: [en](#), [IEC 61850](#), [merging unit](#), [process bus](#)

Wednesday, August 20, 2008

IEC 61850 at the CIGRE Exhibition 2008 Paris

The following UCAIug Booth Sponsors will be present at the UCA Iug Booth (#95) one way or the other:

DIAMOND:

AREVA, GE Digital Energy Multilin, RuggedCom Inc., Siemens, SISCO, Triangle Micro Works, UTInnovation, ZIV, KEMA

GOLD:

Ingeteam T&D, Maschinenfabrik Reinhausen GmbH, Schweitzer Engineering Laboratories, Toshiba,

SILVER:

EFACEC, Kalki Communication Technologies, Nari Relays, [NettedAutomation GmbH](#), OMICRON, RTDS

Several interesting presentations are scheduled:

http://nettedautomation.com/download/uca_cigre_2008.pdf

Karlheinz Schwarz (NettedAutomation) will be available on Monday and Tuesday (25-26 August 2008) ... see you there.

Posted by [Karlheinz Schwarz](#) at 8:38 AM 0 comments 

Labels: [hands-on Training](#), [IEC 61850](#), [IEC61850](#)

[Newer Posts](#)

[Home](#)

[Older Posts](#)

Subscribe to: [Posts \(Atom\)](#)

News on IEC 61850 and related Standards

Daily news concerning the standards IEC 61850, IEC 61400-25, IEC 61970 (CIM), IEC 60870-5, ...

Tuesday, August 12, 2008

UCA International Users Group at Cigre in Paris

The UCAIug is one of the crucial supporter of IEC 61850. Experts of the UCAIug members (e.g. Karlheinz Schwarz from NettedAutomation, Germany, August 25-26, 2008) will be available to meet you at the [Cigre 2008 exhibition](#):

August 25-29, 2008
 Stand #95
 Palais des Congres
 Paris, France

Several presentations will be given on August 25-28, 2008.

See you in Paris.

Posted by [Karlheinz Schwarz](#) at [9:40 PM](#) [0 comments](#) 

Labels: [IEC 61850](#)

Monday, August 11, 2008

IEC 61850 for real-time communication

Ethernet is used for many years for real-time applications - most of the solutions use some dedicated hardware or software. IEC 61850 is sometimes understood as a solution that provides protocols and information models running on top of TCP/IP only ... as shown in the [Industrial Ethernet Handbook](#).

IEC 61850 supports the exchange of real-time traffic:

- Peer-to-peer exchange of status and other simple information by the so-called GOOSE message (Generic Object Oriented Substation Event) - you may replace substation by system ... GOOSE uses Ethernet and multicast messages. Requirement to meet: delay of max 4 ms after failure in the electrical network. GOOSE messaging could be understood as remote I/O communication.
- Peer-to-peer exchange of sampled values of voltage and current measurements (80 or 256 samples/period - 4 kHz for 50 Hz system and 80 samples/period) (Sampled Value exchange). Sampled Value exchange uses Ethernet and multicast messages.

All communication of the client/server for reading, setting, control, reporting, logging, retrieving self-description, ... is using TCP/IP and higher layer protocols.

Posted by [Karlheinz Schwarz](#) at [9:18 AM](#) [0 comments](#) 

Labels: [GOOSE](#), [real-time](#)

Subscribe To IEC 61850 News

 Posts 

 All Comments 

Blog Archive

- [2012](#) (11)
- [2011](#) (159)
- [2010](#) (153)
- [2009](#) (162)
- ▼ [2008](#) (82)
 - [December](#) (12)
 - [November](#) (4)
 - [October](#) (15)
 - [September](#) (18)
 - ▼ [August](#) (13)

[How Vattenfall wants to benefit from IEC 61400-25](#)

[GE Multilin demo on IEC 61850 based HardFiber Proc...](#)

[Siemens sold more 1000 plants with IEC 61850](#)

[IEC 61850 Usersgroup at Cigré 2008 in Paris](#)

[Schniewindt demo on CT and VT according to IEC 618...](#)

[IEC 61850 at the CIGRE Exhibition 2008 Paris](#)

[UCA International Users Group at Cigre in Paris](#)

[IEC 61850 for real-time communication](#)

Friday, August 8, 2008

Independent Interoperability Tests for IEC 61850

STRI has opened an Independent Interoperability Test Lab for IEC 61850.

In order to support Nordic Utilities and industries with the introduction of the new standard for communication networks and systems in substations communication STRI has decided to invest in an extensive interoperability test facility.

This Lab seems to be the first public Test Lab for Interoperability Tests - a real IEC 61850 Competence Center!

[Read more ...](#)

Posted by [Karlheinz Schwarz](#) at 4:23 AM 0 comments 

Labels: [IEC 61850](#), [interoperability tests](#)


RTUs and IEC 61850

RTUs (Remote Terminal Units - German: Fernwirkgerät) are applied in many domains like power transmission and distribution. These RTUs meet the requirements of the past - but the future needs are far beyond the functions currently implemented.

One crucial future requirement is the communication between intelligent electronic devices (IED). A distribution automation device could communicate with many neighboring IEDs (peer-to-peer communication) and figure out autonomously what's going on in the distribution network ... and make decisions without a central SCADA system!

IEC 61850 has all the communication services to support the intelligent IEDs in the distribution network.

[A paper from SEL](#) shows an example how to use GOOSE messaging for peer-to-peer communication in distribution automation.

Posted by [Karlheinz Schwarz](#) at 12:00 AM 0 comments 

Labels: [GOOSE](#), [IEC61850](#)

Tuesday, August 5, 2008

STRI and NettedAutomation GmbH announced cooperation

[STRI](#) (Ludvika, Sweden) and [NettedAutomation](#) GmbH (Karlsruhe, Germany) [announced today a close cooperation on IEC 61850](#) Comprehensive and Independent Hands-on Training with IEDs (intelligent electronic devices) and Tools from Multiple Vendors;

[First hands-on training session](#) in Ludvika (Sweden) on 25-28 November 2008

Objective and structure of the hands-on training

[Independent Interoperability Tests for IEC 61850](#)

[RTUs and IEC 61850](#)

[STRI and NettedAutomation GmbH announced cooperation...](#)

[Wind Power and IEC 61400-25](#)

[IEC 61400-25-4 \(Mappings\) approved as International...](#)

► July (20)

Contributors

[Karlheinz Schwarz](#)

[Michael Schwarz](#)

This training has the objective to provide both theory and practice on the application of IEC 61850 in a substation

The 4 day course consists of:


- Module 1 gives a level 1 introduction to the IEC 61850 standard together with a summary with real applications and the demonstration of STRI facilities for multivendor interoperability testing.
- Module 2 gives an independent and more detailed update on the IEC 61850 standard for substation and device modeling as well as communication principles with real examples.
- Module 3 will present possible functional allocation and architecture of a typical substation with state of the art IEDs from different manufacturers (ABB, Areva, Siemens) as well as available test sets (Omicron, Doble, Programma) with group sessions on how to optimize the solution.
- Module 4 is divided in two parallel courses.
- Option 1 – IEC 61850 hands-on workshop demonstrating inter-operability of protection and control devices from ABB, Areva and Siemens.
- Option 2 – Substation Configuration Language (SCL) hands-on workshop. Learn what you need to know for specification, evaluation, verification, and maintenance of IEC 61850 substations and IEDs.

Posted by [Karlheinz Schwarz](#) at [6:26 AM](#) [0 comments](#) 

Labels: [hands-on Training](#), [IEC61850](#), [real IEDs](#)

Wind Power and IEC 61400-25

[BTC](#) and [Deutsche WindGuard](#) develop Wind Power Plant Control and Management System for Offshore Wind Farms using IEC 61400-25 open communication [more details ...](#)

Posted by [Karlheinz Schwarz](#) at [12:06 AM](#) [0 comments](#) 

Labels: [en](#), [IEC 61400-25](#)


Saturday, August 2, 2008

IEC 61400-25-4 (Mappings) approved as International Standard

The fifth part of the International Standard IEC 61400-25-4 "Wind turbines - Part 25-4: Communications for monitoring and control of wind power plants - [Mapping to communication profile](#)" has been approved as International Standard on 01. August 2008!

The four parts IEC 61400-25-1, -2, -3, and -5 have already been published in 2007.

[Voting result](#): 93 % approval !!

Posted by [Karlheinz Schwarz](#) at [12:05 AM](#) [0 comments](#) 

Labels: [en](#), [IEC 61400-25](#), [wind power](#)

Saturday, July 26, 2008

BTC setzt auf IEC 61400-25 und IEC 61850

BTC Wind Farm Center (WFC)

Windparkleit- und Managementsystem für Offshore Windparks

Das BTC Wind Farm Center umfasst:

- Funktionen zur Überwachung und Steuerung aller Komponenten eines Windparks in Echtzeit
- Funktionen zur Ressourcenplanung und -steuerung für den Betriebsführer
- Funktionen für Zustandsanalyse und Ertragscontrolling für den Betreiber
- Unterstützung des neuen IEC 61400-25 Standard als Kommunikationsprotokoll
- Erfüllung der Berichtsanforderungen von Banken, Versicherungen und öffentlichen Stellen

... unabhängige Prozesskommunikation mittels der Normen IEC 60870-5-104, IEC 61400-25 und IEC 61850

[Mehr Details ...](#)

Posted by [Karlheinz Schwarz](#) at [1:07 AM](#) [0 comments](#) 

Labels: [IEC 1850](#), [IEC 61400-25](#), [wind power](#)

Offshore Windpark alpha ventus - Baustart am 28.07.2008

Die Arbeiten für den ersten Bauabschnitt des Windparks alpha ventus beginnen am 28. Juli 2008 ... [mehr Information](#)

Posted by [Karlheinz Schwarz](#) at [12:58 AM](#) [0 comments](#) 

Tuesday, July 22, 2008

500 kV Bradley Substation in operation

According to CNN Money the Tennessee Valley Authority's (TVA) substation Bradley is a big step forward in the application of IEC 61850 compliant substations in the USA:

"The successful implementation of IEC 61850 is a reality now. Short lead-time, cost-effective, repeatable and flexible protection and control systems can now be designed and implemented at the highest voltage levels."

[more ...](#)

Posted by [Karlheinz Schwarz](#) at [8:06 PM](#) [0 comments](#) 

Labels: [en](#), [IEC 61850](#)

Monday, July 21, 2008

IEC 61850 presentations and seminars in Asia fall 2008

Several IEC 61850 related Presentations, Seminars and Training

sessions in Asia in fall 2008 are planned by Karlheinz Schwarz (SCC):

[CEPSI](#) (Macau) Presentations - 27-31 October, 2008
(exact dates of presentations not yet known)

- IEC 61850 BEYOND SUBSTATIONS – THE STANDARD FOR THE WHOLE ENERGY SUPPLY SYSTEM
- ADVANCED CONDITION MONITORING OF PRIMARY EQUIPMENT WITH THE STANDARD SERIES IEC 61850 AND IEC 61400-25

Brisbane (Australia) - 6-7 November 2008

- Seminar/Update on latest developments on IEC 61850 - Interested? [contact us ...](#)

Wellington (New Zealand) - 10-11 November 2008

- Seminar on IEC 61850 - Interested? [contact us ...](#)

Auckland (New Zealand) - 13-14 November 2008

- Seminar on IEC 61850 - Interested? [contact us ...](#)

Posted by [Karlheinz Schwarz](#) at [5:52 AM](#) [0 comments](#) 

Labels: [en](#), [IEC 1850](#), [Training](#)

Friday, July 18, 2008

Doble Test Equipment speaks IEC 61850

[Doble's Power System Simulator F6150](#) supports IEC 61850 GSE (GOSE and GSSE).

The F6860 IEC 61850–Compliant Protection Testing
Modern protection test systems are designed to comply with the IEC 61850 GSE messaging standard. The [F6860 option](#) and Doble protection testing software package make testing protection schemes that use IEC 61850–compliant IEDs (intelligent electronic devices) simple.

Posted by [Karlheinz Schwarz](#) at [5:54 AM](#) [0 comments](#) 

Labels: [en](#), [IEC 61850](#)

Thursday, July 17, 2008

Bachmann electronic: MMS server for wind turbine controller

2007-07-17: Bachmann electronic (Feldkirch, Austria) offers IEC 61850 (IEC 61400-25) wind turbine controller M1 with MMS (Manufacturing Message Specification) as protocol to run on TCP/IP.

[Press release English](#) (Word document)
[Press release German](#) (Word document)

[More details on IEC 61400-25](#) (Communications for monitoring and control of wind power plants).

[Details on MMS](#).

Posted by [Karlheinz Schwarz](#) at [11:42 PM](#) [0 comments](#) 

Labels: [de](#), [en](#), [IEC 1850](#), [IEC 61400-25](#), [wind turbine controller](#)

Usersgroup for IEC 61400-25: start in September 2008

Vattenfall and other utilities have invited for the start-up of a Usersgroup for [IEC 61400-25](#).

The start-up meeting will be on September 17, 2008, in Kopenhagen (Denmark). On September 16 there will be a meeting to celebrate the successful publication of the standards series IEC 61400-25.

Interested? [contact us ...](#)

Posted by [Karlheinz Schwarz](#) at [6:05 AM](#) [0 comments](#) 

Labels: [en](#), [IEC 61400-25](#)

Kommunikation A und O für zukünftige Energieversorgung

Die VDI-Studie "Smart Distribution 2020 - Virtuelle Kraftwerke in Verteilungsnetzen" fordert die konsequente Anwendung der Normenreihe IEC 61850!

[Bericht in den VDI-Nachrichten](#) vom 10.07.2008


Posted by [Karlheinz Schwarz](#) at [5:59 AM](#) [0 comments](#) 

Labels: [de](#), [IEC 61850](#)

Tuesday, July 15, 2008

Did you know... Kalkitech Sub-Station Configuration Tool?

[Kalki SCL Manager](#) is the leading Substation Configuration Software Platform, that enables substation engineers and design and commissioning engineers to build different substation configurations, architectures, models etc., quickly and cost effectively, without being to be experts in IEC 61850.

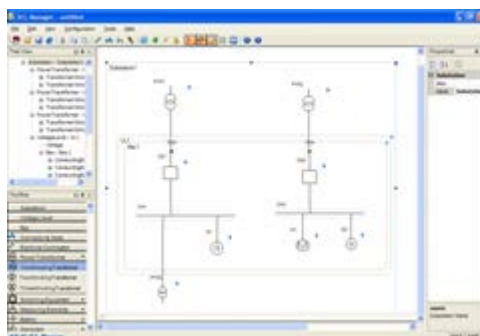

More [details and key functionality overview here...](#)


Posted by Michael Schwarz at [2:54 PM](#) [0 comments](#) 

Labels: [61850](#), [en](#)

Did you know... Visual SCL?

[ASE's](#) Visual SCL is a graphical tool that allows the creation, editing and viewing of IEC 61850 SCL files without requiring

knowledge of the underlying XML syntax. This allows the user to concentrate on the engineering process as opposed to XML syntax. IEC 61850-6 Visual SCL can be used for SAS functional specification (SSD files), IED capability description (ICD files), as well as SA system description (SCD files). Visual SCL contains high level graphical editing tools for the Substation, IED, and Communication models as well as a Data Template editor.

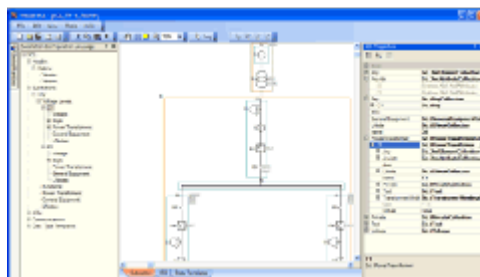

[Download a 15 day limited evaluation copy](#) and [read more about the features of Visual Substation Configuration Language \(SCL\)](#)...

Definition: [SCL](#)

Posted by Michael Schwarz at [2:51 PM](#) [0 comments](#) 

Labels: [61850](#), [en](#)

EnBW to buy a quarter of EWE for 2 billion euros

German utility [EnBW](#) (Number 3 in Germany) agreed to buy 25 per cent of EWE for 2 billion euros (\$3.2 billion). [EWE](#) is quite active in the renewable and distributed energy market .. as well as in the telecom business and software development (BTC). EWE and [BTC both support the standards IEC 61850 and IEC 61400-25](#).

EWE and EnBW have said that the Information and Communication Technologies are the base of the future smart power systems!

[Dr. Brinker \(CEO of EWE\) said](#): "... That includes in particular the combination of **energy**, **telecommunications** and **information technology** as a precondition for **intelligent energy supplies in the future**".

More to come.

[Reuter's news report \[de\]](#)
[de] [EWE und EnBW beschließen Partnerschaft](#)

Posted by [Karlheinz Schwarz](#) at [3:38 AM](#) [0 comments](#) 

Labels: [61850](#), [en](#)

[Newer Posts](#)

[Home](#)

[Older Posts](#)

Subscribe to: [Posts \(Atom\)](#)

News on IEC 61850 and related Standards

Daily news concerning the standards IEC 61850, IEC 61400-25, IEC 61970 (CIM), IEC 60870-5, ...

Sunday, July 13, 2008

Google supports SmartGridCity in Boulder

SmartGridCity in Boulder supported by Google, Current Group, Xcel Energy, ... at a core of a \$ 100 million program !! The information exchange for the smart grid is based on Current Group's BPL (broadband-over-powerline). This allows that every information needed for the future smart power system is available at any time. [more details...](#)

[About Current Group](#)

The connectivity to the transformers may also be used to tap any kind of useful information from the respective substation. IEC 61850 compliant substation IEDs would simplify the access of any needed substation information like voltage, currents, frequency, power factor ...

More to come.

Posted by [Karlheinz Schwarz](#) at [3:18 PM](#) [0 comments](#) 

Labels: [61850](#), [en](#)

Friday, July 11, 2008

IEC 61850 SCL-Validator

I found a free online SCL-Validator for IEC 61850.

"Here is a web-based SCL-validator provided to check the conformity of your SCL-files to the schema of IEC 61850-6.

Used version of the SCL-schema:

xmlns="http://www.iec.ch/61850/2003/SCL" version="1.4"

All you need is to send your SCL-file into the application and get the validation result in a seperate window."

Try the [online demo of the IEC 61850 SCL-Validator...](#)

Posted by Michael Schwarz at [11:18 PM](#) [2 comments](#) 

Labels: [61850](#), [en](#)

From protection to perfection - Unleashing the full potential of the IEC 61850 standard

"Packed with the latest protection technology and featuring native support for the prevailing IEC 61850 substation communication standard, [ABB's REF615 feeder protection relay](#) is the ideal choice

Subscribe To IEC 61850 News

Blog Archive

- [2012](#) (11)
- [2011](#) (159)
- [2010](#) (153)
- [2009](#) (162)
- ▼ [2008](#) (82)
 - [December](#) (12)
 - [November](#) (4)
 - [October](#) (15)
 - [September](#) (18)
 - [August](#) (13)
 - ▼ [July](#) (20)

[BTC setzt auf IEC 61400-25 und IEC 61850](#)

[Offshore Windpark alpha ventus - Baustart am 28.07...](#)

[500 kV Bradley Substation in operation](#)

[IEC 61850 presentations and seminars in Asia fall ...](#)

[Doble Test Equipment speaks IEC 61850](#)

[Bachmann electronic: MMS server for wind turbine C...](#)

[Usersgroup for IEC 61400-25: start in September 20...](#)


for the protection and control of your distribution substations. Implementing horizontal inter-relay communication and GOOSE services over an Ethernet substation LAN, the REF615 relays unleash the full potential of the IEC 61850 standard as demonstrated by a cost-effective, fast and reliable substation busbar protection system."



See the REF615 protection relay at the CIGRÉ 2008 Session in Paris, France, 24 - 29 August 2008.

REF615 Human Machine Interface (HMI) Simulator

The [REF615 HMI Simulator](#) offers you an easy and convenient way to get familiar with the HMI operations and functionality of REF615.

Posted by Michael Schwarz at [1:20 PM](#) [0 comments](#) 

Labels: [61850](#), [en](#)

IEC 61850 Links

Here is my IEC 61850 link collection (unsorted). Feel free to send me your favorite links to be added here.

- Wikipedia article on [IEC 61850](#)
- [IEC Web site for IEC 61850 standards](#)
- IEC 61850 Technical Issues Web site (the [TISSUE](#) database) - the database where open issues related to IEC 61850 (ambiguities or errors) can be reported and the solution for already known issues can be retrieved
- [UCA International Users Group](#) – a users group for IEC 61850

Posted by Michael Schwarz at [4:30 AM](#) [0 comments](#) 

Labels: [61850](#), [61850-7-420](#), [en](#)

IEC 61850 / 61400-25 Training

Here is a list of current seminars or training events on IEC 61850 / 61400-25:

1. 10.-11. July 2008 (New Date)
09:00-18:30 and 8:30-17:00
Atlanta, GA (USA)
2. 21.-22. August 2008
09:00-18:30 and 8:30-17:00
Paris (France)
prior to [CIGRE](#) conference
3. week 22.-26. September 2008 (new date!!)
09:00-18:30 and 8:30-17:00
Seoul (South Korea)
prior to IEC TC 57 Plenary meeting
4. *coming soon*

[Kommunikation A und O für zukünftige Energieversor...](#)

[Did you know... Kalkitech Sub-Station Configuratio...](#)

[Did you know... Visual SCL?](#)

[EnBW to buy a quarter of EWE for 2 billion euros](#)

[Google supports SmartGridCity in Boulder](#)

[IEC 61850 SCL-Validator](#)

[From protection to perfection - Unleashing the ful...](#)

[IEC 61850 Links](#)

[IEC 61850 / 61400-25 Training](#)

[\[de\] VDE: Mehr Intelligenz ins Stromnetz](#)

[\[de\] Dezentrale Energieversorgungsanlagen mit IEC ...](#)

[Smart Grid Vehicle - Putting IEC 61850-7-420 on wh...](#)


[\[de\] Virtuelle Kraftwerke brauchen viel Kommunikat...](#)

Contributors

[Michael Schwarz](#)

[Karlheinz Schwarz](#)

If you offering another event on IEC 61850 feel free to contact me to add it to the list here.

Posted by Michael Schwarz at [4:19 AM](#) [0 comments](#) 


[de] VDE: Mehr Intelligenz ins Stromnetz

In den heise online News vom 2. Juli 2008 gefunden:

"Eine Voraussetzung für die optimale Einbindung des wachsenden Anteils erneuerbarer Energien in die Stromversorgung ist die breit angelegte Aufrüstung mit Informations- und Kommunikationstechniken (IKT) im Bereich der Verteilnetze. Darauf wies der [VDE](#) am heutigen Mittwoch bei der Präsentation der Studie "[Smart Distribution 2020](#)" in Berlin hin. [...]

Anstelle der heute zur Netzsteuerung vielfach verwendeten proprietären Kommunikationsprotokolle unterschiedlicher Hersteller plädiert die Studie für den konsequenten Einsatz des Standards [IEC 61850](#) auf allen Netzebenen und Übertragungsmedien."

Den [ganzen Artikel auf heise online lesen](#)...

Posted by Michael Schwarz at [4:03 AM](#) [0 comments](#) 

Labels: [61850](#), [de](#)

[de] Dezentrale Energieversorgungsanlagen mit IEC 61850 kommunikationsfähig machen

Photovoltaik-Anlagen, Wasserkraftwerke, Brennstoffzellen, Blockheizkraftwerke, Dieselgeneratoren – jeder speist in das Verbundnetz ein, was er gerade zu bieten hat?

"[...] Dazu bedarf es eines Taktstockes, also eines Kommunikationsmediums, das alle angeschlossenen Teilnehmer gleichermaßen verstehen. Das DKE/K 952 Netzleittechnik ist der Ansicht, dass so ein Taktstock auf Basis der [IEC 61850](#) definiert werden kann und hat hierzu den DKE/AK 917.0.17 einberufen"

Lesen sie den [Steckbrief des DKE/AK 952.0.17 \(pdf\)](#) als auch den [ganzen Artikel](#)...

Posted by Michael Schwarz at [3:58 AM](#) [0 comments](#) 


Labels: [61850](#), [de](#)

Smart Grid Vehicle - Putting IEC 61850-7-420 on wheels

A new project from [German Section of the International Solar Energy Society](#) (DGS) has started putting IEC 61850-7-420 on wheels: the Smart Grid Vehicle (SGV).

"Smart Grid Services: Electric cars are basically batteries storage systems on wheels and can serve as versatile distributed energy resources... managed via [IEC 61850](#)."

[Read more at the SGV Web site...](#)

Posted by Michael Schwarz at [3:52 AM](#) [0 comments](#) 

Labels: [61850](#), [61850-7-420](#), [en](#)

[de] Virtuelle Kraftwerke brauchen viel Kommunikation

Energie: VDE-Studie macht Vorschläge für die Einbindung von Ökostrom in Verteilungsnetze - Neue Speicher und Lastmanagement sollen den Anlagenbetrieb unterstützen

Das Ziel der Bundesregierung ist klar: Erneuerbare Energien sollen einen wachsenden Anteil an der Stromerzeugung erbringen. Doch die zahlreichen dezentralen Anlagen - von Windkraft über Biomasse bis Photovoltaik - müssen sinnvoll ins Netz eingepasst werden. Der Verband VDE erarbeitete dazu ein Konzept.

[...]

Der VDE plädiert für den konsequenten Einsatz des Standards [IEC 61850](#) ([Wikipedia EN](#)), weil damit auch Datensicherheit gewährleistet sei.

[Weiter lesen...](#)

Posted by Michael Schwarz at [3:46 AM](#) [0 comments](#) 

Labels: [61850](#), [de](#)

[Newer Posts](#)

[Home](#)

Subscribe to: [Posts \(Atom\)](#)